


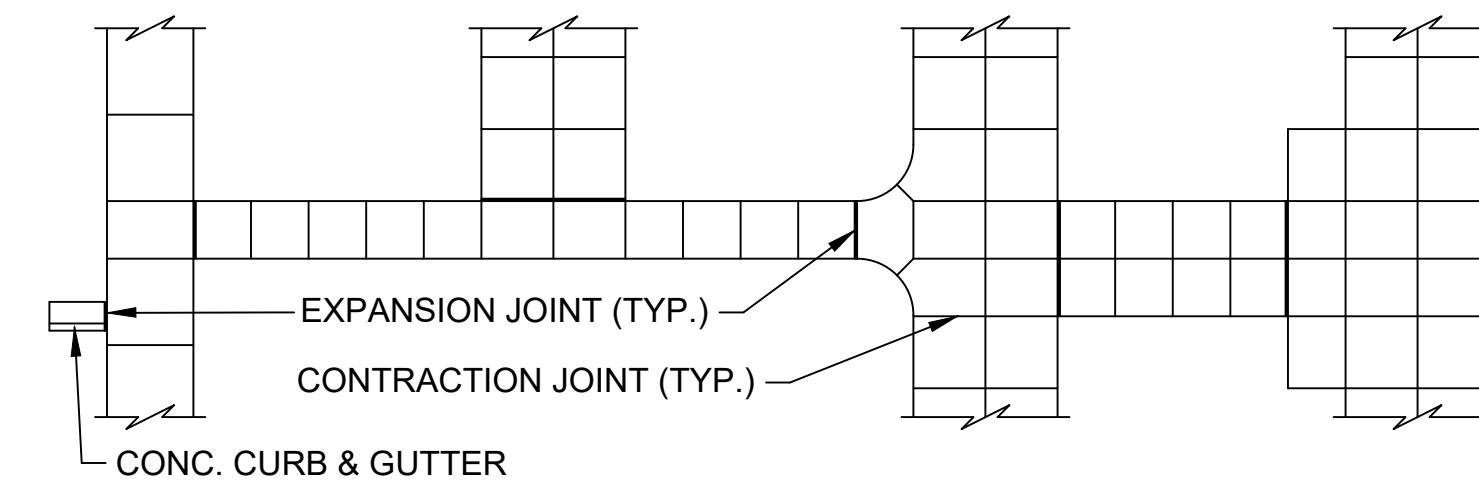


JOINT SPACING FOR STRAIGHT RUNS			
WALK WIDTH	CONTRACTION JOINT SPACING		EXPANSION JOINT SPACING
	TRANSVERSE	LONGITUDINAL	
4'	4'	NOT REQUIRED	40' MAX.
6'	6'	NOT REQUIRED	42' MAX.
8'	4'	4'	40' MAX.
10'	5'	5'	40' MAX.
12'	6'	6'	42' MAX.

NOTES:

1. TRANSVERSE EXPANSION JOINTS MUST BE CONTINUOUS THROUGH BOTH WALK AND CURB WHERE WALK ABUTS CONCRETE CURB AND GUTTER.
2. EXPANSION JOINTS MUST NOT BE REQUIRED BETWEEN CURBS THAT ABUT THE SIDEWALK LONGITUDINALLY.

B5 TYPICAL SIDEWALK JOINT LAYOUT PLAN
SCALE N.T.S.

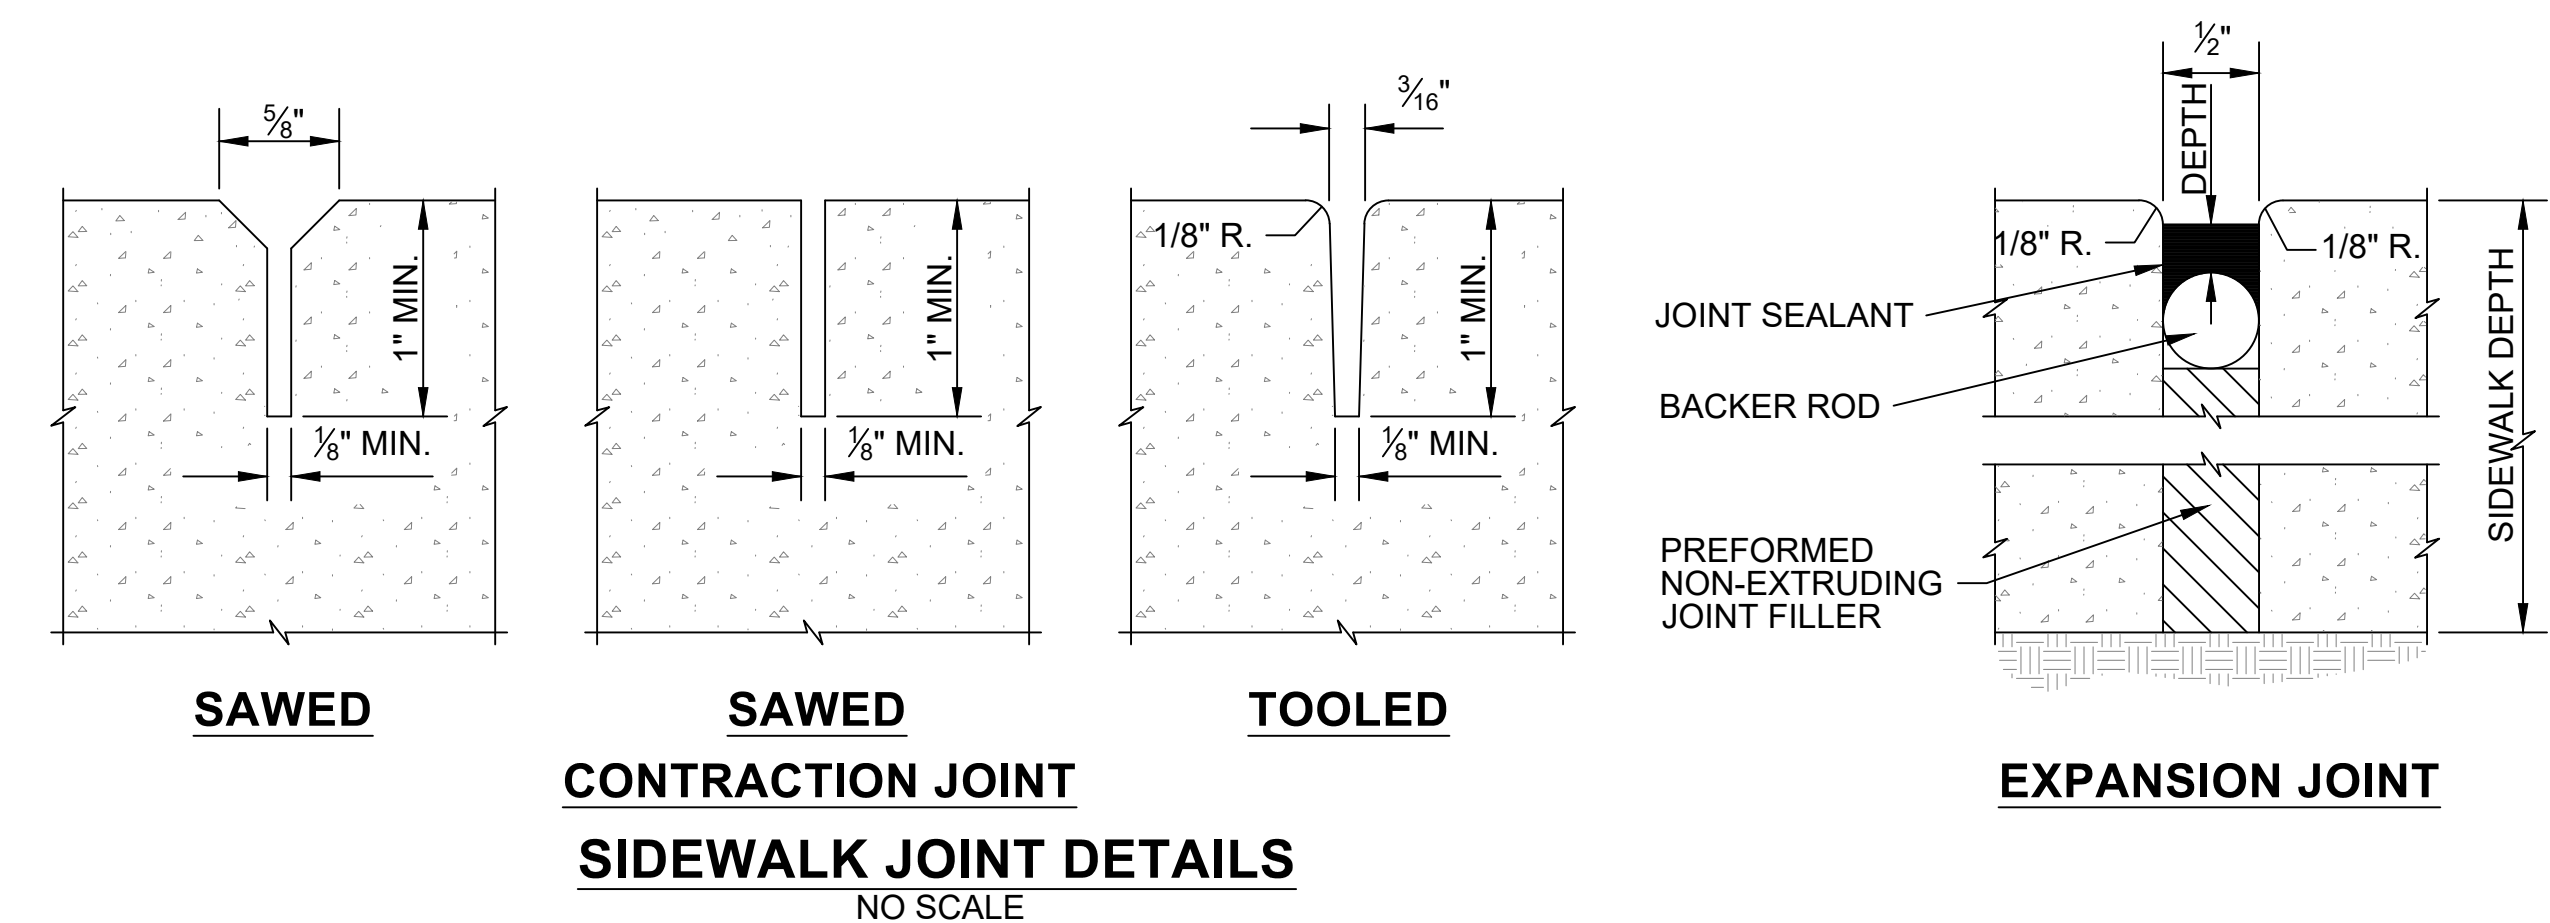

NOTES:
1. DEPTH OF SEALANT MUST BE AS RECOMMENDED BY THE MANUFACTURER.

A5 SIDEWALK JOINTING & SEALANT DETAILS
SCALE N.T.S.



	DSSN	DGG	DR	JPBM	CHKC	APVD	
B	2024/7-19						TM
A	2024/7-01						DG
N							DG
							BY
							APVD
							RR
							TM

Site Development
Camden OSD
Camden, Arkansas
Aerojet Rocketdyne

jacobs

CIVIL SITE PLAN - DETAILS 2

FILE	AS SHOWN
E	07/01/2024
DJ	D3547405
G	CS502.dwg
RET	26 of 99