
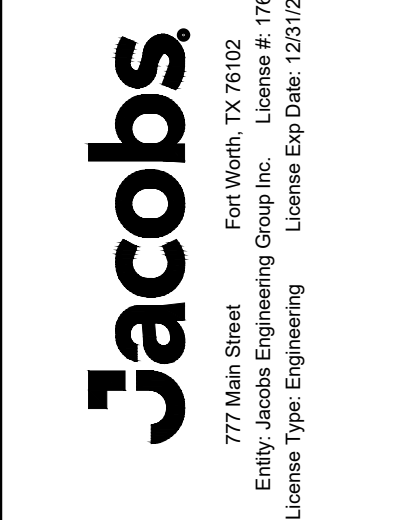


1. BOLLARDS MUST BE INSTALLED SUCH THAT THE USE OF HYDRANT OUTLETS AND FDC INLETS ARE UNOBSTRUCTED.
2. SEE ELECTRICAL DRAWINGS FOR INFORMATION ON SITE LIGHTING.
3. PROVIDE THURST BLOCKS PER DETAIL B3/02/51 AT ALL WATER LINE BENDS.
4. UTILITY LINE SIZING BASED ON BUILDING LOADS FROM 60% DESIGN ON CAMDEN SITE EXPANSION.
5. CONNECTION POINTS TO THE LSRM SITE. UTILITIES ARE BASED ON 30% UTILITY PLANS. UTILITY SIZING AND PGCS BETWEEN PROJECTS MUST BE COORDINATED BETWEEN CONSTRUCTION CONTRACTOR AND EOR OF LSRM EXPANSION.
6. SEE FIRE PROTECTION DRAWINGS FOR INFORMATION ON FIREWATER TANK/PUMPHOUSE.

	SANITARY SEWER
	DOMESTIC WATER
	HIGH PRESSURE GAS
	FIRE WATER
	ELECTRICAL
	SITE LIGHTING
	WATER VALVE
	FIRE HYDRANT



NO.	DATE	OR	REVISION	APVD
B	2024/7/19		100% ISSUED FOR CONSTRUCTION - DEVELOPMENT	DG TM
A	2024/9/21		100% ISSUED FOR REVIEW - DEVELOPMENT	DG TM
				BY
				APVD

Jacobs

SHEET NO	
CU206	
SCALE	AS SHOW
DATE	07/01/202
PROJ	D354740
DWG	CU206.dwg
SHEET	61 of 99