



7/23/2024 10:47:26 AM F-101a Autodesk Docs://US_D3754500_FED_Aerofjet Rocketdyne/D3754500_CMDN_OSD_Grinder_FP.rvt

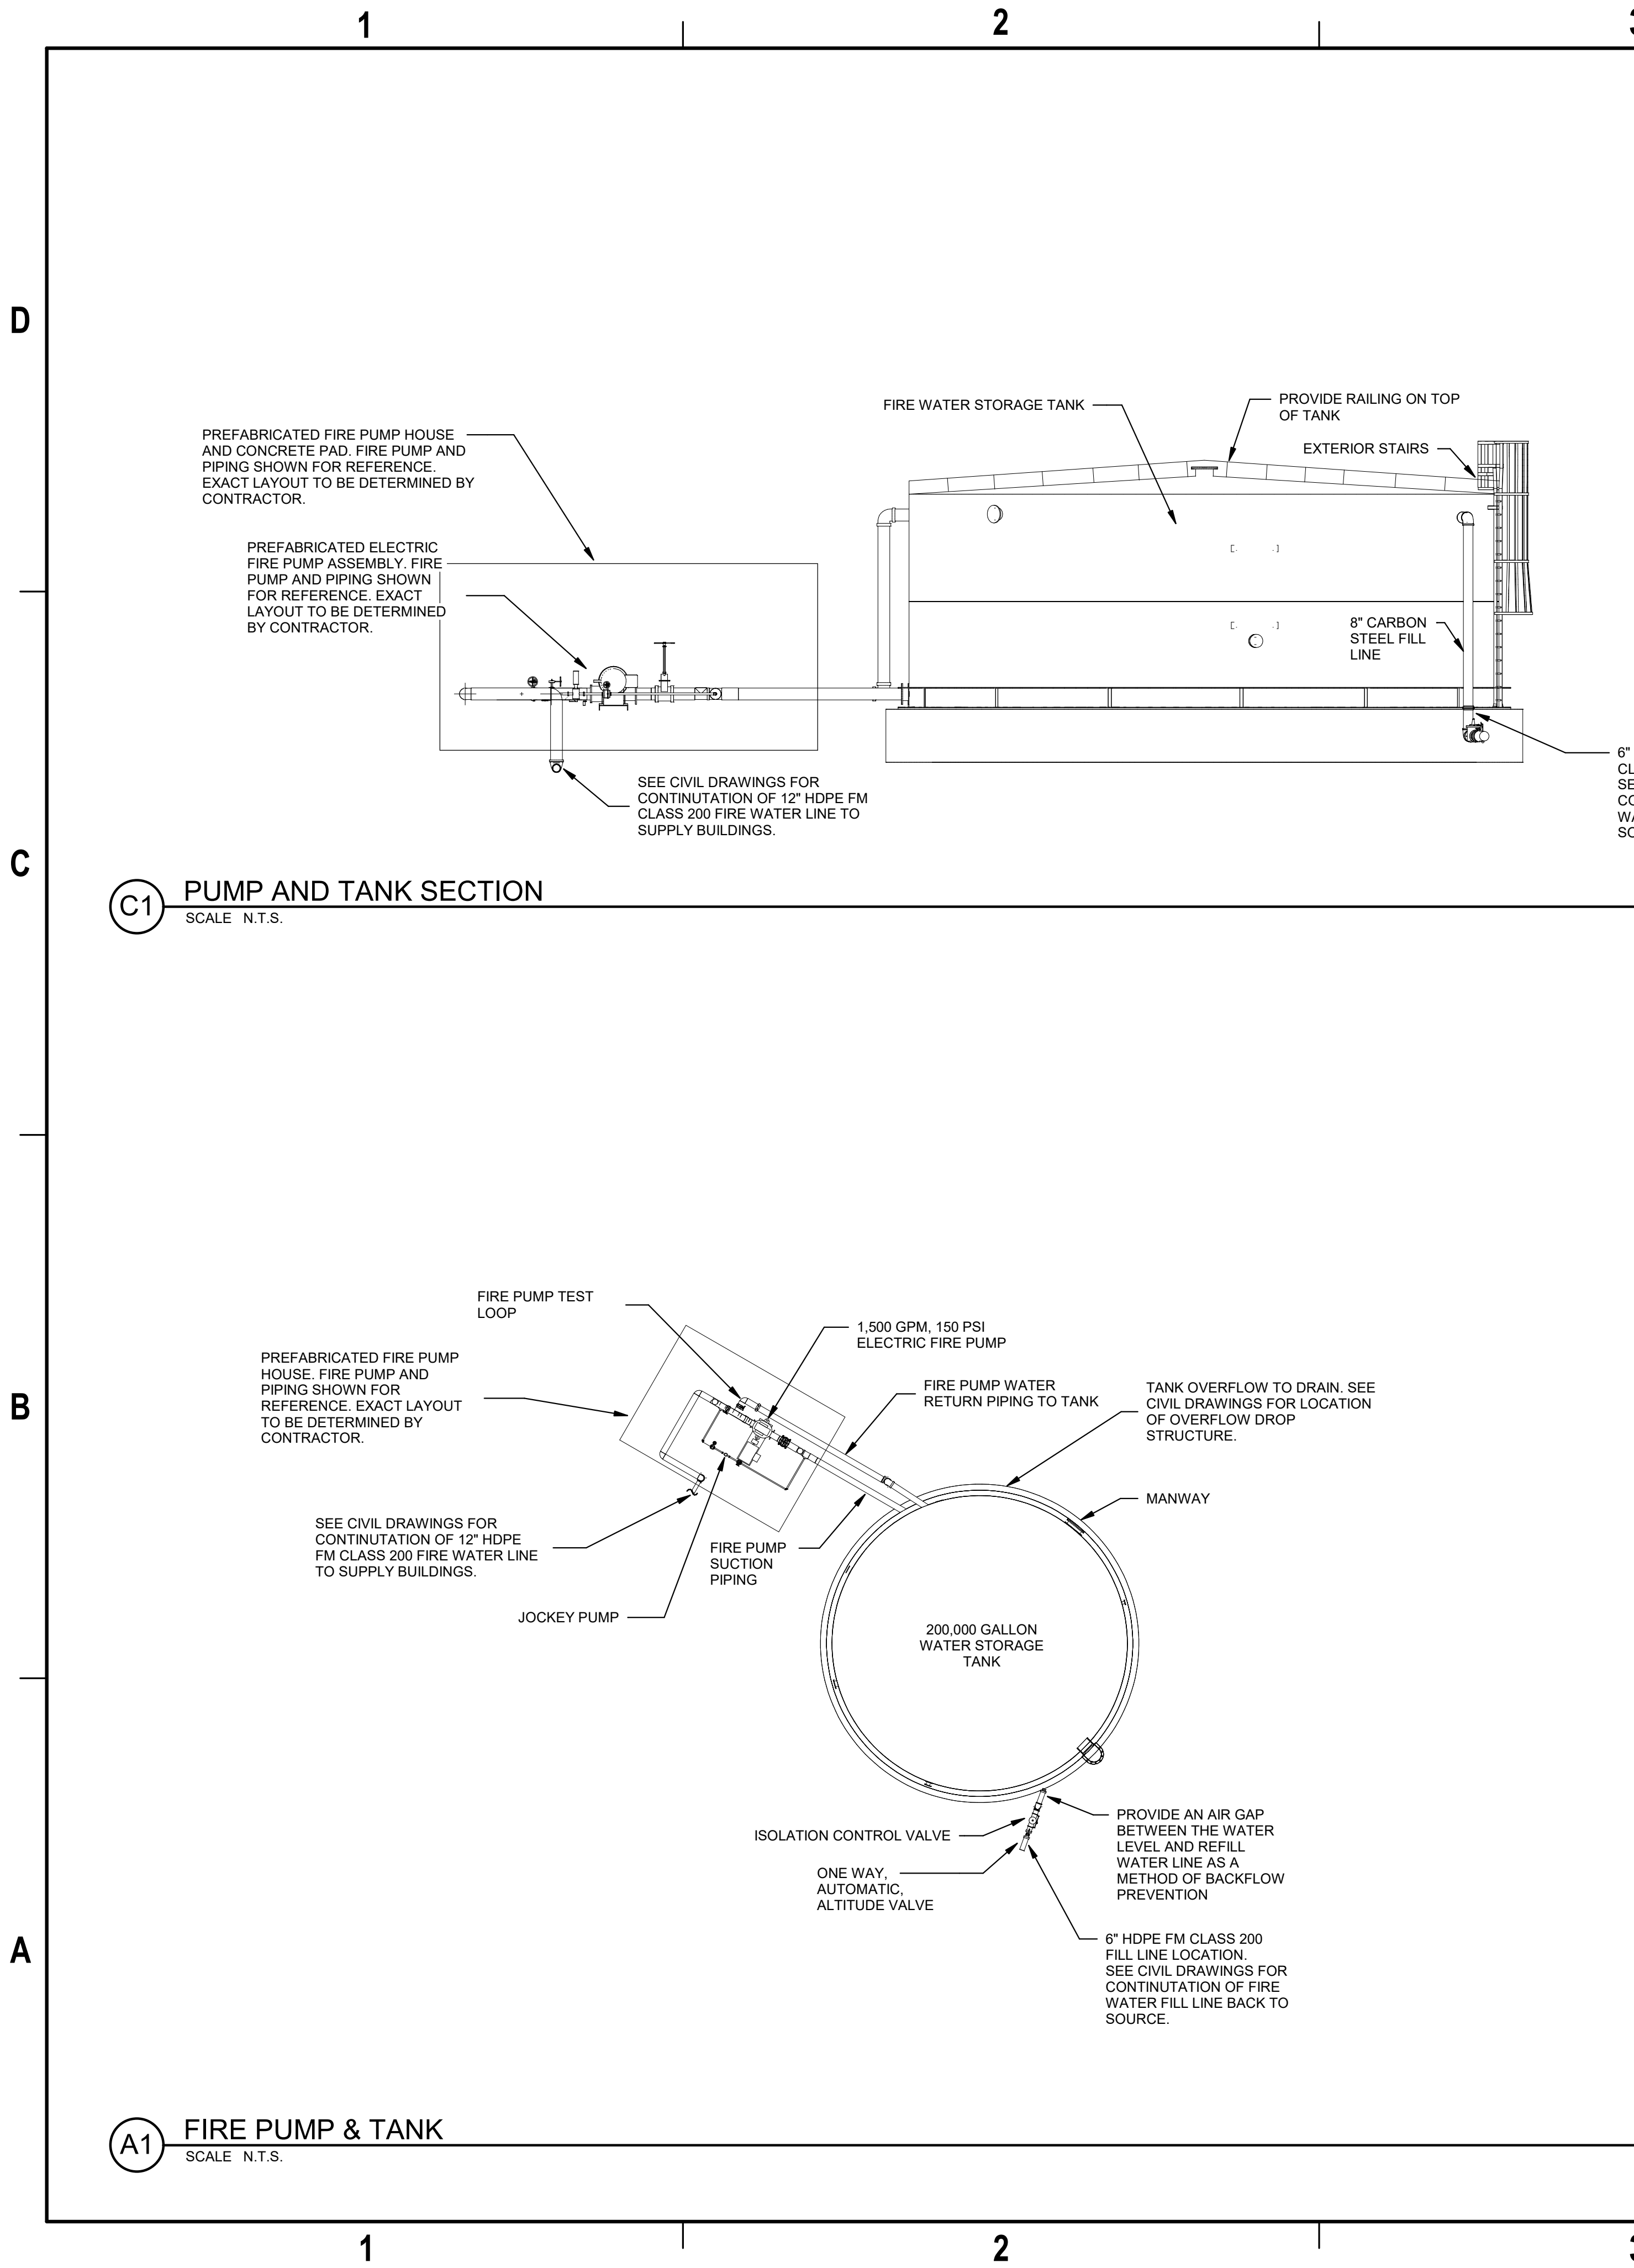

GENERAL SHEET NOTES


- FIRE PUMP ASSEMBLY, PUMP HOUSE, AND TANK DRAWINGS NOT TO SCALE.
- SEE F-102 FOR FIRE TANK TYPICAL DETAILS.
- WATER STORAGE TANK, PUMPS, AND PUMP HOUSE TO BE DESIGNED BY LICENSED FIRE PROTECTION ENGINEER. FOUNDATION TO BE PROVIDED BASED ON MANUFACTURER RECOMMENDATIONS AND SIGNED BY LICENSED ENGINEER.
- THE INSTALLING CONTRACTOR SHALL COMPLETE DESIGN OF THE WATER STORAGE TANKS AND ALL ASSOCIATED COMPONENTS AS REQUIRED BY NFPA 22 AND FM LPDS 3-2.
- DESIGN OF FIRE PUMP HOUSE SHALL BE IN ACCORDANCE WITH THE ARKANSAS BUILDING CODE, 2021.
- THE INSTALLING CONTRACTOR SHALL COMPLETE DESIGN OF THE FIRE PUMP AND ALL ASSOCIATED COMPONENTS AS REQUIRED BY NFPA 20 AND FM LPDS 3-7.
- PROVIDE A TANK HEATER TO MAINTAIN A MINIMUM WATER TEMPERATURE OF 42 DEG F IN THE TANK IN ACCORDANCE WITH NFPA 22.
- PROVIDE "NON-POTABLE FIRE WATER TANK" SIGNAGE ON OR NEAR TANK.

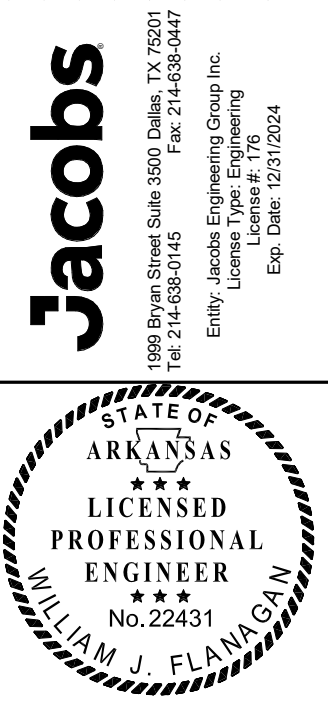

Camden OSD
Calhoun County, Arkansas
Aerofjet Rocketdyne

JACOBS
FIRE PUMP AND WATER STORAGE TANK

SHEET NO	
F-101a	
SCALE	As indicated
DATE	07/19/2024
PROJ	D3754502
DWG	CMDN_OSD_Grinder_F-101a



PLOT DATE/TIME: 7/23/2024 10:47:26 AM