



NOTE:  
1. REFER TO STRUCTURAL FOR ATTACHMENT TO BUILDING WALL.


D1 PIPE SUPPORT ON WALL  
SCALE NTS

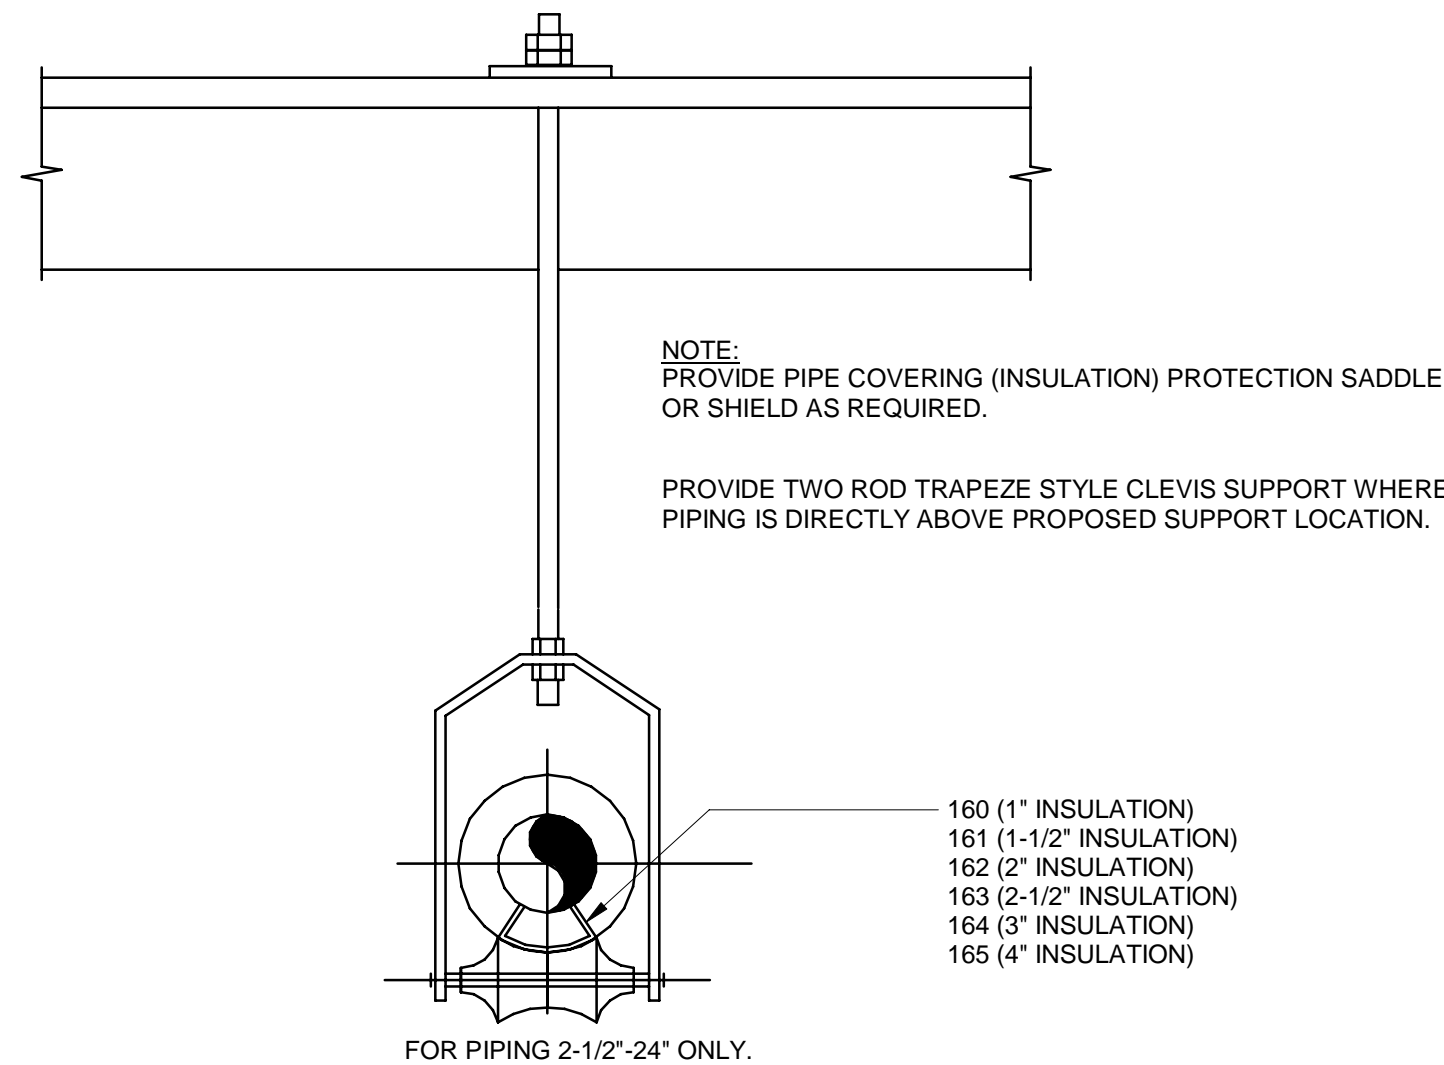


C1 TYPICAL CLEVIS SUPPORT  
SCALE NTS

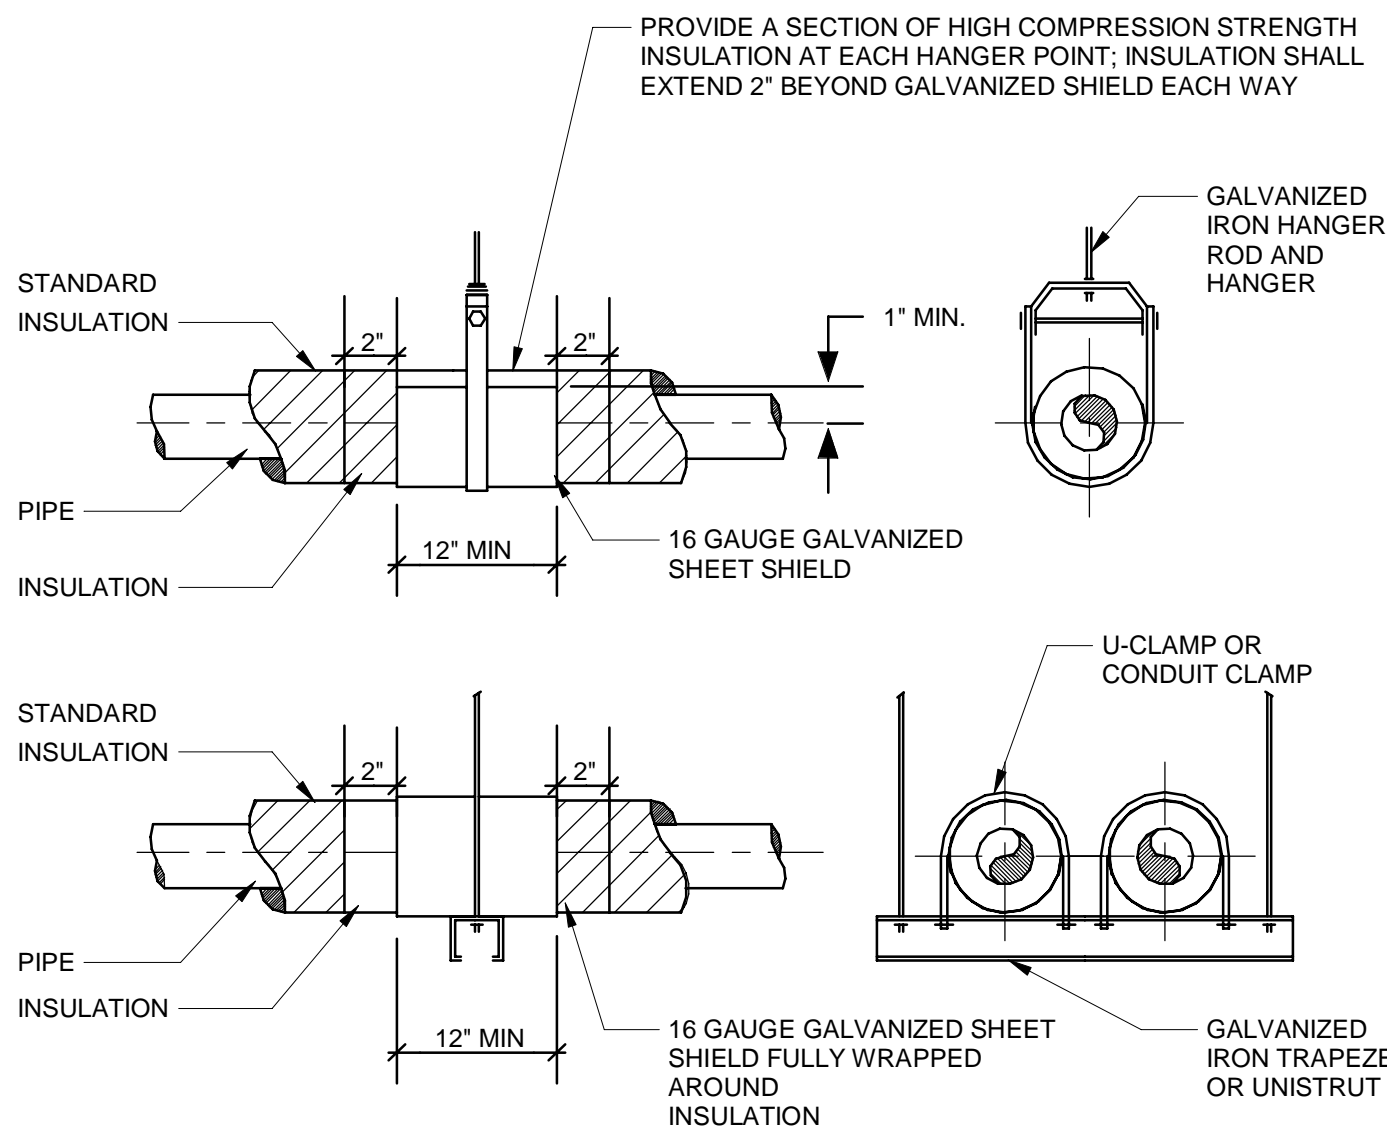

A1 PIPE HANGERS FOR INSULATION  
SCALE NTS

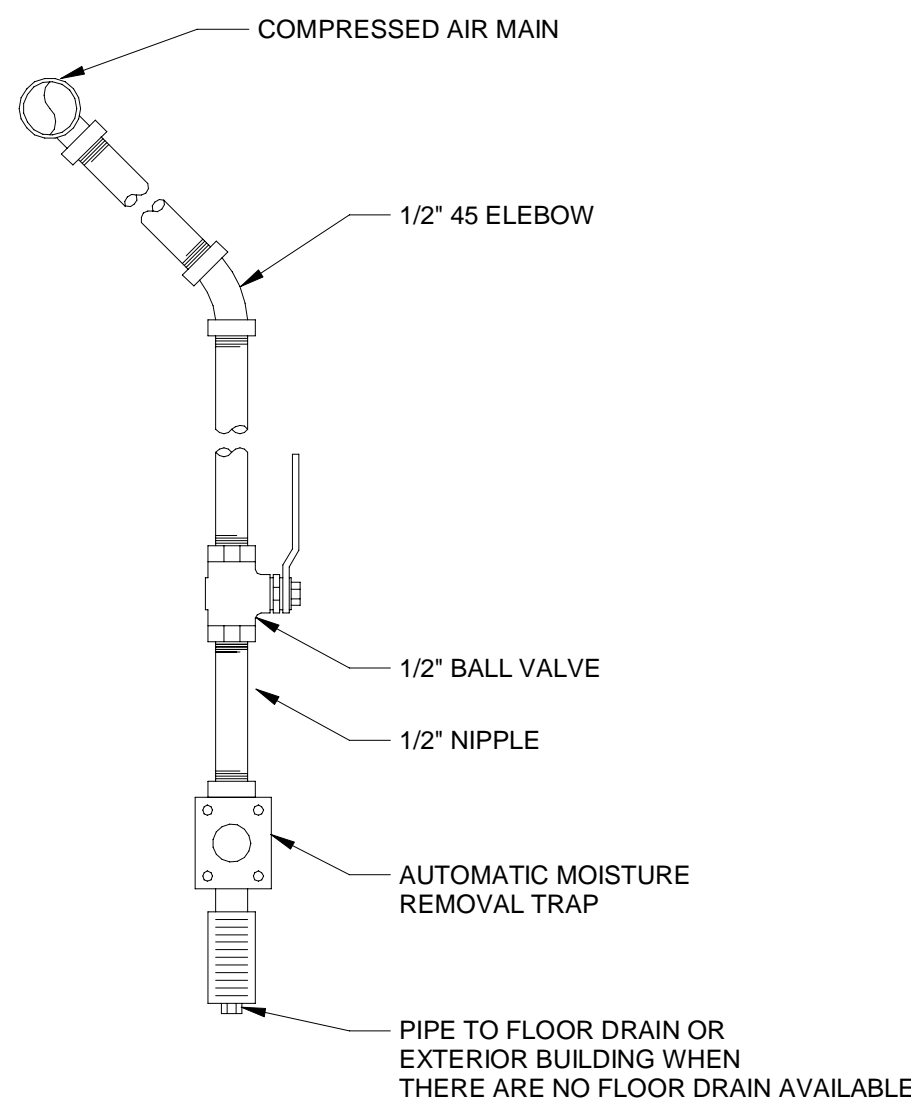


D3 TYP COMPRESSED AIR END OF MAIN DRAIN DETAIL  
SCALE 3/4" = 1'-0"

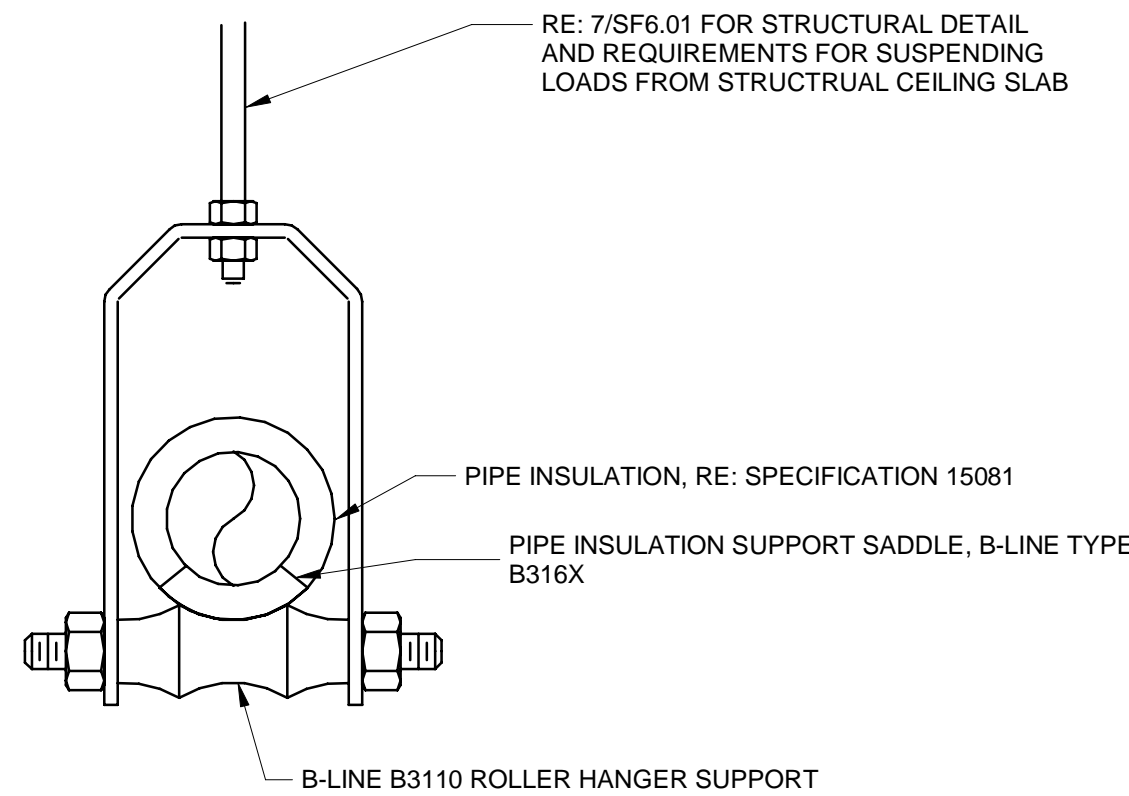


NOTES:  
1. PROVIDE MASON INDUSTRIES TYPE DNHS SPRING ISOLATION HANGER AT FIRST THREE CONNECTION POINTS NEAREST TO VIBRATING EQUIPMENT.  
2. PROVIDE TYPICAL HANGER ASSEMBLY AS SHOWN ABOVE FOR ALL SUSPENDED HOT WATER, CHILLED WATER AND CONDENSER WATER PIPING IN FIRST FLOOR MECHANICAL ROOM.  
3. REFER TO SPECIFICATIONS FOR PIPE SPACING AND HANGER ROD SIZE REQUIREMENTS.

C3 MECHANICAL ROOM PIPE SUPPORT  
SCALE NTS

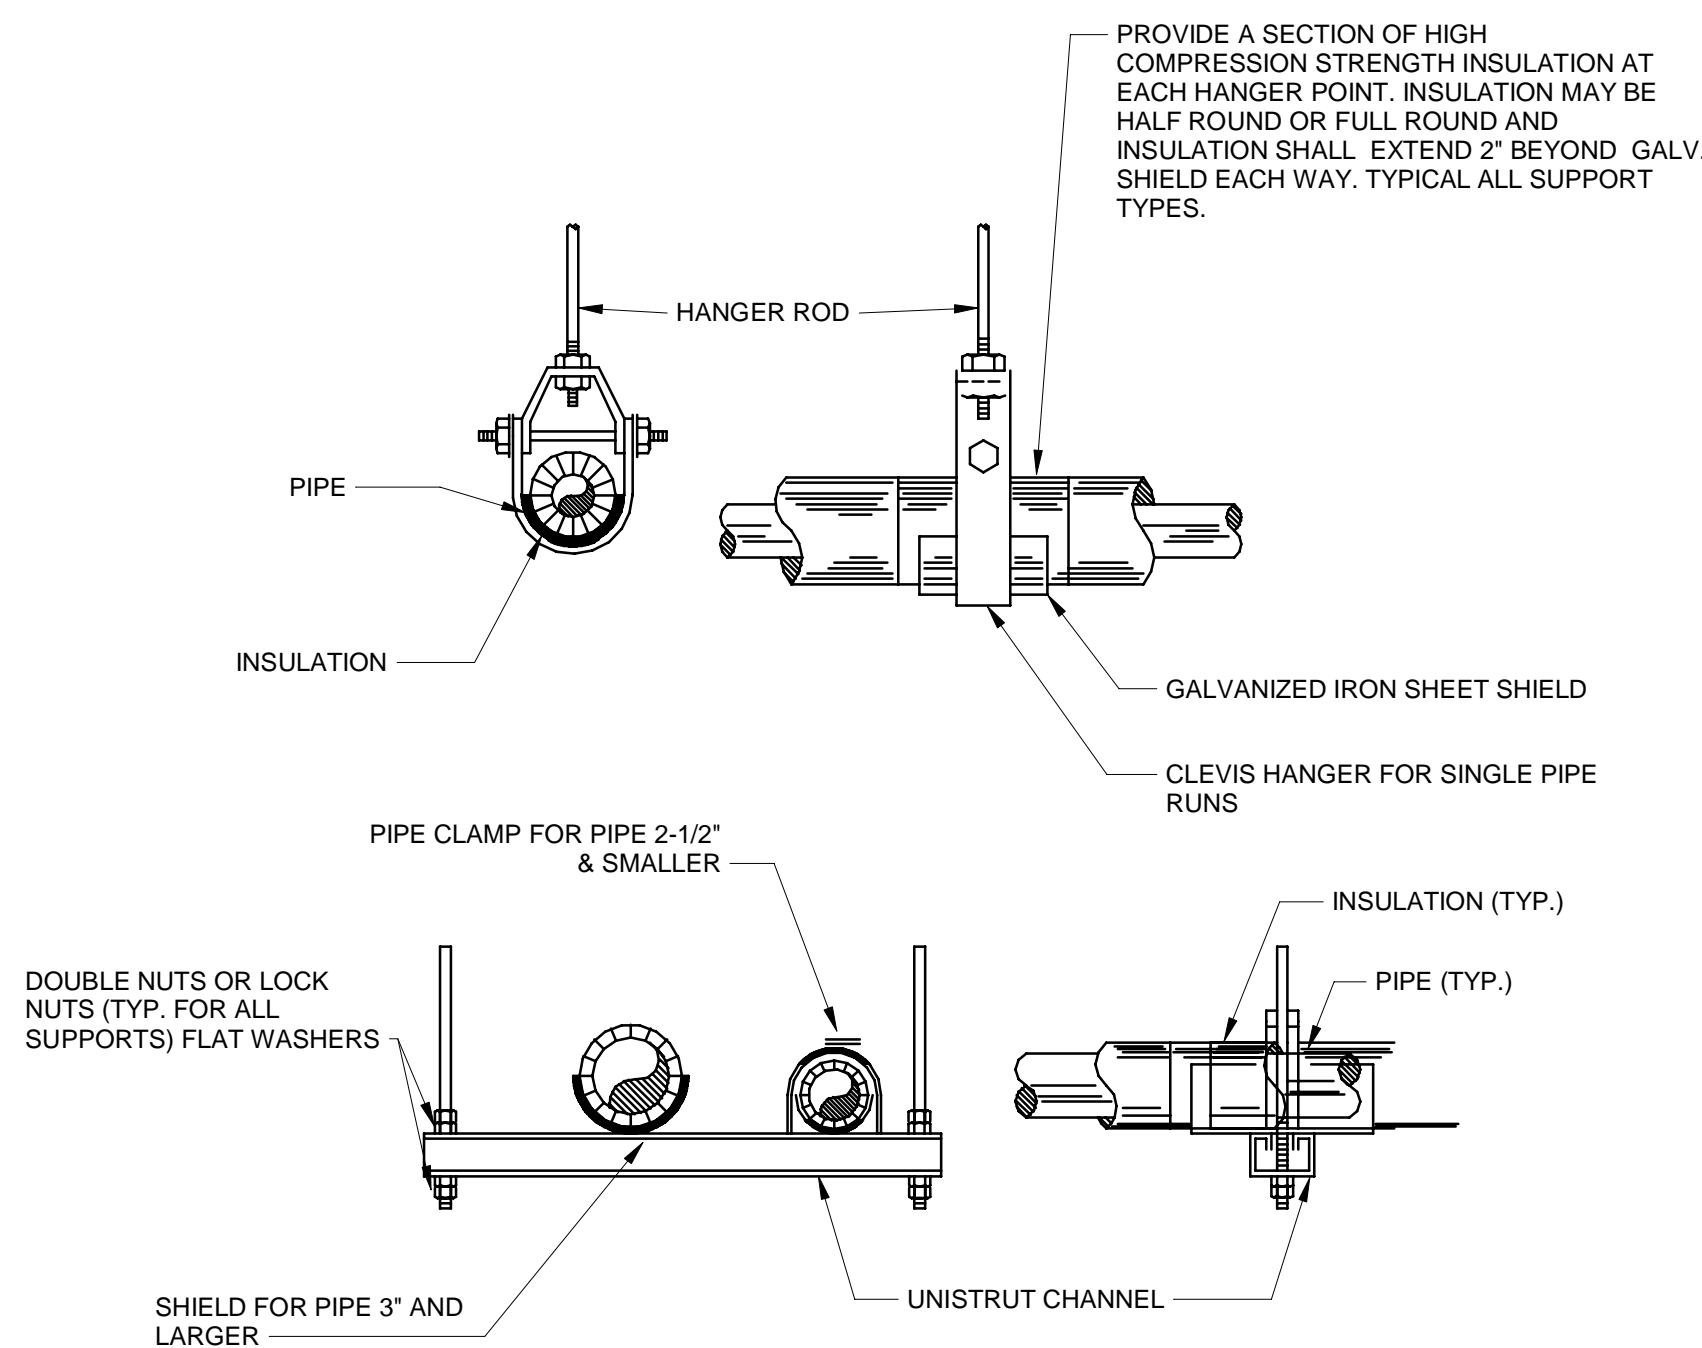


NOTE: PROVIDE SPRING VIBRATION ISOLATORS ON ALL PIPING 3" OR LARGER (TYPICAL)


A3 TYPICAL PIPE SUPPORT DETAIL  
SCALE NTS

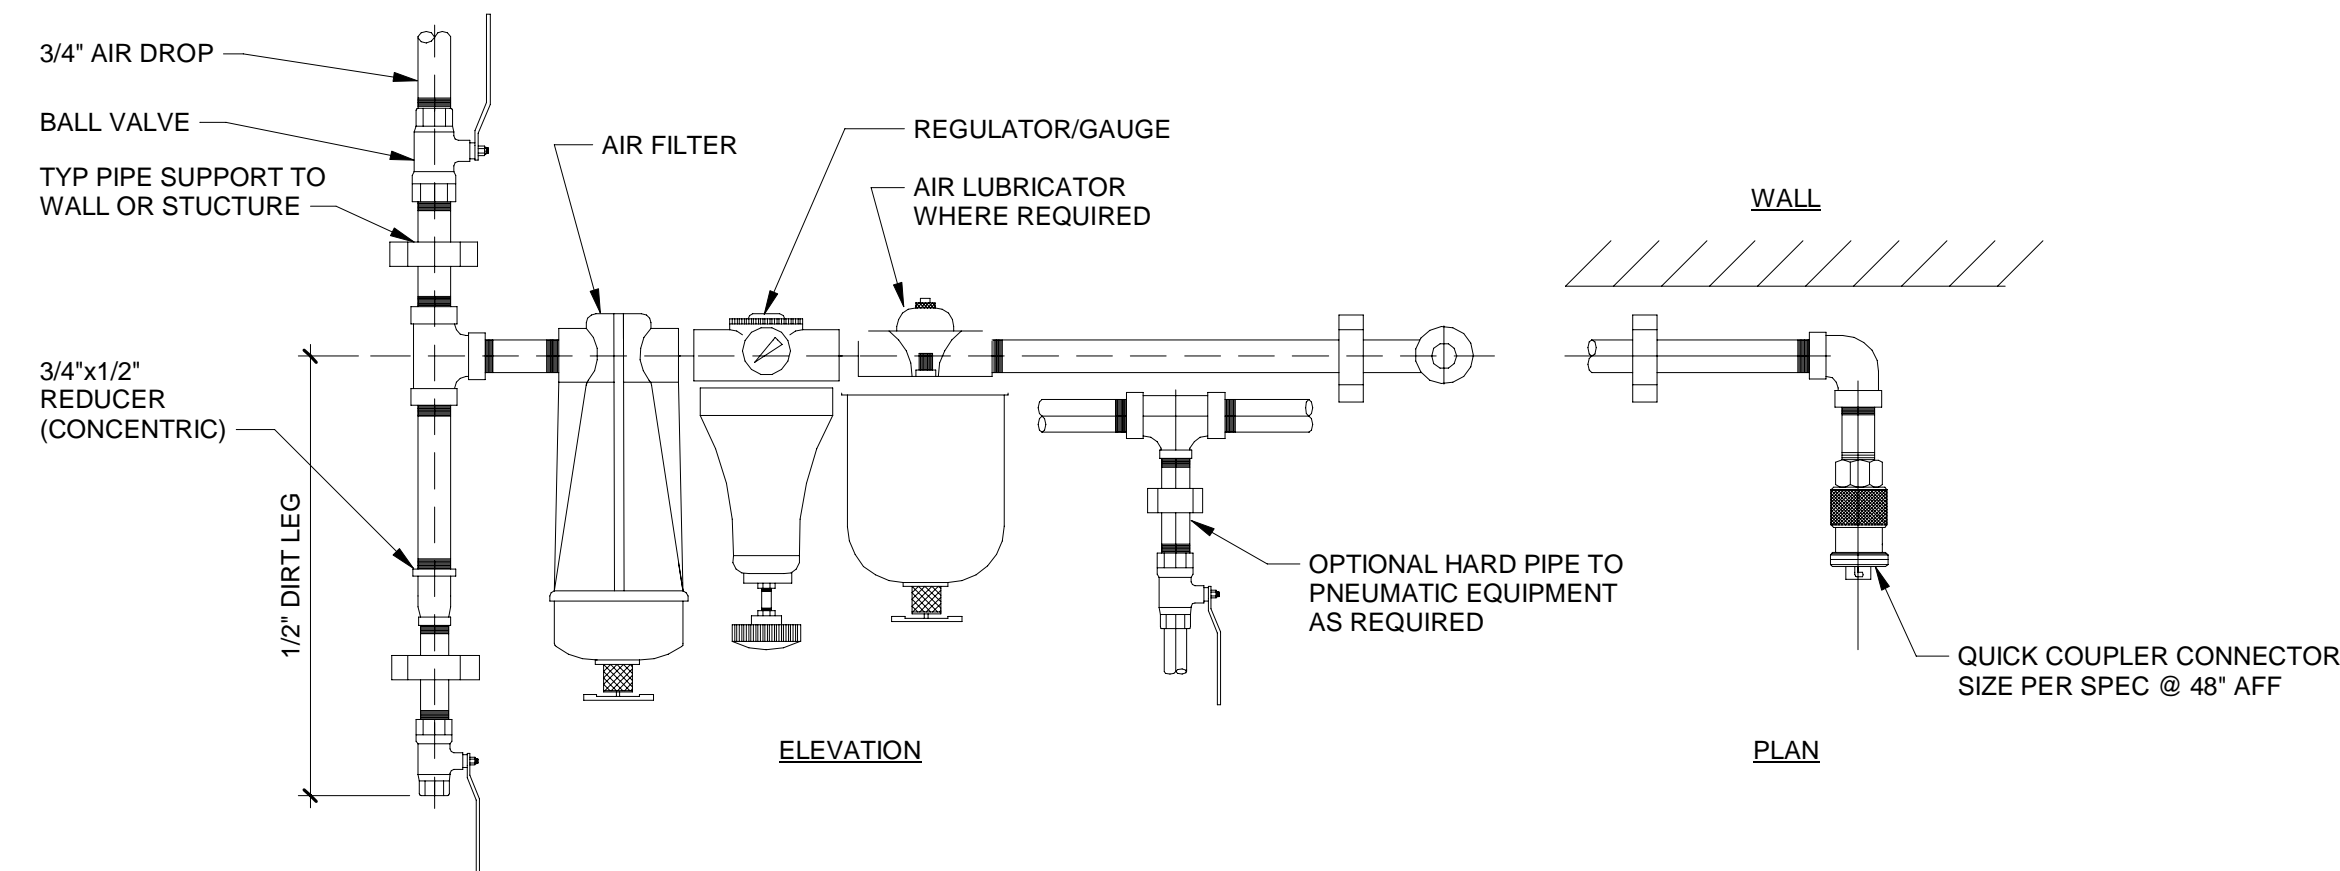

D5 TYP COMPRESSED AIR OUTLET DETAIL  
SCALE 3/16" = 1'-0"

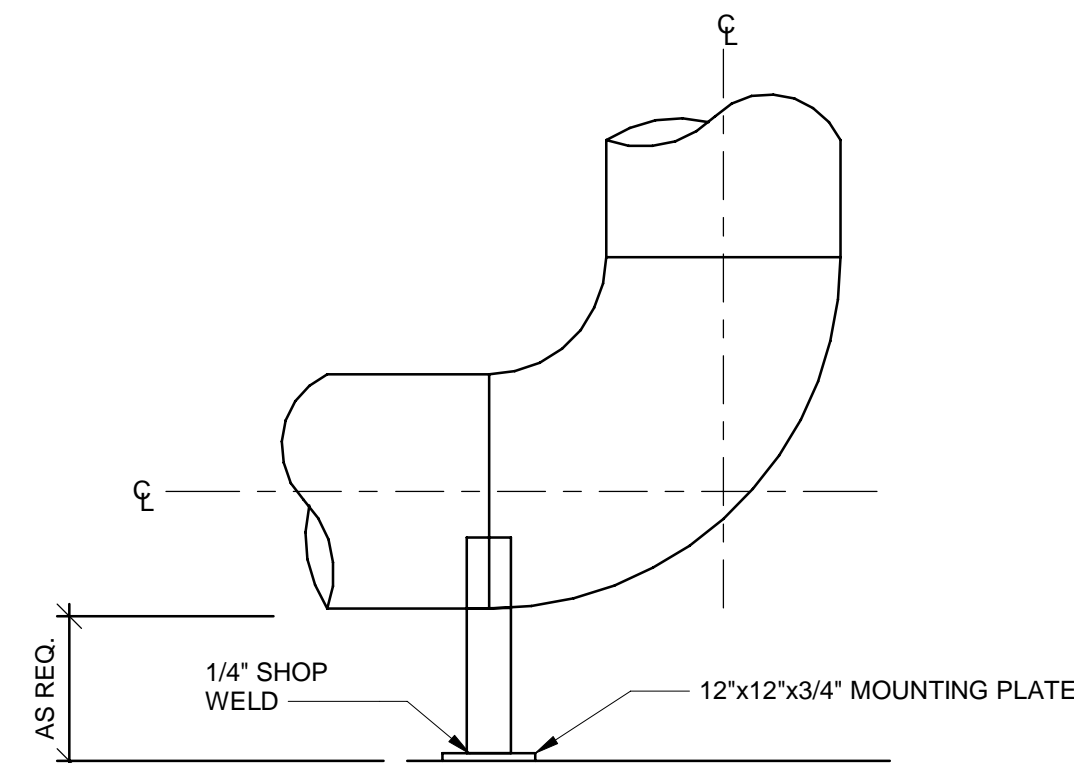


C5 TYPICAL PUMP DISCHARGE ELBOW PIPE SUPPORT DETAIL  
SCALE NTS

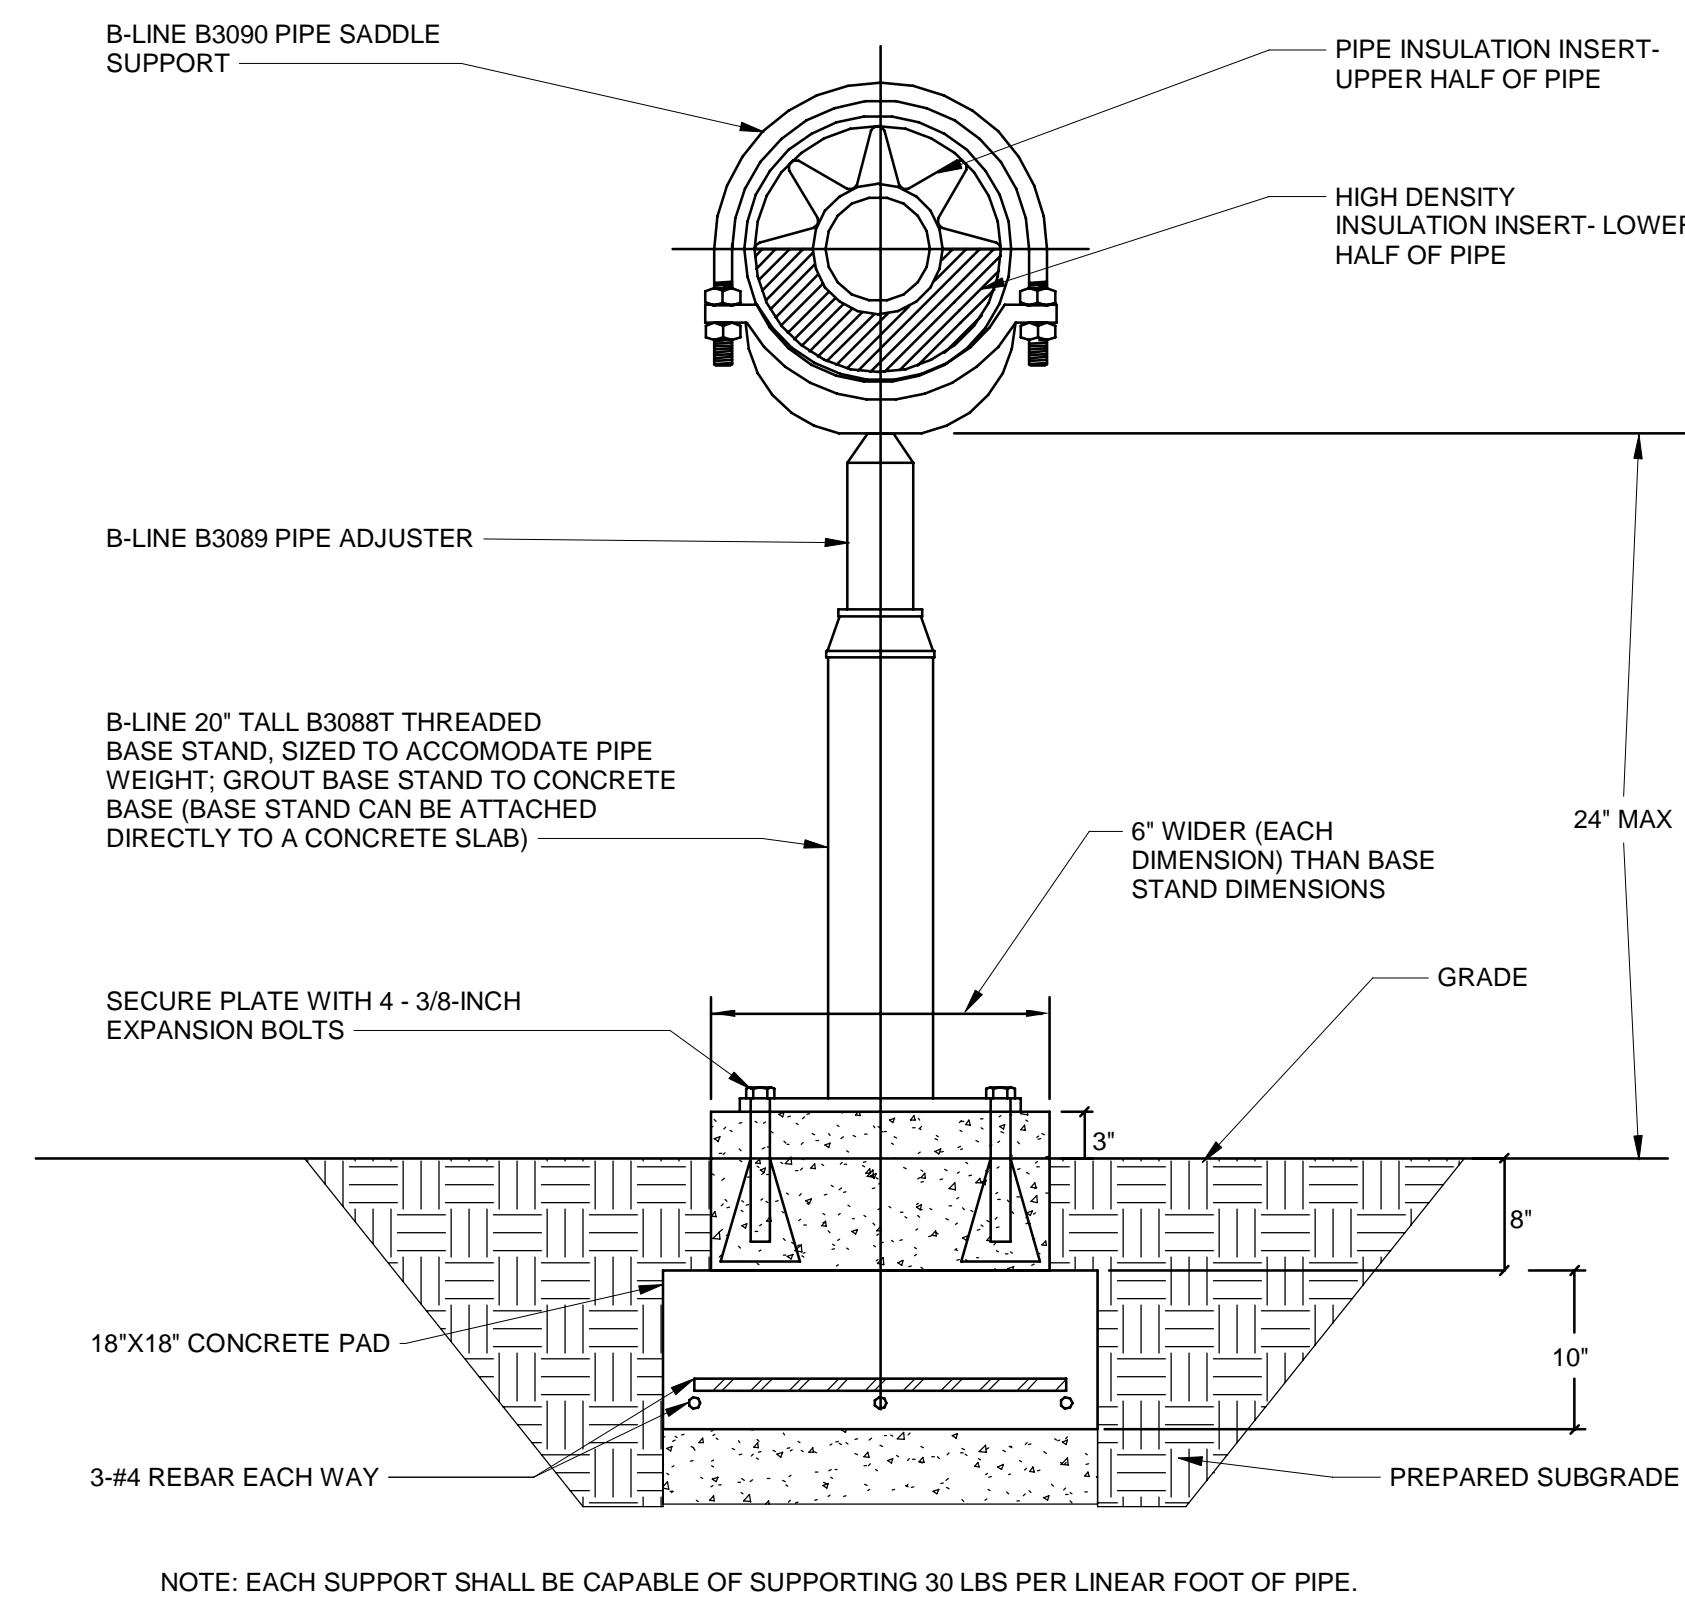

NOTE: EACH SUPPORT SHALL BE CAPABLE OF SUPPORTING 30 LBS PER LINEAR FOOT OF PIPE.

A5 TYPICAL FLOOR/GRADE PIPE SUPPORT DETAIL  
SCALE NTS

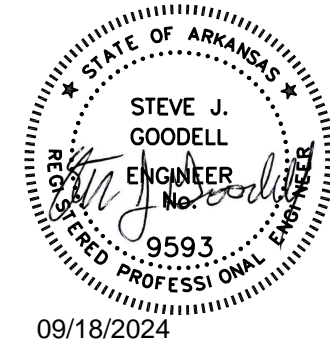

Jacobs

1998 Bryant Street Suite 3000  
Ft. Smith, AR 72304  
Phone: 479.337.1000  
Fax: 479.337.1001  
Email: Jacobs.Engineering@jacobs.com  
License Type: Engineering  
License No.: 2311004  
License Exp. Date: 03/31/2024

NO.	DATE	BY	CHK	APP'D	REVISION
0	09/18/2024	JWG			100% ISSUED FOR CONSTRUCTION - EXPANSION
DESIGN		JWG	DR		
			RPA		
			CHK		
			APP'D		
			SIG		

Campus Standard Details  
Camden OSD  
Calhoun County, Arkansas  
Aerojet Rocketdyne

MECHANICAL  
DETAILS

SHEET NO	M-808
SCALE	As indicated
DATE	09/18/2024
PROJ	D3754500
DWG	CMCN_Standard Details_M-808