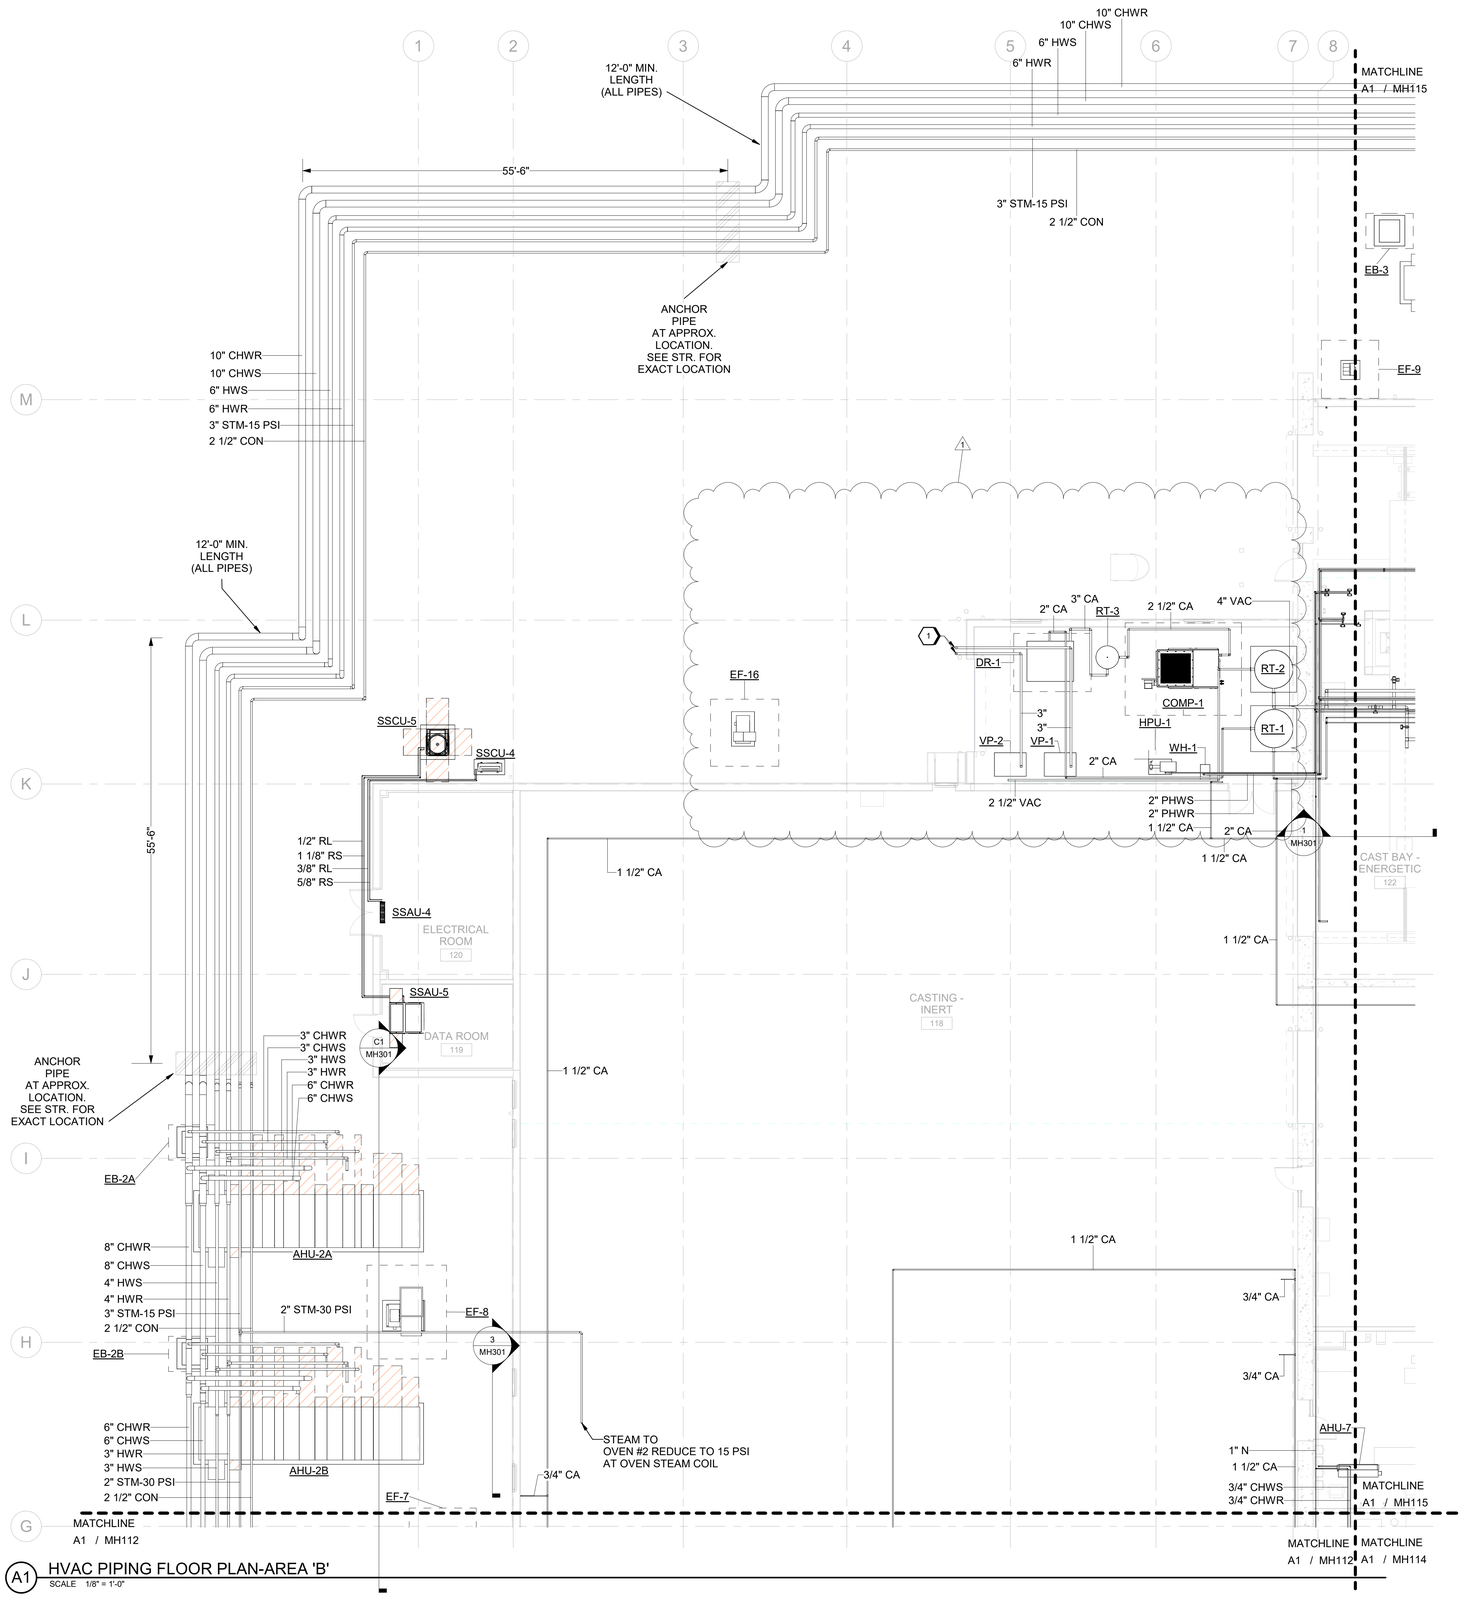

A1 HVAC PIPING FLOOR PLAN-AREA 'B'
SCALE 1/8" = 1'-0"

GENERAL SHEET NOTES

1. HEAT TRACE ALL EXTERIOR HYDRONICS AND STEAM CONDENSATE PIPING
2. STEAM PIPING SHALL BE INSTALLED TO DRAIN TO BOILER OR THE STEAM TRAP. STEAM SYSTEMS SHALL NOT HAVE DRIP POCKETS THAT REUDCE THE CAPACITY OF THE STEAM PIPING.
3. STEAM PIPE SHOULD BE INSTALLED WITH A MINIMUM SLOPE OF 1/8" PER FOOT OF PIPE (1:100) IN THE DIRECTION NECESSARY TO MOVE LIQUIDS TOWARDS STEAM TRAPS.
4. INSTALL STEAM TRAPS WITH APPROPIATELY SIZED TRAP POCKETS AT INTERVALS OF 100 TO 150 FT, AS WELL AS NATURAL LOW POINTS SUCH AS THE BOTTOM OF RISING PIPEWORK.

#SHEET KEYNOTES

KEYNOTES	
1	VACUUM PUMP EXHAUST PIPE SHALL POINT DOWN AND TERMINATE WITH A SCREEN.

LEGEND

KEY PLAN



GRAPHIC SCALE(S)

0 4' 8' 16' 24'
1/8" = 1'-0"

PLAN NORTH
TRUE N

NABHOLZ

STATE OF ARKANSAS
STEVE J. GOODELL
Expires 12/31/2024
No. 9593
LICENSED PROFESSIONAL ENGINEER
10/03/2024

Jacobs
1999 Bryan Street Suite 2000
Dallas, TX 75201
Tel +1 214 638 0145
Fax +1 214 638 0447
Entity: Jacobs Engineering Group Inc.
License # 178
License Type: Engineering
License Exp Date: 12/31/2024

NO.	DATE	REVISION	BY	CHK
1	10/03/2024	ADDENDUM 01 - EXPANSION	JWG	SJG
0	09/18/2024	100% ISSUED FOR CONSTRUCTION - EXPANSION	APVD	APVD

DSGN ASM DR ASM CHK JWG APVD SJG

GMLRS
Camden OSD
Calhoun County, Arkansas
Aerojet Rocketdyne

MECHANICAL
HVAC PIPING FLOOR PLAN
AREA 'B'

SHEET NO
MH113

SCALE	1/8" = 1'-0"
DATE	09/18/2024
PROJ	D3754502
DWG	CMDN-OSD_GMLRS_MH113

© Jacobs Solutions 2023. ALL RIGHTS RESERVED.
REUSE OF DOCUMENTS: THIS DOCUMENT, AND THE IDEAS AND DESIGNS INCORPORATED HEREIN, AS AN INSTRUMENT OF PROFESSIONAL SERVICE, IS THE PROPERTY OF JACOBS AND SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY OTHER PROJECT WITHOUT THE WRITTEN AUTHORIZATION OF JACOBS.