


9/12/2024 11:06:04 AM T-102 Autodesk Docs://US\_D3754500\_FED\_Aerojet Rocketdyne/D3754500\_CIMDN\_OSD\_GuardPost\_TCOMSEC.rvt

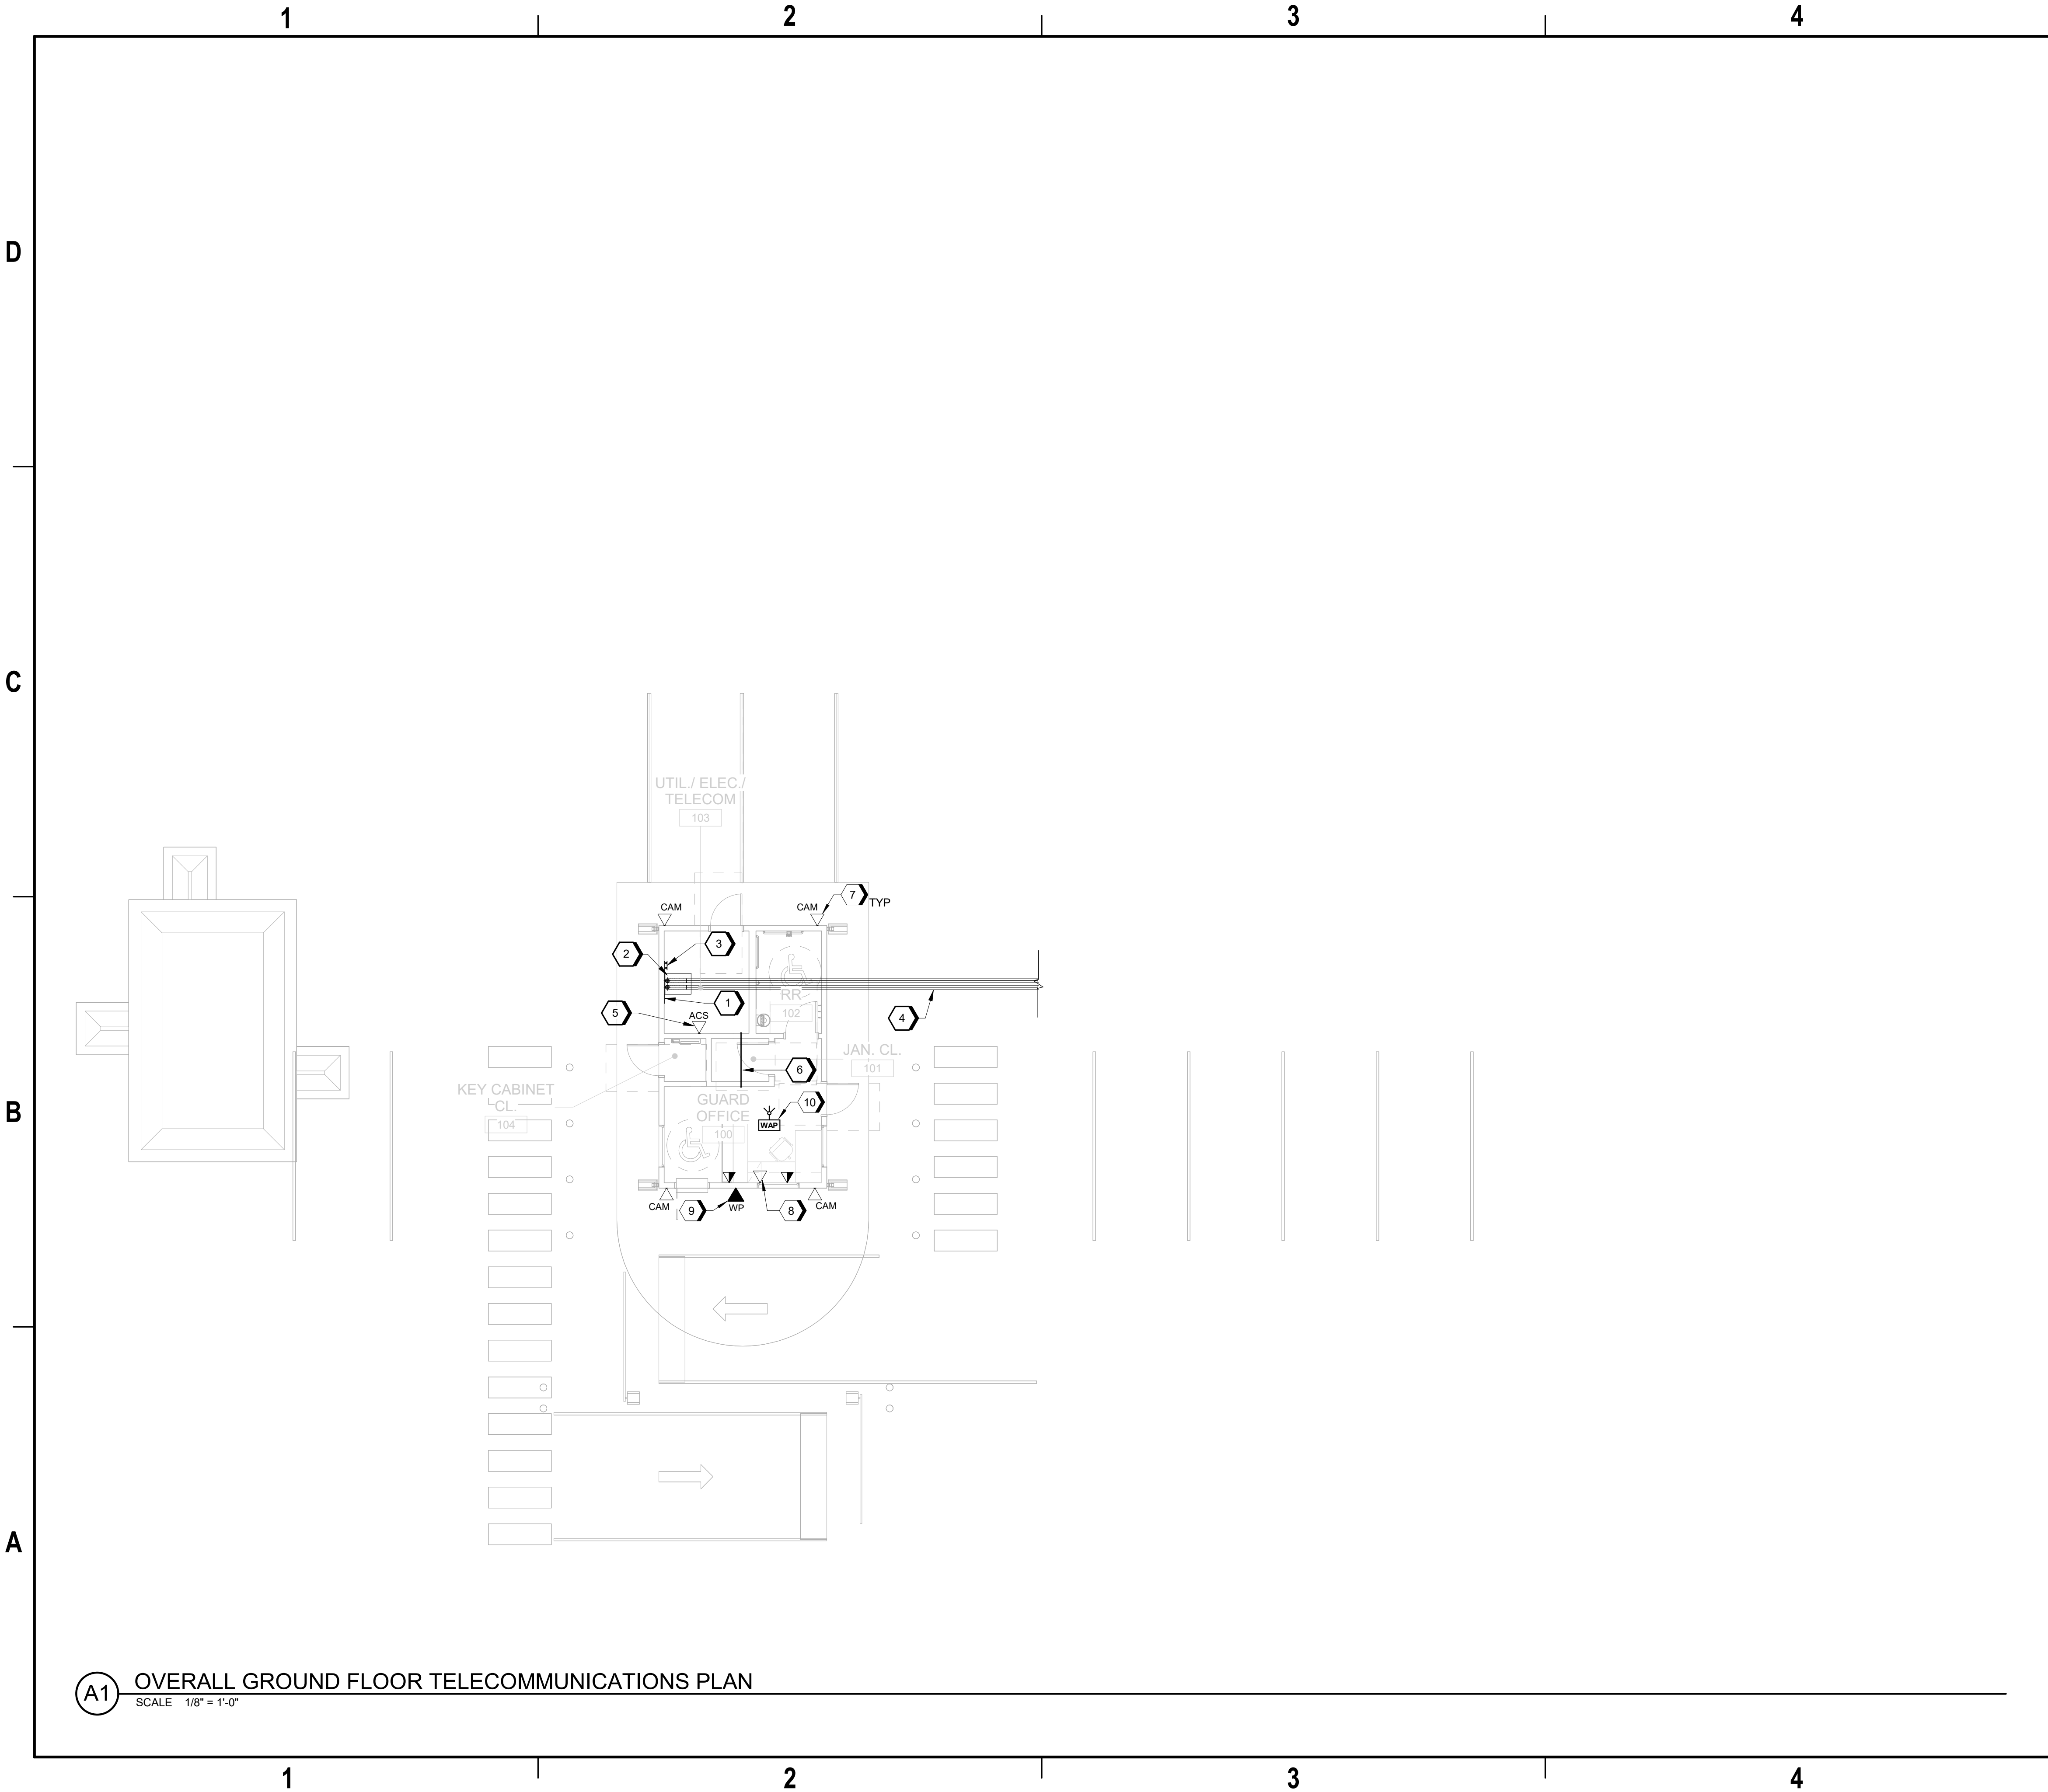

#SHEET KEYNOTES

1. PROVIDE 4' WIDE x 8' HIGH 3/4" GRADE AC PLYWOOD BACKBOARD ON THE WEST WALL OF UTIL/ELEC/TELECOM ROOM 103. BOTTOM OF PLYWOOD TO BE 6" AFF.

2. PROVIDE 24" WIDE x 30" DEEP x 48" HIGH (26 RU) WALL MOUNTED TELECOMMUNICATIONS EQUIPMENT CABINET.

3. PROVIDE PRIMARY BONDING BUSBAR (PBB) TO BE BONDED TO ELECTRICAL GROUNDING ELECTRODE SYSTEM. BOND PBB TO BUILDING STEEL AND RACK BONDING BUSBAR (RBB) IN WALL MOUNT CABINET.

4. PROVIDE TWO (2) 4-INCH CONDUIT EXTENSIONS FROM IT ROOM TO STUB-UP LOCATION. STUB-UP TO BE IN A 3' X 3' HANDHOLE APPROXIMATELY 70' EAST OF THE GUARD POST FOR INTERCONNECTION TO FIBER HUT #2.

5. PROVIDE DATA OUTLET FOR ACP.

6. PROVIDE A 2-INCH CONDUIT FROM UTIL/ELEC/TELECOM ROOM 103 TO THE OFFICE AREA SOUTH OF THE TELECOM ROOM.

7. PROVIDE OUTDOOR RATED RECEPTACLE BOXES AND OUTDOOR RATED OUTLETS FOR CAMERA NETWORK CONNECTIONS ON EACH CORNER OF THE GUARD POST FOR MONITORING BOTH INBOUND AND OUTBOUND TRAFFIC.

8. PROVIDE UTILITY DESKTOP NETWORK OUTLETS FOR SPECIALTY USE AS NEEDED.

9. PROVIDE OUTLET FOR WEATHERPROOF WALL PHONE. TOP OF PHONE AT 48" AFF.

10. PROVIDE WIRELESS ACCESS POINT OUTLET WITH 2 EACH CAT6A CABLES FOR MOBILE COMPUTER AND HANDHELD DEVICE USE.

GRAPHIC SCALE(S)

0 4' 8' 16' 24'

1/8" = 1'-0"

PLAN NORTH

TRUE N

JACOBS

REGISTERED COMMUNICATIONS DISTRIBUTION DESIGNER

Robert A Prichard

BICSI ID #107014

EXPIRES 12-31-25

Guard-Post

Camden OSD

Calhoun County, Arkansas

Aerojet Rocketdyne

T-102

SCALE 1/8" = 1'-0"

DATE 09/18/2024

PROJ D3754502

DWG CIMDN\_OSD\_GuardPost\_T-102

REVISION

NO. DATE

0 09/18/2024

100% ISSUED FOR CONSTRUCTION - EXPANSION

BY BP

MT

APVD

CHK

TS

DR

RF

SL

MT

9/12/2024 11:06:04 AM

PLOT DATE/TIME: