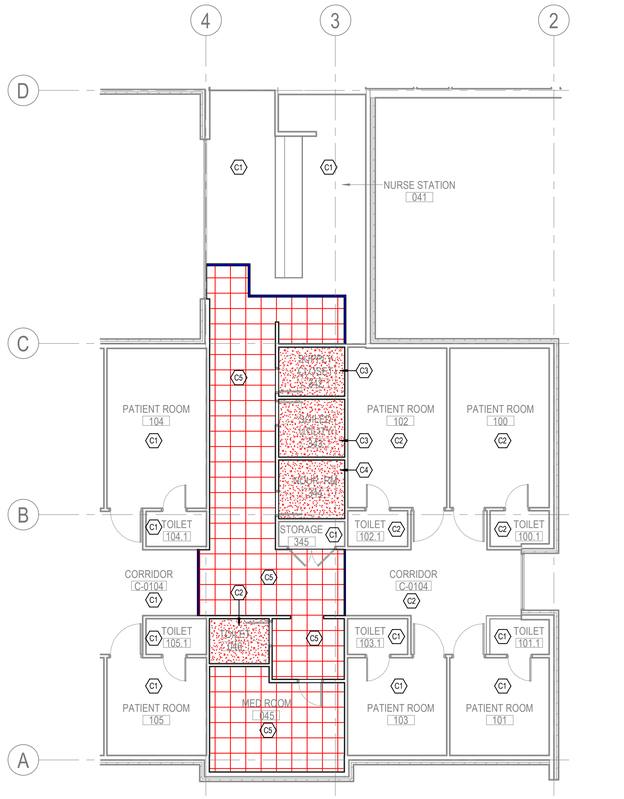

3 ENLARGED MED SURG CEILING PLAN
1/8" = 1'-0" 0 8 16 32 NORTH

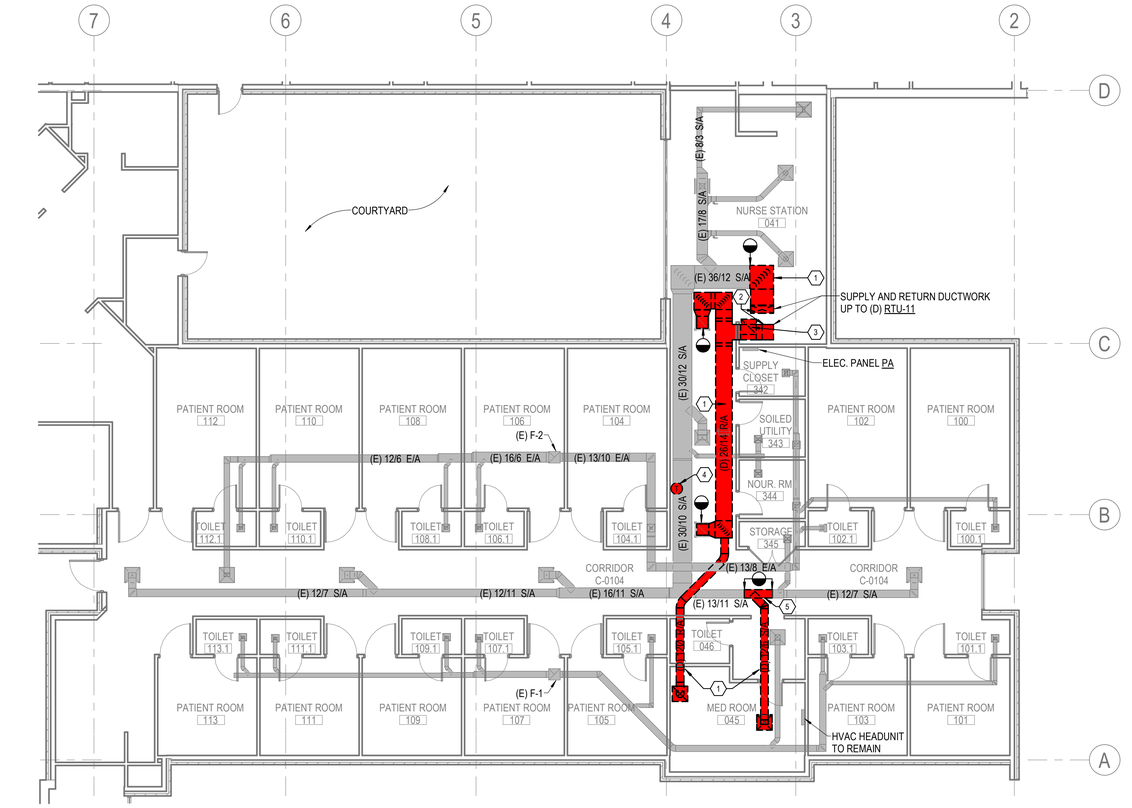

1 MED SURG DEMOLITION PLAN
1/8" = 1'-0" 0 8 16 32 NORTH

CEILING WORK KEYED NOTES

C1 NO CEILING WORK EXPECTED - CEILING TO REMAIN. REPAIR ANY DAMAGE RESULTANT OF CONSTRUCTION ACTIVITIES TO MATCH EXISTING.

C2 CEILING MODIFICATIONS MAY BE REQUIRED TO FACILITATE ABOVE CEILING CHANGES. FIELD VERIFY EXTENT OF REQUIRED CHANGES AND COORDINATE WITH OWNER FOR SCOPE OF CEILING REMOVAL/MODIFICATION.

C3 DEMOLISH ENTIRETY OF CEILING TO FACILITATE CONSTRUCTION ACTIVITIES. INSTALL REPLACEMENT CEILING MATCHING EXISTING AND REINSTALL ALL CEILING DEVICES IN THEIR ORIGINAL LOCATIONS (INCLUDING, BUT NOT LIMITED TO; LIGHTS, AIR DEVICES, FIRE ALARMS, SPRINKLER HEADS, ACCESS HATCHES, ETC). FINISH AND PAINT TO MATCH EXISTING.

C4 DEMOLITION AND REPLACEMENT OF EXISTING CEILING MAY BE REQUIRED DURING STRUCTURAL STEEL MODIFICATIONS FOR NEW HVAC UNIT. CEILING MAY REMAIN AS-IS IF NO WORK IS REQUIRED ABOVE CEILING - FIELD VERIFY.

C5 DROP CEILING WITHIN WORK AREA TO BE REMOVED. CONTRACTOR TO CAREFULLY REMOVE EXISTING CEILING TILES AND CEILING DEVICES (INCLUDING, BUT NOT LIMITED TO; LIGHTS, AIR DEVICES, FIRE ALARMS, SPRINKLER HEADS, ACCESS HATCHES, ETC) - CEILING TILES SHALL BE STORED IN OWNER PROVIDED STORAGE SPACE. DEMOLISH CEILING T-BAR TO FACILITATE NEW CONSTRUCTION - FIELD VERIFY EXTENT OF DEMOLITION REQUIRED. UPON COMPLETION OF ABOVE-CEILING WORK, THE CONTRACTOR SHALL INSTALL NEW T-BAR TO MATCH EXISTING AND REINSTALL CEILING TILES AND CEILING DEVICES IN THEIR ORIGINAL LOCATION. THE OWNER SHALL PROVIDE REPLACEMENT CEILING TILES AS NEEDED TO REPLACE DAMAGED OR BROKEN TILES. 1

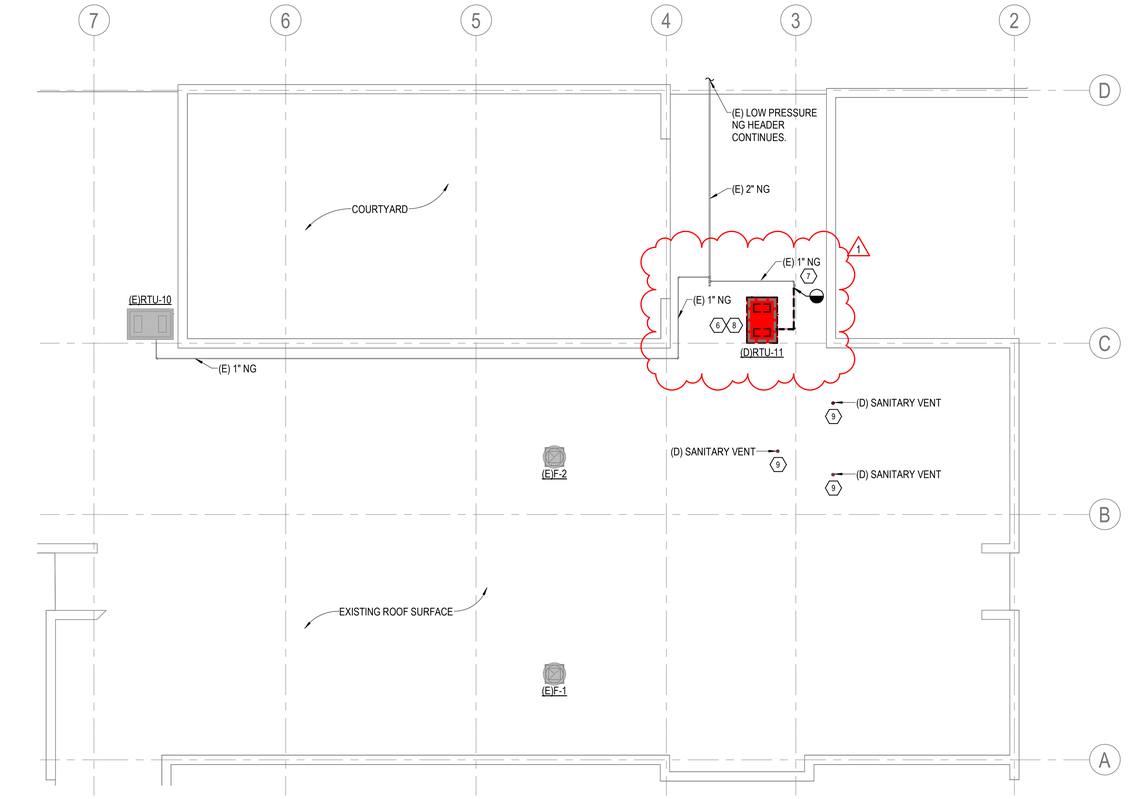

2 ROOF DEMOLITION PLAN
1/8" = 1'-0" 0 8 16 32 NORTH

GENERAL NOTES

1. REFER TO SHEET ME001 FOR MECHANICAL NOTES, ABBREVIATIONS, AND LEGEND SYMBOLS.

KEYED NOTES

1 REMOVE DUCTWORK AND INSULATION TO LOCATION INDICATED. PREPARE DUCTWORK CONNECTION TO BE REUSED FOR CONNECTION IN NEW WORK. FIELD VERIFY ACTUAL ROUTING AND CONNECTION POINT.

2 DEMOLISH DUCTWORK, INSULATION, AND DUCT TRANSITION UP TO (D)RTU-11. DEMOLISH EXISTING THERMOSTAT.

3 DEMOLISH CEILING AIR DEVICE AND DUCTWORK BACK TO LOCATION INDICATED.

4 DEMOLISH WALL MOUNTED THERMOSTAT AND THERMOSTAT WIRE BACK TO UNIT.

5 DEMOLISH PORTION OF RECTANGULAR SUPPLY DUCTWORK AND PREPARE REMAINING DUCTWORK FOR RECONNECTION IN NEW WORK.

6 DISCONNECT (D)RTU-11 FROM DUCTWORK, ELECTRICAL, AND GAS UTILITIES AND REMOVE UNIT FROM CURB FOR SCRAP. CAP EXISTING CURB WATER TIGHT.

7 DEMOLISH EXISTING 1" NG PIPING BACK TO 2" MAIN. REMOVE ANY UNUSED ROOFTOP GAS SUPPORTS SERVING (D)RTU-11.

8 DISCONNECT ELECTRIC CONNECTION TO (D)RTU-11. REMOVE EXISTING CONDUIT, CONDUCTORS, AND DISCONNECT SWITCH BACK TO PANEL PA FROM WHICH IT WAS SERVED.

9 EXISTING SANITARY VENT TO BE RELOCATED IN NEW WORK. FIELD VERIFY EXACT LOCATION AND TOTAL QUANTITY. DEMOLISH VENT PIPING AND SEAL ROOF SURFACE WATERTIGHT. SEE NEW WORK FOR NEW LOCATION. REFER ME102.



CROMWELL
1300 East 6th Street Little Rock, AR 72202
501.372.2900 cromwell.com
100 W. Emma Ave. Springdale, AR 72764
479.320.2741

Project

MERCY HOSPITAL BERRYVILLE
RTU - 11 REPLACEMENT
214 CARTER STREET, BERRYVILLE, AR 72616

Design Phase
CONSTRUCTION DOCUMENTS

Revisions

No.	Date	Description
1	07-28-2025	ADD 001

Stamp

CERTIFICATE OF AUTHORIZATION — CROMWELL ARCHITECTS/ ENGINEERS #5 — ARKANSAS, ENGINEER

STATE OF ARKANSAS — REGISTERED PROFESSIONAL ENGINEER — No. 22271 — SHAWN B. SORNBACK — 07-14-2025

Notes

1. CROMWELL ARCHITECTS ENGINEERS, INC. ALL RIGHTS RESERVED

2. THIS SHEET DESIGNED FOR COLOR PRINTING. CRITICAL INFORMATION MAY BE LOST WITH BLACK AND WHITE PRINTING.

Project Number 2025-020

Issue Date 07-14-2025

Sheet Title
DEMOLITION AND CEILING PLANS

Sheet Number
MD101