



AIA[®] Document G709™ – 2018

Proposal Request

PROJECT: *(name and address)*
AWSOM
Bentonville, Arkansas

CONTRACT INFORMATION:
Contract For: General Construction
Date: 11.09.2021

Architect's Project Number: 993A
Proposal Request Number: 050
Proposal Request Date: 04.25.2024

OWNER: *(name and address)*
AWSOM Lands, LLC
PO Box 2030
Bentonville, AR 72712

ARCHITECT: *(name and address)*
Polk Stanley Wilcox
509 W. Spring St., Ste 150
Fayetteville, AR 72701

CONTRACTOR: *(name and address)*
Crossland Construction Company
1800 S. 52nd Street, Suite 410
Rogers, AR 72758

The Owner requests an itemized proposal for changes to the Contract Sum and Contract Time for proposed modifications to the Contract Documents described herein. The Contractor shall submit this proposal within five (5) days or notify the Architect in writing of the anticipated date of submission.

(Insert a detailed description of the proposed modifications to the Contract Documents and, if applicable, attach or reference specific exhibits.)

Refer to the attached Proposal Request 050 Narrative listing revised drawings with brief description of changes.

THIS IS NOT A CHANGE ORDER, A CONSTRUCTION CHANGE DIRECTIVE, OR A DIRECTION TO PROCEED WITH THE WORK DESCRIBED IN THE PROPOSED MODIFICATIONS.

REQUESTED BY THE ARCHITECT:

Mark Herrmann, AIA

PRINTED NAME AND TITLE

PROPOSAL REQUEST 050

RFI 335

ISSUED: April 25, 2024

PROJECT: AWSOM
BENTONVILLE, AR

FROM ARCHITECT: POLK STANLEY WILCOX ARCHITECTS
801 SOUTH SPRING ST.
LITTLE ROCK AR 72201

TO CONTRACTOR: CROSSLAND CONSTRUCTION COMPANY, INC

PROPOSAL REQUEST 50 BRIEF

Revised drawings in PR 050 update per RFI 335.

REVISED DRAWING SHEETS


1) Technology

- a) Refer to Revised Sheet **TN201B**, with original issue date 02.24.2023 and revised date 04.25.2024.
 - Revised conduit pathway crossing over Services Corridor #C15.4. Conduits are to be continuous over hard-lid ceiling in-lieu of fire-rated sleeves. Contractor to ensure that fire-rating meets the project requirements.
- b) Refer to Revised Sheet **TN203A** with original issue date of 02.24.2023 and revised date of 04.25.2024.
 - Revised cable tray originating from Data #3102 to be continuous conduits from Corridor #C31.2 to Circulation Area #C13.6.
 - Replaced cable trays over hard ceiling in Public Lobby #3000 with 4" conduits. Refer to drawing for exact quantity.


End of PR 050

TECHNOLOGY PLAN NOTES:
T11 PROVIDE (4) 4" CONDUIT SLEEVES, PROVIDE UL FIRESTOP SYSTEM ASSEMBLY AS REQUIRED. SEE DIVISION 27 SPECIFICATIONS FOR ADDITIONAL INFORMATION.
T14 PROVIDE (3) 4" CONDUIT SLEEVES, PROVIDE UL FIRESTOP SYSTEM ASSEMBLY AS REQUIRED. SEE DIVISION 27 SPECIFICATIONS FOR ADDITIONAL INFORMATION.

ALL STRUCTURED AND LOW VOLTAGE CABLING ON THIS VIEW IS TO BE FED FROM DATA ROOM #1538.

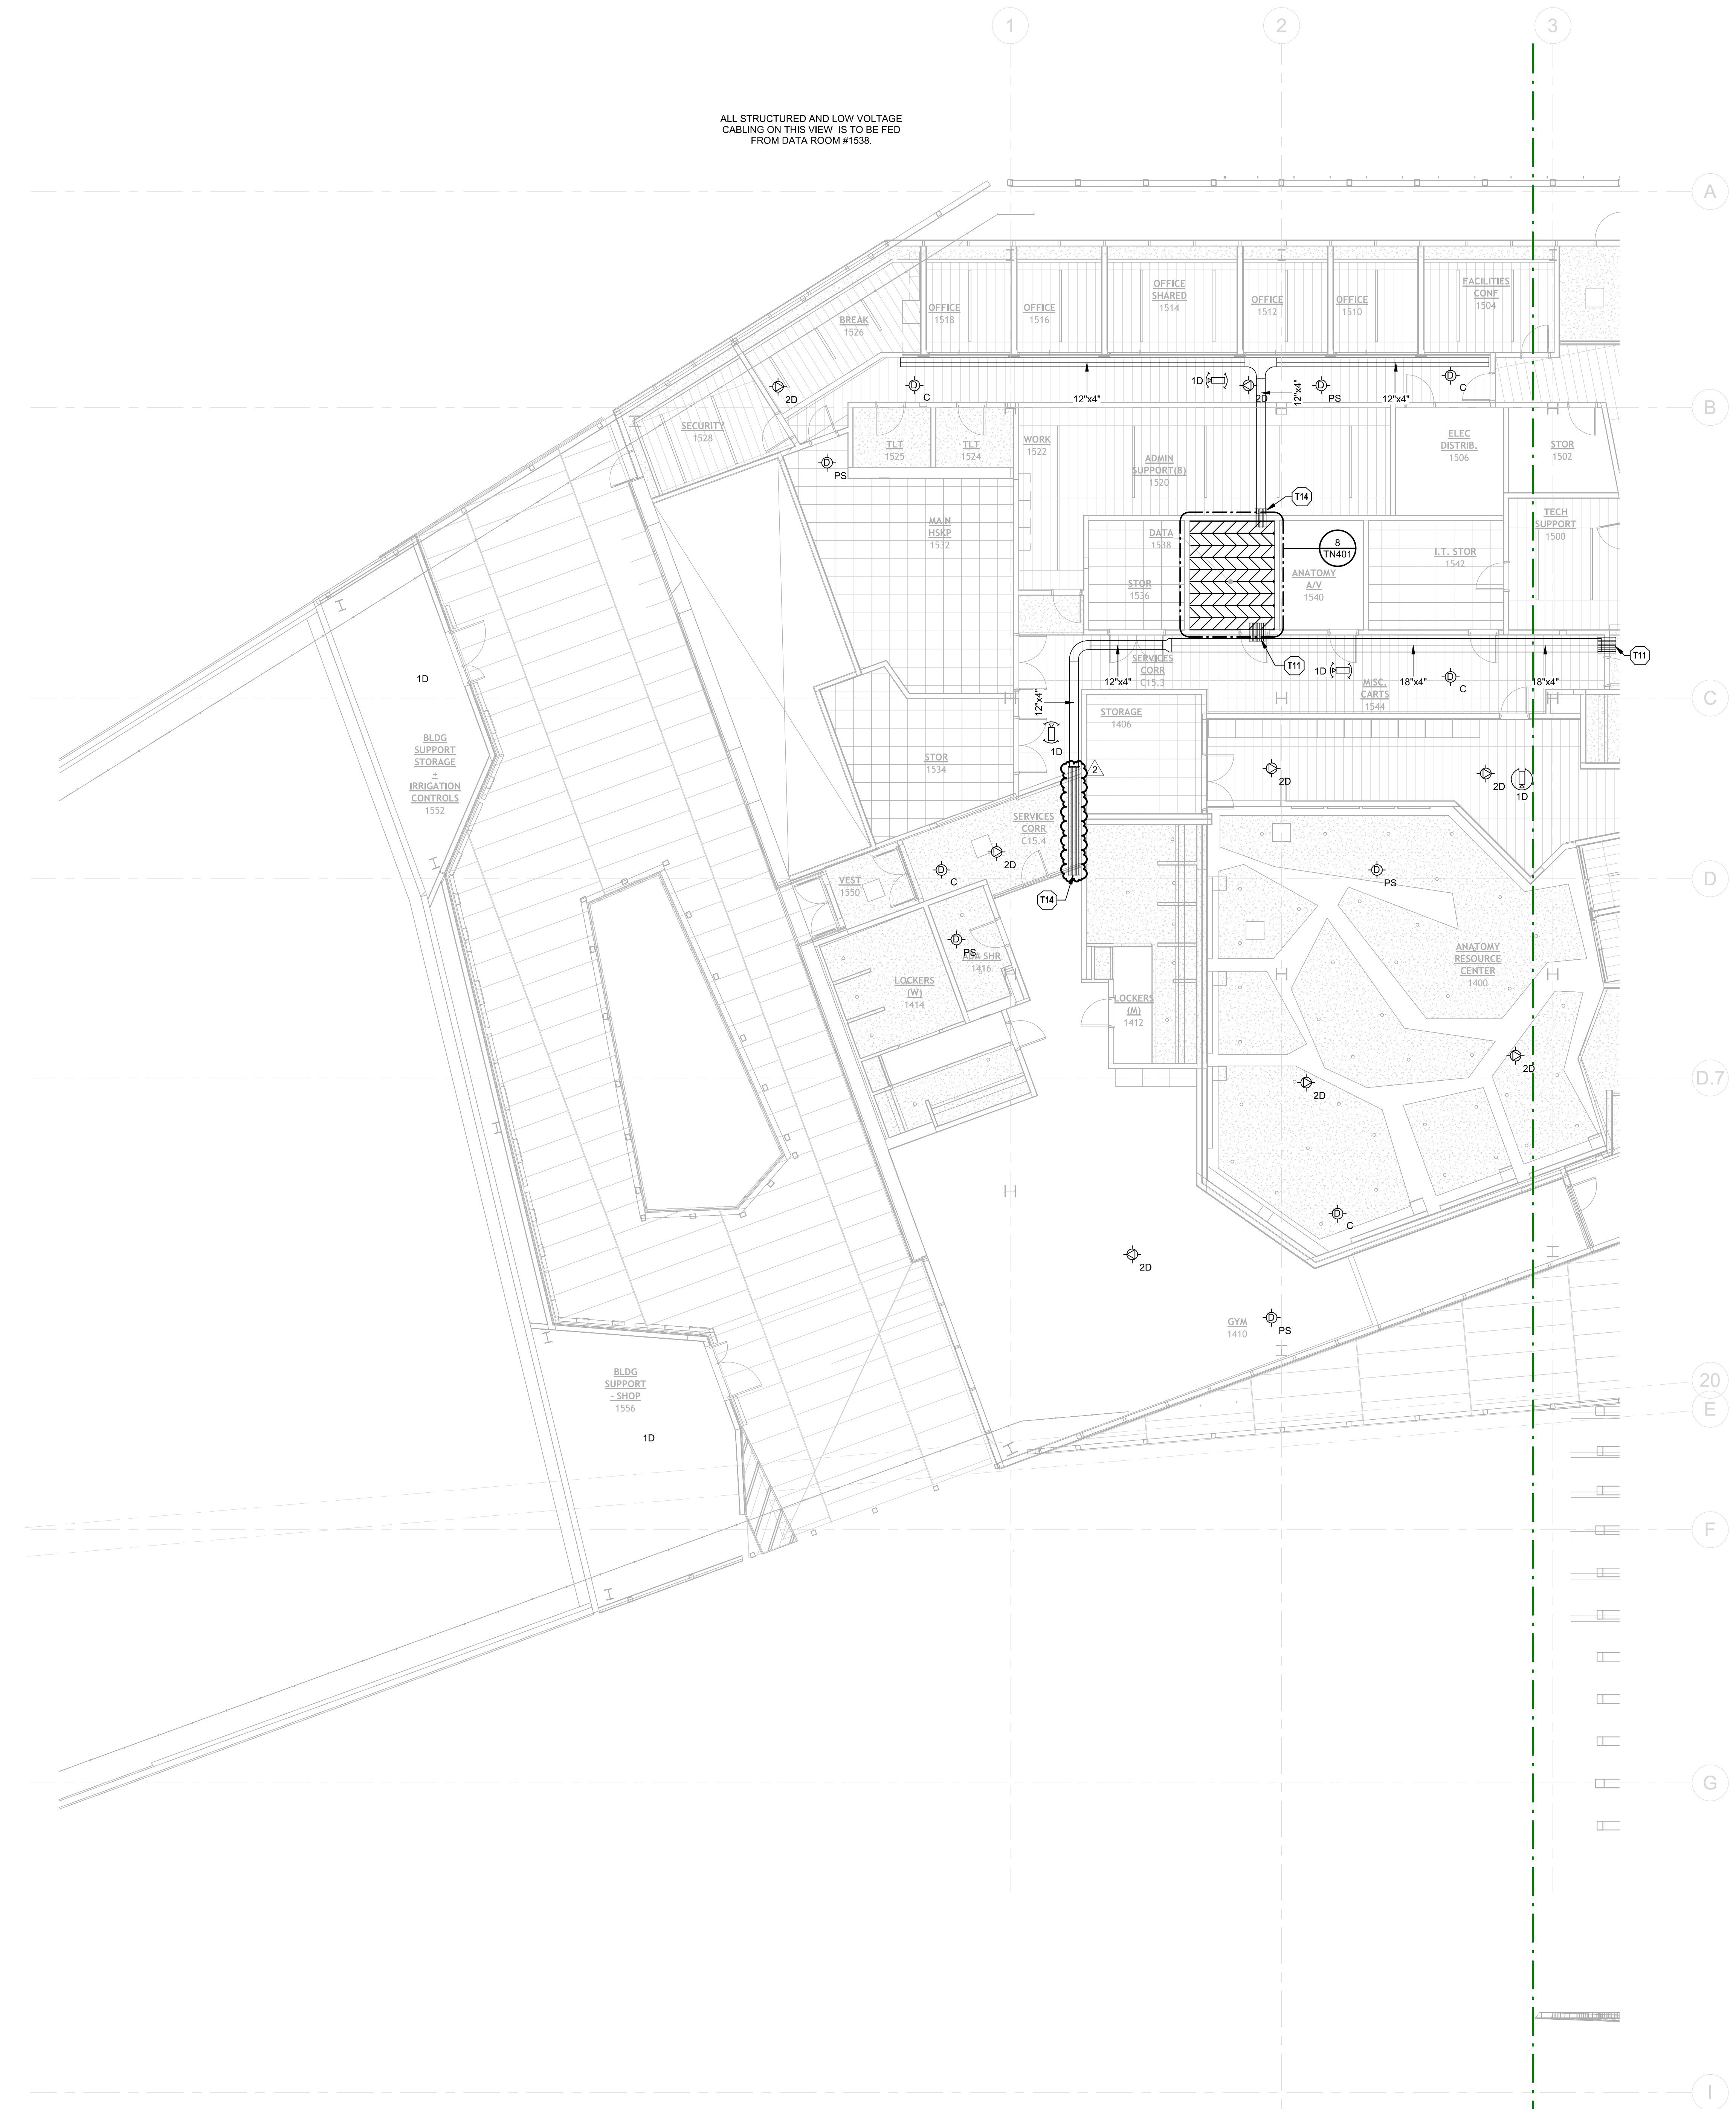


① TECHNOLOGY - LEVEL 1 RCP - AREA B
1/8" = 1'-0"

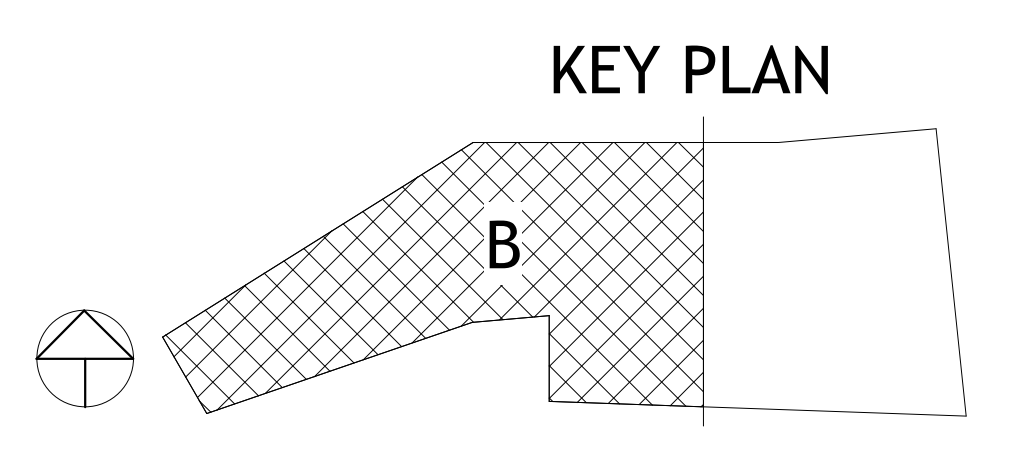

PSW Job Number:
993A

Henderson Job Number:
2150002607

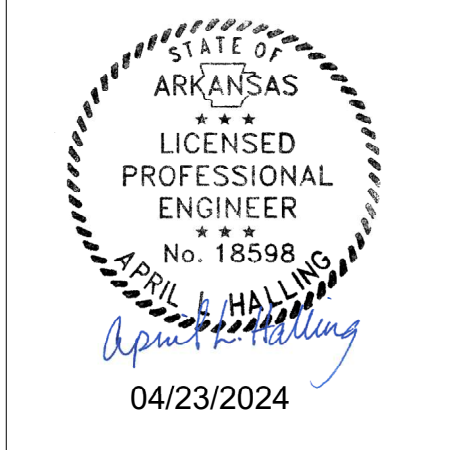

AWSOM
Bentonville, AR


Issue Date:
02.24.2023

REVISIONS		
NUMBER	DATE	DESCRIPTION
1	03.10.23	Addendum 1
2	04.23.24	PR.000

Contents:
**TECHNOLOGY -
LEVEL 1 RCP -
AREA B**

PSW Job Number:
993A

Henderson Job Number:
2150002607

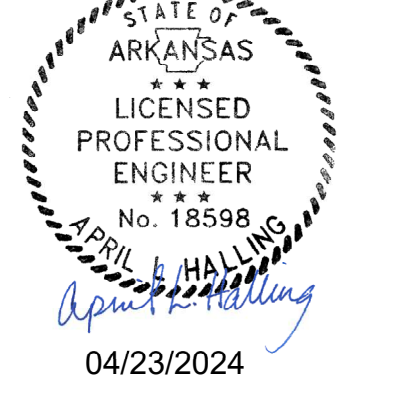

AWSOM
Bentonville, AR

Issue Date:
02.24.2023

REVISIONS		
NUMBER	DATE	DESCRIPTION
1	04.25.24	PR.020

Contents:
**TECHNOLOGY -
LEVEL 3 RCP -
AREA A**

TN203A

TECHNOLOGY PLAN NOTES:

- T11 PROVIDE (4) 4" CONDUIT SLEEVES. PROVIDE UL FIRESTOP SYSTEM ASSEMBLY AS REQUIRED. SEE DIVISION 27 SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- T14 PROVIDE (3) 4" CONDUIT SLEEVES. PROVIDE UL FIRESTOP SYSTEM ASSEMBLY AS REQUIRED. SEE DIVISION 27 SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- T54 PROVIDE ACCESS PANEL AS REQUIRED. SEE DIVISION 27 SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- T55 PROVIDE (3) 4" CONDUITS OVER HARD CEILING. PROVIDE FIRE-STOPPING AS REQUIRED. SEE DIVISION 27 SPECIFICATIONS FOR ADDITIONAL INFORMATION.

ALL STRUCTURED AND LOW VOLTAGE CABLING ON THIS SIDE OF LINE IS TO BE FED FROM DATA ROOM #3504.

ALL STRUCTURED AND LOW VOLTAGE CABLING ON THIS SIDE OF LINE IS TO BE FED FROM DATA ROOM #3316.

TECHNOLOGY - LEVEL 3 RCP - AREA A
1/8" = 1'-0"

KEY PLAN

