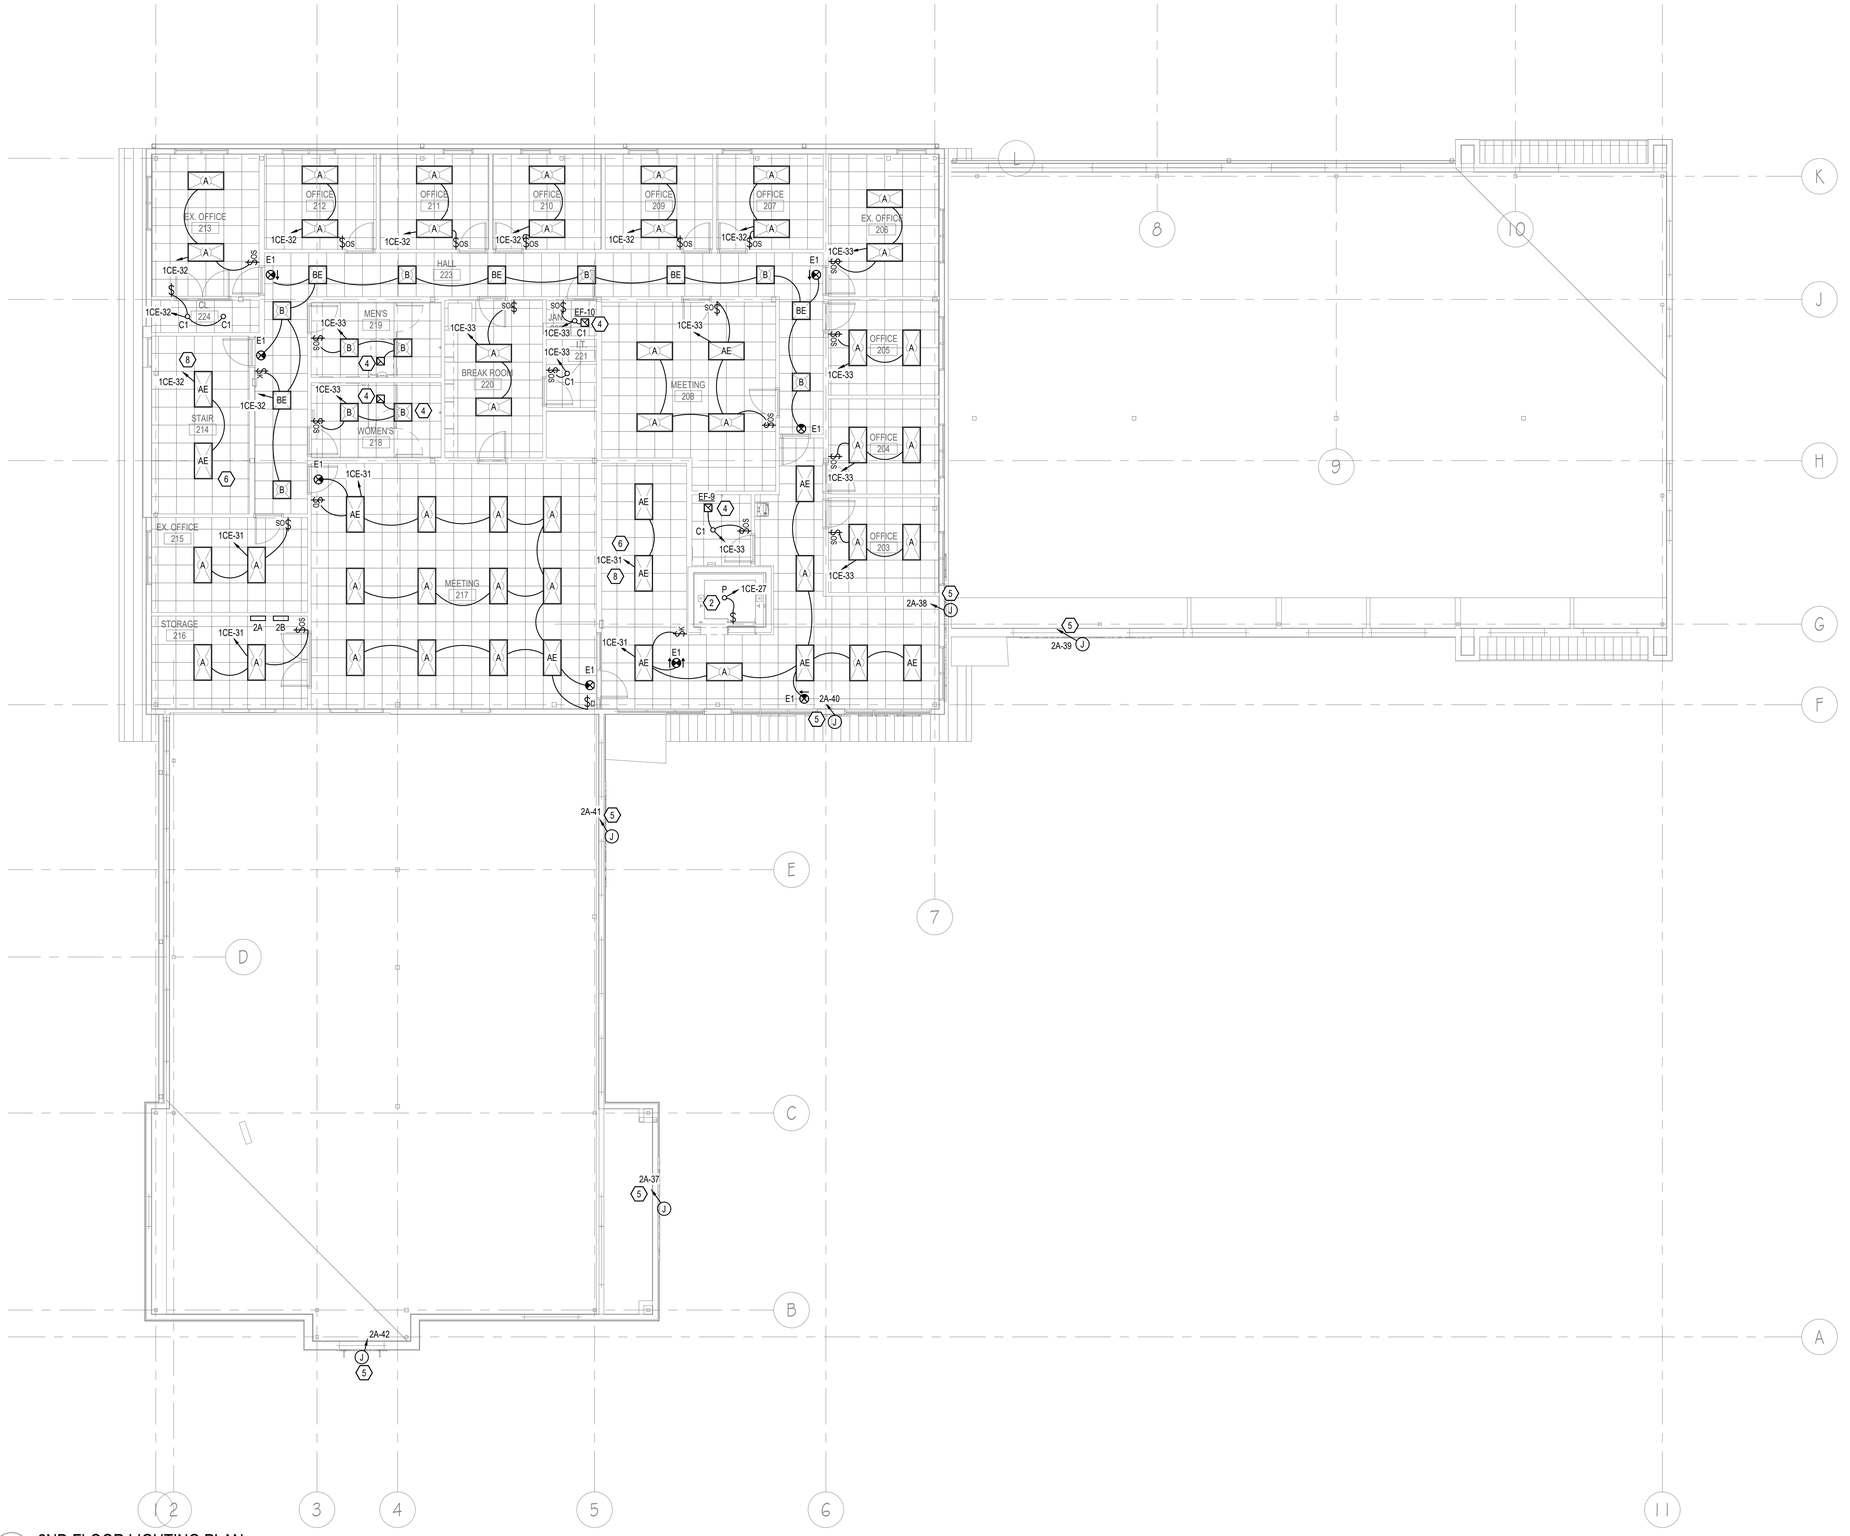

1 2ND FLOOR LIGHTING PLAN
1/8" = 1'-0" RE: 1/M501

KEYED LIGHTING NOTES

1. LOCATE SWITCH FOR ELEVATOR PIT LIGHTING NEAR LADDER
2. INSTALL LIGHT FIXTURE AT TOP OF ELEVATOR SHAFT. LOCATE SWITCH PER ELEVATOR MANUFACTURER REQUIREMENTS.
3. SEE EXTERIOR LIGHTING DETAIL FOR LIGHTING POWER AND CONTROL. LIGHTING SHALL ENERGIZE WITH PHOTOCELL/TIME CLOCK FOR DUSK TO DAWN OPERATION.
4. EXHAUST FAN TO BE ENERGIZED WITH LIGHTING CIRCUIT THIS ROOM. PROVIDE ALL NECESSARY RELAYS AND CONTACTORS. COORDINATE WITH OTHER ROOMS CONNECTED TO SAME EXHAUST FAN. WIRE PER FAN MANUFACTURER RECOMMENDATIONS. RE: HVAC PLANS.
5. JUNCTION BOX MOUNTED BEHIND EXTERIOR BUILDING SIGNAGE. VERIFY EXACT LOCATION, QUANTITY, AND MOUNTING HEIGHTS WITH ARCHITECT AND SIGN CONTRACTOR PRIOR TO ROUGH IN. INSTALL PER SIGN CONTRACTOR REQUIREMENTS. SIGN LIGHTING SHALL BE CONTROLLED WITH EXTERIOR BUILDING LIGHTING.
6. LIGHTING IN STAIRWELL TO MAINTAIN CONSTANT POWER. PROVIDE ALL NECESSARY BATTER PACKS, CONTACTORS, RELAYS, ETC. TO MAINTAIN POWER DURING OUTAGES.
7. LIGHTING CONTROL TO FIXTURES ABOVE. SEE ADDITIONAL LIGHTING PLANS FOR CIRCUIT CONTINUATION.
8. TO LIGHTING CONTROLS BELOW. SEE ADDITIONAL LIGHTING PLANS FOR CIRCUIT CONTINUATION.
9. COORDINATE ALL LIGHTING AND POWER SHIELDING REQUIREMENTS IN X-RAY ROOM WITH MEDICAL EQUIPMENT CONSULTANT.

SEAL
STATE OF ARKANSAS
LICENSED PROFESSIONAL ENGINEER
No. 16934
JEREMY L. TERRELL
06-15-2026

KEY ARCHITECTURE INC.
P.O. BOX 748 FAYETTEVILLE, ARKANSAS 72702
PH: 479.444.6066 FAX: 479.444.1445

FOR PERMIT & CONSTRUCTION

Revision Schedule		
Rev. #	Date	Description

NEW ARcare MEDICAL OFFICE BUILDING
2709 Massard Rd
FT. SMITH, AR 72903

ARcare
117 S. 2ND ST.
AUGUSTA, AR 72006

DATE	DRAWN BY
06-15-2026	CH
PROJECT #	CHECKED BY
2517	JT

SHEET
E103
2ND FLOOR LIGHTING PLAN

TERRELL
ENGINEERING CONSULTANTS
310 W. MAIN ST. SUITE C
RUSSELLVILLE, AR 72801
PHONE (479) 595-8777
WWW.TERRELLENG.COM
AR FIRM # 3434

These Drawings and Specifications are the exclusive property of Key Architecture Inc. and are protected by Copyright. Use or reproduction is prohibited without written consents.

As indicated 6/16/2026 10:39:25 AM Autodesk Docs://26-031 - ARCare Clinic - Fort Smith, AR/ARCc MEP.rvt