


As indicated 6/16/2026 10:38:25 AM Autodesk Docs://26-031 - ARCare Clinic- For Smith, AR/ARCC MEP.rvt

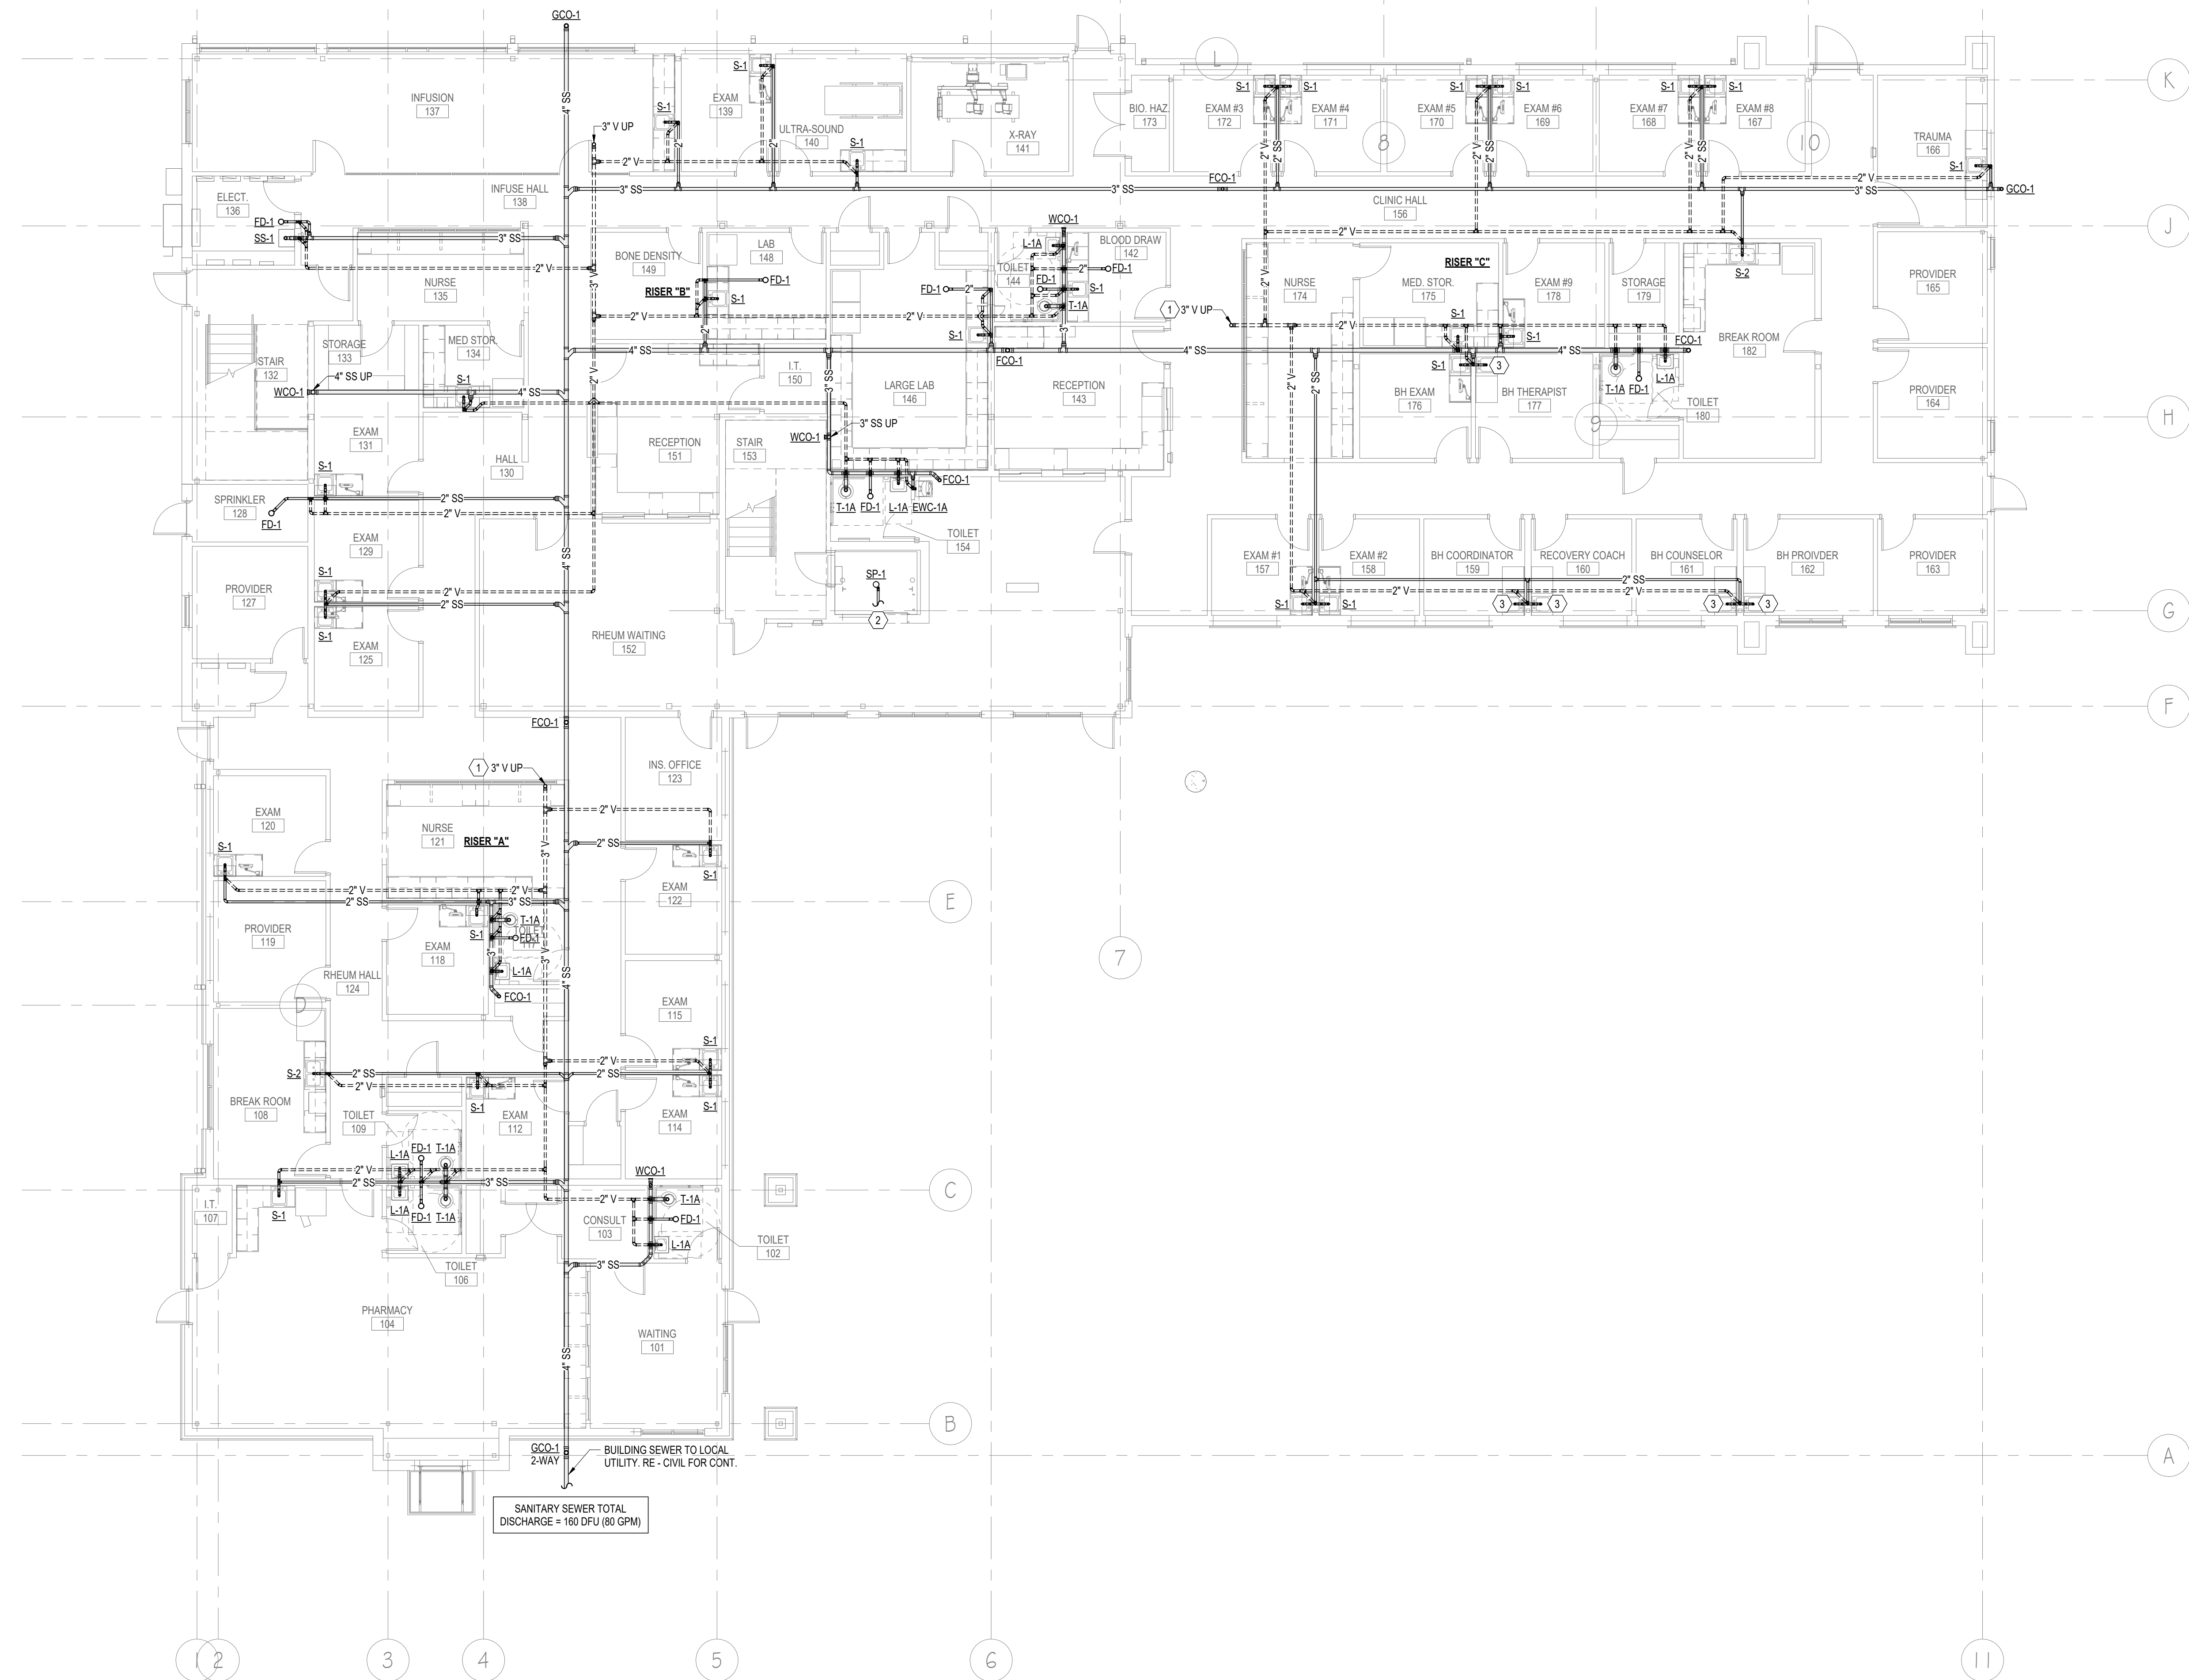

1 1ST FLOOR DWV PLAN
1/8" = 1'-0" RE: 1/M501

KEYED DWV NOTES

- 1 MAINTAIN A MINIMUM 10-FOOT CLEARANCE BETWEEN ALL EXHAUST OUTLETS, FLUES, PLUMBING VENTS AND ANY FRESH AIR INTAKES. IF 10-FOOT CLEARANCE CAN NOT BE MAINTAINED, EXHAUST OUTLET, FLUE, OR VENT MUST TERMINATE AT A POINT AT LEAST 36 INCHES ABOVE HIGHEST FRESH AIR INTAKE WITHIN 10-FOOT LIMIT.
- 2 SUMP PUMP SHALL DISCHARGE AT A LOCATION APPROVED BY THE A.H.J. VERIFY LOCATION PRIOR TO CONSTRUCTION.
- 3 FUTURE SINK ROUGH-IN ONLY. CAP PIPING.

DWV NOTES

1. WHERE PIPING PENETRATES FIRE AND/OR SMOKE BARRIERS, PROVIDE A UL LISTED SLEEVE AND SEAL ASSEMBLY TO MAINTAIN THE RATING INTEGRITY OF THE FIRE AND/OR SMOKE WALL/BARRIER. REFER TO THE ARCHITECTURAL DRAWINGS FOR RATING OF FIRE/SMOKE ASSEMBLIES.
2. PIPING IN EXPOSED PLENUM SPACE SHALL BE FIRE-WRAPPED PVC, OR CAST IRON.

TERRELL
ENGINEERING CONSULTANTS
310 W. MAIN ST. SUITE C
RUSSELLVILLE, AR 72801
PHONE (479) 595-8177
WWW.TERRELLENG.COM
AR FIRM # 3434



KEY ARCHITECTURE INC.
P.O. BOX 748 FAYETTEVILLE, ARKANSAS 72702
PH: 479.444.6066 FAX: 479.444.1445

FOR PERMIT & CONSTRUCTION

Revision Schedule		
Rev. #	Date	
NEW ARcare MEDICAL OFFICE BUILDING 2709 Massard Rd FT. SMITH, AR 72903		
ARcare 117 S. 2ND ST. AUGUSTA, AR 72006		

DATE 06-15-2026	DRAWN BY CO
PROJECT # 2517	CHECKED BY JT
SHEET P101 1ST FLOOR DWV PLAN	
These Drawings and Specifications are the exclusive property of Key Architecture Inc. and are protected by Copyright. Use or reproduction is prohibited without written consent.	