




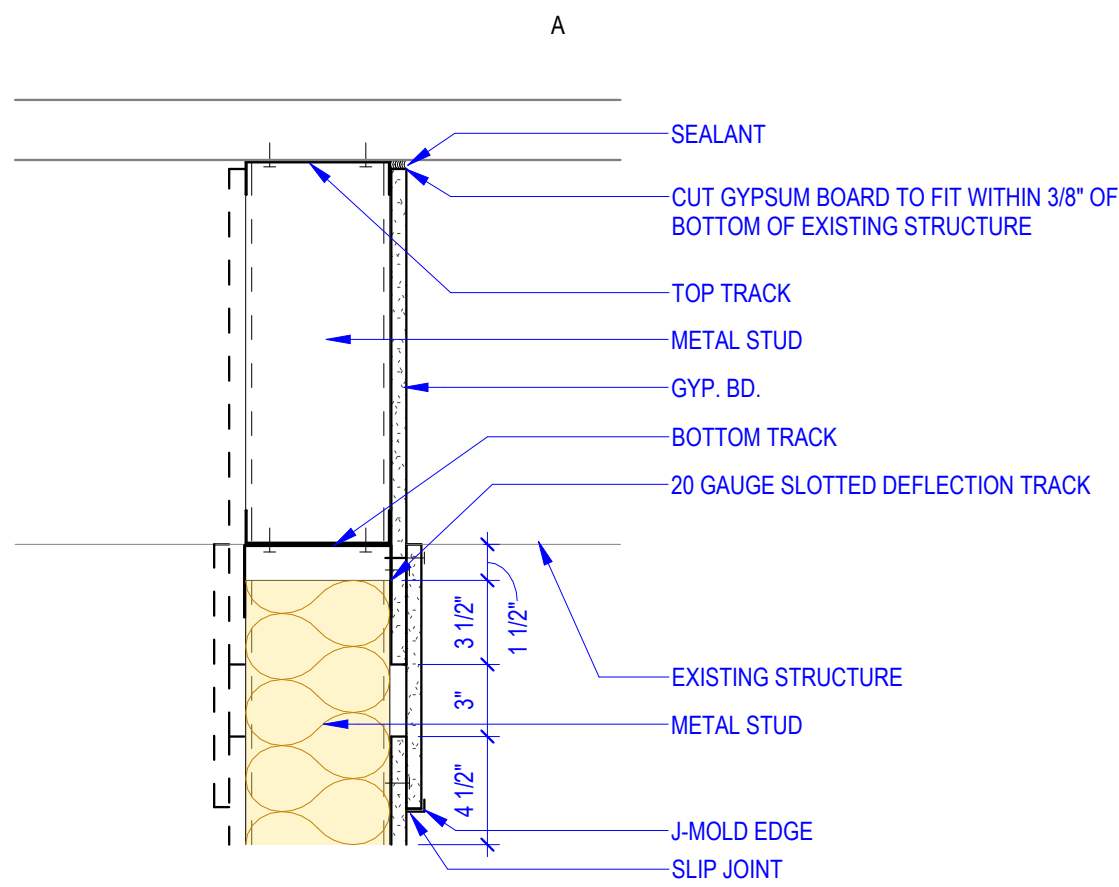


A1 PARTITION ATTACHMENT
1 1/2" = 1'-0" PERPENDICULAR TO STRUCTURE

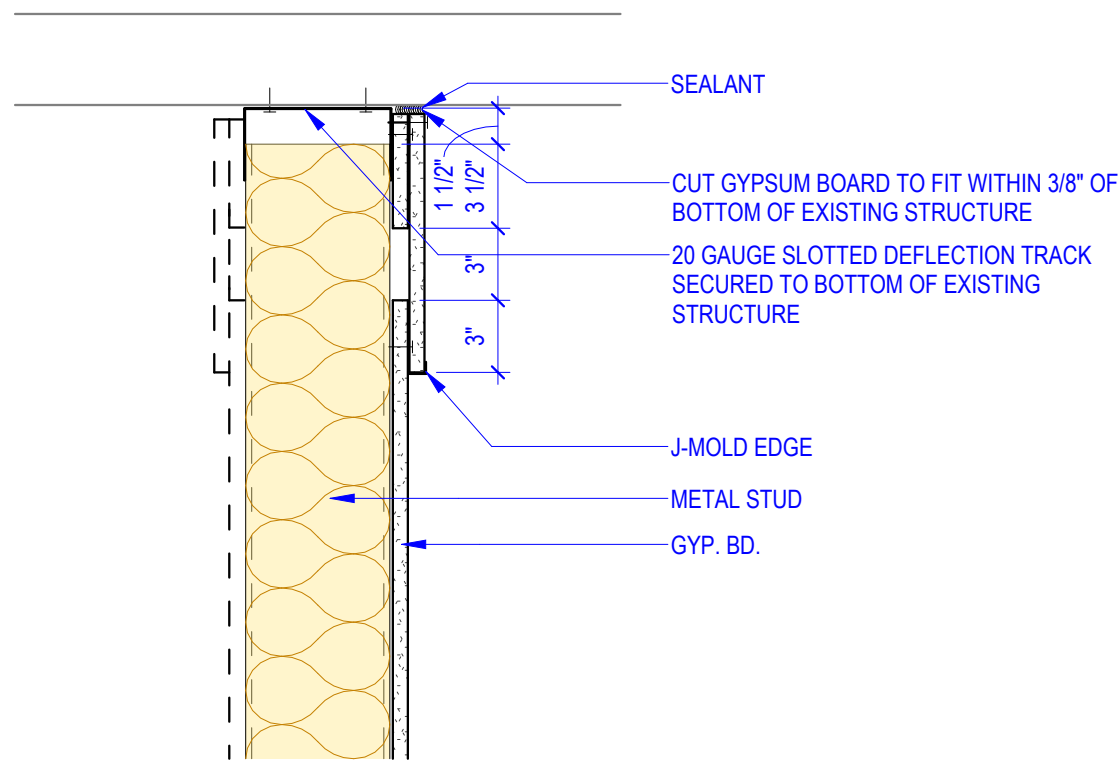

A2 PARTITION ATTACHMENT
1 1/2" = 1'-0" PARALLEL TO STRUCTURE

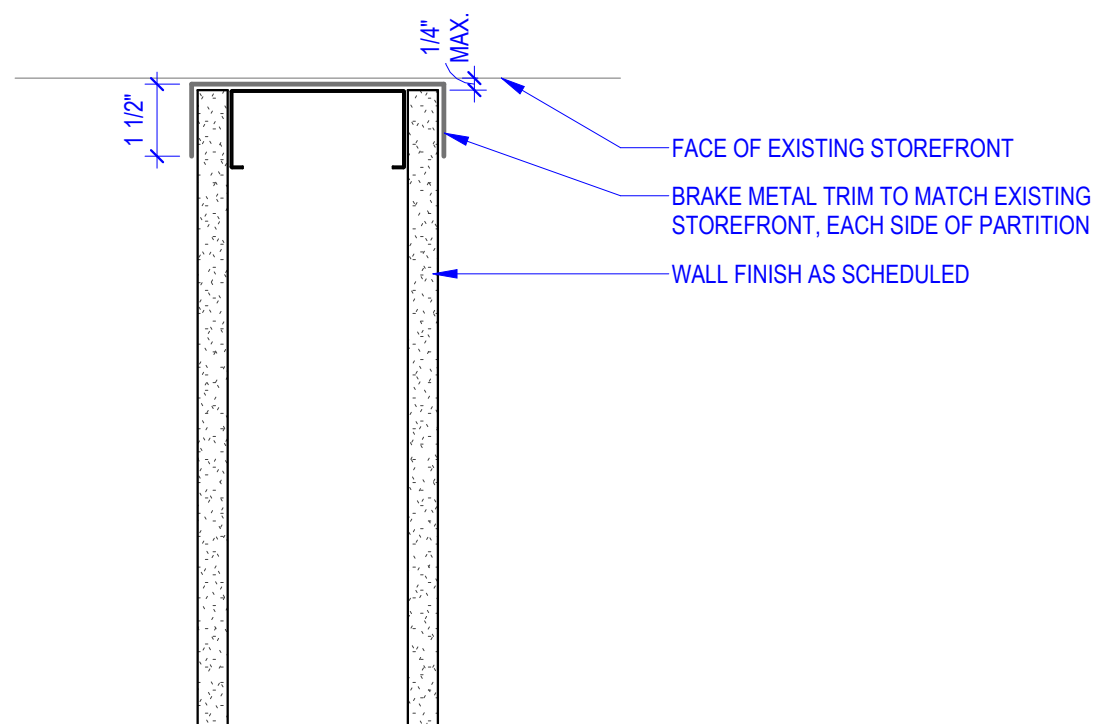


A3 BRAKE METAL WALL END
3" = 1'-0"

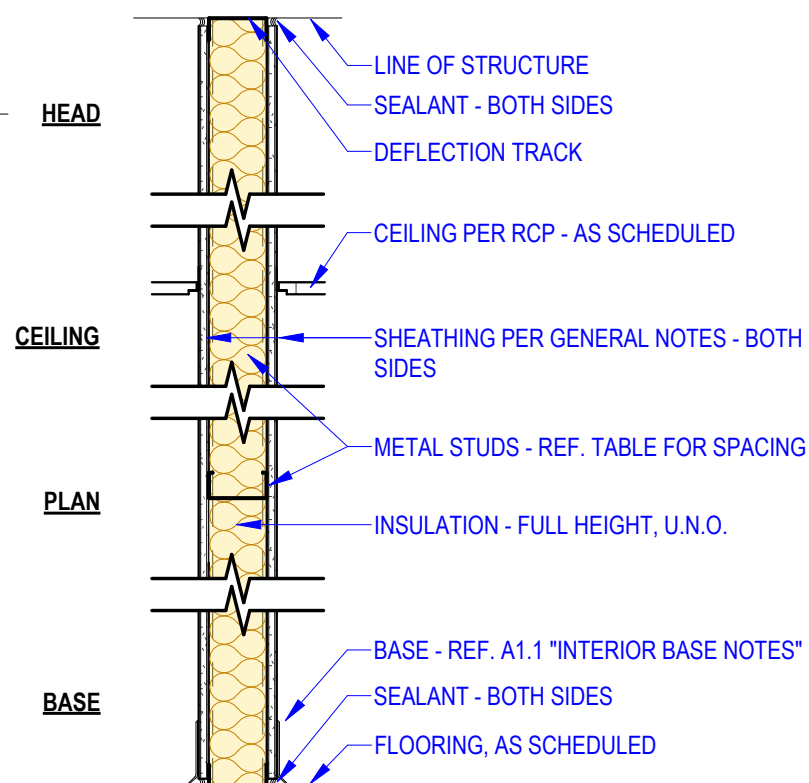


PARTITION TYPE A
GY.P. BOTH SIDES TO DECK

PARTITION SCHEDULE - TYPE A		
TYPE	STUD DEPTH	COMMENTS
A3	3 5/8"	
A6	6"	

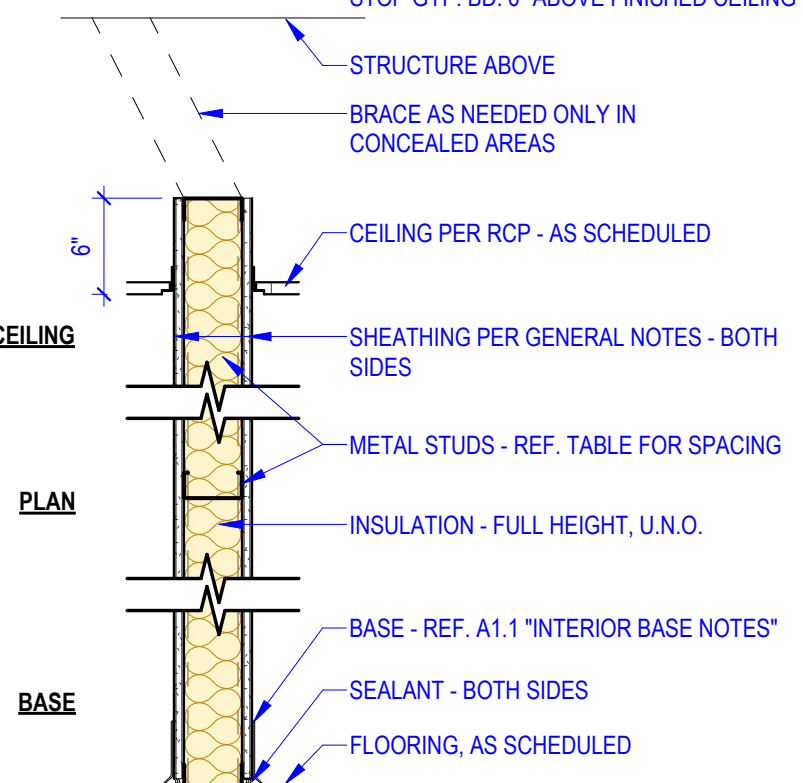


PARTITION TYPE B
GY.P. BOTH SIDES TO ABOVE CEILING

PARTITION SCHEDULE - TYPE B		
TYPE	STUD DEPTH	COMMENTS
B-6	6"	

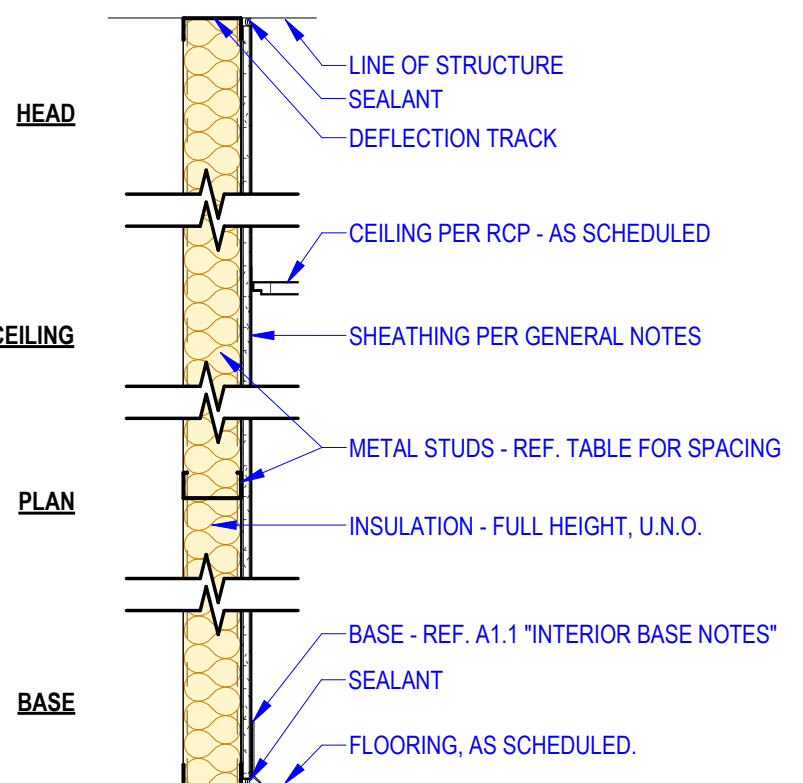


PARTITION TYPE C
GY.P. ONE SIDE TO DECK

PARTITION SCHEDULE - TYPE C		
TYPE	STUD DEPTH	COMMENTS
C3	3 5/8"	

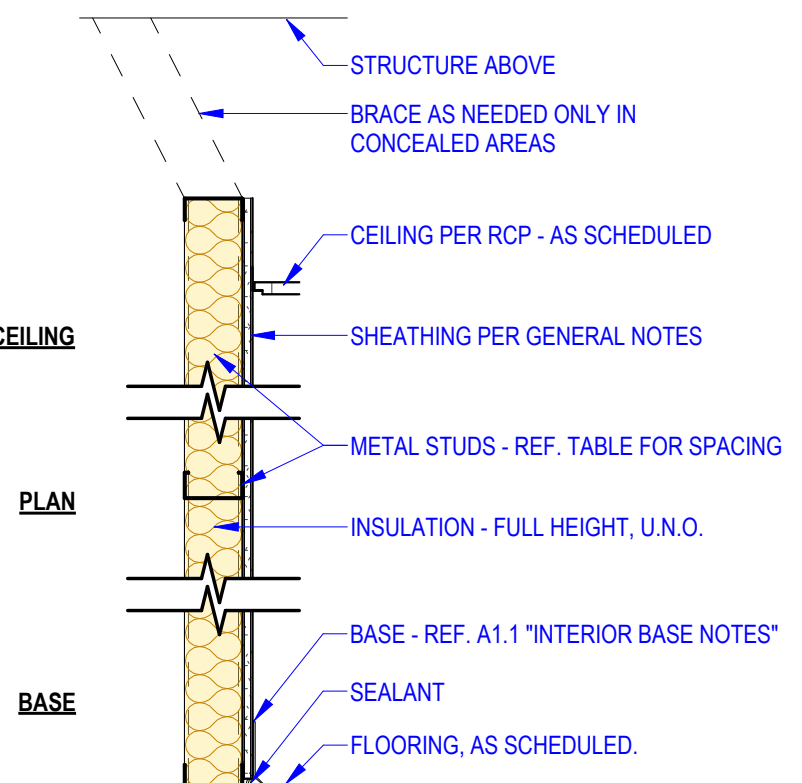


PARTITION TYPE D
GY.P. ONE SIDE TO ABOVE CEILING

PARTITION SCHEDULE - TYPE D		
TYPE	STUD DEPTH	COMMENTS
D2	2 1/2"	

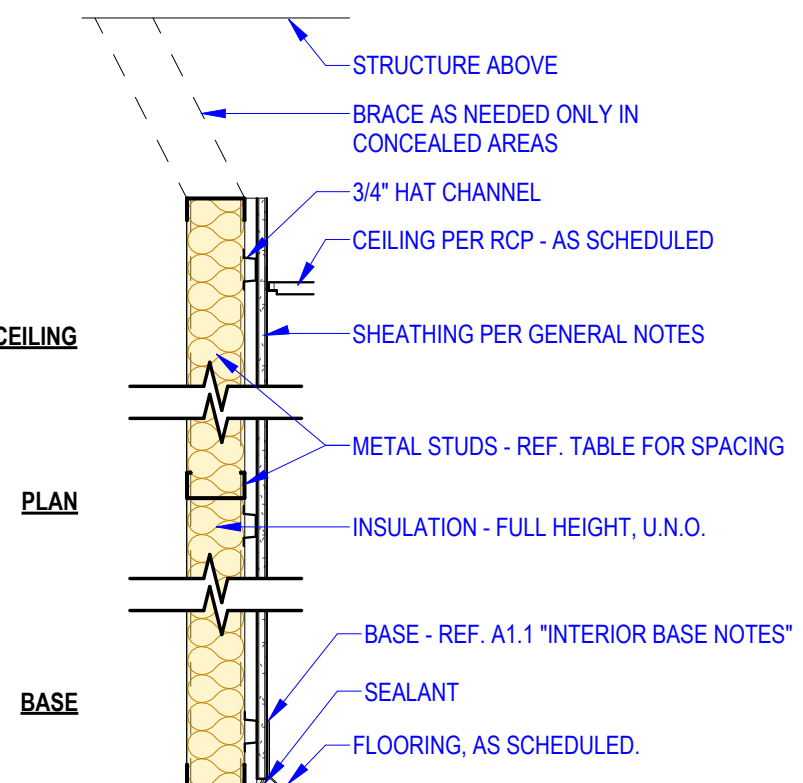


PARTITION TYPE E
HAT CHANNEL AND GYP. ONE SIDE TO ABOVE CEILING

PARTITION SCHEDULE - TYPE E		
TYPE	STUD DEPTH	COMMENTS
E1	3/4"	3/4" HAT CHANNEL

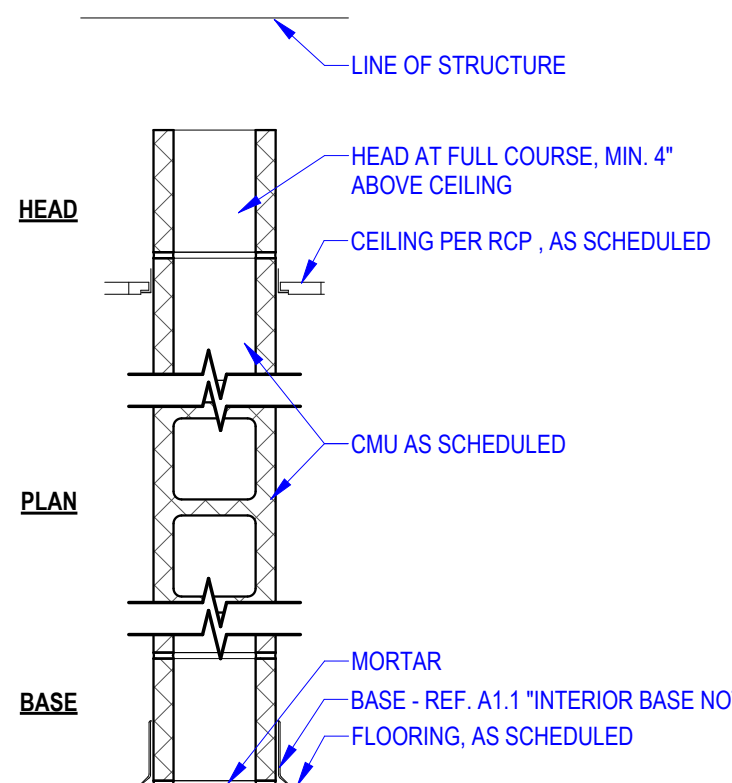


PARTITION TYPE G
NON-STRUCTURAL CMU TO ABOVE CEILING

PARTITION SCHEDULE - TYPE G		
TYPE	STUD DEPTH	COMMENTS
G8	<varies>	

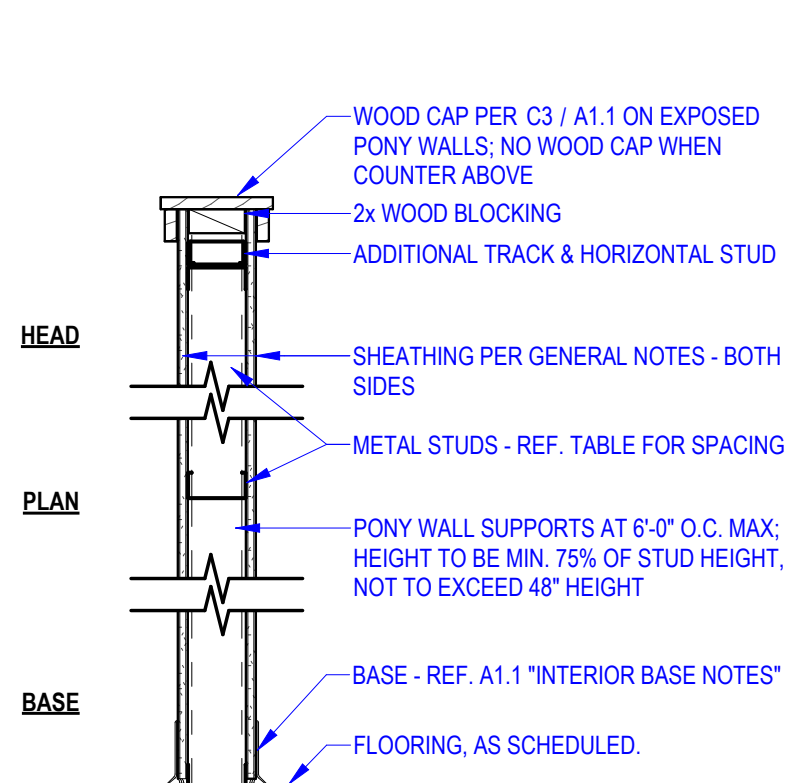


PARTITION TYPE P
GY.P. ONE SIDE


PARTITION SCHEDULE - TYPE P		
TYPE	STUD DEPTH	COMMENTS
P3X	3 5/8"	

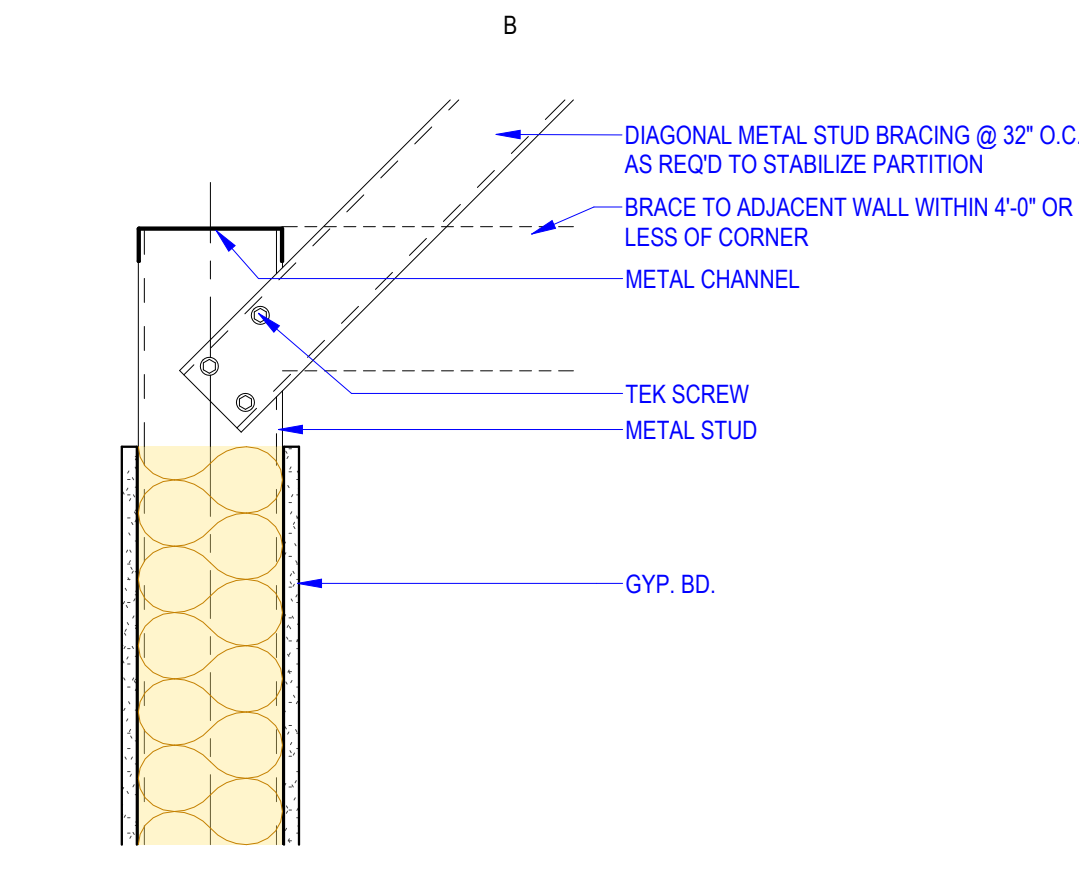


B1 PARTITION BRACING
1 1/2" = 1'-0" SPANS GREATER THAN 4'

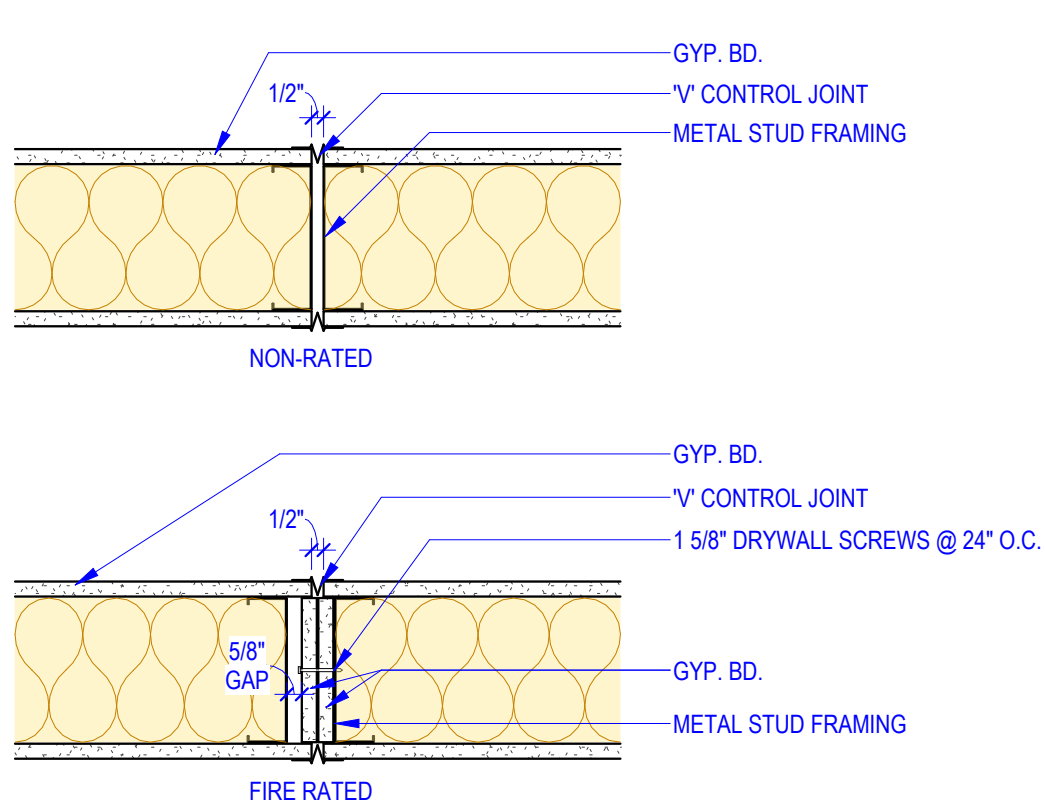


B2 GYP. BOARD CONTROL JOINT
1 1/2" = 1'-0"

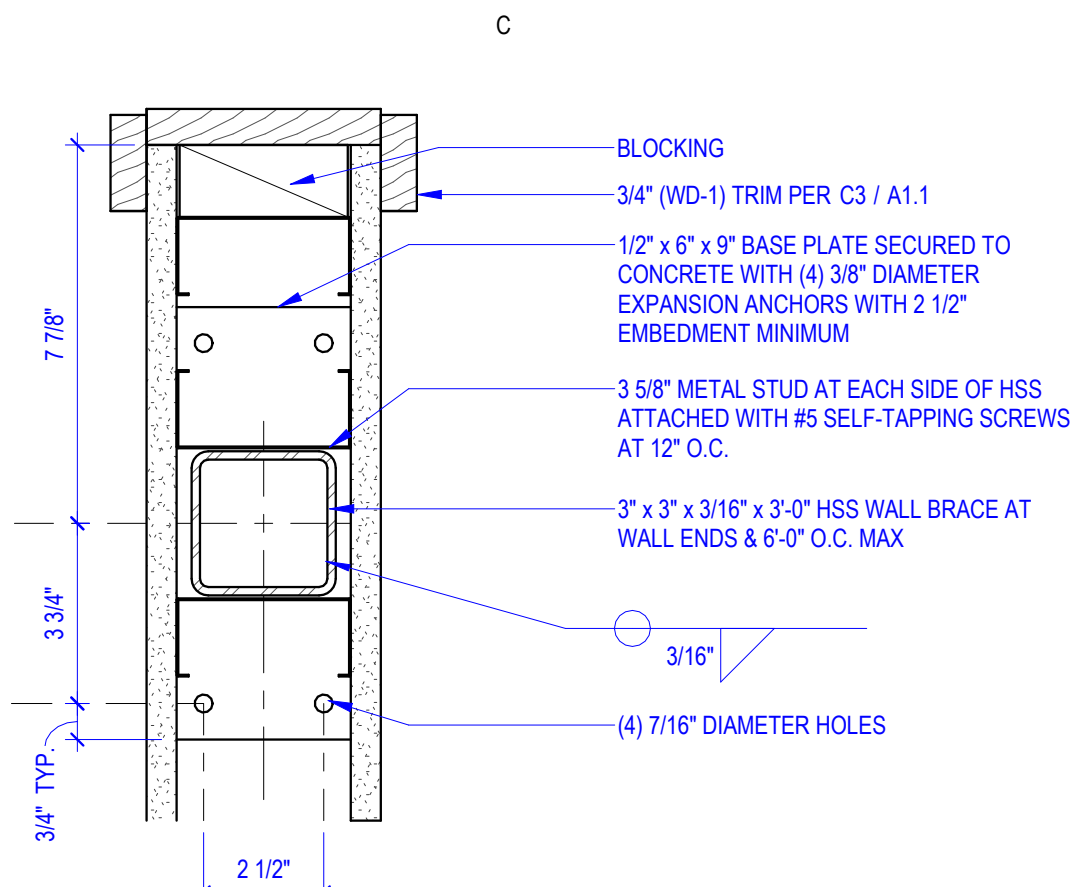


C1 KNEE WALL PLAN
3" = 1'-0"

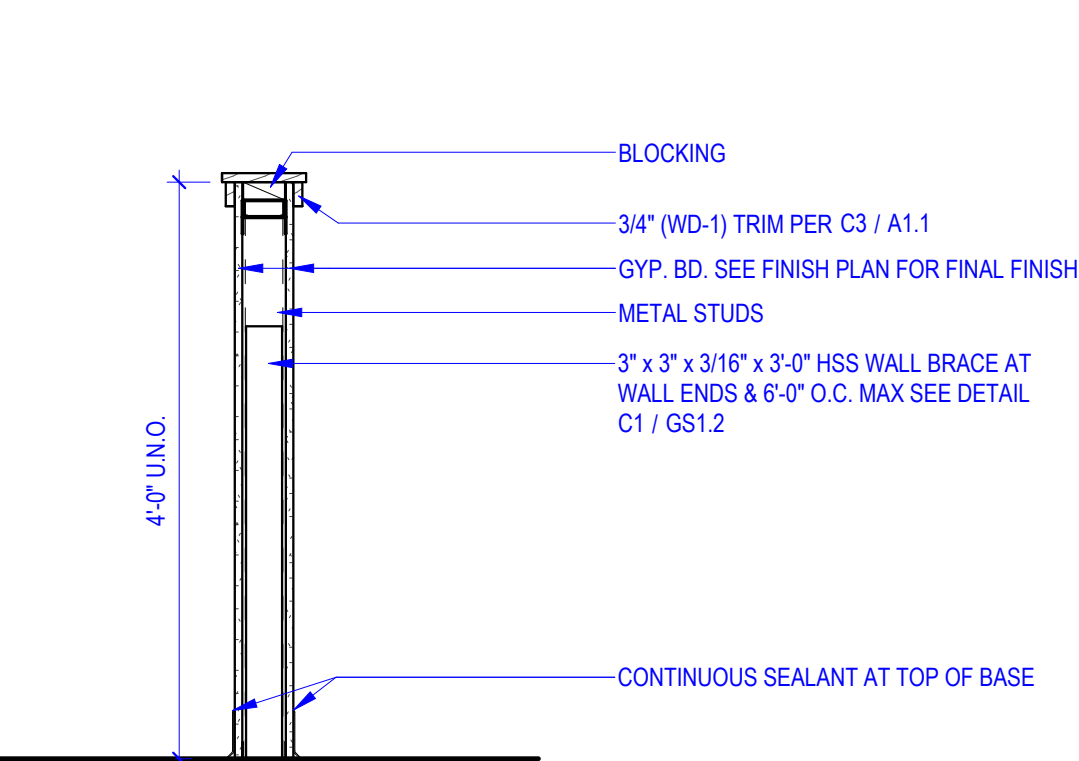

C2 KNEE WALL SECTION
3/4" = 1'-0"

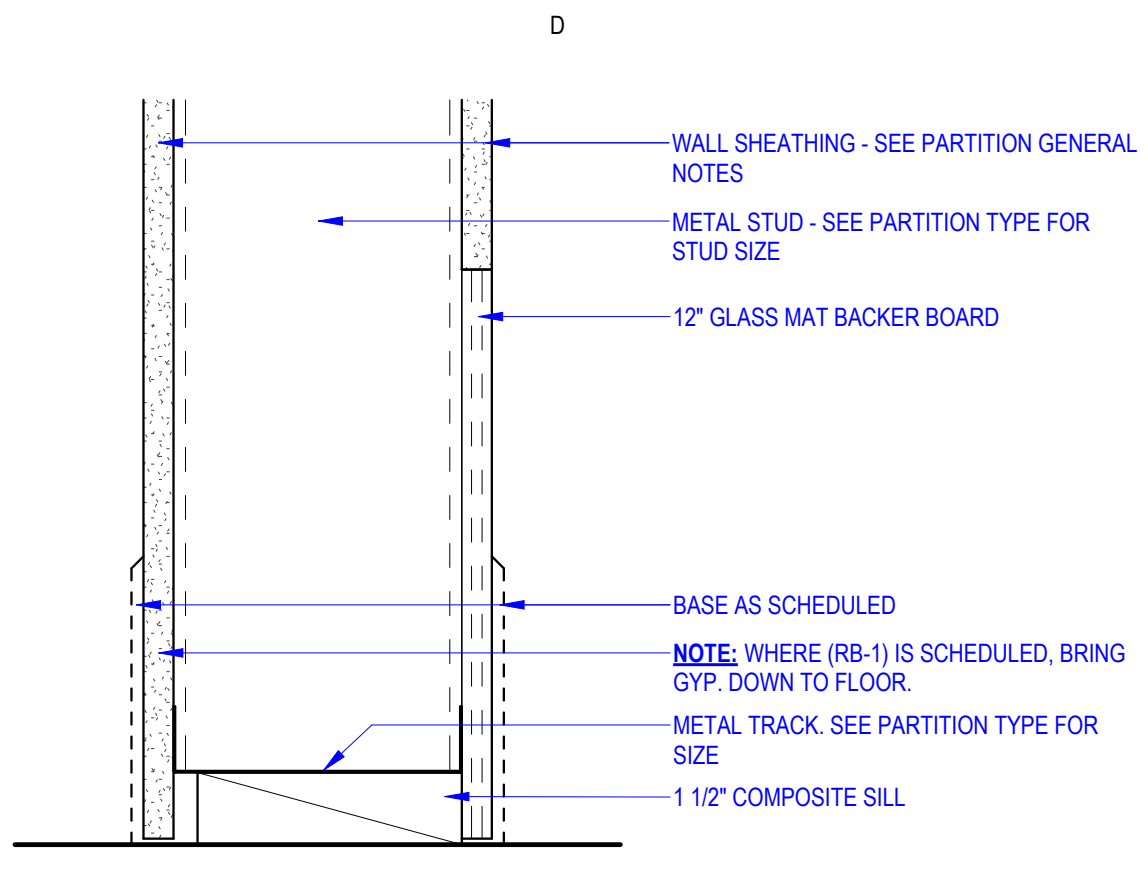

D1 COMPOSITE SILL
3" = 1'-0"

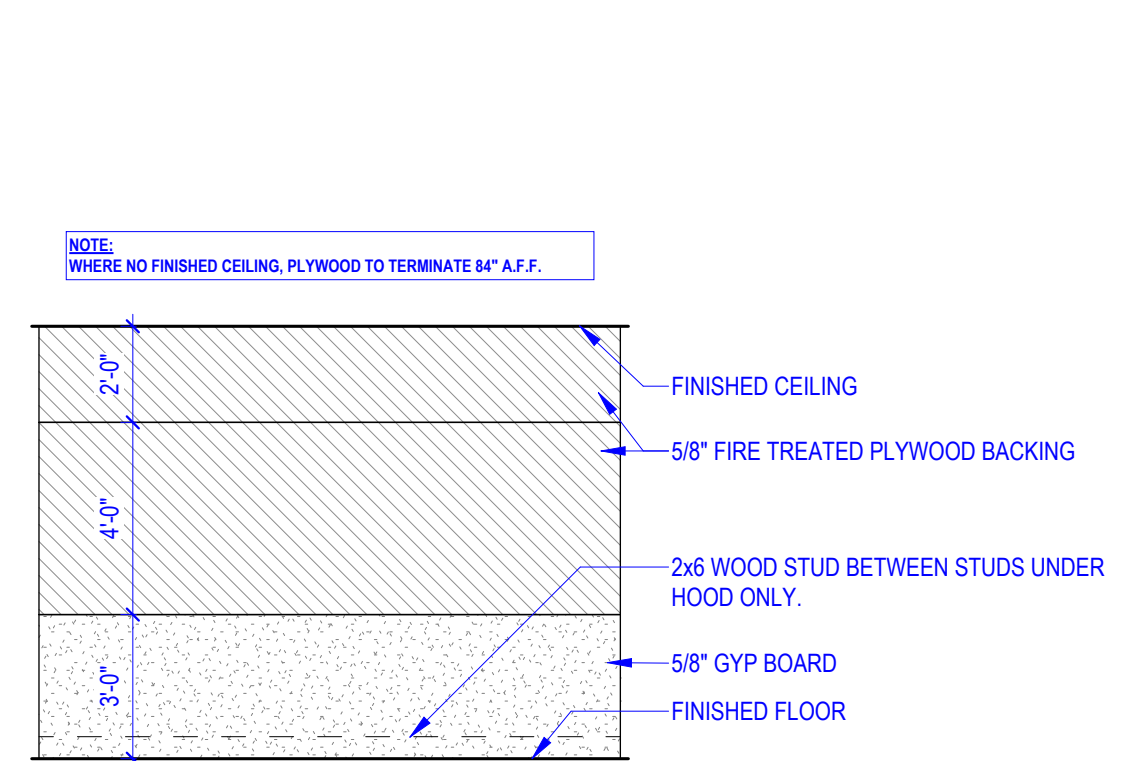

D2 BACKING ELEVATION
1/4" = 1'-0"


INTERIOR NON-LOAD BEARING PARTITION HEADERS			
HEADER LENGTH	HEADER MEMBERS	HEADER TRACKS	JAMB STUDS
UP TO 4'-0"	(2) C3-5/8 x 1-1/4" x 20 GA	(2) C3-5/8 x 20 GA	(2) C3-5/8 x 1-1/4" x 20 GA
UP TO 10'-0"	(2) C6 x 1-5/8" x 18 GA	(2) C6 x 18 GA	(2) C6 x 1-5/8" x 18 GA
OVER 10'-0" & UP TO 14'-0"	(2) C8 x 1-5/8" x 18 GA	(2) C6 x 18 GA	(2) C6 x 1-5/8" x 18 GA
OVER 14'-0" & UP TO 18'-0"	(2) C8 x 1-5/8" x 16 GA	(2) C6 x 16 GA	(2) C6 x 1-5/8" x 16 GA
OVER 18'-0" & UP TO 20'-0"	(2) C10 x 1-5/8" x 16 GA	(2) C6 x 16 GA	(2) C6 x 1-5/8" x 16 GA
OVER 20'-0" & UP TO 24'-0"	(2) C12 x 1-5/8" x 16 GA	(2) C6 x 16 GA	(2) C6 x 1-5/8" x 16 GA

NOTES:
1. MAX WALL HEIGHT ABOVE HEADER ASSEMBLY IS 14'-9".
2. SPLICING OF HEADER AND JAMB MEMBERS IS NOT PERMITTED.
3. MAX SPAN FOR OPENINGS TO RECEIVE INFILL BELOW THE HEADER IS 19'-0".
4. JAMBS NOT TO DECK ARE TO BE BRACED IN ACCORDANCE WITH THE PARTITION BRACING DETAILS. 3-5/8" JAMBS BEYOND 13'-4" ARE TO BE BRACED ABOVE THE OPENING AND SUCH THAT THE MAXIMUM UNBRACED LENGTH IS NOT EXCEEDED.
5. FRAMING MEMBERS ARE NOT SIZED FOR VERTICAL LOAD OTHER THAN THAT OF THE PORTION OF WALL ABOVE THE OPENING.

INTERIOR NON-LOAD BEARING PARTITIONS (BOTH FLANGES SUPPORTED)			
SIZE (IN.)	GAUGE	STUD SPACING (IN.)	
		12	16
3 5/8"	25	15'-10"	13'-8"
3 5/8"	20	20'-11"	19'-0"
3 5/8"	18	-	23'-0"
6"	20	31'-8"	28'-10"

NO PUNCHOUTS OR HOLES DRILLED WITH 12" OF STUD ENDS. TRACK GAUGE SAME AS STUD WITH 1" TRACK LEG HEIGHT.

PARTITION TYPE LEGEND

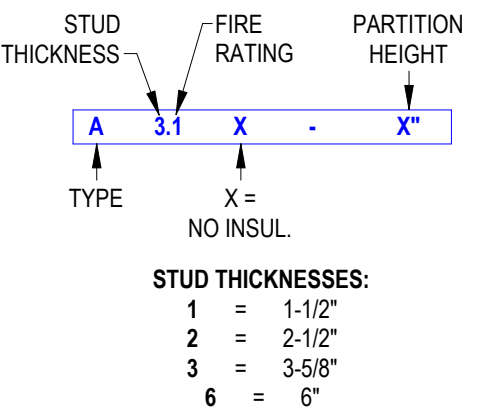

EXAMPLE: D3X-132" = TYPE D PARTITION, 3-5/8" STUDS, NO INSULATION, TOP OF PARTITION @ 132" FROM FINISH FLOOR.

GENERAL NOTES - PARTITIONS

- REFER TO PARTITION TYPE LEGEND FOR HOW TO READ PARTITION TAGS ON PLAN.
- ALL PARTITIONS OF PARTITION TYPES "ABOVE CEILING" TO BE 6" ABOVE CEILING UNLESS INDICATED OTHERWISE IN PARTITION TAG.
- TOP SLIP TRACKS - WHERE REQUIRED - TO MATCH STUD SIZE, GAUGE, & FINISH WITH 3" DEEP SLOTTED LEG WITH SLIP FASTENERS.
- PROVIDE DOUBLE JAMB STUDS AT ALL DOOR JAMBS PER STANDARD DETAIL.
- NO EXPOSED STUD BRACING TO STRUCTURE FOR UNSUPPORTED WALLS. REFER TO PARTITION TYPES AND INTERIOR SECTIONS AND DETAILS FOR HOW TO PROVIDE SUFFICIENT RIGIDITY. UPON INSTALLATION, IF ADDITIONAL BRACING OR SUPPORT IS REQUIRED, COORDINATE SOLUTION WITH ARCHITECT.
- REFER TO INTERIOR DETAILS FOR FINISHED PARTITION CAPS.
- ALL EXTERIOR ENVELOPE WALLS TO BE FULLY INSULATED WITH UNFACED BATT INSULATION WITH CONTINUOUS FSK VAPOR BARRIER SEALED AT ALL ENDS, LAPS AND PENETRATIONS.
- ALL EXTERIOR FURRING AT NON-INSULATED CMU OR CONCRETE WALLS TO RECEIVE CLOSED CELL POLYURETHANE SPRAY FOAM INSULATION CONTINUOUS FROM SLAB TO ROOF DECK, R-15 MIN.
- INTERIOR SOUND BATT INSULATION TO BE 3-1/2" THICK OR 6-1/4" THICK, KNAUF, CERTAINTED, OR EQUAL.
- BLOCKING TO BE PROVIDED BEHIND ALL WALL-HUNG MILLWORK, WALL-HUNG PLUMBING FIXTURES WHERE A FLOOR-MOUNTED CARRIER IS NOT PROVIDED, ALL COUNTERTOPS REQUIRING BRACKET SUPPORT (CONCEALED OR EXPOSED), WALL-MOUNTED GRAB BARS AND HANDRAILS, WALL-HUNG SHELVING INCLUDING OWNER-PROVIDED SHELVING INDICATED ON DRAWINGS, WALL-HUNG OR WALL-MOUNTED EQUIPMENT WEIGHING MORE THAN 15 POUNDS INCLUDING OWNER-PROVIDED EQUIPMENT INDICATED ON DRAWINGS, HOSE REELS AND BIBS, AND WALL-MOUNTED SIGNAGE WEIGHING MORE THAN 10 POUNDS INCLUDING OWNER-PROVIDED SIGNAGE OR SIGNAGE LOCATIONS INDICATED ON DRAWINGS.
- ALL BLOCKING, ROOF CURBS, NAILERS, ETC. SHALL BE DIMENSIONAL LUMBER OR PLYWOOD. ALL EXTERIOR DIMENSIONAL LUMBER SUBJECT TO HEAVY MOISTURE OR OTHER DETERIORATING FACTORS SHALL BE PRESSURE TREATED. FIRE RETARDANT LUMBER TO BE USED AS REQUIRED BY CODE AND INDICATED PER DETAILS. INSTALLATIONS AND USAGE SHALL MEET THE REQUIREMENTS OF THE TIMBER PRODUCTS ASSOCIATION. INCORPORATE INTO THE WORK ONLY LUMBER THAT IS STRAIGHT AND TRUE AND MEETS CONSTRUCTION STANDARDS.
- AT ALL SOUND-INSULATED PARTITIONS, ALL ELECTRICAL FIXTURES REQUIRING BACK BOXES (SWITCHES, RECEPTACLES, DATA LOCATIONS, ETC.) ARE TO BE STAGGERED OR SEPARATED BY STUD CAVITY TO REDUCE SOUND TRANSFER WHERE FIXTURES OCCUR ON OPPOSITE SIDES OF THE PARTITION.
- ALL BACK BOXES TO BE FULLY SECURED BETWEEN TWO STUDS ON A MOUNTING BRACKET OR STRAP.
- REF. INTERIOR MATERIAL SCHEDULE FOR PAINT COLORS WHERE LEVEL 5 FINISH IS REQUIRED. REF. INTERIOR MATERIAL SCHEDULE AND SPECIFICATIONS FOR PRIMER AND PAINT PRODUCTS. REF. DEMO PLANS FOR WHERE SKIM COATING MAY BE REQUIRED TO REPAIR EXISTING WALL CONDITIONS TO MAKE SUITABLE FOR NEW PAINT.
- ALL INTERIOR PARTITION SHEATHING TO BE 5/8" TYPE 'X' GYP. EXCLUDING THE FOLLOWING CONDITIONS:
 - PROVIDE 5/8" MOISTURE RESISTANT TYPE 'X' GYPSUM BOARD ON WET WALLS AND CEILINGS AND WITHIN 3' OF PLUMBING FIXTURES U.N.O.
 - PROVIDE 5/8" CEMENTITIOUS BACKER BOARD WHERE TILE FINISH IS INDICATED AT WET LOCATIONS (SHOWERS, ETC.).
 - PROVIDE 5/8" MOISTURE RESISTANT TYPE 'X' TILE BACKER BOARD WHERE TILE FINISH IS INDICATED AT DRY LOCATIONS. REF. WALL FINISH PLAN AND INTERIOR ELEVATIONS FOR TILE LOCATIONS.
 - REFER TO FINISH PLANS, INTERIOR ELEVATIONS, AND DETAILS FOR WHERE GYP. BOARD IS TO BE SUBSTITUTED WITH PLYWOOD OR SIMILAR BEHIND WAINSCOTING.