

GENERAL NOTES:

- COORDINATE ALL DUCTWORK AND PIPING PENETRATIONS THROUGH BUILDING WALLS AND ROOF WITH THE BUILDING MANUFACTURER. ALL PENETRATIONS SHALL BE IN ACCORDANCE TO MANUFACTURER'S RECOMMENDATIONS.
- ALL EXPOSED SUPPLY DUCTWORK SHALL BE DOUBLE-WALL.

KEYNOTES:

- 18"x18" RECTANGULAR SUPPLY DUCT UP TO LEVEL ABOVE.
- 10"x6" RECTANGULAR SUPPLY DUCT UP TO LEVEL ABOVE.
- 12"x12" RECTANGULAR SUPPLY DUCT UP TO LEVEL ABOVE.
- 12"x14" RECTANGULAR RETURN DUCT UP TO LEVEL ABOVE.
- 16"x16" RECTANGULAR RETURN DUCT UP TO LEVEL ABOVE.
- 14"x12" RECTANGULAR RETURN DUCT UP TO LEVEL ABOVE.
- 18"x16" RECTANGULAR RETURN DUCT UP TO LEVEL ABOVE.
- 8"x12" RECTANGULAR RETURN DUCT UP TO LEVEL ABOVE.
- 16"x16" RECTANGULAR SUPPLY DUCT UP TO LEVEL ABOVE.
- 10"x12" RECTANGULAR SUPPLY DUCT UP TO LEVEL ABOVE.
- DIFFUSER SHALL HAVE A 1-FOOT (1'-0") SECTION BLANK OFF.
- DIFFUSER SHALL HAVE A 2-FOOT (2'-0") SECTION BLANK OFF.
- DIFFUSER SHALL BE BLANKED OFF.
- 8" ROUND EXHAUST DUCT WITH WALL CAP.
- DUCT DOWN TO LEVEL BELOW.
- MOTORIZED CONTROL DAMPERS, SET PER AIRFLOW SHOWN ON FURNACE SCHEDULE.
- REFRIGERANT PIPING UP TO FLOOR ABOVE.
- CONDENSATE PIPING UP TO FLOOR ABOVE.
- REFRIGERANT PIPING DOWN TO FLOOR BELOW.
- CONDENSATE PIPING DOWN TO FLOOR BELOW.
- UNDERCUT DOOR FOR JANITOR'S CLOSET.
- ROUTE COMBUSTION AND EXHAUST PIPING TO SOUTH SIDE OF ROOF WITH CONCENTRIC VENT.


PRIGM
ENGINEERING

310 W. DICKSON ST., SUITE 210
FAYETTEVILLE, AR 72701
479.877.3188 | WWW.PRIGM.COM
#25078




05/08/2026


DEMx
ARCHITECTURE
104 N EAST AVENUE
FAYETTEVILLE, ARKANSAS 72701 | 479.966.4871

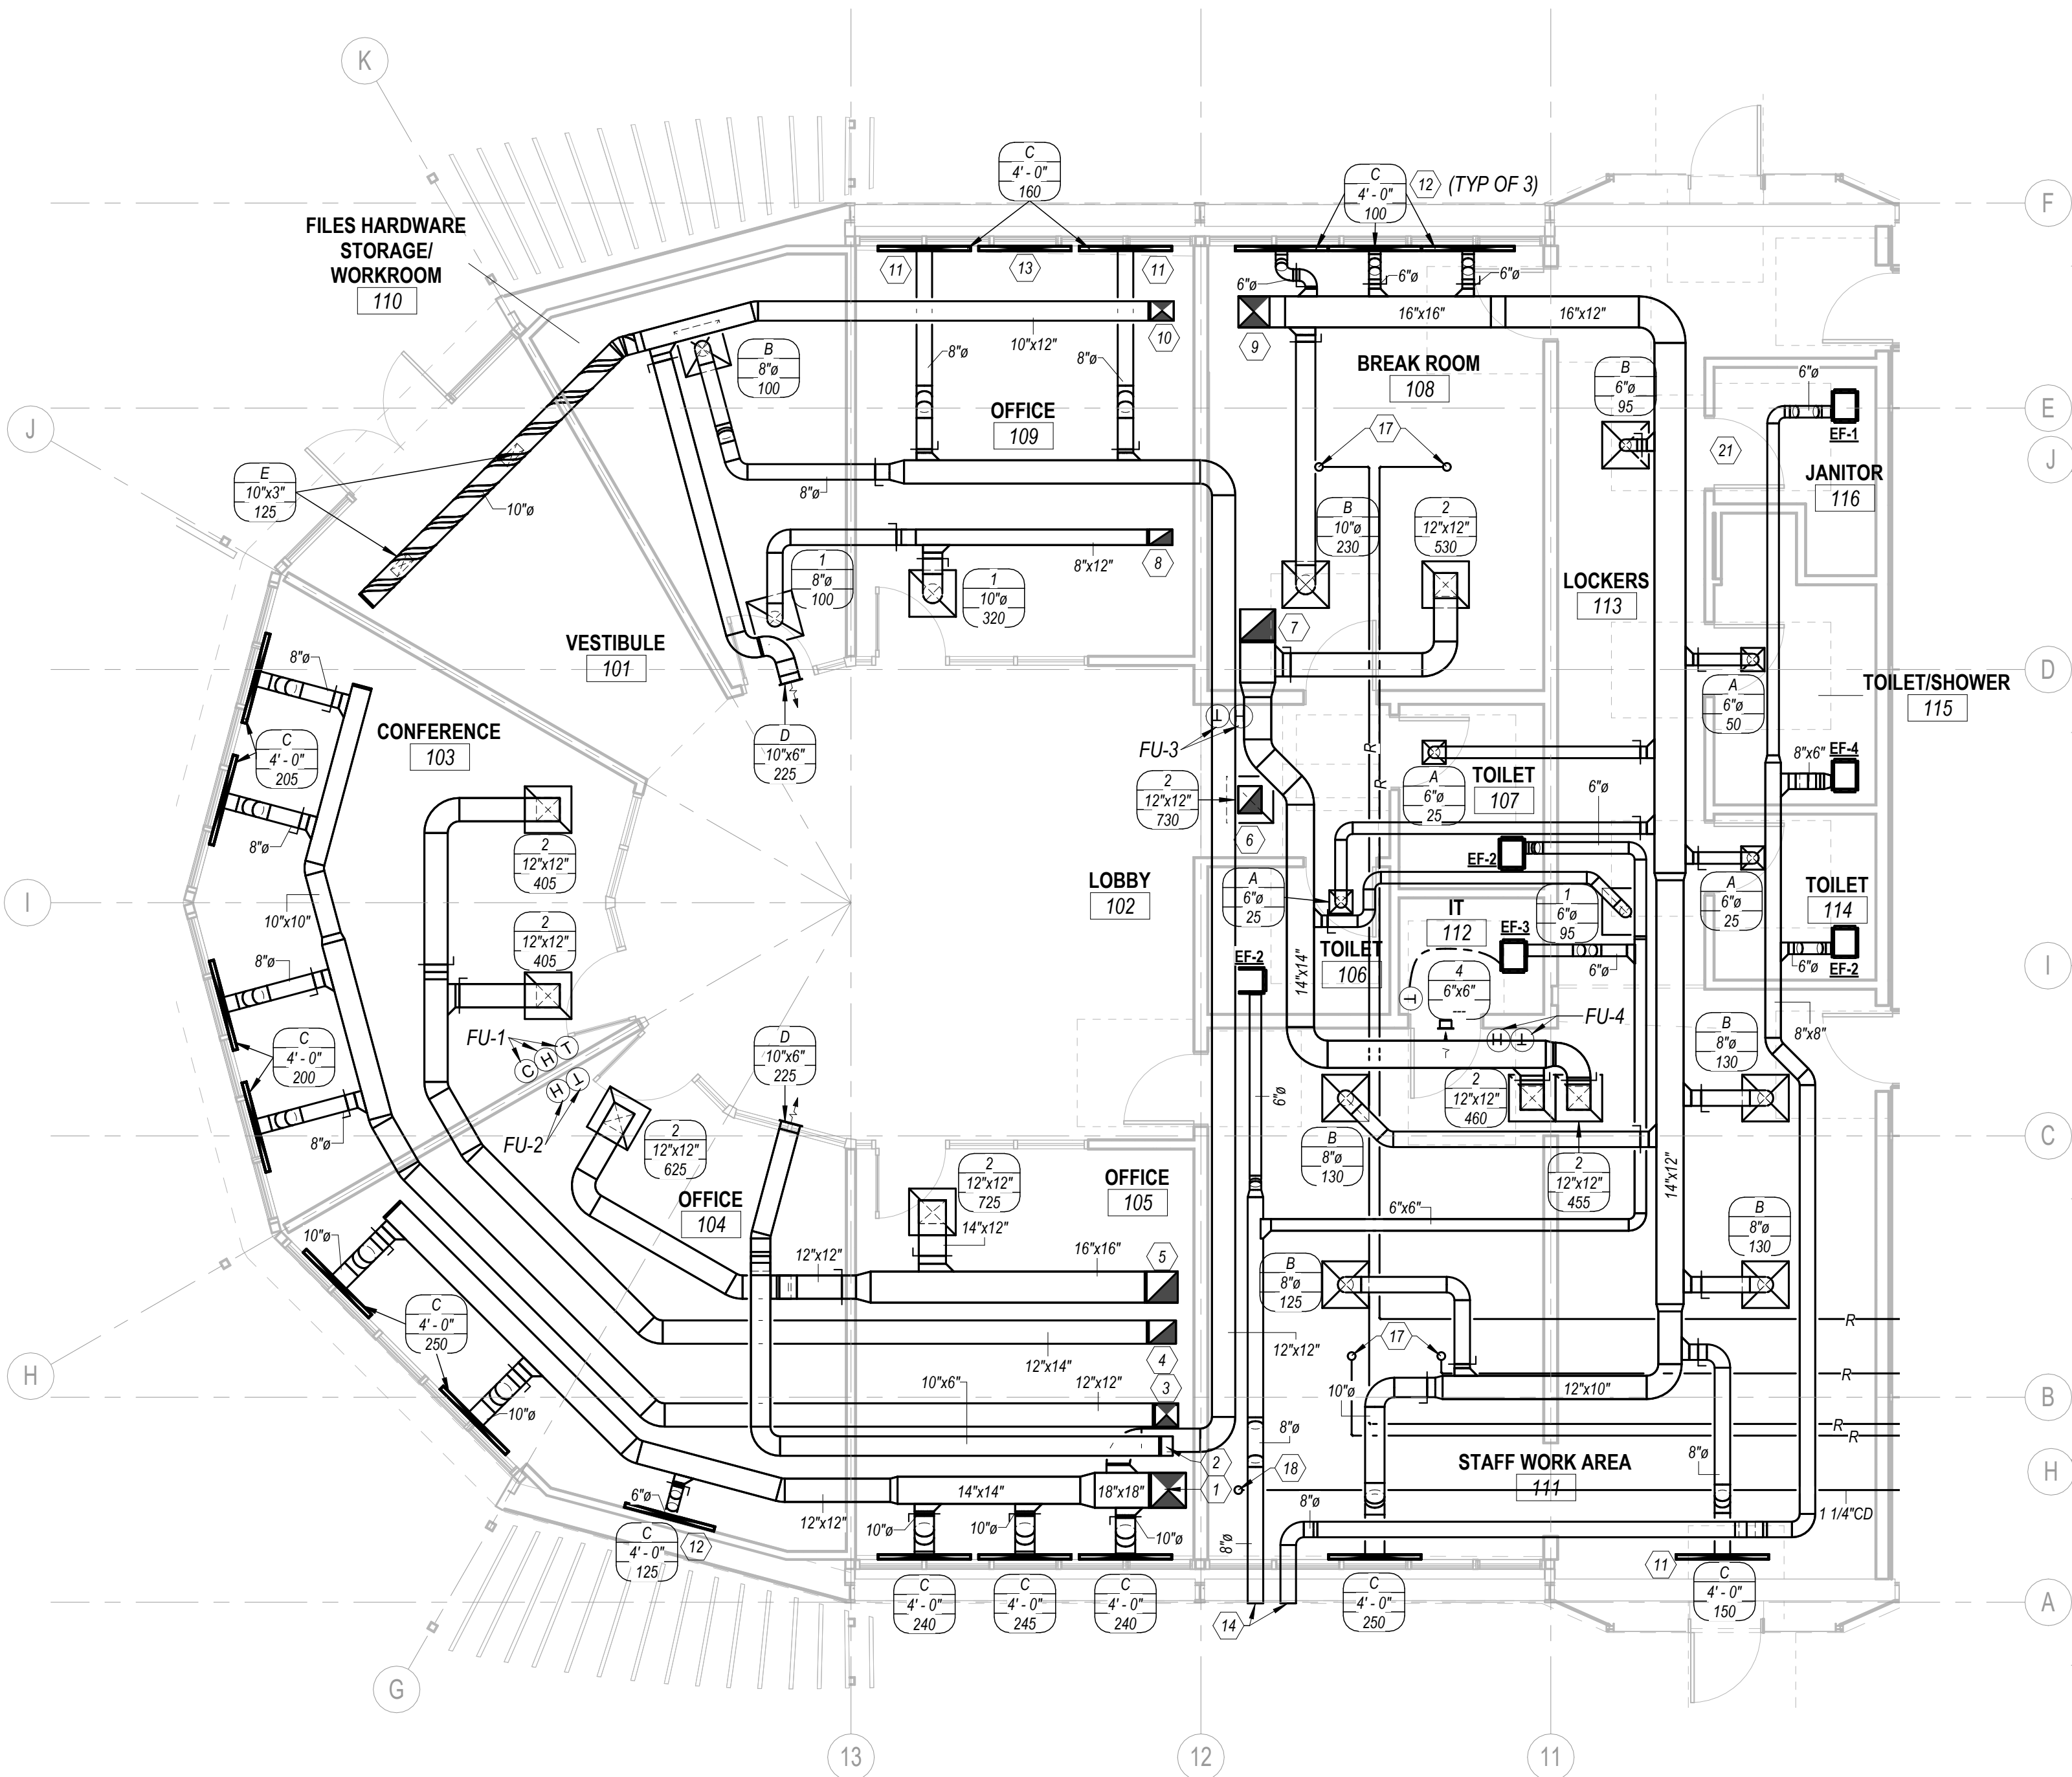

1 MECHANICAL ENLARGED OFFICE PLAN
3/16" = 1'-0"

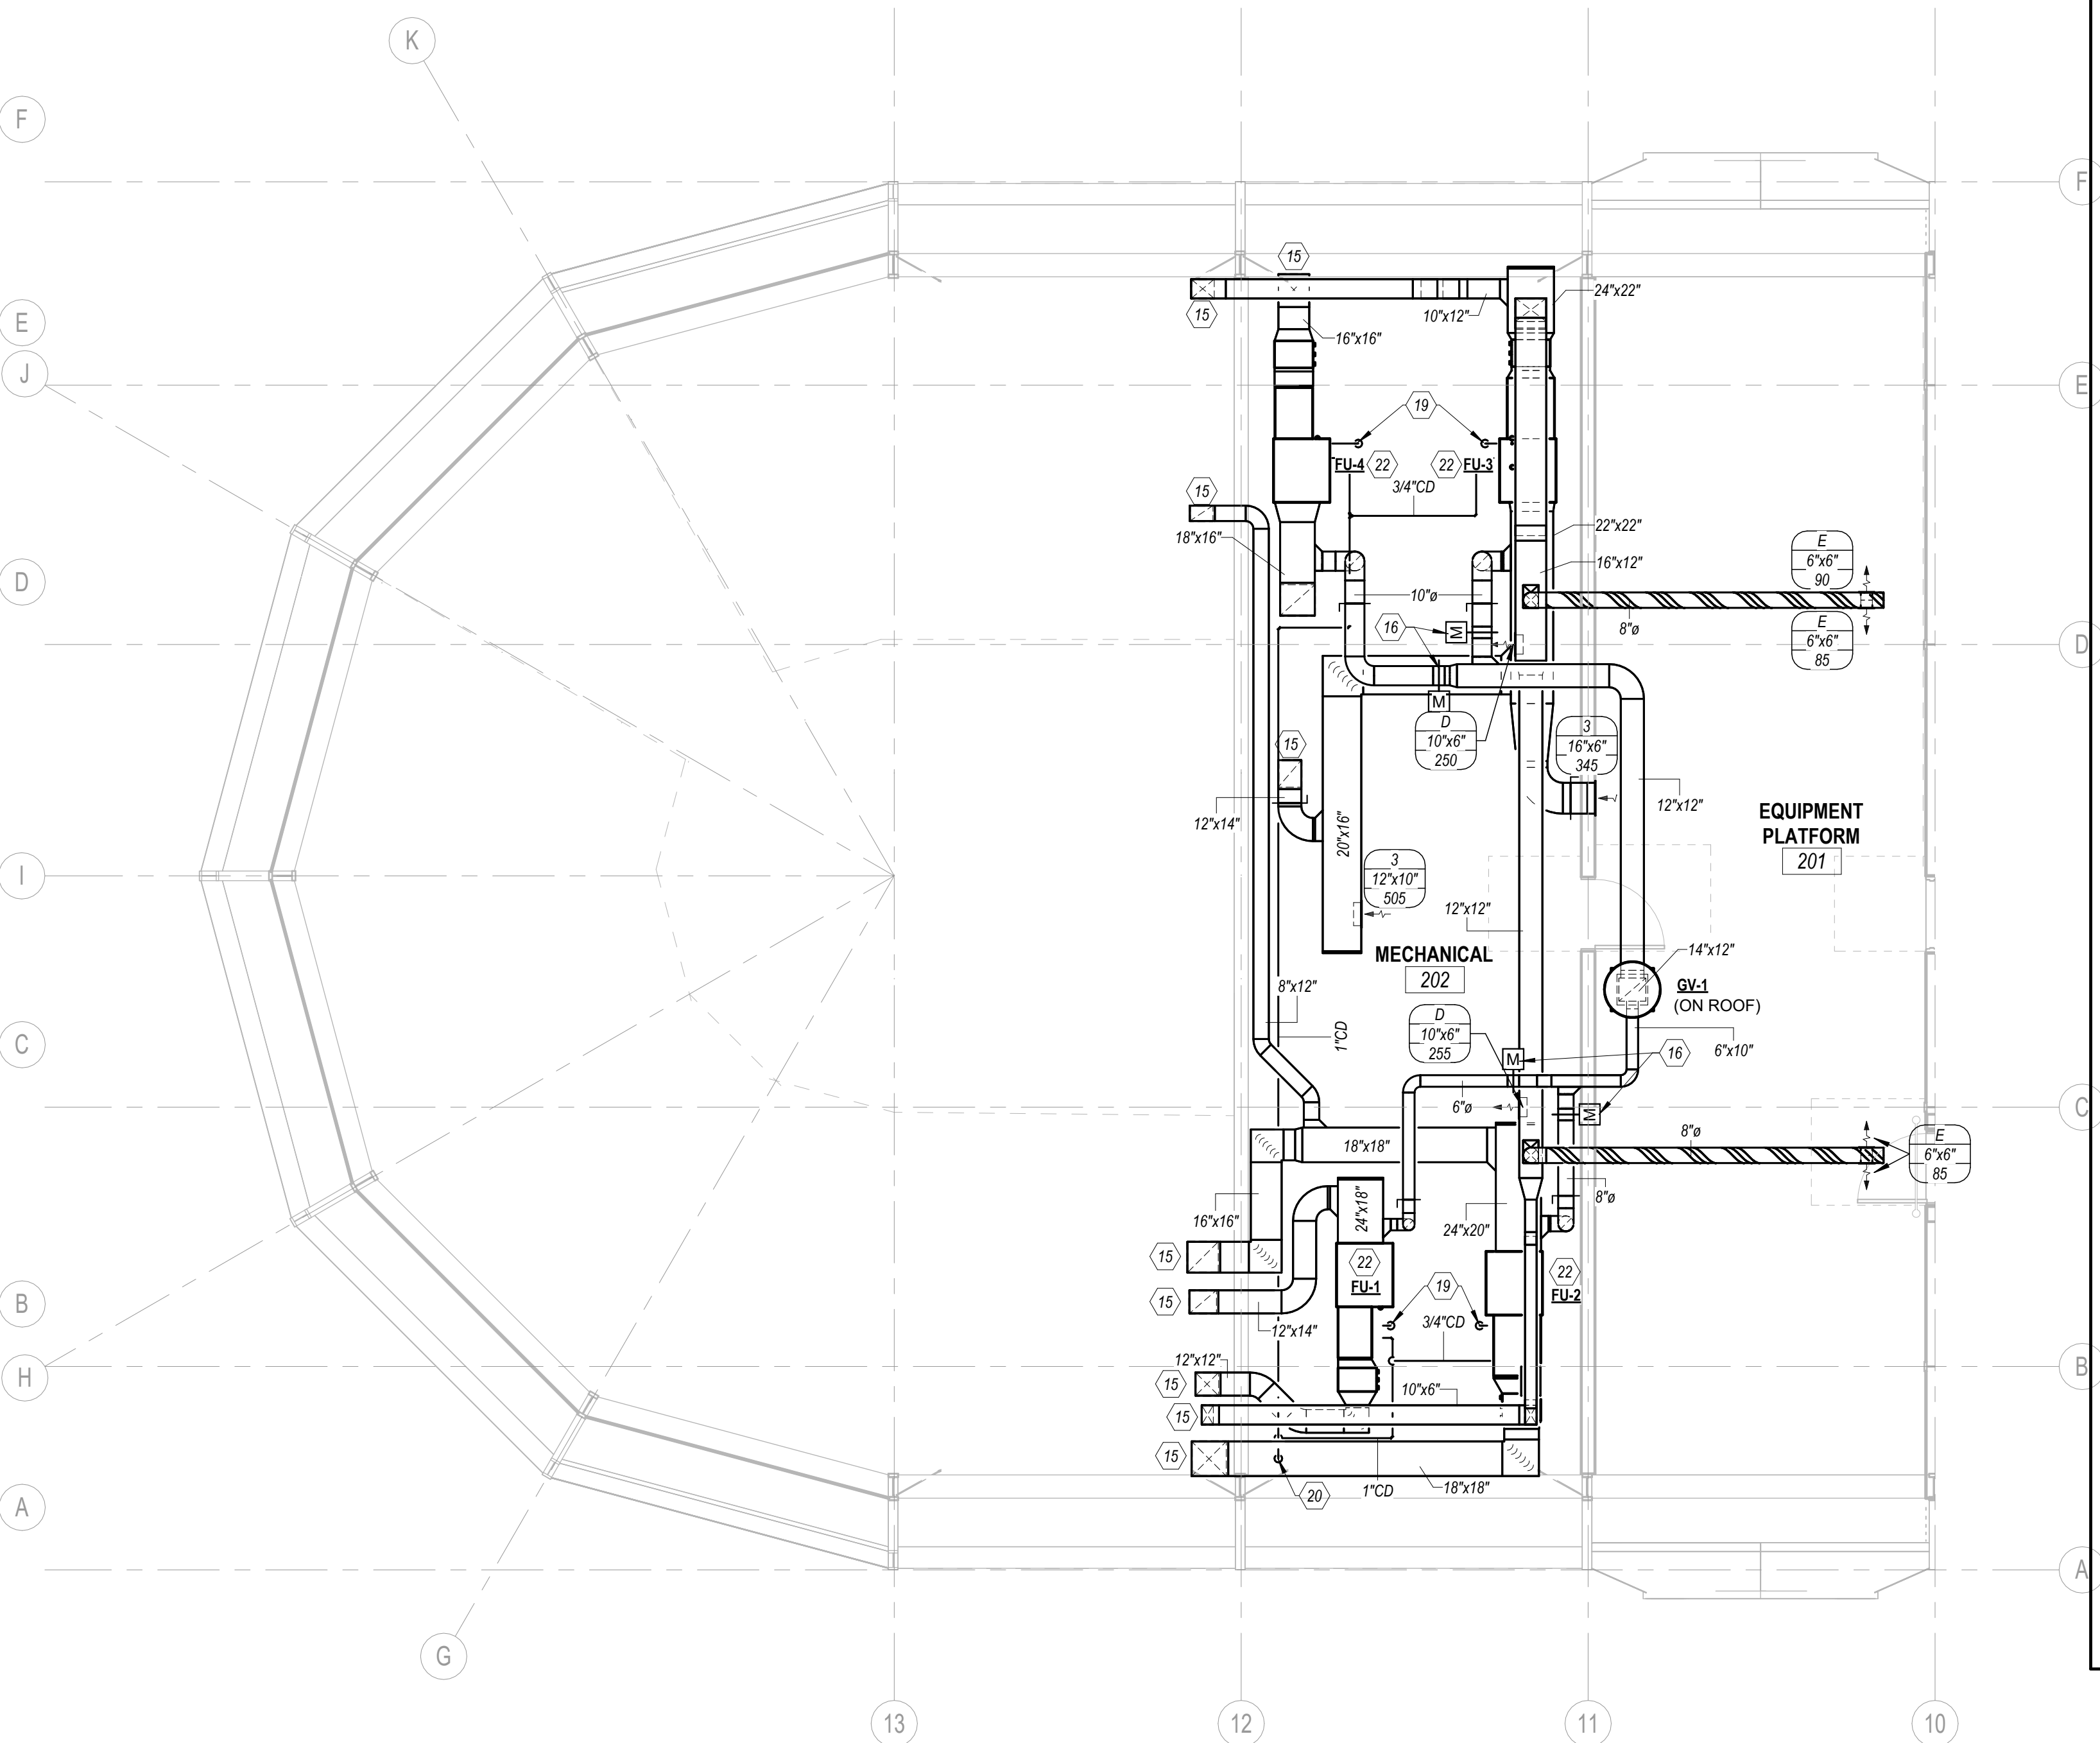

2 MECHANICAL ENLARGED MEZZANINE PLAN
3/16" = 1'-0"



MECHANICAL
ENLARGED PLANS

M3.0

05/08/2026 BID SET 25078