

FIRE ALARM NOTES

FIRE ALARM DEVICES ARE SHOWN FOR REFERENCE ONLY. THE FINAL FIRE ALARM DESIGN AND PERMITTING SHALL BE PERFORMED BY THE FIRE ALARM CONTRACTOR.


KEYNOTES:

- 1 PROVIDE PLYWOOD BACKBOARDS ON ALL ROOM WALLS WITH FIRE RETARDANT PLYWOOD FOR PHONE/DATA USE. PROVIDE (2) 4" CONDUITS WITH PULL-WIRE FOR DATA/PHONE UTILITY. NO HARD 90 DEGREE TURNS ARE PERMITTED, SWEEPS MUST BE USED FOR BENDS UNDERGROUND. COORDINATE WITH UTILITY FOR REQUIREMENTS AND FINAL LOCATION OF BUILDING ENTRY.
- 2 ACCESS CONTROLS, TYP OF ALL. COORDINATE WITH LOW VOLTAGE CONTRACTOR TO PROVIDE ALL REQUIRED INFRASTRUCTURE TO THE DEVICES.
- 3 COORDINATE ELECTRICAL INSTALLATION WITH MANUFACTURER DRAWINGS. PROVIDE ALL NECESSARY DEVICES INCLUDING RECEPTACLE AND GFCI PROTECTION IF REQUIRED.

PRIGM
ENGINEERING

310 W. DICKSON ST., SUITE 210
FAYETTEVILLE, AR 72701
479.877.3188 | WWW.PRIGM.COM

#25078

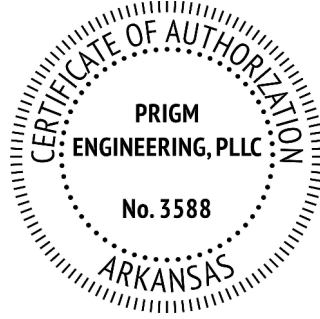

05/08/2026


DEMEX
ARCHITECTURE
104 N EAST AVENUE
FAYETTEVILLE, ARKANSAS 72701 | 479.986.4871

© 2025 DEMEX ARCHITECTURE

POWER PLAN -
ENLARGED OFFICE

E1.1

05/08/2026
25078

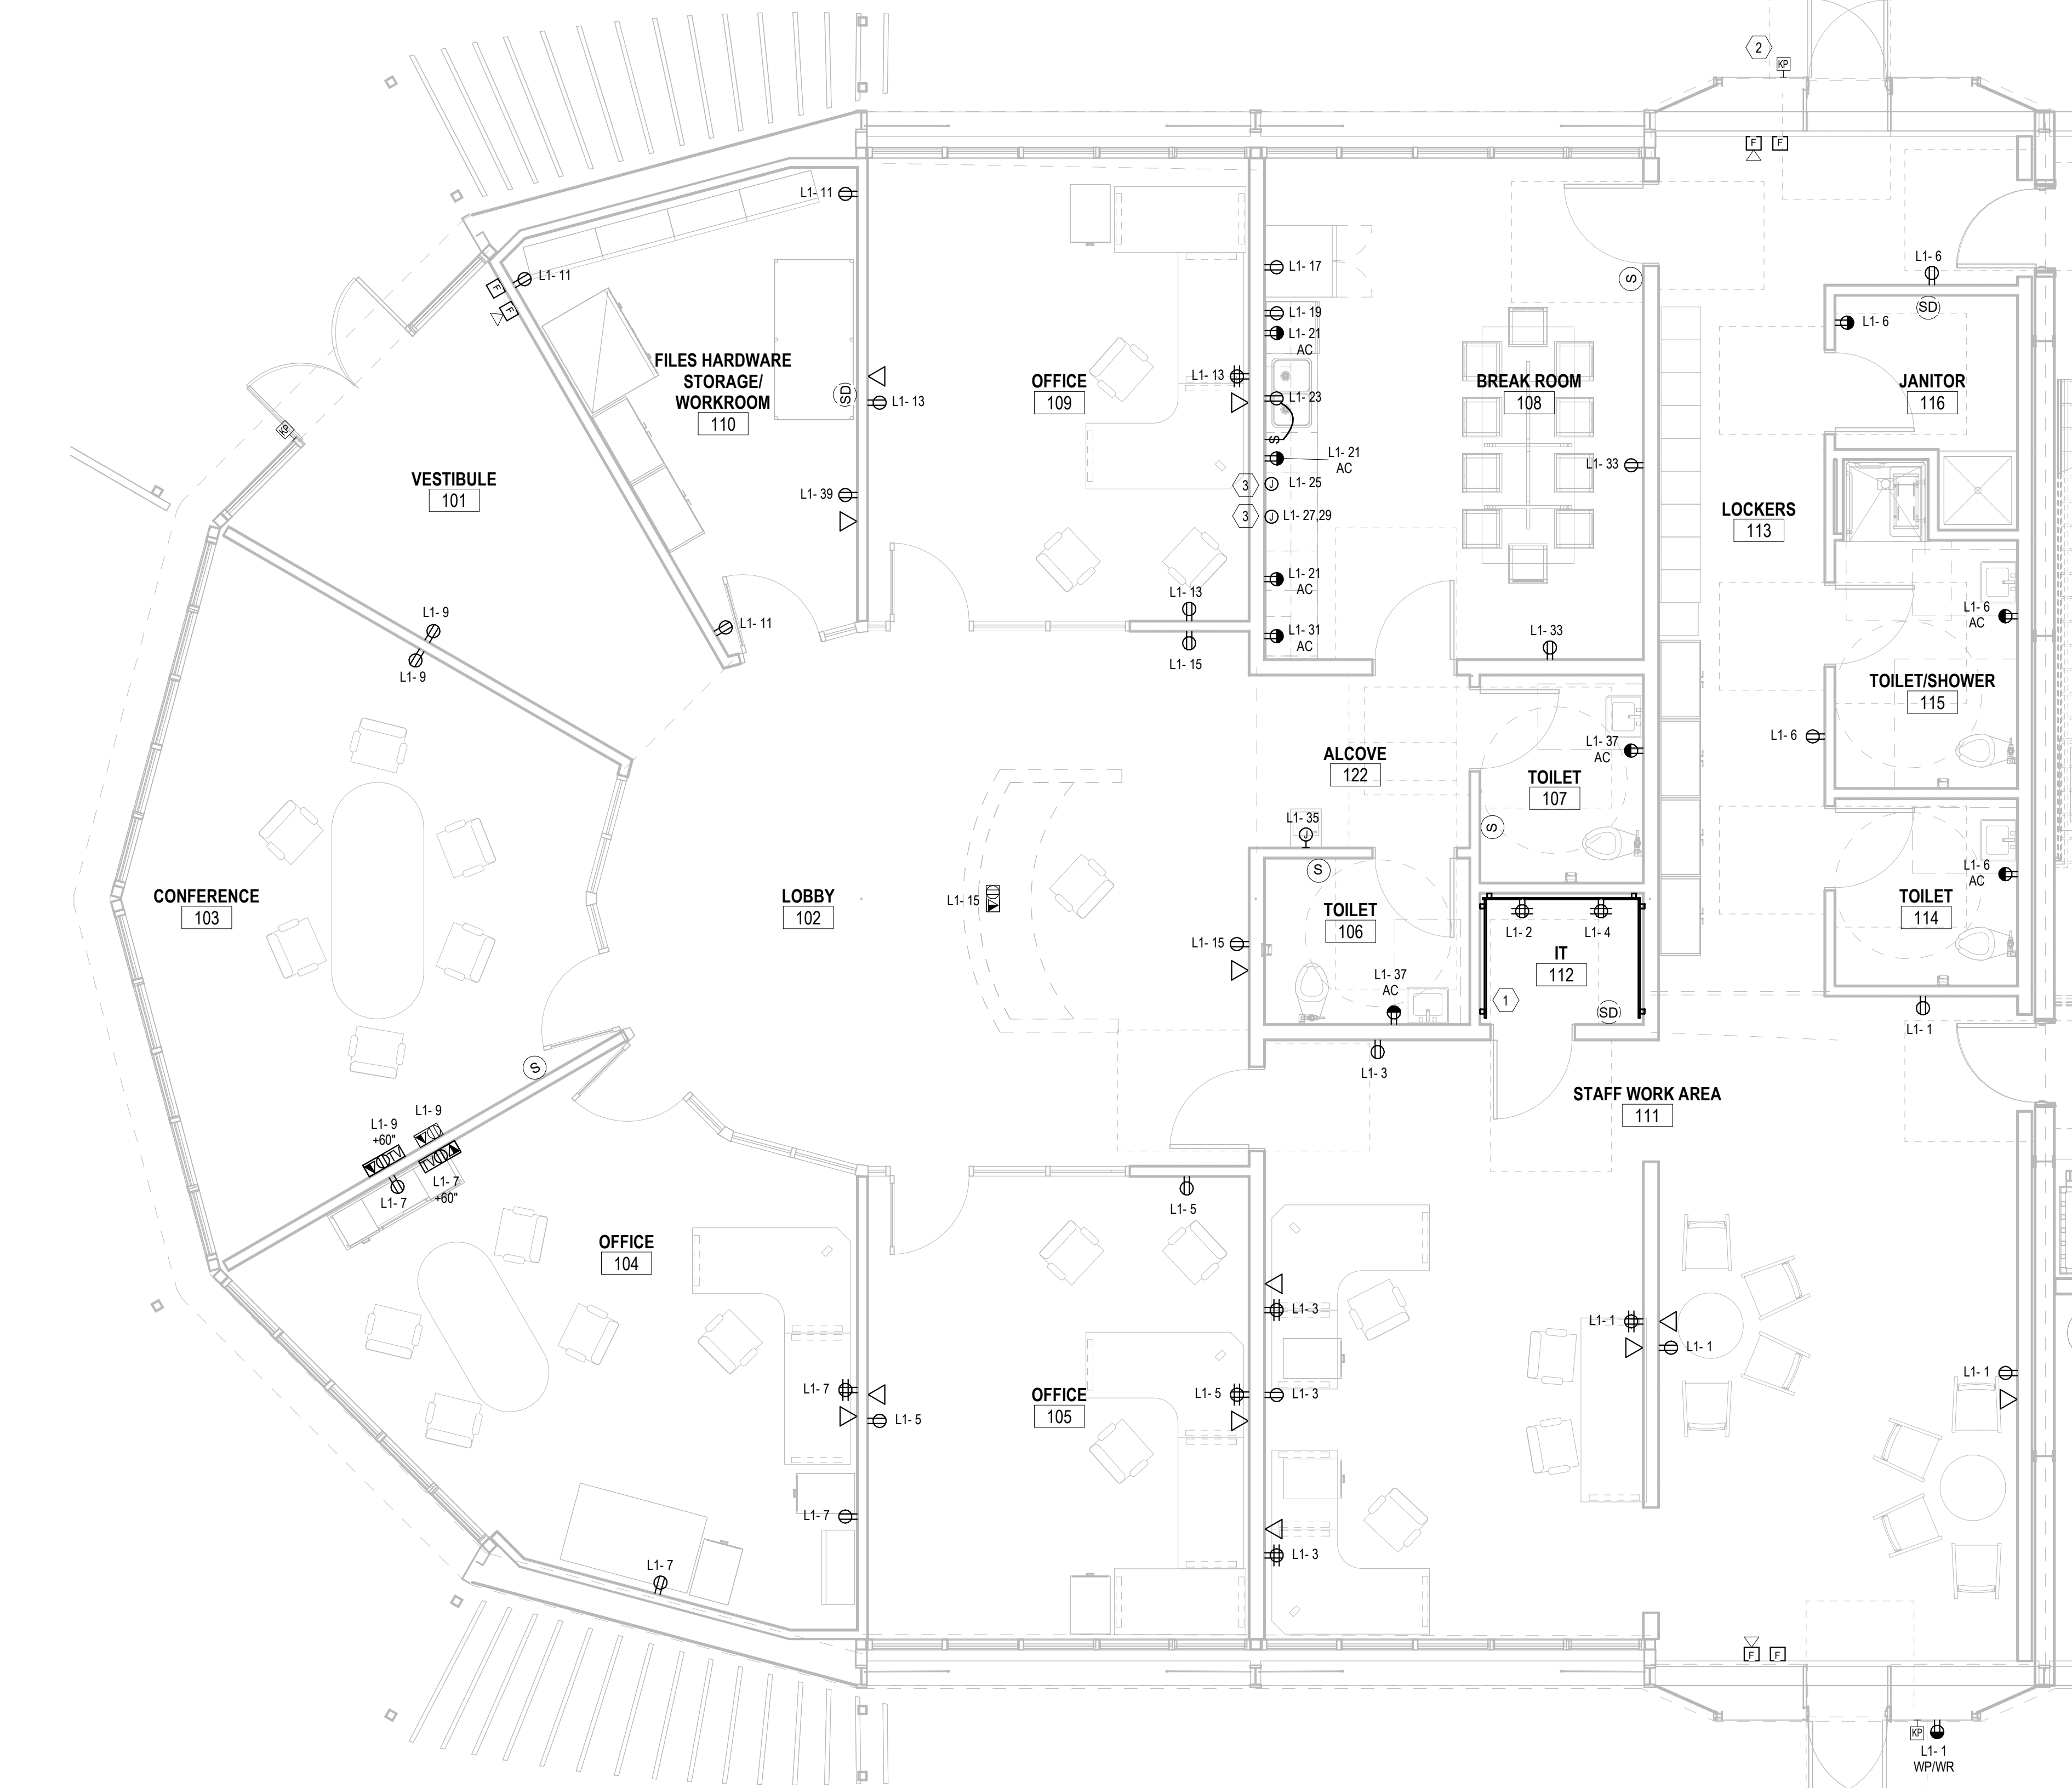

1 POWER PLAN - ENLARGED OFFICE
1/4" = 1'-0"