5/8/2026 12:10:54 PM

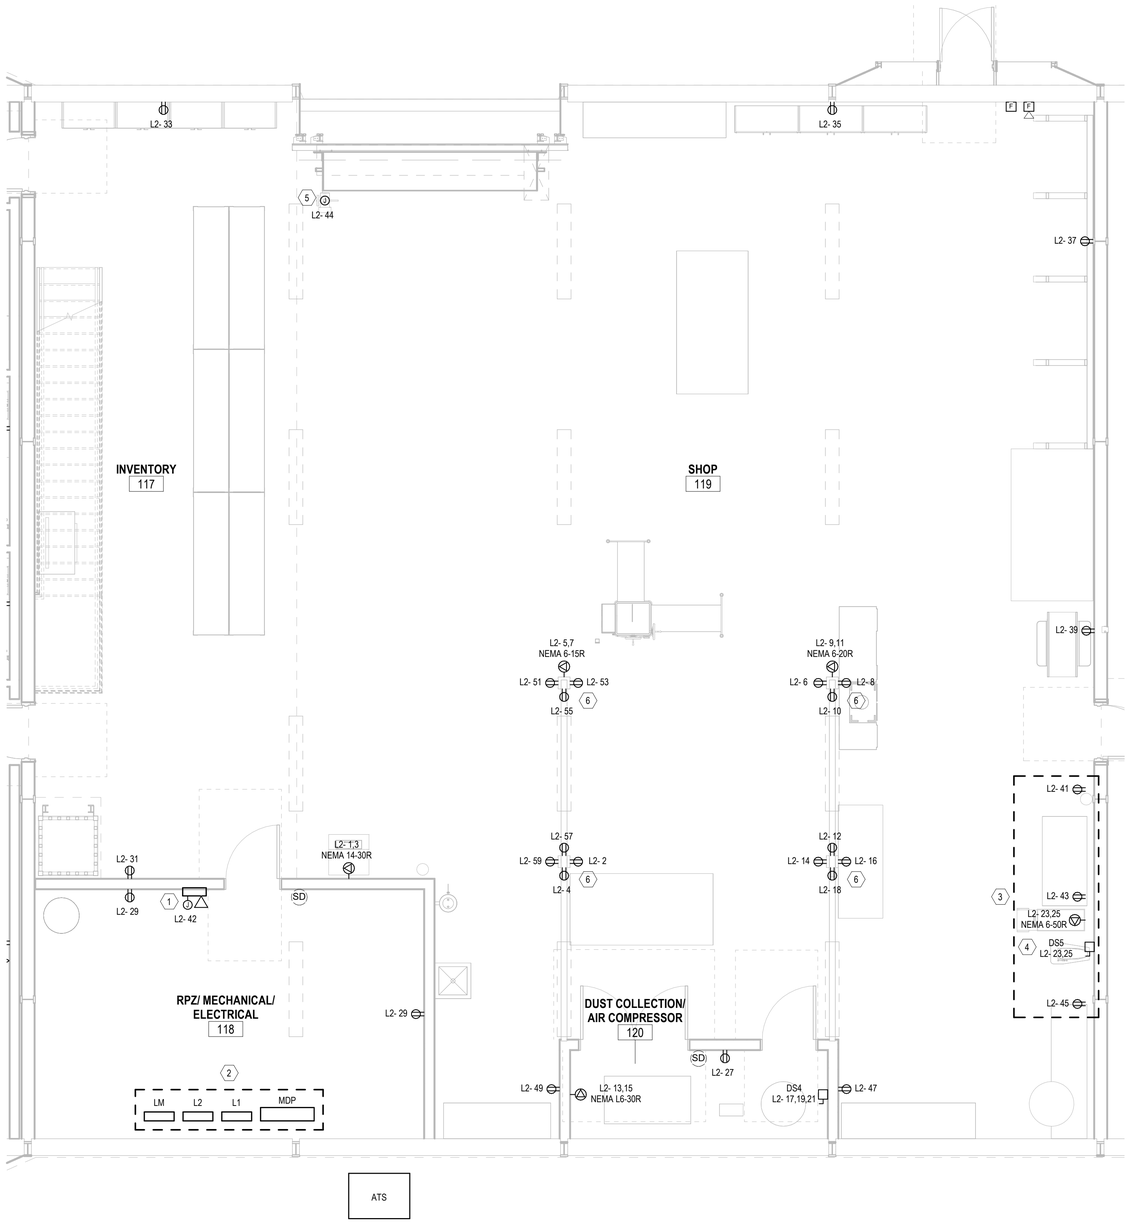

1 POWER PLAN - ENLARGED SHOP

1/4" = 1'-0"

KEYNOTES:

1 FIRE ALARM CONTROL PANEL. COORDINATE WITH FIRE ALARM CONTRACTOR AND DESIGNER FOR FINAL LOCATION AND HEIGHT. PROVIDE DEDICATED, RED, LOCKABLE CIRCUIT BREAKER ABLE TO BE LOCKED IN THE ON POSITION. FIRE ALARM DESIGN IS A DEFERRED SUBMITTAL AND SHALL BE PERFORMED BY FIRE ALARM SYSTEM PROVIDER.

2 EQUIPMENT SHALL BE MOUNTED TO FLOOR MOUNTED UNISTRUT RACK

3 ELECTRICAL DEVICES TO BE MOUNTED TO UNISTRUT 42" AFF. UNISTRUT TO SPAN SPRUNG COLUMNS.

4 DISCONNECT FOR WELDER. CIRCUIT FOR WELDER RECEPTACLE SHALL BE ROUTED THROUGH DISCONNECT.

5 GARAGE DOOR POWER. VERIFY POWER AND CONTROL REQUIREMENTS WITH MANUFACTURER'S INSTRUCTIONS PRIOR TO ROUGH-IN.

6 ALL RECEPTACLES ON COLUMN TO BE MOUNTED AT 42" AFF.

PRIGM ENGINEERING
310 W. DICKSON ST., SUITE 210
FAYETTEVILLE, AR 72701
479.877.3188 | WWW.PRIGM.COM
#25078

CERTIFICATE OF AUTHORIZATION
PRIGM ENGINEERING, PLLC
No. 3588
ARKANSAS

STATE OF ARKANSAS
REGISTERED PROFESSIONAL ENGINEER
No. 14710
DANIEL E. MILES

05/08/2026

DEMX ARCHITECTURE
104 N EAST AVENUE
FAYETTEVILLE, ARKANSAS 72701 | 479.966.4871

© 2025 DEMX ARCHITECTURE

POWER PLAN - ENLARGED SHOP

E1.2

BID SET
05/08/2026
25078