

GENERAL HVAC NOTES

- COORDINATE GRILLE LOCATIONS WITH LIGHT FIXTURES, SPRINKLERS AND CEILING GRID.
- INDICATED DUCT SIZES ARE NET FREE AREA.
- ADJUST ALL AIR QUANTITIES AS SHOWN ON THE PLANS AFTER COMPLETION OF THE JOB.
- INSULATE THE SUPPLY GRILLE TOPS, RETURN AIR GRILLE FLENUMS AND EXHAUST AIR FLENUMS WITH 2 IN., 3/4 LB DENSITY FOIL BACKED INSULATION.
- FIRE AND/OR SMOKE DAMPERS ARE INDICATED ON MECHANICAL DRAWINGS. MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE TO VERIFY LOCATIONS AND FIRE RATING REQUIREMENTS WHERE ANY DUCT PASSES THROUGH A PARTITION. REFER TO ARCHITECTURAL PLANS FOR LOCATION OF ALL FIRE AND SMOKE PARTITIONS. VERIFY REQUIRED DAMPER ASSEMBLY IN ALL DUCTS PENETRATING THESE WALLS PER ALL STATE AND LOCAL CODES.
- EXTERNALLY INSULATE ALL ROUND SUPPLY AND RETURN DUCT. INTERNALLY INSULATE ALL RECTANGULAR SUPPLY AND RETURN DUCT PER MECHANICAL CODE. ATTACH THE INTERNAL INSULATION TO THE DUCT WITH APPROVED ADHESIVE AND WELDED FASTENERS.
- MECHANICAL CONTRACTOR SHALL COORDINATE ALL DUCTWORK WITH FIELD CONDITIONS AND PROVIDE ALL OFFSETS, BENDS, TRANSITIONS AND SPECIAL FITTINGS FOR A COMPLETE INSTALLATION OF THE SYSTEMS.
- INTERIOR OF ALL DUCT FLENUMS VISIBLE THROUGH GRILLE SHALL BE PAINTED MATTE BLACK PRIOR TO INSTALLATION.
- INTERLOCK EXHAUST FANS WITH LIGHT SWITCHES. REFER TO ELECTRICAL PLANS.
- PAINT ALL SUPPLY AND RETURN AIR GRILLES NOT SPECIFIED AS PRE-FINISHED, TO ARCHITECT'S SPECIFICATIONS UNLESS OTHERWISE SPECIFIED.
- MAINTAIN 10 FT. MINIMUM CLEARANCE BETWEEN FRESH AIR INTAKES AND ALL EXHAUST OUTLETS, GAS FLUES AND PLUMBING VENTS.
- INSTALL VOLUME CONTROL DAMPERS IN SUPPLY, RETURN, EXHAUST AND FRESH AIR BRANCH DUCT RUNS.
- REGULATING AIR SYSTEMS WITH A FAN CAPACITY GREATER THAN 2,000 NOMINAL CFM SHALL AUTOMATICALLY SHUT DOWN BY MEANS OF AN APPROVED SMOKE DETECTOR PLACED IN THE RETURN AIR STREAM PRIOR TO ANY EXHAUSTING FROM THE BUILDING OR MIXING WITH FRESH AIR MAKEUP. ALL CONTROLS SHALL BE LISTED. UPON ACTIVATION OF THE SAFETY CONTROL, THE SYSTEM SHALL NOT RESTART UNTIL THE SAFETY CONTROL IS MANUALLY RESET.
- ALL MECHANICAL INSTALLATIONS SHALL CONFORM TO THE LATEST ACCEPTABLE MECHANICAL CODE.
- SEAL ALL DUCT SEAMS WITH HARDCAST IRON GRIP 601 SEALANT SYSTEM OR AN APPROVED EQUAL DUCT TAPE, WHETHER LISTED OR NOT, WILL NOT BE ACCEPTED.
- FABRICATE AND INSTALL ALL GALVANIZED DUCT SYSTEMS TO SMACNA DUCT CONSTRUCTION STANDARDS, LATEST EDITION, AND MECHANICAL CODE.
- FABRICATE AND INSTALL AUXILIARY CONDENSATE DRAIN PAN UNDER ENTIRE AIR HANDLER WITH CONDENSATE PAN SWITCH INTERLOCKED WITH AIR HANDLER FOR SHUT DOWN WHEN CONDENSATE OVER FLOW IS SENSED.
- SMOKE DETECTOR PROVIDED AND INSTALLED BY MECHANICAL CONTRACTOR.
- SUPPLY AIR SYSTEMS AND RETURN AIR SYSTEMS INSTALLED IN AN ATTIC, VENTILATED CRAWL SPACE OR OTHER NON-CONDITIONED AREA SHALL BE INSULATED.
- SPRINKLER CONTRACTOR TO BE RESPONSIBLE FOR ROUTING ALL SPRINKLER PIPING TO AVOID ALL UNCONDITIONED SPACES.
- DO NOT SCALE DIRECTLY FROM THE HVAC DRAWINGS. REFER TO ARCHITECTURAL DRAWINGS FOR ALL DIMENSIONAL INFORMATION.

MECHANICAL LEGEND

- SUPPLY DUCT SECTION
- RETURN OR EXHAUST DUCT SECTION
- CEILING SUPPLY GRILLE
- CEILING RETURN GRILLE
- CEILING EXHAUST GRILLE
- SIDEWALL SUPPLY OR RETURN GRILLE
- SEE KEYED NOTES
- SUPPLY, RETURN, OR EXHAUST DUCT
- VOLUME DAMPER
- RECTANGULAR DUCT FIRE DAMPER
- ROUND DUCT FIRE DAMPER (NUMBER DENOTES FIRE RATING OF IFD WALL. EXAMPLE: IFD = ONE HR. RATED WALL)
- FLEX DUCT CONNECTION MAXIMUM OF 5 FT.
- SMOKE DETECTOR
- THERMOSTAT. MOUNT AT 48" A.F.F. TO TOP (NUMBER DENOTES FURNACE OR AIR HANDLER UNIT)

FURNACE SCHEDULE

MARK	MFG.	MODEL	ESP IN. WG	CFM	HEATING			OUTSIDE AIR (CFM)	FAN MOTOR HP	VOLT/PH/HZ	REMARKS / ACCESSORIES
					INPUT (MBH)	OUTPUT (MBH)	FUEL TYPE				
F-1	DAIKIN	DR96SN0805CN	0.5	1600	80	76	GAS	200	3/4	115 / 1 / 60	1 THRU 8
F-2	DAIKIN	DR96SN0805CN	0.5	1600	80	76	GAS	200	3/4	115 / 1 / 60	1 THRU 8
F-3	DAIKIN	DR96SN0804CN	0.5	1400	80	76	GAS	350	3/4	115 / 1 / 60	1 THRU 8
F-4	DAIKIN	DR96SN1005CN	0.5	2000	100	95	GAS	250	3/4	115 / 1 / 60	1 THRU 8

- REMARKS/ACCESSORIES
- 92% MIN. AFUE UPFLOW GAS FURNACE.
 - ELECTRONIC SPARK IGNITION.
 - PROVIDE FACTORY VERTICAL CONCENTRIC VENT TERMINATION KITS REFER TO 7/M3.1 FOR DETAIL.
 - 10 YEAR MIN. NON-PROTATED HEAT EXCHANGER.
 - PROVIDE 2" FARR 30/30 FILTERS.
 - PROVIDE FILTER HOUSING EQUAL TO MCDANIEL METALS "ACCOMMODATOR" FILTER HOUSING. HOUSING MUST ACCEPT UP TO 2 INCH FILTER.
 - PROVIDE MATCHING MULTI-POSITION CASED "A" TYPE COIL WITH TXV REFRIGERANT CONTROL.
 - PROVIDE 1 INDIVIDUAL DAY PROGRAMMABLE THERMOSTAT.

AIR DISTRIBUTION SCHEDULE

MARK	CFM	NECK SIZE	MFG.	MODEL	TYPE	FINISH	FRAME	REMARKS/ACCESSORIES
A	50-75	6"Ø	TITUS	TMS	4-WAY SUPPLY	WHITE	LAY-IN	1, 6, 7
B	100-200	8"Ø	TITUS	TMS	4-WAY SUPPLY	WHITE	LAY-IN	1, 6, 7
C	205-300	10"Ø	TITUS	TMS	4-WAY SUPPLY	WHITE	LAY-IN	1, 6, 7
D	305-400	12"Ø	TITUS	TMS	4-WAY SUPPLY	WHITE	LAY-IN	1, 6, 7
E	200-1200	22" X 22"	TITUS	355RL	RETURN	WHITE	LAY-IN	1, 4, 6, 7
F	100-375	22" X 22"	TITUS	50F	EXHAUST	WHITE	LAY-IN	2, 4, 6, 7
G	200-400	12" X 10"	TITUS	272RL	SIDEWALL SUPPLY	WHITE	SURFACE	1, 3, 5
H	800	12" X 10"	TITUS	50F	SIDEWALL EXHAUST	WHITE	SURFACE	2, 5
J	75	10" X 10"	TITUS	50F	SIDEWALL EXHAUST	WHITE	SURFACE	2, 5
K	1400	24" X 22"	TITUS	355RL	SIDEWALL RETURN	WHITE	SURFACE	1, 5

- REMARKS/ACCESSORIES
- STEEL CONSTRUCTION.
 - ALUMINUM CONSTRUCTION.
 - PROVIDE DOUBLE DIRECTIONAL BLADES.
 - NO SCREEN HOLES.
 - PROVIDE WITH COUNTER-SUNK SCREEN HOLES.
 - PROVIDE OPPOSED BLADE DAMPERS WHERE INSTALLED WITHIN GYPSUM CEILINGS.
 - PROVIDE RAPID-MOUNT FRAME FOR GRILLES IN GYPSUM CEILINGS.

AIR CONDITIONER SCHEDULE

MARK	MFG.	UNIT MODEL NUMBERS		MOUNTING STYLE	TON(S)	CFM (LO-M1-M2-HI)	COOLING		HEATING MBH	UNIT WEIGHTS		ELECTRICAL (SINGLE POINT CONNECTION)			ACCESSORIES
		OUTDOOR	INDOOR				TMBH	SMBH		OUTDOOR	INDOOR	M.C.A.	M.O.P.	VOLT / PH / HZ	
AC-1	DAIKIN	RKF12AXVJU	FTKF12AXVJU	WALL	1 TON	132-316-436-473	12	9.5	-	75	20	9.15	15	208-230 / 1 / 60	1 THRU 4

- REMARKS/ACCESSORIES
- PROVIDE WIRELESS REMOTE UNIT.
 - PROVIDE OUTDOOR CONDENSING UNIT, MODEL PUY-A30 (CU-1, 2 & 3), WEIGHT-190 LBS.
 - PROVIDE FACTORY WALL MOUNTING HARDWARE. INSTALL 8"-0" A.F.F. IN LOCATION INDICATED ON PLAN.
 - PROVIDE WITH LOW AMBIENT KIT TO 0° F.

DEDICATED OUTSIDE AIR UNIT WITH ENERGY RECOVERY VENTILATOR SCHEDULE

MARK	MFG.	MODEL	AIRFLOW		SUPPLY AIR		EXHAUST AIR		COOLING			HEATING			ELECTRICAL			REMARKS / ACCESSORIES				
			SUPP. CFM	EXH. CFM	SUPP. MOTOR HP	EX. MOTOR HP	ESP SUPP./EX.	SUMMER (DB/°B)	WINTER (DB/°B)	SUMMER (DB/°B)	WINTER (DB/°B)	TMBH	EAT °F (DB/°B)	LAT °F (DB/°B)	INPUT / OUTPUT (MBH)	EAT °F	LAT °F		FUEL	M.C.A.	M.O.P.	VOLT/PH/HZ
DOAS-1	DAIKIN	DFSC1T	4000	3955	4.4	3	0.5 / 0.5	96.6 / 74.5	10.1 / 8.0	75.0 / 63.0	70.0 / 53.0	185.68	85.0 / 64.5	54.0 / 54.0	300 / 243	42.3	48.3	GAS	49.9	70	460 / 3 / 60	1 THRU 12

- REMARKS/ACCESSORIES
- PROVIDE HINGED ACCESS PANELS
 - PROVIDE DOUBLE WALL UNIT CONSTRUCTION
 - PROVIDE FACTORY NON FUSED DISCONNECT SWITCH
 - PROVIDE FACTORY HALL GUARD.
 - PROVIDE FACTORY STAINLESS STEEL CONDENSATE PAN
 - PROVIDE ENERGY RECOVERY FIXED PLATE HEAT EXCHANGER.
 - PROVIDE MICROPROCESSOR CONTROLS
 - PROVIDE FACTORY INSTALLED BACNETMSP
 - PROVIDE HOT GAS REHEAT.
 - PROVIDE FACTORY 2" MERV 8 SUPPLY AND RETURN AIR FILTERS
 - PROVIDE MODULATING GAS FURNACE
 - PROVIDE 1 YR UNIT, 5 YR WHEEL, 25 YEAR HEAT EXCHANGER, AND 5 YEAR COMPRESSOR WARRANTY

UNIT HEATER SCHEDULE

MARK	MFG.	MODEL	HEATING			F.L.A	MOP	VOLT / PH / HZ	ACCESSORIES
			INPUT (MBH)	OUTPUT (MBH)	FUEL TYPE				
UH-1	REZNOR	UDXC-125	120	99.6	GAS	5.6	15	115 / 1 / 60	1 THRU 5

- REMARKS/ACCESSORIES
- PROVIDE RELAY FOR LOW VOLTAGE CONTROL (24V)
 - PROVIDE LOW VOLTAGE THERMOSTAT AND SUBBASE.
 - PROVIDE FACTORY COMBINATION VENT AND COMBUSTION AIR KIT. REFER TO 10/M3.1 FOR DETAIL
 - PROVIDE SPARK IGNITION
 - PROVIDE FACTORY SUSPENSION HANGING KIT.

CONDENSER SCHEDULE

MARK	MFG.	MODEL	TMBH	SMBH	MCA	MOP	VOLT/PH/HZ	REMARKS / ACCESSORIES
CU-1	DAIKIN	DC55EA4810	45.5	33.2	25.5	40	208-230 / 1 / 60	1 THRU 5
CU-2	DAIKIN	DC55EA4810	45.5	33.2	25.5	40	208-230 / 1 / 60	1 THRU 5
CU-3	DAIKIN	DC55EA4210	39	29	19.3	30	208-230 / 1 / 60	1 THRU 5
CU-4	DAIKIN	DC55EA6010	56	41	36.4	60	208-230 / 1 / 60	1 THRU 5

- REMARKS/ACCESSORIES
- MINIMUM 14.0 SEER CONDENSER.
 - PROVIDE LOW AMBIENT TO 0° F CONTROL WITH TXV AND CRANK CASE HEATERS.
 - PROVIDE LIQUID LINE FILTER DRYER.
 - PROVIDE FACTORY HALL GUARD.
 - SIZE AND INSTALL REFRIGERANT LINES PER MANUFACTURERS RECOMMENDATIONS.

EXHAUST FAN SCHEDULE

MARK	MFG.	MODEL	CFM	ESP. IN. WC	H.P./WATTS	VOLT/PH/HZ	SONE	RPM	REMARKS / ACCESSORIES
EF-1	GREENHECK	AER-20	3500	0.5	3/4	115 / 1 / 60	24	1687	1, 2, 5, 6, 7, 8
EF-2	GREENHECK	CSP-A700	650	0.5	148 W	115 / 1 / 60	2.1	1258	1, 2, 3, 4

- REMARKS/ACCESSORIES
- PROVIDE FACTORY BACK DRAFT DAMPER.
 - PROVIDE DIRECT DRIVE MOTOR WITH FAN SPEED CONTROLLER.
 - PROVIDE FACTORY CEILING HUNG VIBRATION ISOLATORS.
 - PROVIDE LINE VOLTAGE THERMOSTAT.
 - PROVIDE WITH WALL SWITCH. INTERLOCK WITH MOTORIZED INTAKE LOUVER PER PLANS.
 - PROVIDE OSHA MOTOR GUARD.
 - PROVIDE FACTORY WALL SLEEVE.
 - PROVIDE EXTERIOR WEATHER HOOD WITH A PRIMED FINISH FOR FIELD PAINTING. PAINT PER ARCHITECT'S DIRECTION.

LOUVER SCHEDULE

MARK	CFM	NECK SIZE	MFG.	MODEL	TYPE	FINISH	FRAME	ACCESSORIES
EL-1	650	24" X 16"	GREENHECK	ESD-635	EXHAUST LOUVER	PRIMED	FLANGED	1, 2, 3
IL-1	3500	44" X 32"	GREENHECK	EAD-635	INTAKE LOUVER	PRIMED	FLANGED	1, 2, 3, 4, 5
IL-2	650	24" X 16"	GREENHECK	ESD-635	INTAKE LOUVER	PRIMED	FLANGED	1, 2, 3

- REMARKS/ACCESSORIES
- ALUMINUM CONSTRUCTION.
 - PROVIDE STEEL BIRD SCREEN.
 - PROVIDE FACTORY SIGHT-PROOF, STATIONARY, DRAINABLE LOUVER.
 - PROVIDE COMBINATION LOUVER/DAMPER WITH 120 VOLT ACTUATOR AND END SWITCH.
 - INTERLOCK MOTORIZED LOUVER WITH EXHAUST FAN AS NOTED ON PLANS.

NOTES:
REFER TO SHEET M1.1 FOR HVAC NOTES, LEGEND & SCHEDULES
REFER TO SHEET M2.1 FOR HVAC PLANS,
REFER TO SHEET M3.1 FOR HVAC DETAILS.

HSA Engineering
479 / 452 / 8922 office
7405 Ellis St.
Fort Smith, AR 72916
HSAConsultants.com

PRELIMINARY
30% REVIEW

Hight Jackson
ASSOCIATES
5201 W Village Parkway, Suite 3001 Rogers, Arkansas 72768 | (479) 464-4955 | www.hjarch.com

A NEW FACILITY FOR
BWHS - Locker Room Building
Centerton, AR

DRAWN BY:
RJK
CHECK BY:
NEW
ISSUE DATE
02/02/2026

PROJECT NO.
2412.2

REVISION DATES


HVAC NOTES, LEGEND & SCHEDULES
SHEET
M1.1
COPYRIGHT 2026
THESE DRAWINGS AND SPECIFICATIONS ARE THE EXCLUSIVE PROPERTY OF HIGHT JACKSON ASSOCIATES P.A. USE OR REPRODUCTION IS PROHIBITED WITHOUT WRITTEN CONSENT.

HVAC KEYED NOTES

- SMOKE DETECTORS TO BE INSTALLED IN THE SUPPLY AND RETURN AIR DUCTS AND INTERLOCKED WITH AIR HANDLER FAN FOR SHUT-OFF PER N.F.P.A. 90 A & B ON ALL AIR HANDLERS GREATER THAN 2000 C.F.M. SUPPLY AIR DUCT SMOKE DETECTOR SHALL BE INSTALLED ON SUPPLY SIDE OF AIR HANDLING SYSTEM DOWN STREAM OF ANY AIR FILTERS AND PRIOR TO ANY BRANCH DUCT CONNECTIONS, EXCEPTION: THE SMOKE DETECTOR IN THE SUPPLY AIR STREAM MAY BE OMITTED IN SYSTEMS 2000 C.F.M. OR LESS. CAPACITY. RECIRCULATING AIR SYSTEMS WITH FAN CAPACITY LESS THAN 2000 C.F.M., BUT SERVING AREAS USED FOR EGRESS SHALL HAVE AUTOMATIC SMOKE DETECTION SHUTDOWN. SMOKE DETECTORS SHALL BE PROVIDED, INSTALLED AND WIRED BY (MECHANICAL CONTRACTOR) (FIRE ALARM CONTRACTOR). MECHANICAL CONTRACTOR SHALL WIRE SMOKE DETECTOR TO THE FAN SHUT OFF CONTACTS. MECHANICAL CONTRACTOR SHALL PROVIDE ALL ACCESSORIES REQUIRED TO MAKE THE FAN SHUT OFF CONNECTION. LOCATE SMOKE DETECTORS IN RETURN AIR DUCT PRIOR TO THE INTRODUCTION OF THE OUTSIDE AIR. (MECHANICAL CONTRACTOR SHALL PROVIDE SMOKE DETECTORS COMPATIBLE WITH THE BUILDING'S EXISTING FIRE ALARM SYSTEM.)
- MAINTAIN A MINIMUM OF 10 FT. CLEARANCE BETWEEN ALL EXHAUST OUTLETS, FLUES, PLUMBING VENTS AND ANY FRESH AIR INTAKES, IF 10 FT. CLEARANCE CAN NOT BE MAINTAINED EXHAUST OUTLET, FLUE, OR VENT MUST TERMINATE AT A POINT AT LEAST 36 IN. ABOVE HIGHEST FRESH AIR INTAKE WITHIN 10 FT. LIMIT.
- LOCATE THERMOSTAT, CO2 SENSOR OR HUMIDISTAT AS INDICATED WITH THE TOP OF THE THERMOSTAT AT 48 IN. ABOVE FINISHED FLOOR. SEAL ALL THERMOSTAT CONDUITS AT TOP AND BOTTOM OF CONDUIT. PROVIDE INSULATED BACKING FOR MOUNTING THERMOSTATS.

NOTE:
ALL RECTANGULAR DUCTWORK SHALL BE INTERNALLY LINED.

NOTE:
ALL EXPOSED DUCTWORK IS TO BE CONSTRUCTED OF A PAINT LOCK METAL. PAINT PER ARCHITECT'S DIRECTIONS.

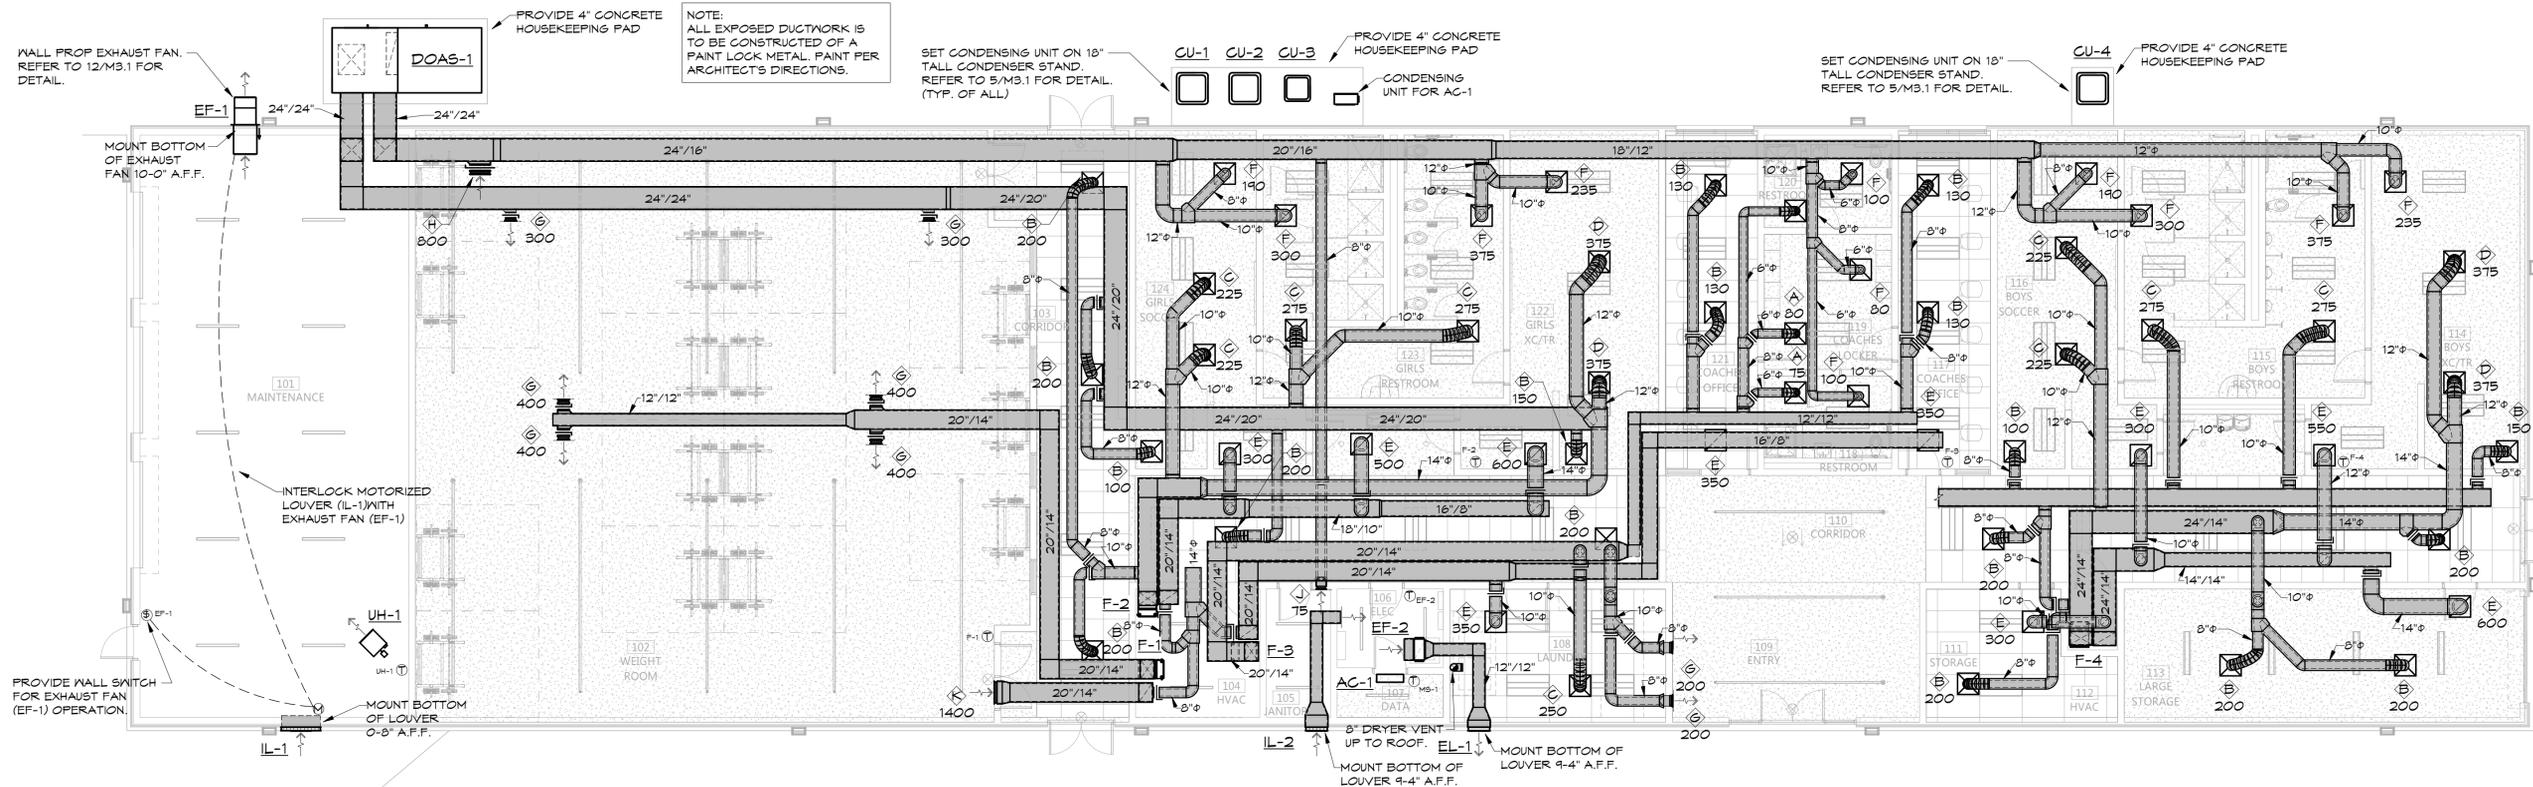

1 HVAC PLAN
1/8" = 1'-0"

NOTES:
REFER TO SHEET M1.1 FOR HVAC NOTES, LEGEND & SCHEDULES
REFER TO SHEET M2.1 FOR HVAC PLANS,
REFER TO SHEET M3.1 FOR HVAC DETAILS.

HSA Engineering
479 / 452 / 8922 office
7405 Ellis St.
Fort Smith, AR 72916
HSAConsultants.com


PRELIMINARY
30% REVIEW

Hight Jackson
ASSOCIATES
5201 W Village Parkway, Suite 3001 Rogers, Arkansas 72768 | (479) 464-4965 | www.hjarch.com


A NEW FACILITY FOR
BWHS - Locker Room Building
Centerton, AR

DRAWN BY:
RJK
CHECK BY:
NEW
ISSUE DATE:
02/02/2026
PROJECT NO:
2412.2
REVISION DATES:


HVAC PLAN
SHEET
M2.1
COPYRIGHT 2026
THESE DRAWINGS AND SPECIFICATIONS ARE THE EXCLUSIVE PROPERTY OF HIGHT JACKSON ASSOCIATES P.A. USE OR REPRODUCTION IS PROHIBITED WITHOUT WRITTEN CONSENT.

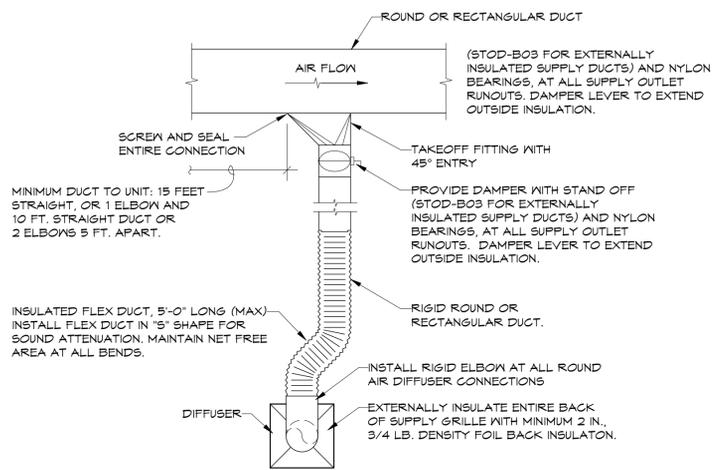


1 SUPPLY DUCT CONNECTION DETAIL
NTS

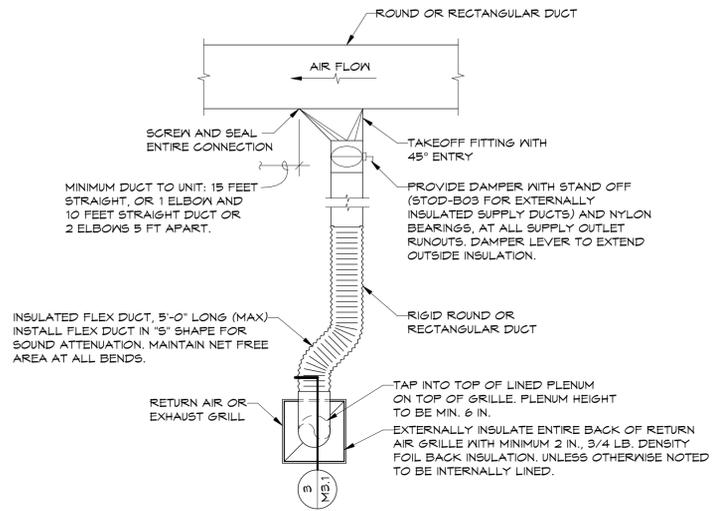


2 RETURN DUCT CONNECTION DETAIL
NTS

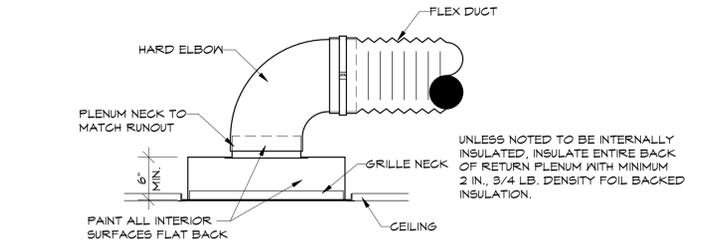


3 RETURN GRILLE CONNECTION SECTION
NTS

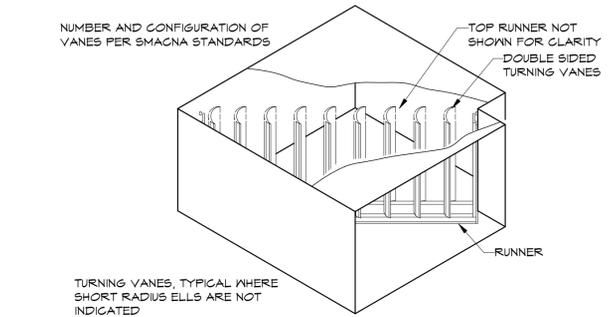


4 TURNING VANE DETAIL
NTS

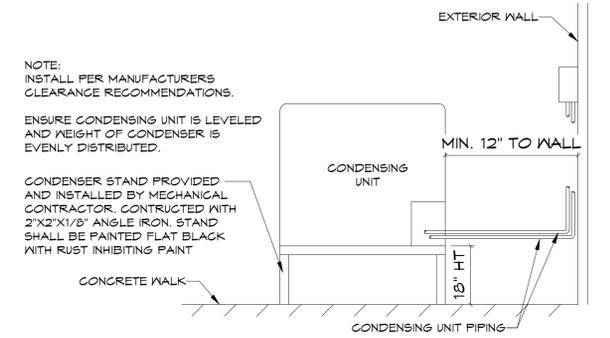


5 CONDENSER STAND DETAIL
NTS

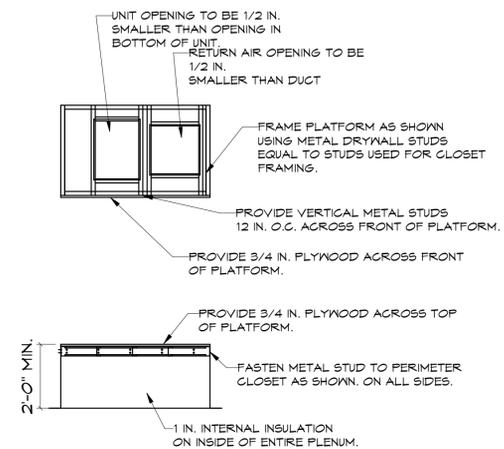


6 FURNACE STAND DETAIL
N.T.S.

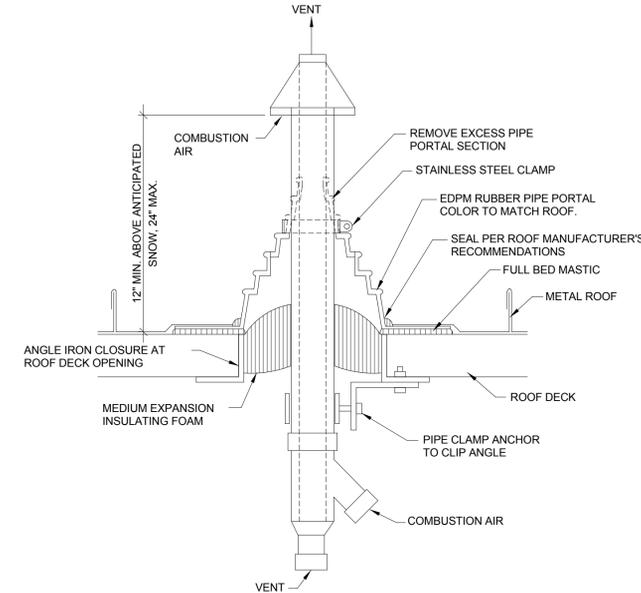

7 FURNACE CONCENTRIC VENT DETAIL
NTS

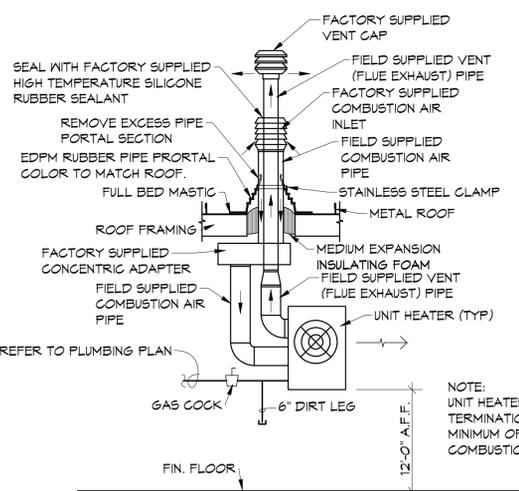


8 UNIT HEATER DETAIL
NTS

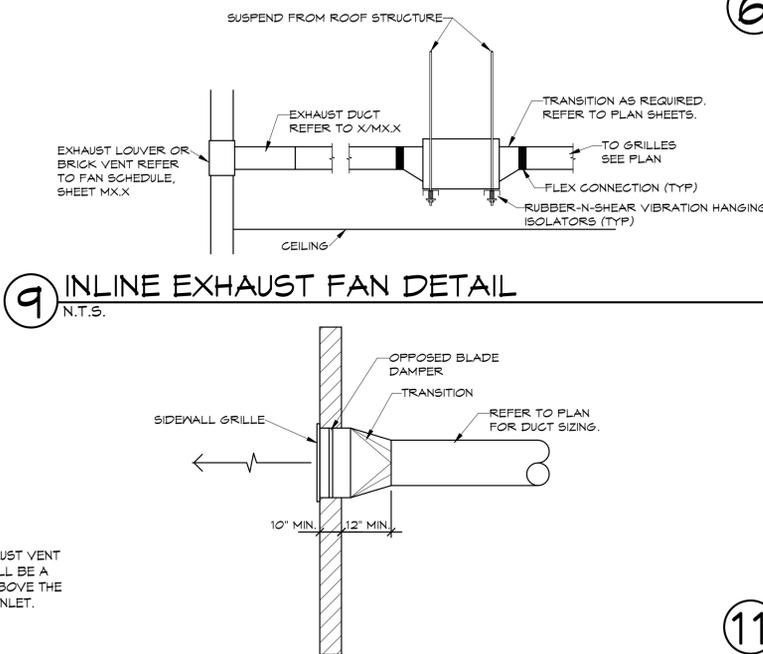


9 INLINE EXHAUST FAN DETAIL
N.T.S.

10 SIDE WALL GRILLE
NTS

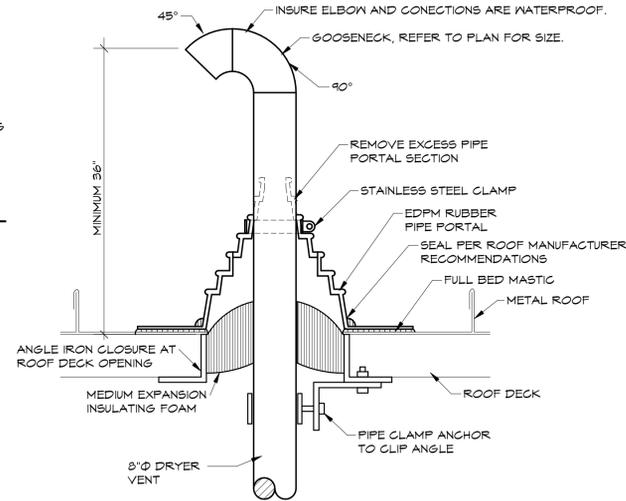

11 DRYER VENT GOOSENECK DETAIL
N.T.S.

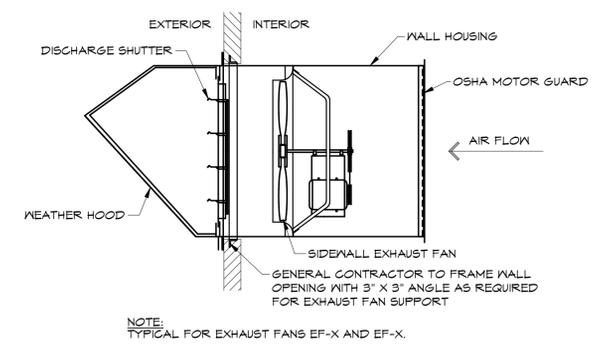

12 WALL PROP EXHAUST FAN DETAIL
N.T.S.

NOTES:
REFER TO SHEET M1.1 FOR HVAC NOTES, LEGEND & SCHEDULES
REFER TO SHEET M2.1 FOR HVAC PLANS,
REFER TO SHEET M3.1 FOR HVAC DETAILS.

HSA Engineering
479 / 452 / 8922 office
7405 Ellis St.
Fort Smith, AR 72916
HSAConsultants.com

PRELIMINARY
30% REVIEW

Hight Jackson
ASSOCIATES
5201 W Village Parkway, Suite 3001 Rogers, Arkansas 72768 | (479) 464-4965 | www.hjarch.com

A NEW FACILITY FOR
BWHS - Locker Room Building
Centerton, AR

DRAWN BY:
RJK
CHECK BY:
NEW
ISSUE DATE:
02/02/2026
PROJECT NO:
2412.2
REVISION DATES:

HVAC DETAILS
SHEET
M3.1
COPYRIGHT 2026
THESE DRAWINGS AND SPECIFICATIONS ARE THE EXCLUSIVE PROPERTY OF HIGHT JACKSON ASSOCIATES P.A. USE OR REPRODUCTION IS PROHIBITED WITHOUT WRITTEN CONSENT.