



Hight Jackson
ASSOCIATES
5201 W Village Parkway, Suite 300 | Rogers, Arkansas 72768 | (479) 464-4965 | www.hjarch.com

A RESTORATION FOR
RPS Administration Building
500 W Walnut St. Rogers AR 72756

DRAWN BY:
AS
CHECK BY:
MR
ISSUE DATE
11/25/2025
PROJECT NO.
2534
REVISION DATES
12/17/2025

PHASE 3 - ELECTRICAL DEMO PLAN
SHEET
E2.0
COPYRIGHT 2025
THESE DRAWINGS AND SPECIFICATIONS ARE THE EXCLUSIVE PROPERTY OF HIGHT JACKSON ASSOCIATES P.A. USE OR REPRODUCTION IS PROHIBITED WITHOUT WRITTEN CONSENT.

DEMOLITION LEGEND


- ⚡ ELECTRICAL DEVICES WITH DASHED LINES ARE TO BE DEMOLISHED; DISCONNECT REMOVE CONDUIT AND WIRE BACK TO JUNCTION POINT. MAINTAIN CONTINUITY TO REMAINING DEVICES ON THAT CIRCUIT. FIELD VERIFY EXISTING CONDITIONS.
- ⚡ GRAYED OUT ELECTRICAL DEVICES ARE TO BE REMOVED AND REPLACED WITH NEW DEVICES

ELECTRICAL DEMOLITION GENERAL NOTES


- FOR ALL DEVICES IN WALLS/MILLWORK BEING DEMOLISHED: DISCONNECT REMOVE CONDUIT AND WIRE BACK TO JUNCTION POINT. MAINTAIN CONTINUITY TO REMAINING DEVICES ON THAT CIRCUIT.
- REMOVE ALL DEVICES IN CEILINGS THAT ARE TO BE DEMOLISHED: DISCONNECT AND REMOVE CONDUIT AND WIRE BACK TO SOURCE, LABEL BREAKER AS SPARE.
- ALL EXISTING LIGHT FIXTURES AND LIGHTING CONTROL DEVICES ARE TO BE REMOVED AND DISPOSED OF UNLESS OTHERWISE NOTED.
- FOR ALL UNUSED CIRCUITS, REMOVE CONDUIT AND WIRE BACK TO SOURCE, LABEL BREAKER AS SPARE.
- REFER TO ARCHITECTURAL DRAWINGS FOR AREAS TO BE DEMOLISHED.
- GRAYED OUT DEVICES SHOW EXISTING TO REMAIN DEVICE LOCATIONS.
- DEVICES SHOWN AS BOLD OR DASHED ARE TO BE REMOVED AND DISPOSED OF UNLESS OTHERWISE NOTED.
- REMOVE POWER TO ALL EXISTING EQUIPMENT TO BE DEMOLISHED, COORDINATE WITH ALL TRADES.
- FIELD VERIFY ALL EXISTING CONDITIONS.

KEYED NOTES


- REMOVE EXISTING FIRE ALARM DEVICES AND REINSTALL NEW DEVICES AT SAME LOCATION.
- REMOVE EXISTING ELECTRICAL FIXTURES AND REINSTALL NEW DEVICES AT SAME LOCATION.
- REMOVE AND DISPOSE OF EXISTING FIRE ALARM DEVICES TO BE REMOVED AS CONSTRUCTION DICTATES.
- REMOVE AND DISPOSE OF EXISTING ELECTRICAL PANEL TO BE REMOVED AS CONSTRUCTION DICTATES.

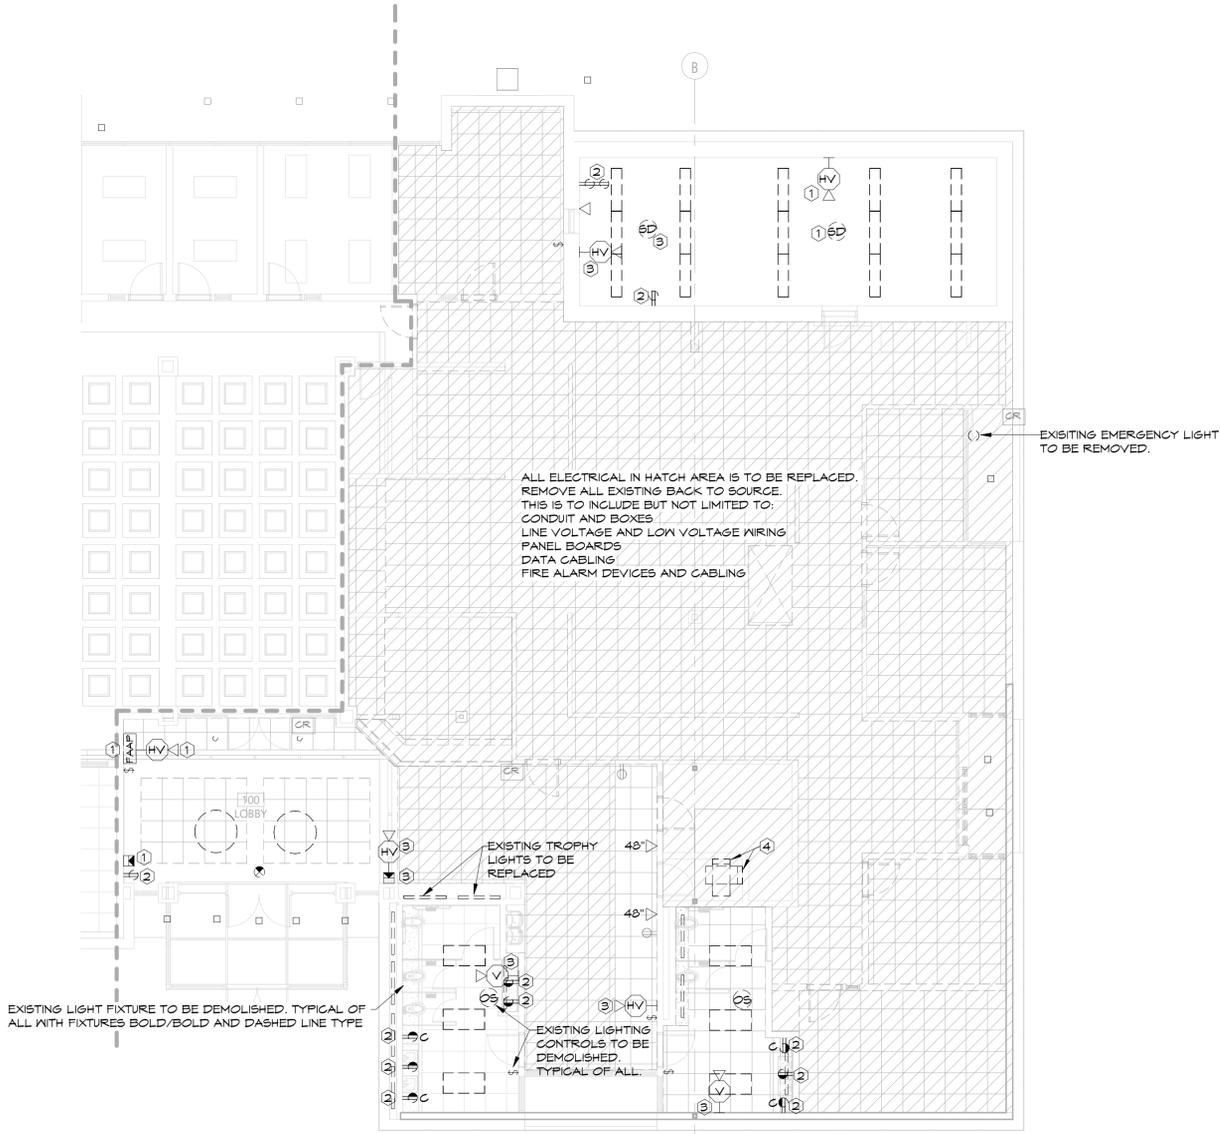

1 PHASE 3 - DEMOLITION PLAN
1/8" = 1'-0"

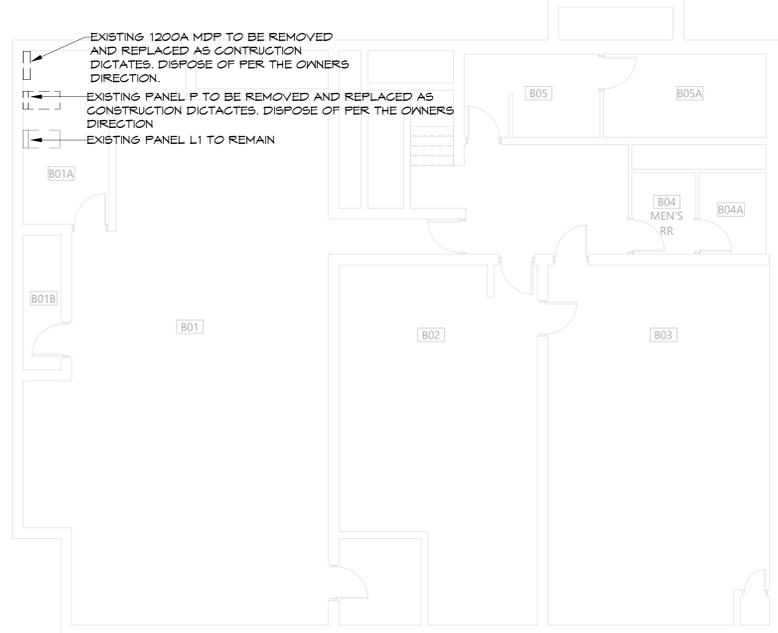

2 PHASE 3 - BASEMENT DEMOLITION PLAN
1/8" = 1'-0"

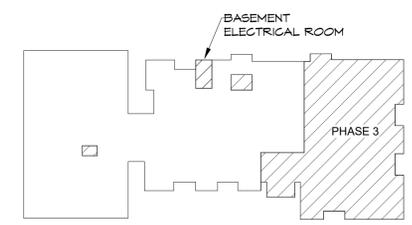

KEYPLAN

HSA Engineering
479 / 452 / 8922 office
7405 Ellis St.
Fort Smith, AR 72916
HSAConsultants.com