



GENERAL POWER NOTES


1. GRAYED OUT DEVICES SHOW EXISTING TO REMAIN DEVICE LOCATIONS.

KEYED POWER NOTES


1. COORDINATE EXACT LOCATION WITH PROVIDER/INSTALLER, CONSIDER MILLWORK AND HEIGHT OF MICROWAVE.
2. REPLACE EXISTING PANEL P WITH NEW PANEL. RECONNECT ALL EXISTING CIRCUITS TO PANEL. EXTEND ALL CIRCUITRY AS REQUIRED. FIELD VERIFY ALL EXISTING CONDITIONS.
3. INTERLOCK EXHAUST FAN WITH LIGHTING CONTROL. IN WOMENS TOILET 101 AND MENS TOILET 102. LOCATED ON ROOF.
4. PROVIDE CONDUIT FEED FOR POWER AND DATA DOWN METAL STUD FURR OUTS ON NORTH SIDE OF EXISTING STEEL COLUMNS.
5. REPLACE EXISTING PANEL MDP WITH NEW PANEL. RECONNECT ALL EXISTING CIRCUITS TO PANEL. EXTEND ALL CIRCUITRY AS REQUIRED. FIELD VERIFY ALL EXISTING CONDITIONS.

5. NEW PANEL 'MDP'
2. NEW PANEL 'P'
- EXISTING PANEL 'L1' TO REMAIN



3 PHASE 3 - BASEMENT POWER PLAN
1/8" = 1'-0"

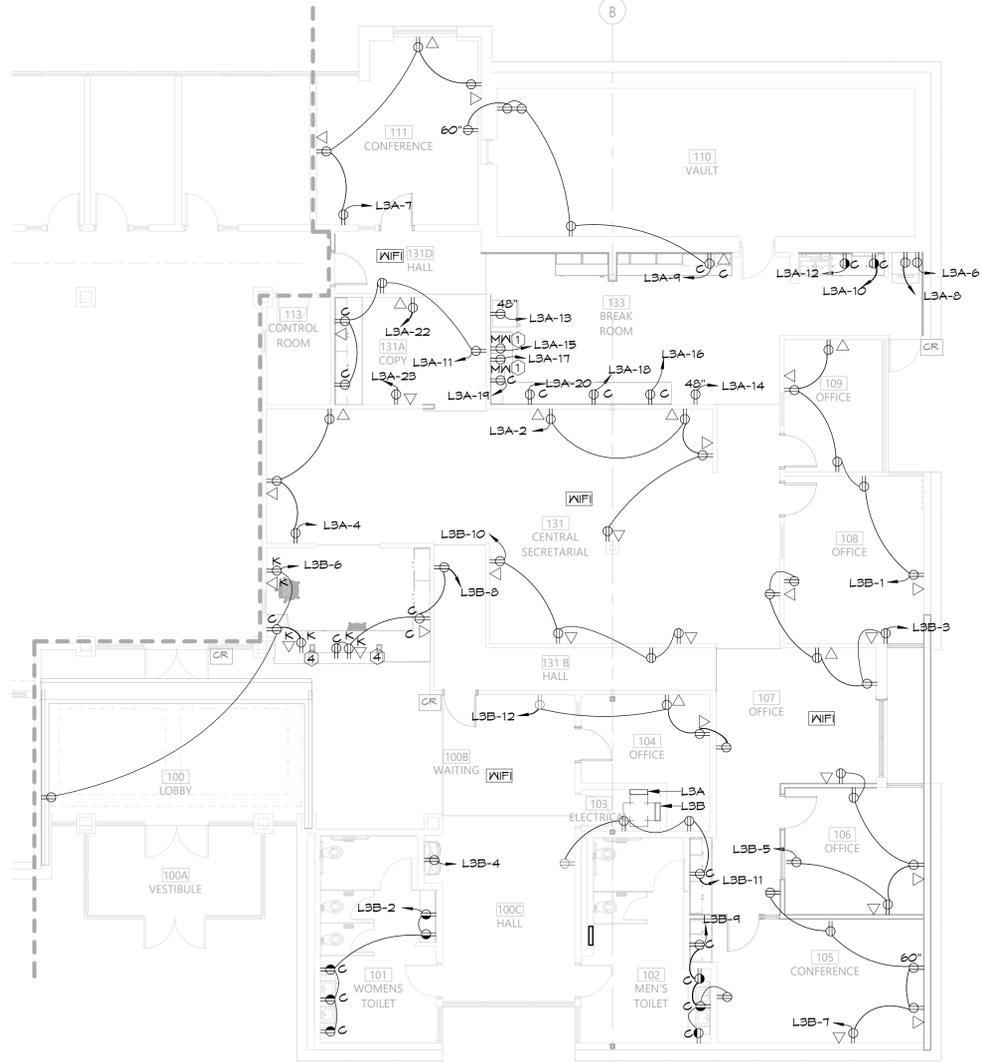

1 PHASE 3 - POWER PLAN
1/8" = 1'-0"

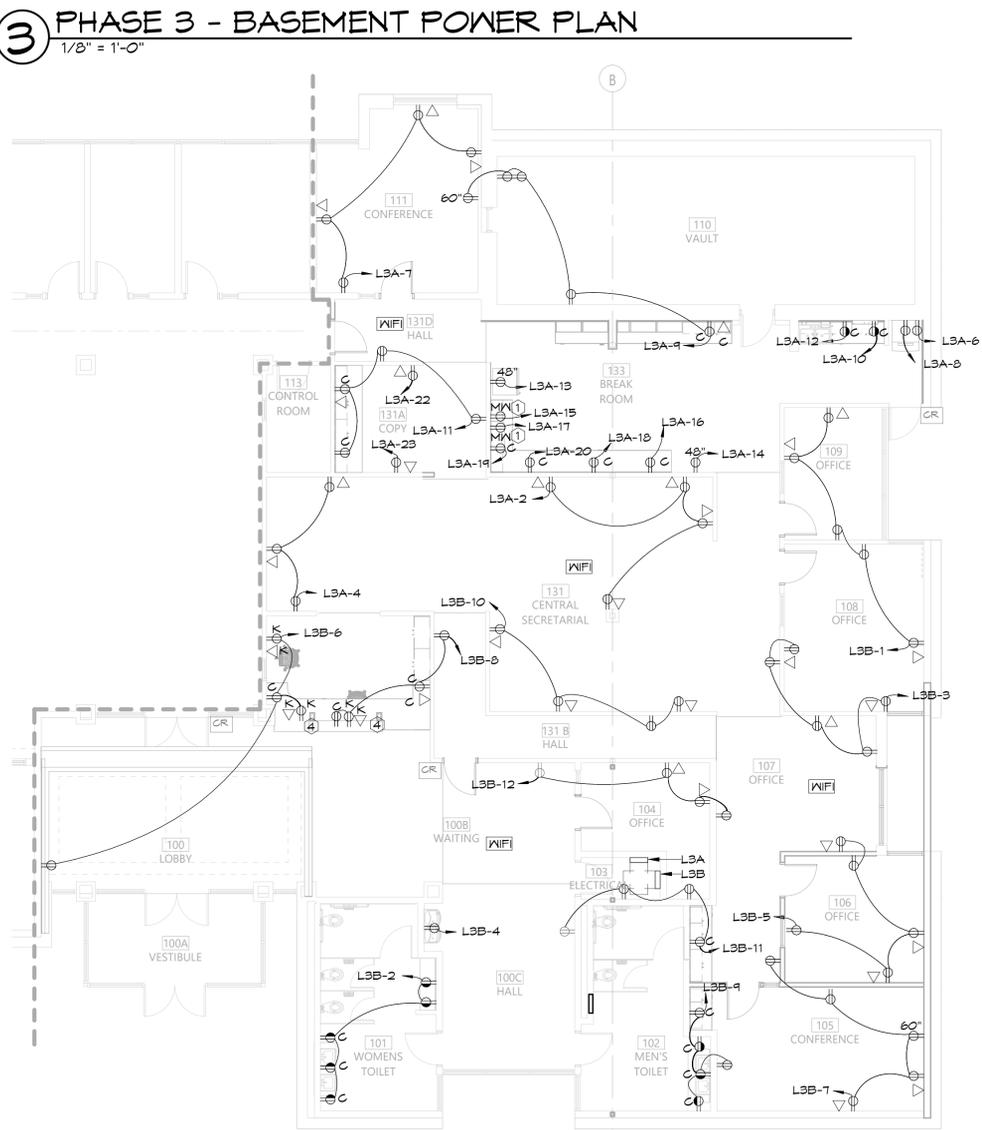

2 PHASE 3 - MECHANICAL POWER PLAN
1/8" = 1'-0"

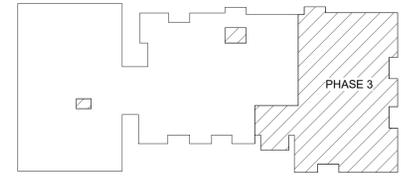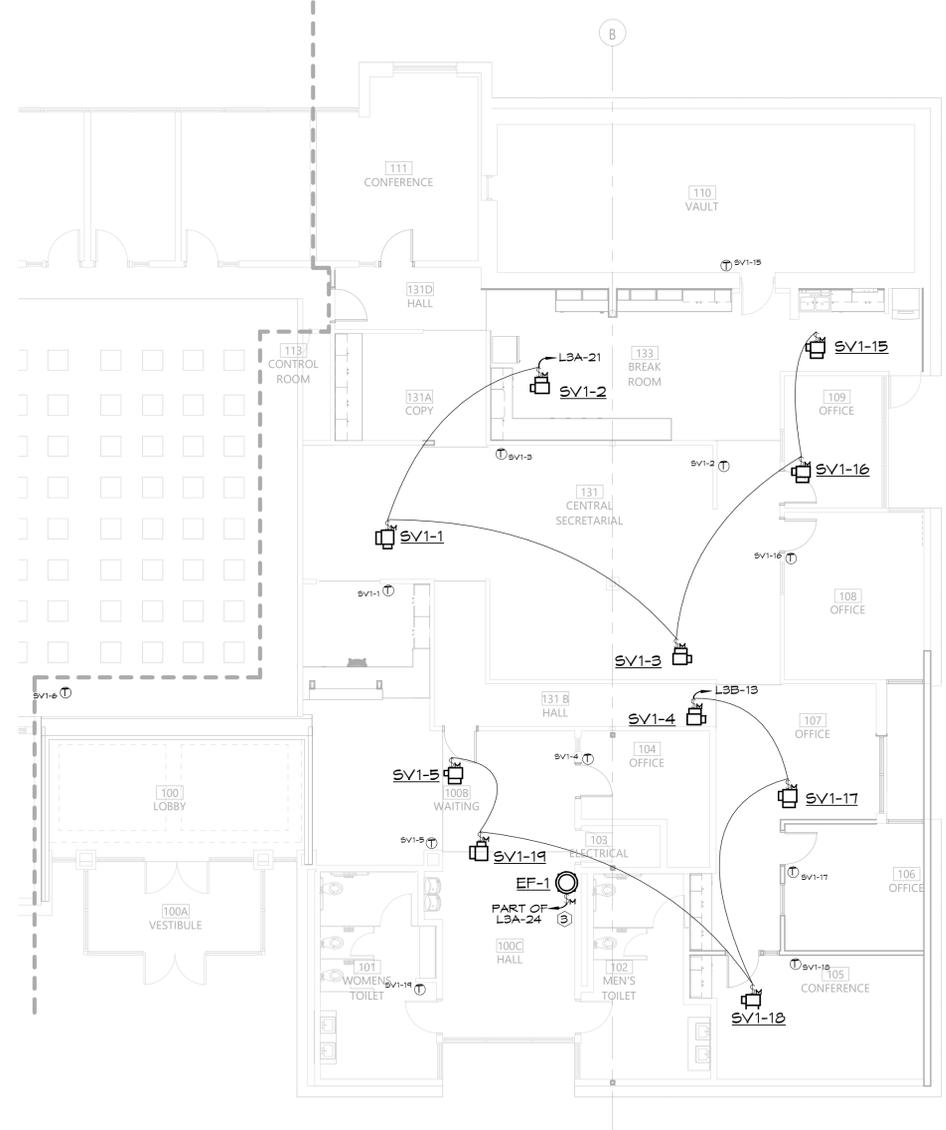

KEYPLAN

HSA HSAEngineering
479 / 452 / 8922 office
7405 Ellis St.
Fort Smith, AR 72916
HSAConsultants.com

