



FLOOR
PLANEXISTINGMECHANICAL
DEMOLITION



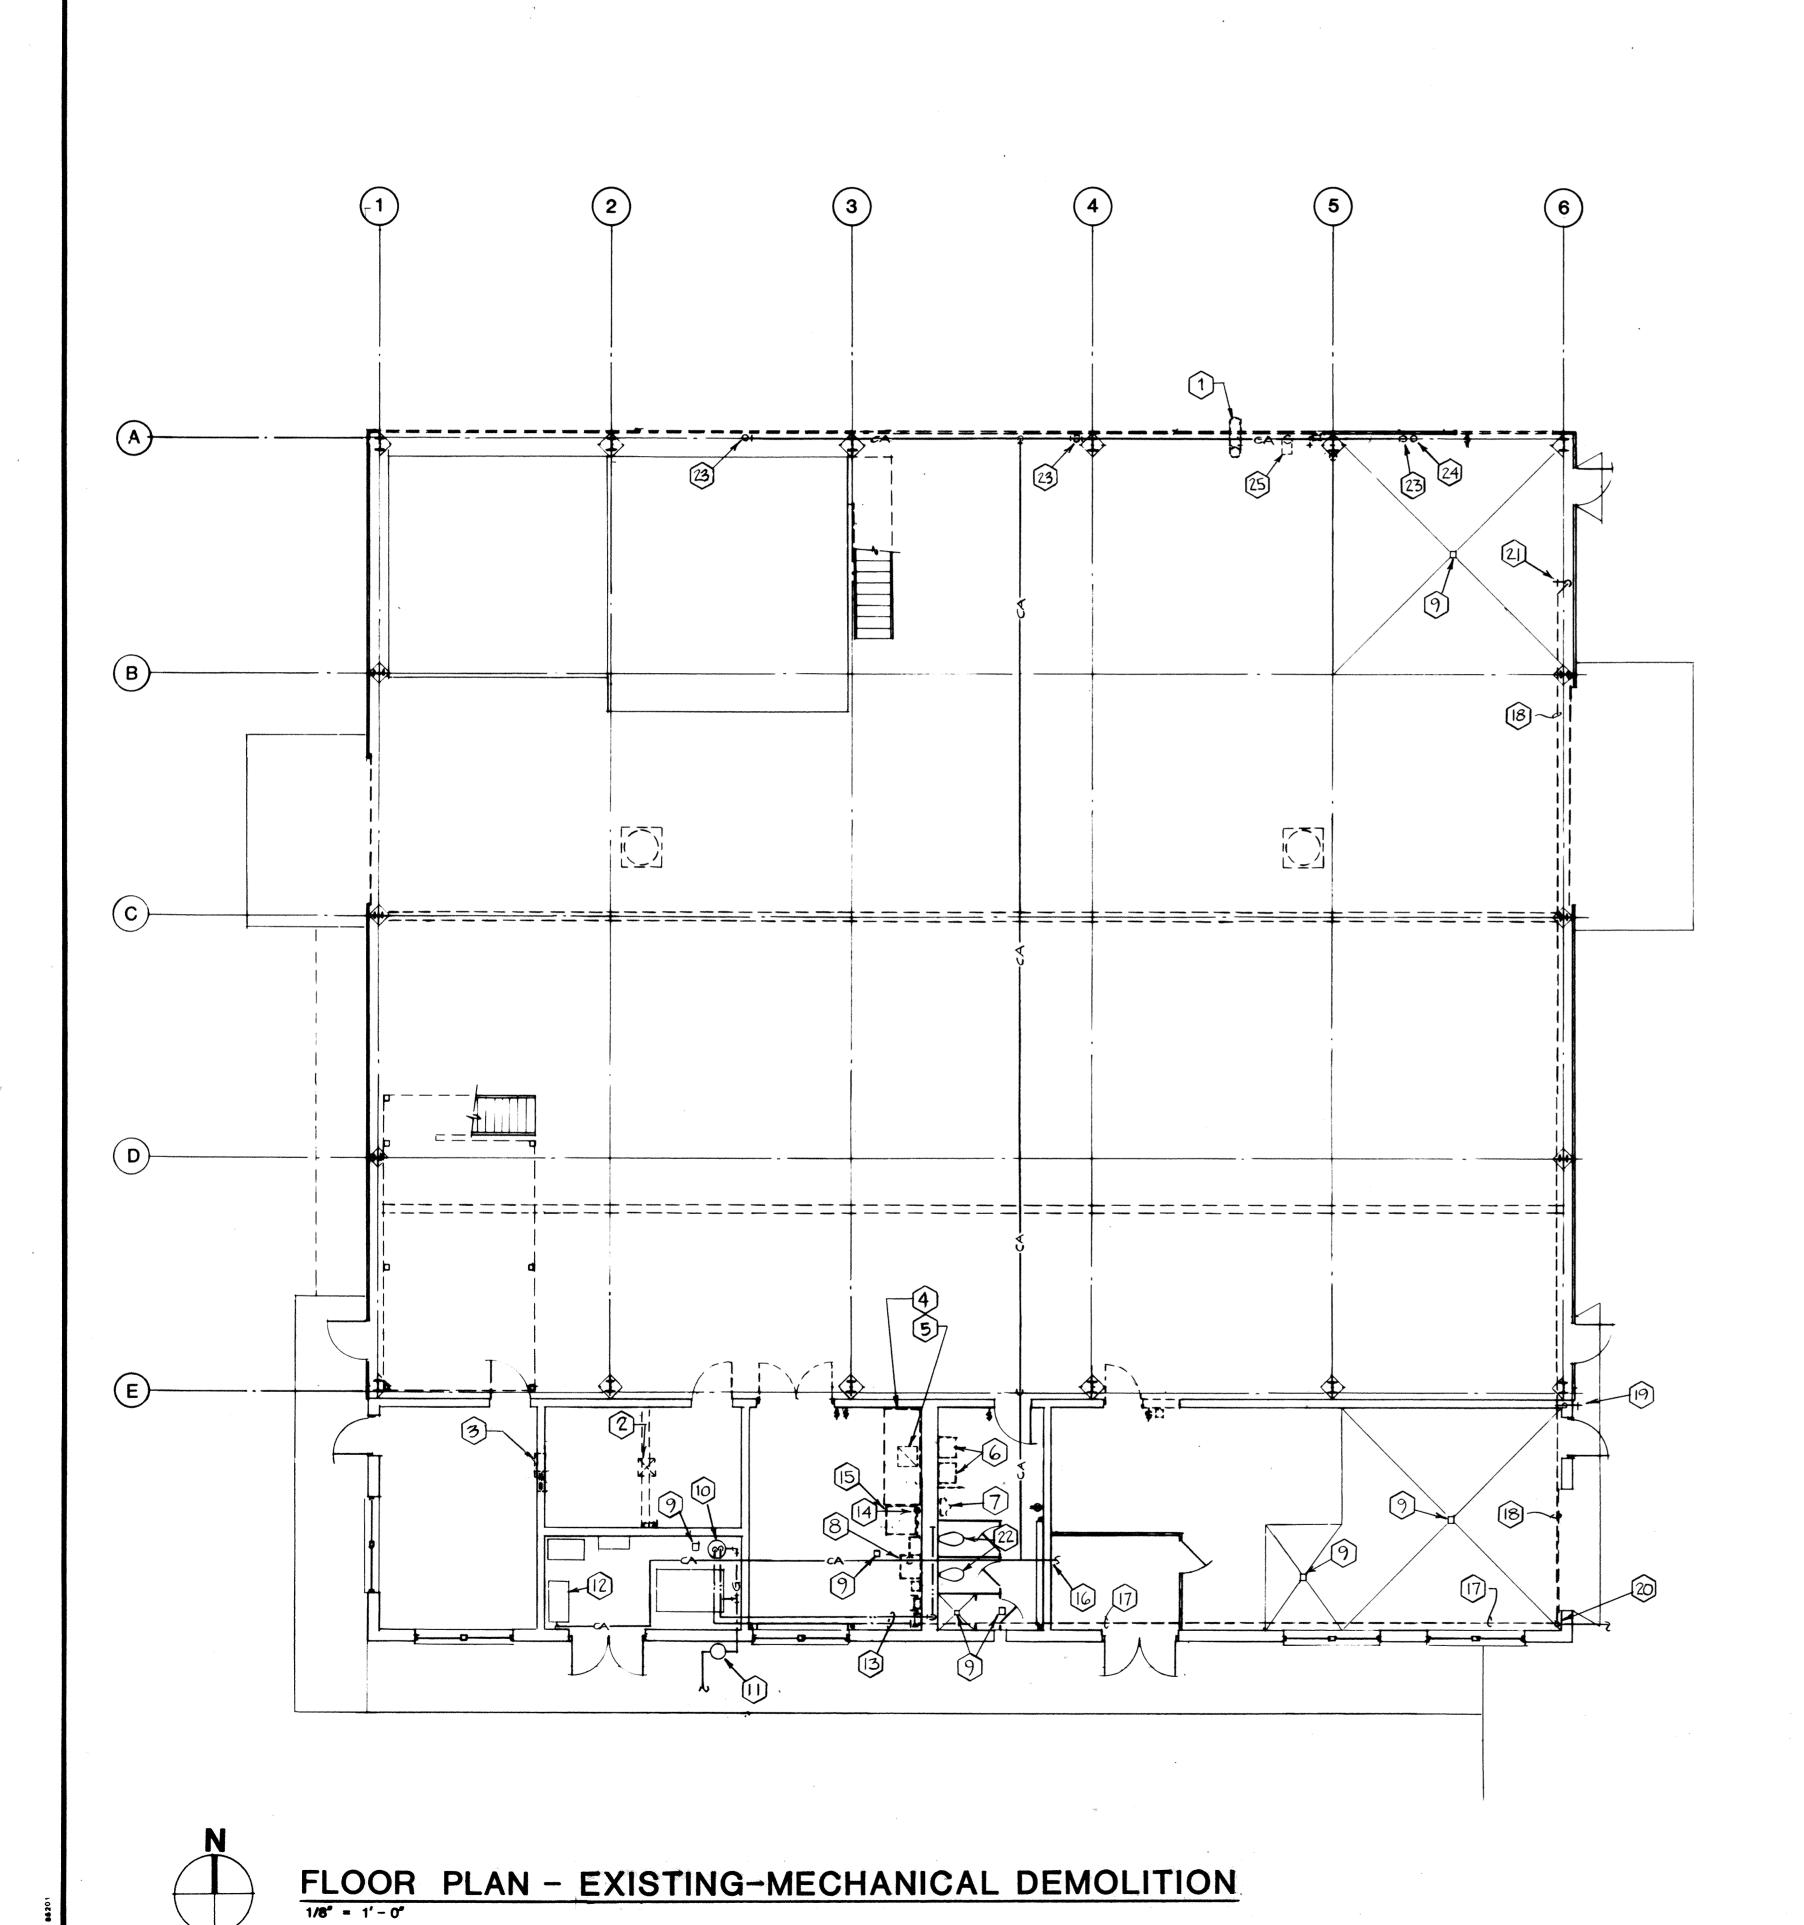

KEYED NOTES

- 1 REMOVE EXISTING EXHAUST DUCT.
- REMOVE AND RELOCATE EXISTING SUPPLY DIFFUSER.
- REMOVE EXISTING RETURN AIR TRANSFER GRILLES, WALL SLEEVE, AND BAROMETRIC DAMPER. REPAIR WALL TO MATCH EXISTING CONDITIONS.
- REMOVE EXISTING EXHAUST HOOD AND EXHAUST FAN ON ROOF.
- REMOVE EXISTING EXHAUST DUCT UP TO BOTTOM OF BAR JOIST. LEAVE DUCT THROUGH ROOF AND CURB. PROVIDE SHEET METAL RAIN CAP OVER CURB UNTIL NEW FAN IS INSTALLED.
- REMOVE EXISTING LAVATORY, WASTE, AND WATER SUPPLY PIPING.
- REMOVE EXISTING URINAL, WASTE AND WATER SUPPLY PIPING.
- REMOVE EXISTING SERVICE SINK AND WATER PIPING. CAP EXISTING WASTE AND VENT PIPING AS REQUIRED FOR CONCEALMENT.
- EXISTING FLOOR DRAIN TO REMAIN, CLEAN, AND BUFF.
- EXISTING WATER HEATER TO REMAIN.
- EXISTING GAS SERVICE, PRV, AND ALL GAS PIPING TO REMAIN.
- EXISTING AIR COMPRESSOR TO REMAIN.
- EXISTING HOT AND COLD WATER TO REMAIN.
- REMOVE EXISTING COMPRESSED AIR OUTLET AND PIPING UP TO MAIN AND CAP.
- REMOVE EXISTING EMERGENCY SHOWER AND EYE-WASH. REMOVE WATER SUPPLY PIPING.
- EXISTING COMPRESSED AIR PIPING AND OUTLETS ON THIS BRANCH TO REMAIN.
- REMOVE EXISTING 1-1/2" COLD WATER (SHOWN DASHED).
- REMOVE EXISTING 3/4" COLD WATER (SHOWN DASHED).
- EXISTING FREEZE-PROOF HOSE BIBB TO REMAIN.
- EXISTING 2" COLD WATER SERVICE INTO BUILDING TO REMAIN.
- EXISTING HOSE BIBB TO REMAIN.
- EXISTING WATER CLOSETS TO REMAIN (SEE SPECIFICATIONS, ITEM WC-2 OF PLUMBING FIXTURES).
- REMOVE EXISTING COMPRESSED AIR OUTLET AND CAP PIPING.
- EXISTING VENT THROUGH ROOF TO REMAIN, REMOVE VENT FROM FLOOR TO ROOF LINE OF NEW CONSTRUCTION.
- REMOVE EXISTING COMPRESS AIR HOSE REEL AND CAP PIPING.