

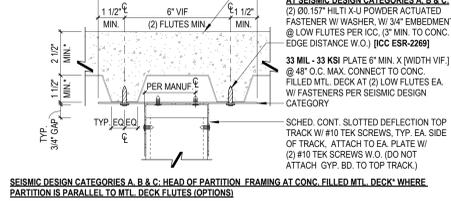
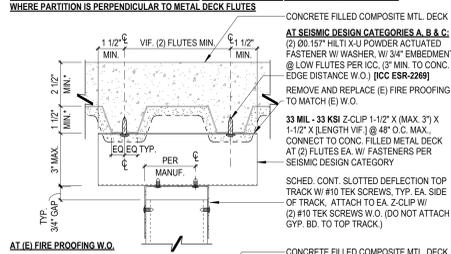
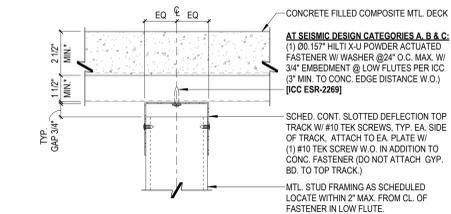
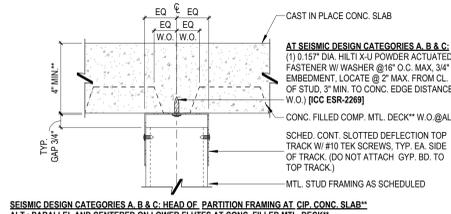
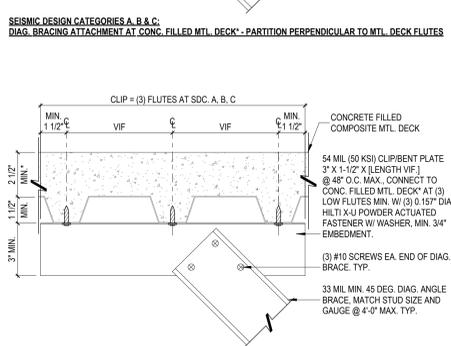






14 SOFFIT HEAD ATTACHMENT AT CONC. FILLED MTL. DECK/CIP. SLAB  
3" = 1'-0"

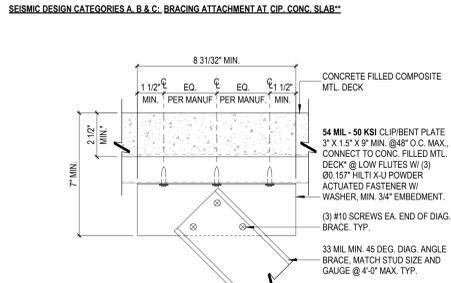




11 FULL HT. PARTITION HEAD ATTACHMENT AT CONC. FILLED MTL. DECK/CIP. SLAB  
3" = 1'-0"

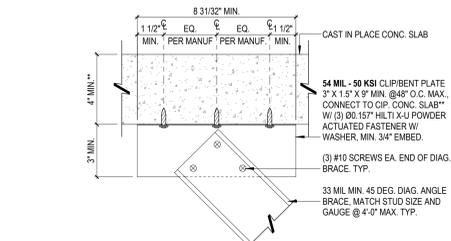

12 MTL. STUD BRACING ATTACHMENT AT CONC. FILLED MTL. DECK/CIP. SLAB  
3" = 1'-0"

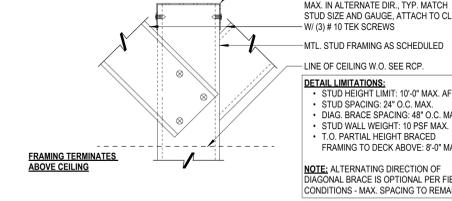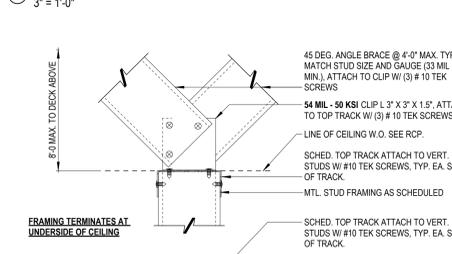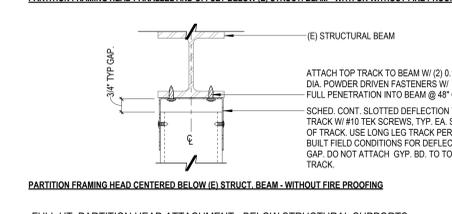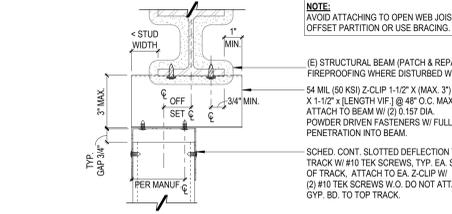


6 PARTIAL HEIGHT PARTITION HEAD BRACING ATTACHMENT  
3" = 1'-0"

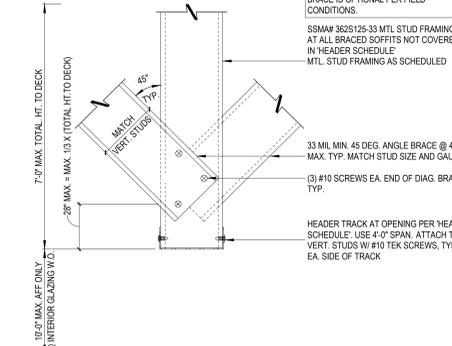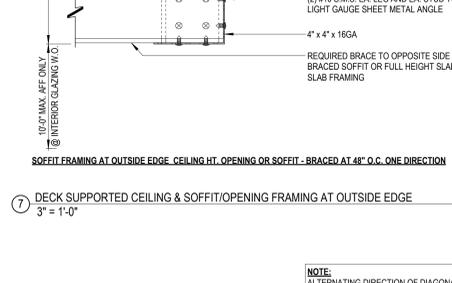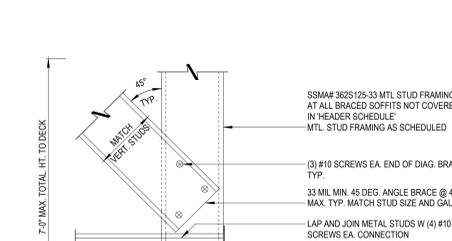




8 DECK SUPPORTED CEILING & SOFFIT/OPENING FRAMING  
3" = 1'-0"

**QUALIFICATIONS & ASSUMPTIONS**

- \*REQUIREMENTS FOR (E) METAL FILLED CONCRETE DECK:**
- MIN. 1 1/2" DECK W/ MIN. 2 1/2" CONCRETE TOPPING UNON.
  - MIN. TOTAL 4 3/4" DECK + CONCRETE TOPPING FOR SCREW ANCHOR ALTERNATE W.O.
- \*\*REQUIREMENTS FOR (E) CAST IN PLACE (CIP) CONCRETE SLAB:**
- THICKNESS: 4" MIN.
  - THICKNESS: 4 3/4" MIN. FOR SCREW ANCHOR ALTERNATE W.O.
- REQUIREMENTS FOR (N) PARTITION AND SOFFIT FRAMING:**
- SEE PARTITION SCHEDULE FOR MTL. FRAMING TYPE.
  - STUD SPACING: 24" O.C. MAX.
  - STUD HEIGHT LIMITATION: 15'-0" MAX. AFF.
  - STUD WALL WEIGHT: 10 PSF MAX.
  - LATERAL LOAD: 5 PSF MAX.
  - T.O. PARTIAL HEIGHT AND BRACED FRAMING TO DECK ABOVE: 8'-0" MAX.
- REQUIREMENTS FOR (N) SOFFIT FRAMING:**
- SSMA# 3625125-33 MTL. STUD FRAMING AT ALL BRACED SOFFITS NOT COVERED IN 'HEADER SCHEDULE'
  - \*\*\*SOFFIT DROP: 7'-0" MAX. FROM STRUCTURE ABOVE @ W.O. GLAZING BELOW
  - HEIGHT OF GLAZING BELOW SOFFITS: 10'-0" MAX. AFF.
  - STUD & CONNECTION SPACING: 24" O.C. MAX.
  - BRACE SPACING: 48" O.C. MAX.
  - STUD WALL WEIGHT: 10 PSF MAX.
- \* DETAILS APPLICABLE FOR INTERIOR METAL STUD FRAMING AT CAST IN PLACE CONC. SLAB, CONCRETE FILLED METAL DECK OR UNFILLED METAL DECK AT ROOF UNON.**
- PROVIDE IN WRITING ANY AS BUILT FIELD DISCREPANCIES WITH THESE CONDITIONS, AND COORDINATE WITH ARCHITECT BEFORE START OF WORK.
  - REFER TO OPENING FRAMING JAMB - HEADER - SILL SCHEDULES FOR MEMBER SIZING.
- \*\*\* MAX. LIMITS APPLY TO REFERENCED DETAILS ONLY. COORDINATE WITH PARTITION SCHEDULE.**

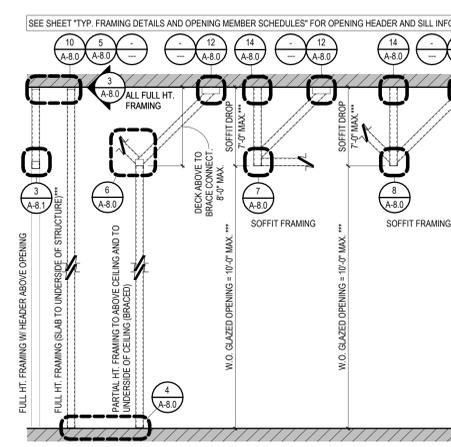

2 TYPICAL INTERIOR PARTITION FRAMING ATTACHMENT DIAGRAMS  
NTS.

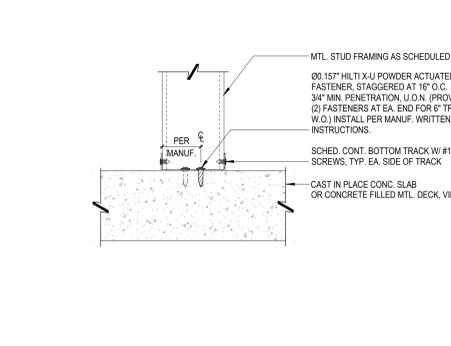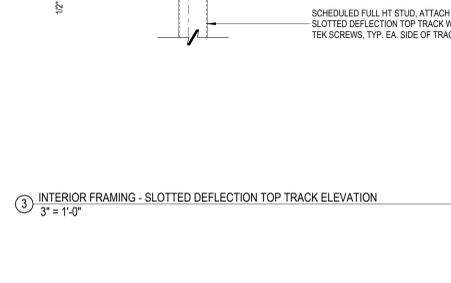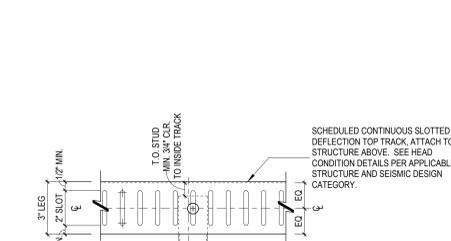

4 INTERIOR FRAMING - SILL AT CONC. FILLED MTL. DECK/CIP SLAB  
3" = 1'-0"



**SC JOHNSON AR - STE 300 RENOVATION**

903 N. 47TH ST. STE 300  
ROGERS, AR 72756



2	5	ISSUE FOR BID & PERMIT	01/07/2026
	2	90% CD REVIEW	11/11/2025
DELTA	ISSUE	DESCRIPTION	DATE



**NEW YORK**  
 100 BROADWAY 12th FLOOR  
 NEW YORK CITY, NY 10005  
 TEL 212-682-6909

©2025 INTERIOR ARCHITECTS, P.C., A NEW YORK PROFESSIONAL SERVICES CORPORATION. ALL DRAWINGS AND WRITTEN MATERIAL HEREIN CONSTITUTE THE ORIGINAL AND UNPUBLISHED WORK OF THE ARCHITECT AND THE SAME MAY NOT BE REPRODUCED, USED, OR DISCLOSED WITHOUT THE WRITTEN CONSENT OF THE ARCHITECT.

Owner Approval  
 05SCJIS.0037.000 As Indicated  
 Job No. Scale

**TYP. MTL. STUD FRAMING DETAILS - SDC A, B, C**

**A-8.0**