



1 ACCESSIBLE MANEUVERING CLEARANCES AT DOORS
1/4" = 1'-0"

NOTE:
 * A PARALLEL APPROACH COMPLYING WITH SECTION 305 SHALL BE PERMITTED TO A KITCHEN SINK IN A SPACE WHERE A COOK TOP OR CONVENTIONAL RANGE IS NOT PROVIDED AND TO WET BARS.
 * FAUCET CONTROLS, SOAP DISP. OUTLETS ETC. REQUIRING MANUAL OPERATION MUST BE USABLE WITH ONE HAND AND NOT REQUIRE TIGHT GRASPING, PINCHING, OR TWISTING OF THE WRIST, THE FORCE REQUIRED TO ACTIVATE OPER. PARTS SHALL BE 5 LBS. MAX.; METERING FAUCETS W/ MANUAL OR TOUCH CONTROLS MUST REMAIN OPEN FOR AT LEAST 10 SEC. EXCEPT MOTION-ACTIVATED OR TOUCH-FREE FAUCETS AND DISPENSERS. ALL CONTROLS TO BE MOUNTED MAX. 46" AFF.
 * THE CABINET DEPTH MAY EXCEED THE 24" MAX. SIDE REACH, IF ALL ACCESSIBLE ELEMENTS ARE INSTALLED WITHIN THE 24" MAX. REACH RANGE, INCL. BUT NOT LIMITED TO FAUCET CONTROLS, PAPER AND SOAP DISPENSERS AND USER ACCESSIBLE POWER/DATE OUTLETS.

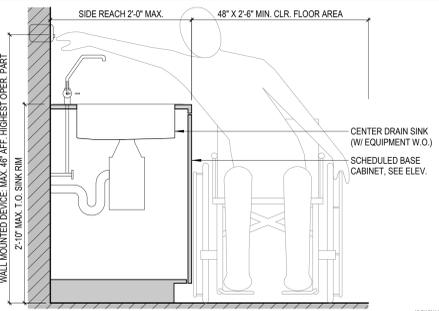


5 TYP. BASE CABINET W/ SIDE APPROACH SINK
1" = 1'-0"

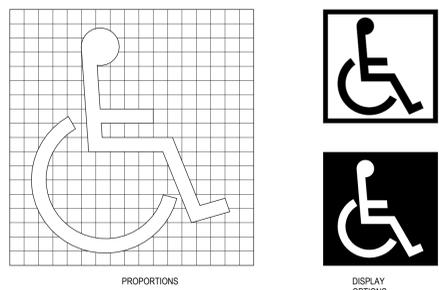


6 INTERNATIONAL SYMBOL OF ACCESSIBILITY
6" = 1'-0"

2 ACCESSIBILITY: LIMITS OF PROTRUDING OBJECTS
1/2" = 1'-0"


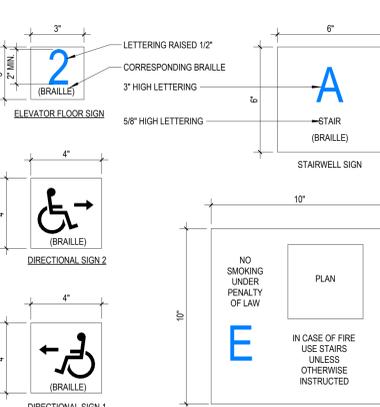


7 EVACUATION SIGNAGE
3" = 1'-0"


3 ACCESSIBLE VESTIBULE CLEARANCES
1/4" = 1'-0"

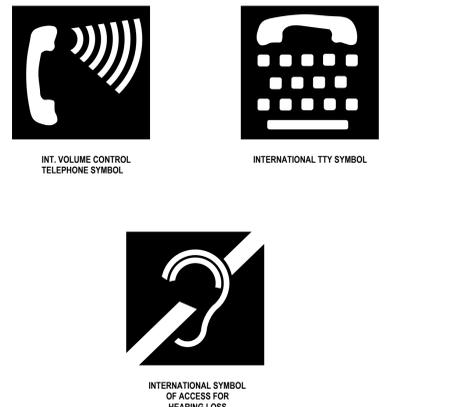


8 INT'L SYMBOL OF ACCESS FOR HEARING LOSS
N.T.S.

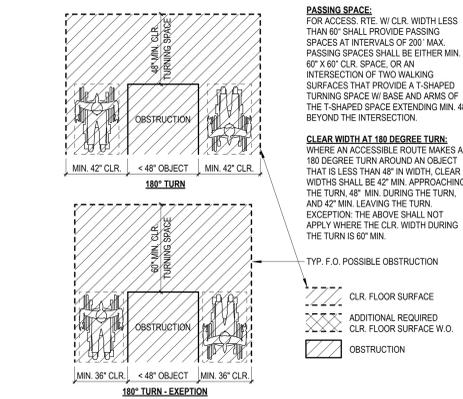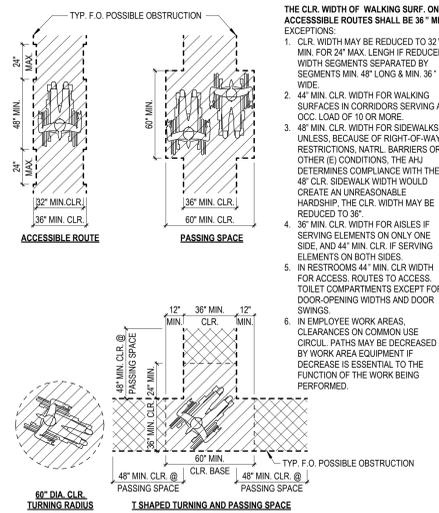

9 ACCESSIBLE ROUTE - CLEARANCES
1/4" = 1'-0"

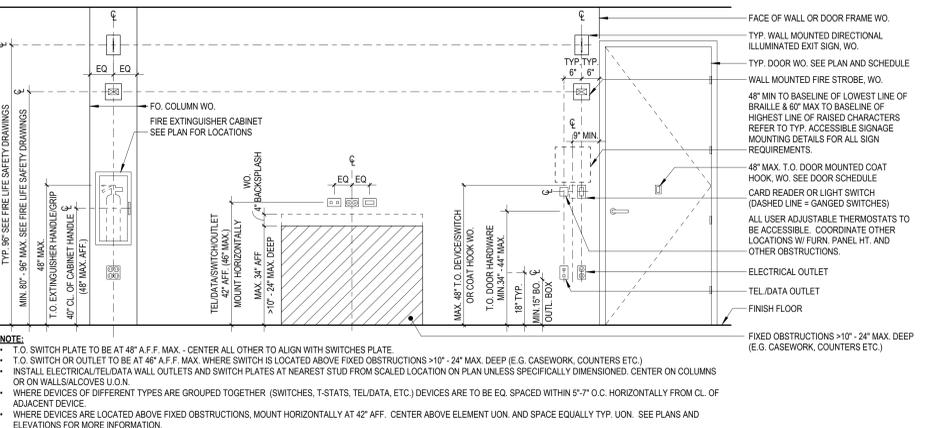

10 DEVICE MOUNTING HEIGHTS AND ALIGNMENT
1/2" = 1'-0"

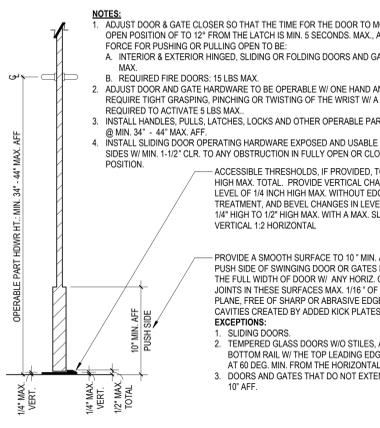

11 ACCESSIBLE DOOR HARDWARE
1 1/2" = 1'-0"

**SC JOHNSON AR - STE 300
RENOVATION**

**903 N. 47TH ST. STE 300
ROGERS, AR 72756**



DELTA	ISSUE	DESCRIPTION	DATE
2	5	ISSUE FOR BID & PERMIT	01/07/2026
	2	90% CD REVIEW	11/11/2025

IA INTERIOR ARCHITECTS

NEW YORK
100 BROADWAY 12th FLOOR
NEW YORK CITY, NY 10005
TEL 212-682-6909

©2026 INTERIOR ARCHITECTS, P.C., A NEW YORK PROFESSIONAL SERVICES CORPORATION.
ALL DRAWINGS AND WRITTEN MATERIAL HEREIN CONSTITUTE THE ORIGINAL AND UNPUBLISHED WORK OF THE ARCHITECT AND THE SAME MAY NOT BE REPRODUCED, COPIED, OR DISCLOSED WITHOUT THE WRITTEN CONSENT OF THE ARCHITECT.

Owner Approval
 05SCJIS.0037.000 As Indicated
 Job No. Scale

**ACCESSIBILITY NOTES &
DIAGRAMS**

AN-1.2