
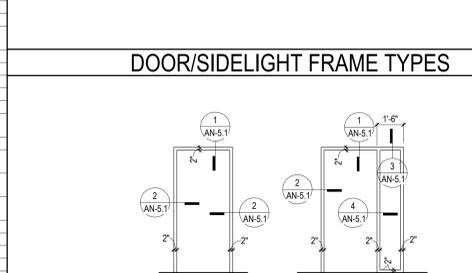


DOOR SCHEDULE														
NO.	ROOM NAME	CONFIGURATION	DOOR				FRAME			OPENING FIRE RATING	DOOR REMARKS			
			PANEL WIDTH	PANEL HEIGHT	PANEL THICKNESS	HARDWARE GROUP	PANEL FG	CORE	MATERIAL			FINISH	TYPE	MATERIAL
3000A	ELEV LOBBY	SINGLE	3'-0"	7'-0"	1 3/4"	AC-3.00	N	-	HM/GLASS	PAINTED	02	HM	PAINTED	PROVIDE CARD READER, ELECTRIC STRIKE (FAIL-SECURE), DOOR CONTACT AND REQUEST TO EXIT MOTION SENSOR, DOOR LEVER TO BE FREE ACTING ON THE PATH OF EGRESS. DOOR PANEL TO BE STAINED TO MATCH ELEVATOR LOBBY FINISH AND PAINTED TO MATCH ADJACENT WALL ON SUITE SIDE.
3001A	PUBLIC CORRIDOR	SINGLE	3'-0"	7'-0"	1 3/4"	AC-3.00	N	-	HM/GLASS	PAINTED	01	HM	PAINTED	PROVIDE CARD READER, ELECTRIC STRIKE (FAIL-SECURE), DOOR CONTACT AND REQUEST TO EXIT MOTION SENSOR, DOOR LEVER TO BE FREE ACTING ON THE PATH OF EGRESS.
3001B	PUBLIC CORRIDOR	SINGLE	3'-0"	7'-0"	1 3/4"	AC-3.00	N	-	HM/GLASS	PAINTED	01	HM	PAINTED	PROVIDE CARD READER, ELECTRIC STRIKE (FAIL-SECURE), DOOR CONTACT AND REQUEST TO EXIT MOTION SENSOR, DOOR LEVER TO BE FREE ACTING ON THE PATH OF EGRESS.
3001C	PUBLIC CORRIDOR	SINGLE	3'-0"	7'-0"	1 3/4"	AC-3.00	N	-	HM/GLASS	PAINTED	01	HM	PAINTED	PROVIDE CARD READER, ELECTRIC STRIKE (FAIL-SECURE), DOOR CONTACT AND REQUEST TO EXIT MOTION SENSOR, DOOR LEVER TO BE FREE ACTING ON THE PATH OF EGRESS.
3010	RECEPTION	SINGLE	3'-0"	7'-0"	1 3/4"	AC-3.00	FG	-	HM/GLASS	PAINTED	02	HM	PAINTED	PROVIDE CARD READER, ELECTRIC STRIKE (FAIL-SECURE), DOOR CONTACT AND REQUEST TO EXIT MOTION SENSOR, DOOR LEVER TO BE FREE ACTING ON THE PATH OF EGRESS.
3010A	REC. STO.	SINGLE	3'-6"	7'-0"	1 3/4"	AC-1.0	F	-	HM	PAINTED	01	HM	PAINTED	PROVIDE CARD READER, ELECTRIC STRIKE (FAIL-SECURE), DOOR CONTACT AND REQUEST TO EXIT MOTION SENSOR, DOOR LEVER TO BE FREE ACTING ON THE PATH OF EGRESS.
3011A	LARGE CONF.	SINGLE	3'-0"	7'-0"	1 3/4"	2.00	F	SOLID	WOOD	PAINTED	02	HM	PAINTED	PROVIDE ROOM SCHEDULER.
3011B	LARGE CONF.	SINGLE	3'-0"	7'-0"	1 3/4"	2.00	F	SOLID	WOOD	PAINTED	02	HM	PAINTED	PROVIDE ROOM SCHEDULER.
3012	LARGE CONF.	SINGLE	3'-0"	7'-0"	1 3/4"	2.01	F	SOLID	WOOD	PAINTED	02	HM	PAINTED	PROVIDE ROOM SCHEDULER.
3013	SMALL CONF.	SINGLE	3'-0"	7'-0"	1 3/4"	2.01	F	SOLID	WOOD	PAINTED	02	HM	PAINTED	PROVIDE ROOM SCHEDULER.
3017	HUDDLE	SINGLE	3'-0"	7'-0"	1 3/4"	2.01	F	SOLID	WOOD	PAINTED	01	HM	PAINTED	PROVIDE ROOM SCHEDULER.
3020	STORAGE	SINGLE	3'-0"	7'-0"	1 3/4"	AC-1.0	F	-	HM	PAINTED	01	HM	PAINTED	PROVIDE CARD READER, ELECTRIC STRIKE (FAIL-SECURE), DOOR CONTACT AND REQUEST TO EXIT MOTION SENSOR, DOOR LEVER TO BE FREE ACTING ON THE PATH OF EGRESS.
3021A	CAFE	SINGLE	3'-0"	7'-0"	1 3/4"	3.03	FG	SOLID	WOOD/GLASS	PAINTED	02	HM	PAINTED	PROVIDE CARD READER, ELECTRIC STRIKE (FAIL-SECURE), DOOR CONTACT AND REQUEST TO EXIT MOTION SENSOR, DOOR LEVER TO BE FREE ACTING ON THE PATH OF EGRESS.
3021B	CAFE	SINGLE	3'-0"	7'-0"	1 3/4"	3.03	FG	SOLID	WOOD/GLASS	PAINTED	02	HM	PAINTED	PROVIDE CARD READER, ELECTRIC STRIKE (FAIL-SECURE), DOOR CONTACT AND REQUEST TO EXIT MOTION SENSOR, DOOR LEVER TO BE FREE ACTING ON THE PATH OF EGRESS.
3022	FOCUS	SINGLE	3'-0"	7'-0"	1 3/4"	2.01	F	SOLID	WOOD	PAINTED	02	HM	PAINTED	PROVIDE ROOM SCHEDULER.
3023	FOCUS	SINGLE	3'-0"	7'-0"	1 3/4"	2.01	F	SOLID	WOOD	PAINTED	02	HM	PAINTED	PROVIDE ROOM SCHEDULER.
3027	MED. CONF.	SINGLE	3'-0"	7'-0"	1 3/4"	2.01	F	SOLID	WOOD	PAINTED	02	HM	PAINTED	PROVIDE ROOM SCHEDULER.
3028	STORAGE	SINGLE	3'-0"	7'-0"	1 3/4"	AC-1.0	F	-	HM	PAINTED	01	HM	PAINTED	PROVIDE CARD READER, ELECTRIC STRIKE (FAIL-SECURE), DOOR CONTACT AND REQUEST TO EXIT MOTION SENSOR, DOOR LEVER TO BE FREE ACTING ON THE PATH OF EGRESS.
3029	SMALL CONF.	SINGLE	3'-0"	7'-0"	1 3/4"	2.01	F	SOLID	WOOD	PAINTED	02	HM	PAINTED	PROVIDE ROOM SCHEDULER.
3033	STORAGE	SINGLE	3'-0"	7'-0"	1 3/4"	AC-1.0	F	-	HM	PAINTED	01	HM	PAINTED	PROVIDE CARD READER, ELECTRIC STRIKE (FAIL-SECURE), DOOR CONTACT AND REQUEST TO EXIT MOTION SENSOR, DOOR LEVER TO BE FREE ACTING ON THE PATH OF EGRESS.
3034	OPEN OFFICE	SINGLE	3'-0"	7'-0"	1 3/4"	AC-1.0	F	-	HM	PAINTED	02	HM	PAINTED	PROVIDE CARD READER, ELECTRIC STRIKE (FAIL-SECURE), DOOR CONTACT AND REQUEST TO EXIT MOTION SENSOR, DOOR LEVER TO BE FREE ACTING ON THE PATH OF EGRESS.
3035	IDF	SINGLE	3'-0"	7'-0"	1 3/4"	AC-1.0	F	-	HM	PAINTED	01	HM	PAINTED	PROVIDE CARD READER, ELECTRIC STRIKE (FAIL-SECURE), DOOR CONTACT AND REQUEST TO EXIT MOTION SENSOR, DOOR LEVER TO BE FREE ACTING ON THE PATH OF EGRESS.
3038	FOCUS	SINGLE	3'-0"	7'-0"	1 3/4"	2.01	F	SOLID	WOOD	PAINTED	02	HM	PAINTED	PROVIDE ROOM SCHEDULER.
3037	SMALL CONF.	SINGLE	3'-0"	7'-0"	1 3/4"	2.01	F	SOLID	WOOD	PAINTED	02	HM	PAINTED	PROVIDE ROOM SCHEDULER.
3039	SMALL CONF.	SINGLE	3'-0"	7'-0"	1 3/4"	2.01	F	SOLID	WOOD	PAINTED	02	HM	PAINTED	PROVIDE OVERHEAD DOOR STOP.
3040	FOCUS	SINGLE	3'-0"	7'-0"	1 3/4"	2.01	F	SOLID	WOOD	PAINTED	02	HM	PAINTED	PROVIDE OVERHEAD DOOR STOP.
E3003	BUILDING STORAGE	SINGLE	3'-0"	7'-0"	1 3/4"	EX.00	F	EXISTING	EX TO REMAIN	PAINTED	01	EX HM	PAINTED	PROVIDE OVERHEAD DOOR STOP.
E3004	JANITORS CLOSET	SINGLE	3'-0"	7'-0"	1 3/4"	EX.00	F	EXISTING	EX TO REMAIN	PAINTED	01	EX HM	PAINTED	PROVIDE OVERHEAD DOOR STOP.
E3006	ELECTRICAL ROOM	SINGLE	3'-0"	7'-0"	1 3/4"	EX.00	F	EXISTING	EX TO REMAIN	PAINTED	01	EX HM	PAINTED	PROVIDE OVERHEAD DOOR STOP.
E3014	HUDDLE	SINGLE	3'-0"	7'-0"	1 3/4"	2.01	F	SOLID	WOOD (NEW)	PAINTED	02	EX HM	PAINTED	PROVIDE OVERHEAD DOOR STOP.
E3015	SMALL CONF.	SINGLE	3'-0"	7'-0"	1 3/4"	2.01	F	SOLID	WOOD (NEW)	PAINTED	02	EX HM	PAINTED	PROVIDE OVERHEAD DOOR STOP.
E3016	FOCUS	SINGLE	3'-0"	7'-0"	1 3/4"	2.01	F	SOLID	WOOD (NEW)	PAINTED	02	EX HM	PAINTED	PROVIDE OVERHEAD DOOR STOP.
E3019	WELLNESS	SINGLE	3'-0"	7'-0"	1 3/4"	1.00	F	SOLID	WOOD (NEW)	PAINTED	01	EX HM	PAINTED	PROVIDE OVERHEAD DOOR STOP.
E3038	LARGE CONF.	SINGLE	3'-0"	7'-0"	1 3/4"	2.01	F	SOLID	WOOD (NEW)	PAINTED	02	EX HM	PAINTED	PROVIDE OVERHEAD DOOR STOP.
ES1	STAIR 1	SINGLE	3'-0"	7'-0"	1 3/4"	EX.00	N	-	EX HM	PAINTED	01	EX HM	PAINTED	PROVIDE ROOM SCHEDULER.
ES2	STAIR 2	SINGLE	3'-0"	7'-0"	1 3/4"	EX.00	N	-	EX HM	PAINTED	01	EX HM	PAINTED	PROVIDE ROOM SCHEDULER.

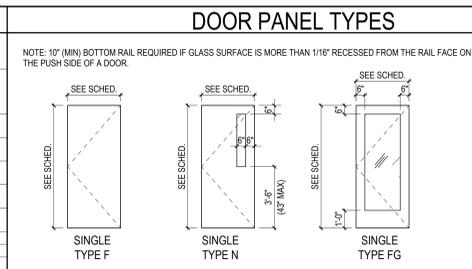

DOOR HARDWARE SCHEDULE

Set: E3019				
Quantity	Description	Model	Finish	Manufacturer
3	Hinge, Full Mortise	TA2714 4-1/2" x 4-1/2"	US260	MK
1	Privacy Lock w/ Indicator	10XU83 V33 MW	US260	SA
1	Surface Closer	7500H (reg. arm)	689	NO
1	Wall Stop	403	US260	RO
3	Silencer	608-RKW		RO

Set: 2.00				
Quantity	Description	Model	Finish	Manufacturer
3	Hinge, Full Mortise	TA2714 4-1/2" x 4-1/2"	US260	MK
1	Passage Latch	10XU115 MW	US260	SA
1	Surface Closer w/ Stop arm & H.O.	CPS7500T	689	NO
3	Silencer	608-RKW		RO

Set: 2.01				
Quantity	Description	Model	Finish	Manufacturer
4	Hinge, Full Mortise	TA2714 4-1/2" x 4-1/2"	US260	MK
1	Passage Latch	10XU115 MW	US260	SA
1	Surface Closer	7500 (reg. arm)	689	NO
1	H & J Smoke Seal	5880		PE

Set: 3.03				
Quantity	Description	Model	Finish	Manufacturer
4	Hinge (heavy weight)	TA43786 5" x 4-1/2"	US260	MK
1	Exit Device Rim, Passage	19 43 8815 ETMW	US320	SA
1	Surface Closer	7500 (reg. arm)	689	NO
1	Wall Stop	403	US260	RO
1	H & J Smoke Seal	5880		PE

Set: AC1.00				
Quantity	Description	Model	Finish	Manufacturer
3	Hinge, Full Mortise	TA2714 4-1/2" x 4-1/2"	US260	MK
1	Stemwind Lock	10XG24 MW	US260	SA
1	Electric Strike	1500C	630	HS
1	SMART Pac Bridge Rectifier	2005M3		HS
1	Surface Closer	7500 (arm as req.)	689	NO
1	Wall Stop	403	US260	RO
3	Silencer	608-RKW		RO
1	Card Reader	By Security Contractor		OT
1	Wiring Diagram	By Security Contractor		SA
1	ElectroLynx Harness	QC-C3000P (hinge/magnet/strike to power)		MK
1	Position Switch	DPS-M-BK		SU
1	Power Supply	ADL Series		SU

Notes: Electrically controlled opening. Door normally closed and locked. Egress allowed at all times. Entry by mechanical key or by presenting valid proximity card to card reader which will temporarily disengage the electric strike. Upon loss of power, door will remain locked. FAIL SECURE.

Manufacturer's Abbreviations:


MK - McKinley	AD - Adams Rite
OT - Other	SU - Securitron
MR - Manor	AT - Accurate Lock and Hardware
PE - Pemko	HS - HES
RO - Rockwood	RF - Rixon
SA - SARGENT	NO - Norton

DOOR & HARDWARE NOTES

- ALL (E) DOORS REQUIRING HARDWARE UPDATE/MODIFICATION: REPLACE DOOR AS REQUIRED TO MATCH (E) WITH NEWLY PREPARED DOORS AS SCHEDULED FOR NEW WORK. G.C. TO BE RESPONSIBLE TO MAINTAIN (E) UL-RATING OF DOOR AND FRAME ASSEMBLY AT RATED LOCATIONS.
- SEE DETAIL (1 AN-1-2) FOR TYPICAL DOOR CLEARANCES. ALL HARDWARE SHALL BE UNLOCKED IN THE DIRECTION OF EGRESS, REGARDLESS OF OTHER LOCK FUNCTIONS.
- ALL 20 MIN. UL RATED DOORS AND FRAME ASSEMBLIES TO HAVE S-LABEL.
- ALL RATED DOOR ASSEMBLIES SHALL BE UL AND NFPA APPROVED.
- ALL DOORS AND FRAMES TO BE INSTALLED PLUMB, STRAIGHT AND TRUE. MAINTAIN ADEQUATE TOLERANCES AND CLEARANCES SO THAT ALL DOORS FIT AS SPECIFIED AND SWINGS/SIDE PROPERLY. ANY DEVIATION FROM THIS WILL BE REJECTED BY OWNER AS UNACCEPTABLE AND WILL BE REPLACED AT SUPPLIER'S AND INSTALLER'S SOLE COST.
- PROVIDE ALL PARTS NECESSARY FOR PROPER OPERATION OF ALL DOORS.
- MAXIMUM DOOR OPENING EFFORT OF 5 LBS. AT INTERIOR DOORS AND EXTERIOR DOORS. 15 LBS. AT FIRE RATED DOORS.
- ALL DOORS IN THE REQUIRED PATH OF EGRESS EQUIPPED WITH ELECTRONIC LOCKING DEVICES SHALL HAVE THESE DEVICES RELEASE IN THE EVENT OF A FIRE ALARM ACTIVATION.
- ALL DOORS ARE EQUIPPED WITH SINGLE-EFFORT, NON-GRASP HARDWARE (I.E., LEVER OR LOOP) CENTERED BETWEEN 34" AND 44" ABOVE THE FLOOR.
- ALL DOORS MUST BE OPERABLE FROM THE INSIDE WITHOUT THE USE OF KEY, SPECIAL KNOWLEDGE OR EFFORT.
- ALL GLAZING AND SIDELITES TO BE CLEAR TEMPERED GLASS, UNON.
- ALL KEYED LOCKSETS TO BE SUPPLIED WITH BUILDING STANDARD CYLINDER.
- FIRE RATED DOORS AND FRAMES TO HAVE APPROVED FIRE RETARDANT BACKING. CONTRACTOR TO PROVIDE CERTIFICATION OF FIRE RETARDANT TREATMENT TO THE FIRE MARSHAL.
- DOOR HEIGHTS GIVEN IN THE DOOR SCHEDULE DO NOT INCLUDE THE DOOR FRAME.
- DO NOT UNDERCUT UL RATED DOORS. PROVIDE MINIMUM CLEARANCE ABOVE THRESHOLD OR ABOVE FINISHED FLOOR.
- CONTRACTOR TO PREP ALL DOORS AND FRAMES TO RECEIVE ELECTRIFIED HARDWARE AS REQUIRED FOR CARD READERS, INCLUDING CABLING, PROVIDING A RACEWAY FROM ELECTRIFIED HINGE TO POWER TRANSFER AND PROVIDING ALL HARDWARE INCLUDING ELECTRIFIED HINGES. ALL CARD READER DEVICES ARE FAIL-SAFE UNLESS OTHERWISE NOTED. ALL DOORS SCHEDULED TO RECEIVE CARD READERS PROVIDE FREE EGRESS AT ALL TIMES. CARD KEY ACCESS IS NEVER REQUIRED TO EXIT/EGRESS OUT OF ANY AREA OF THE BUILDING.
- AT PAINTED WOOD DOORS, PAINT DOOR AND FRAME TO MATCH ADJACENT WALL FINISH. UNON.
- PROVIDE THREE JAMB ANCHORS MINIMUM AT APPROXIMATE HINGE POINTS FOR DOORS UP TO 7'-6" H MAX. AND ONE BASE ANCHOR WITH TWO POWER ACTUATED FASTENERS PER JAMB.
- PROVIDE FRAME ROUGH OPENING DIMENSIONS AS RECOMMENDED BY FRAME MANUFACTURER.
- PROVIDE STANDARD FRAME PROFILE THROAT DIMENSIONS COMPATIBLE WITH AND AS DETERMINED BY SCHEDULED PARTITION TYPES.
- PROVIDE STRAPS, ANCHORS AND FRAMING ACCESSORIES AS REQUIRED FOR AS-BUILT FIELD CONDITIONS AS RECOMMENDED BY THE MANUFACTURER AND INDUSTRY STANDARDS.
- DOOR FRAMES SHALL BE SECURED IN PLACE WITH TWO FULL HEIGHT STUDS PER JAMB MIN.
- DOOR UNDERCUTS SHALL BE KEPT TO A MINIMAL DIMENSION BASED ON FLOOR FINISH MATERIAL, AND SHALL BE UNIFORM THROUGHOUT PROJECT. UNON.
- THROUGH-BOLTING WILL NOT BE ACCEPTED. REINFORCE DOORS INTERNALLY.
- ALL DOORS SHALL COMPLY WITH THE DOOR LANDING CLEARANCES FOR APPROACHES MEETING MINIMUM ADA REQUIREMENTS.
- SEQUENCE OF OPERATIONS FOR CARD READERS AT EXIT DOORS:
 - NORMAL BUSINESS HOURS - DOORS OPEN WITH CARD READER, FREE EGRESS
 - AFTER HOURS - DOORS OPEN WITH CARD READER, FREE EGRESS
 - FIRE ALARM - FREE EGRESS
- ALL NEW HARDWARE TO BE IN SATIN CHROME TO MATCH EXISTING. ALL NEW LEVERS TO BE "M" TYPE TO MATCH EXISTING TUBULAR TYPE.
- ALL NEW HARDWARE TO BE CYLINDRICAL LOCKSETS WITH CONVENTIONAL CYLINDERS (CLASS 3). KEYING TO BE MEDCO KEY SYSTEM BAXALX, MS.
- PROVIDE LATCH PROTECTOR, AS NEEDED, TO SECURE EXPOSED LATCH AND STRIKE AREAS ON THE SECURED SIDE OF THE DOOR.

GLAZING NOTES

- GLAZING TYPES PROVIDED ARE FOR DESIGN INTENT ONLY. CONTRACTOR SHALL FIELD VERIFY EACH APPLICATION. SUPPLY STRUCTURALLY APPROVED BY THE GLAZING MANUFACTURER OF A MINIMUM THICKNESS GREATER THAN OR EQUAL TO THE THICKNESS INDICATED, AND SHALL NOTIFY THE ARCHITECT OF DISCREPANCIES.
- GLASS HEIGHTS (H) INDICATED ARE UNSUPPORTED SPANS FROM BOTTOM TO TOP OF GLASS UNIT.
- HEAT STRENGTHENED GLASS CANNOT BE DRILLED, SANDED, ETCHED, AFTER FORMING.
- FOR ALL GLASS APPLICATIONS NOT LISTED, VERIFY SPECIFICATION WITH GLAZING MANUFACTURER.
- WHERE BOTTOM EDGE IS CLOSER TO THE FLOOR THAN INDICATED, USE NEXT THICKER SIZE OF GLASS (IN 1/8" INCREMENTS)
- NO WROD GLASS ALLOWED.

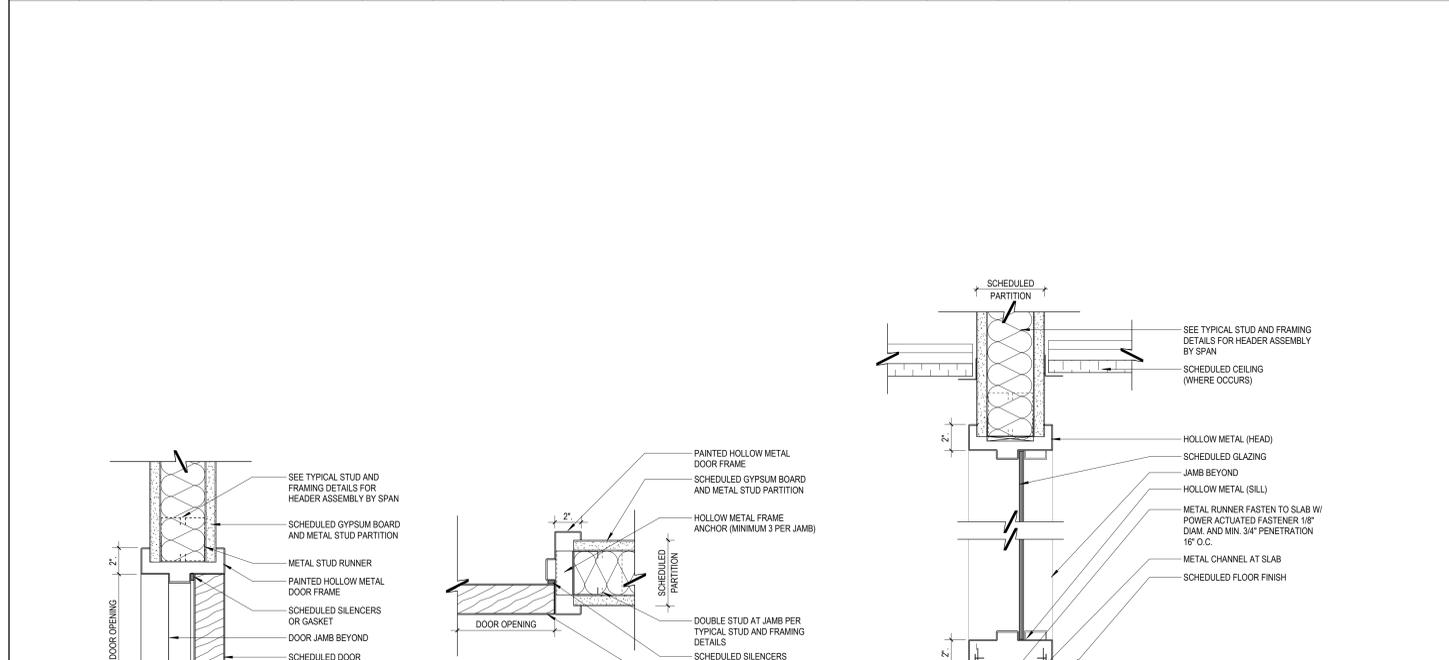

GLAZING TYPES

CATEGORY	SUB-CATEGORY	GLAZING MARK	THICKNESS	LAMINATED	TEMPERED	HEAT STRENGTHENED	LOW-IRON	CLARITY/SURFACE CONDITION	FINISHED EDGES	COMMENTS (EXCEPTIONS)
1.0 - DOORS	RAIL AND STYLE	GL-1.4	1/2"	YES/NO	YES/NO	NO	YES/NO	CLEAR	PENCIL OR FLAT POLISHED	<42" w x 108" h [IF LAMINATED CERTIFIED SAFETY GLAZING, TEMPERED IS NOT REQUIRED]
2.0 - SIDELIGHTS AND STOREFRONTS (OPENINGS)	THICKNESS FOR FULLY TEMPERED GLASS USED IN BUTT-GLAZED, FIXED INTERIOR PANELS MOUNTED OR RESTRAINED AT TOP AND BOTTOM ONLY. REFER TO COMMENTS SECTION FOR REQUIREMENTS OF ADJACENT PANELS LINKED W/ SILICONE JOINTS OR PERMANENT FASTENERS @ 48" O.C. MAX REQUIRED. MEETING REQUIREMENTS FOR 2018 IBC 1607.16 Interior walls and partitions AND 2403.4 Interior glazed areas	GL-2.3	1/2"	NO	YES	NO	YES/NO	CLEAR	PENCIL OR FLAT POLISHED	<48" w x 120" h (4'-0" w x 10'-0" h) IF LINKED WITH SILICON OR PERMANENT FASTENERS @ 48" O.C.

DOOR & HARDWARE NOTES

- ALL (E) DOORS REQUIRING HARDWARE UPDATE/MODIFICATION: REPLACE DOOR AS REQUIRED TO MATCH (E) WITH NEWLY PREPARED DOORS AS SCHEDULED FOR NEW WORK. G.C. TO BE RESPONSIBLE TO MAINTAIN (E) UL-RATING OF DOOR AND FRAME ASSEMBLY AT RATED LOCATIONS.
- SEE DETAIL (1 AN-1-2) FOR TYPICAL DOOR CLEARANCES. ALL HARDWARE SHALL BE UNLOCKED IN THE DIRECTION OF EGRESS, REGARDLESS OF OTHER LOCK FUNCTIONS.
- ALL 20 MIN. UL RATED DOORS AND FRAME ASSEMBLIES TO HAVE S-LABEL.
- ALL RATED DOOR ASSEMBLIES SHALL BE UL AND NFPA APPROVED.
- ALL DOORS AND FRAMES TO BE INSTALLED PLUMB, STRAIGHT AND TRUE. MAINTAIN ADEQUATE TOLERANCES AND CLEARANCES SO THAT ALL DOORS FIT AS SPECIFIED AND SWINGS/SIDE PROPERLY. ANY DEVIATION FROM THIS WILL BE REJECTED BY OWNER AS UNACCEPTABLE AND WILL BE REPLACED AT SUPPLIER'S AND INSTALLER'S SOLE COST.
- PROVIDE ALL PARTS NECESSARY FOR PROPER OPERATION OF ALL DOORS.
- MAXIMUM DOOR OPENING EFFORT OF 5 LBS. AT INTERIOR DOORS AND EXTERIOR DOORS. 15 LBS. AT FIRE RATED DOORS.
- ALL DOORS IN THE REQUIRED PATH OF EGRESS EQUIPPED WITH ELECTRONIC LOCKING DEVICES SHALL HAVE THESE DEVICES RELEASE IN THE EVENT OF A FIRE ALARM ACTIVATION.
- ALL DOORS ARE EQUIPPED WITH SINGLE-EFFORT, NON-GRASP HARDWARE (I.E., LEVER OR LOOP) CENTERED BETWEEN 34" AND 44" ABOVE THE FLOOR.
- ALL DOORS MUST BE OPERABLE FROM THE INSIDE WITHOUT THE USE OF KEY, SPECIAL KNOWLEDGE OR EFFORT.
- ALL GLAZING AND SIDELITES TO BE CLEAR TEMPERED GLASS, UNON.
- ALL KEYED LOCKSETS TO BE SUPPLIED WITH BUILDING STANDARD CYLINDER.
- FIRE RATED DOORS AND FRAMES TO HAVE APPROVED FIRE RETARDANT BACKING. CONTRACTOR TO PROVIDE CERTIFICATION OF FIRE RETARDANT TREATMENT TO THE FIRE MARSHAL.
- DOOR HEIGHTS GIVEN IN THE DOOR SCHEDULE DO NOT INCLUDE THE DOOR FRAME.
- DO NOT UNDERCUT UL RATED DOORS. PROVIDE MINIMUM CLEARANCE ABOVE THRESHOLD OR ABOVE FINISHED FLOOR.
- CONTRACTOR TO PREP ALL DOORS AND FRAMES TO RECEIVE ELECTRIFIED HARDWARE AS REQUIRED FOR CARD READERS, INCLUDING CABLING, PROVIDING A RACEWAY FROM ELECTRIFIED HINGE TO POWER TRANSFER AND PROVIDING ALL HARDWARE INCLUDING ELECTRIFIED HINGES. ALL CARD READER DEVICES ARE FAIL-SAFE UNLESS OTHERWISE NOTED. ALL DOORS SCHEDULED TO RECEIVE CARD READERS PROVIDE FREE EGRESS AT ALL TIMES. CARD KEY ACCESS IS NEVER REQUIRED TO EXIT/EGRESS OUT OF ANY AREA OF THE BUILDING.
- AT PAINTED WOOD DOORS, PAINT DOOR AND FRAME TO MATCH ADJACENT WALL FINISH. UNON.
- PROVIDE THREE JAMB ANCHORS MINIMUM AT APPROXIMATE HINGE POINTS FOR DOORS UP TO 7'-6" H MAX. AND ONE BASE ANCHOR WITH TWO POWER ACTUATED FASTENERS PER JAMB.
- PROVIDE FRAME ROUGH OPENING DIMENSIONS AS RECOMMENDED BY FRAME MANUFACTURER.
- PROVIDE STANDARD FRAME PROFILE THROAT DIMENSIONS COMPATIBLE WITH AND AS DETERMINED BY SCHEDULED PARTITION TYPES.
- PROVIDE STRAPS, ANCHORS AND FRAMING ACCESSORIES AS REQUIRED FOR AS-BUILT FIELD CONDITIONS AS RECOMMENDED BY THE MANUFACTURER AND INDUSTRY STANDARDS.
- DOOR FRAMES SHALL BE SECURED IN PLACE WITH TWO FULL HEIGHT STUDS PER JAMB MIN.
- DOOR UNDERCUTS SHALL BE KEPT TO A MINIMAL DIMENSION BASED ON FLOOR FINISH MATERIAL, AND SHALL BE UNIFORM THROUGHOUT PROJECT. UNON.
- THROUGH-BOLTING WILL NOT BE ACCEPTED. REINFORCE DOORS INTERNALLY.
- ALL DOORS SHALL COMPLY WITH THE DOOR LANDING CLEARANCES FOR APPROACHES MEETING MINIMUM ADA REQUIREMENTS.
- SEQUENCE OF OPERATIONS FOR CARD READERS AT EXIT DOORS:
 - NORMAL BUSINESS HOURS - DOORS OPEN WITH CARD READER, FREE EGRESS
 - AFTER HOURS - DOORS OPEN WITH CARD READER, FREE EGRESS
 - FIRE ALARM - FREE EGRESS
- ALL NEW HARDWARE TO BE IN SATIN CHROME TO MATCH EXISTING. ALL NEW LEVERS TO BE "M" TYPE TO MATCH EXISTING TUBULAR TYPE.
- ALL NEW HARDWARE TO BE CYLINDRICAL LOCKSETS WITH CONVENTIONAL CYLINDERS (CLASS 3). KEYING TO BE MEDCO KEY SYSTEM BAXALX, MS.
- PROVIDE LATCH PROTECTOR, AS NEEDED, TO SECURE EXPOSED LATCH AND STRIKE AREAS ON THE SECURED SIDE OF THE DOOR.



SC JOHNSON AR - STE 300 RENOVATION

903 N. 47TH ST. STE 300 ROGERS, AR 72756

