

**SC JOHNSON AR - STE 300
RENOVATION**

903 N. 47TH ST. STE 300
ROGERS, AR 72756




01/07/2026

GENERAL POWER NOTES

- REFER TO THE AV DRAWINGS FOR ALL INFRASTRUCTURE REQUIREMENTS, INCLUDING JUNCTION BOX SIZES, CONDUIT SIZES, MOUNTING HEIGHTS, ETC. AT THE MB# DETAILS/ELEVATIONS, ETC. POWER CONDUITS ARE NOT SHOWN. ALL POWER CONDUITS SHALL BE BY THE ELECTRICAL CONTRACTORS AS REQUIRED.
- REFER TO THE ARCHITECTURAL DRAWINGS FOR ALL INFRASTRUCTURE REQUIREMENTS, INCLUDING DEVICE LOCATIONS, SIZES, MOUNTING HEIGHTS, ETC.
- REFER TO ARCHITECTURAL DRAWINGS FOR ALL FULL HEIGHT PARTITIONS THAT GO TO THE DECK. PROVIDE SLEEVES AT THESE LOCATIONS.
- FLOOR MOUNTED CONNECTRAC SURFACE RACEWAY SYSTEM FURNISHED BY AV INSTALLER. POWER CONDUITS TO UNDER THE TABLE SHALL BE ROUTED IN THIS SURFACE RACEWAYS, TYPICAL.
- REFER TO DRAWING AN5.0 FOR A PARTIAL RESPONSIBILITY MATRIX.
- AT ALL DEVICES DENOTED WITH 'ER' (EXISTING TO REMAIN) REPLACE DEVICE, REUSE CONDUIT AND WIRING WHERE POSSIBLE. PROVIDE NEW AS REQUIRED, TYPICAL OF ALL.

KEYED POWER NOTES

- REFER TO THE AV000, AV001 AND AV401.0 DRAWINGS FOR ALL INFRASTRUCTURE REQUIREMENTS INCLUDING, JUNCTION BOX SIZES, LOW VOLTAGE CONDUITS, ETC. PROVIDE AN ADDITIONAL CONCEALED IN WALL CONDUIT FOR RECEPTACLE CIRCUITS FROM 'MB-1' JUNCTION BOXES UP TO ABOVE FINISHED CEILING AND DOWN TO THE TRANSITION FROM CONCEALED CONDUIT TO CONNECTRAC SURFACE RACEWAY SYSTEM. FLOOR MOUNTED CONNECTRAC FURNISHED BY AV INSTALLER, TYPICAL.
- SURFACE FLOOR MOUNTED CONNECTRAC FURNISHED AND INSTALLED BY THE AV INSTALLER. ROUTE POWER WIRING IN THE TRACK CONNECTOR.
- REFER TO THE AV000, AV001 AND AV401.0 DRAWINGS FOR ALL INFRASTRUCTURE REQUIREMENTS INCLUDING, JUNCTION BOX SIZES, LOW VOLTAGE CONDUITS, ETC. PROVIDE AN ADDITIONAL CONCEALED IN WALL CONDUIT FOR RECEPTACLE CIRCUITS FROM 'MB-1' JUNCTION BOXES UP TO ABOVE FINISHED CEILING AND DOWN TO THE TRANSITION FROM CONCEALED CONDUIT TO CONNECTRAC SURFACE RACEWAY SYSTEM. FLOOR MOUNTED CONNECTRAC, FURNISHED BY AV INSTALLER, TYPICAL.
- PROVIDE FLUSH WALL MOUNTED DOUBLE GANG DEEP BACKBOX WITH A REMOVABLE COVER WITH A 2" GROMMET OPENING FOR LOW VOLTAGE CABLING. PROVIDE EMPTY 2" C. WITH FULLSTRINGS STUBBED ABOVE NEAREST LAY IN CEILING, TYPICAL.
- PROVIDE FLUSH WALL MOUNTED JUNCTION BOX AND HARDWARE CONNECTION TO FURNITURE BASE FOR POWER, TYPICAL.
- REFER TO THE AV000, AV001 AND AV412.0 DRAWINGS FOR ALL INFRASTRUCTURE REQUIREMENTS INCLUDING, JUNCTION BOX SIZES, LOW VOLTAGE CONDUITS, ETC. PROVIDE AN ADDITIONAL CONCEALED IN WALL CONDUIT FOR RECEPTACLE CIRCUITS FROM 'MB-1' JUNCTION BOXES UP TO ABOVE FINISHED CEILING AND DOWN TO THE TRANSITION FROM CONCEALED CONDUIT TO CONNECTRAC SURFACE RACEWAY SYSTEM. FLOOR MOUNTED CONNECTRAC, FURNISHED BY AV INSTALLER, TYPICAL.
- PROVIDE TWO (2) 3/4" T X 3/8" X 4'-0" FIRE RATED PLYWOOD BACKBOARD. PAINT TO MATCH ADJACENT SURFACE. MOUNT BOTTOM OF BACKBOARD 20" AFF.
- PROVIDE 1/4" X 4" X 12" GROUNDING BAR. PROVIDE 1 #1/0 TO BUILDING GROUNDING SYSTEM.
- PROVIDE EMPTY 1" C. TO MB1.
- FOR DISHWASHER. MOUNT IN ADJACENT LOWER CABINET FOR ACCESS.
- PROVIDE FLUSH WALL MOUNTED DOUBLE GANG DEEP BACKBOX WITH A REMOVABLE COVER WITH A 1" GROMMET OPENING FOR LOW VOLTAGE CABLING. PROVIDE EMPTY 1" C. WITH FULLSTRINGS STUBBED ABOVE NEAREST LAY IN CEILING. REFER TO ARCHITECTURAL DRAWINGS FOR ADDITIONAL INFORMATION.
- STUB CONDUIT UP/CONCEALED IN MILLWORK. FLUSH MOUNT RECEPTACLES IN THE MILLWORK. COORDINATE WITH THE ARCHITECT. ROUTE CONDUIT IN THE CEILING OF THE FLOOR BELOW. COORDINATE ACCESS TO THE LOWER FLOOR TENANT WITH THE LANDLORD SEVEN BUSINESS DAYS PRIOR TO NEEDING ACCESS.
- PROVIDE DEVICES MOUNTED FLUSH IN THE MILLWORK. COORDINATE WITH THE ARCHITECT.

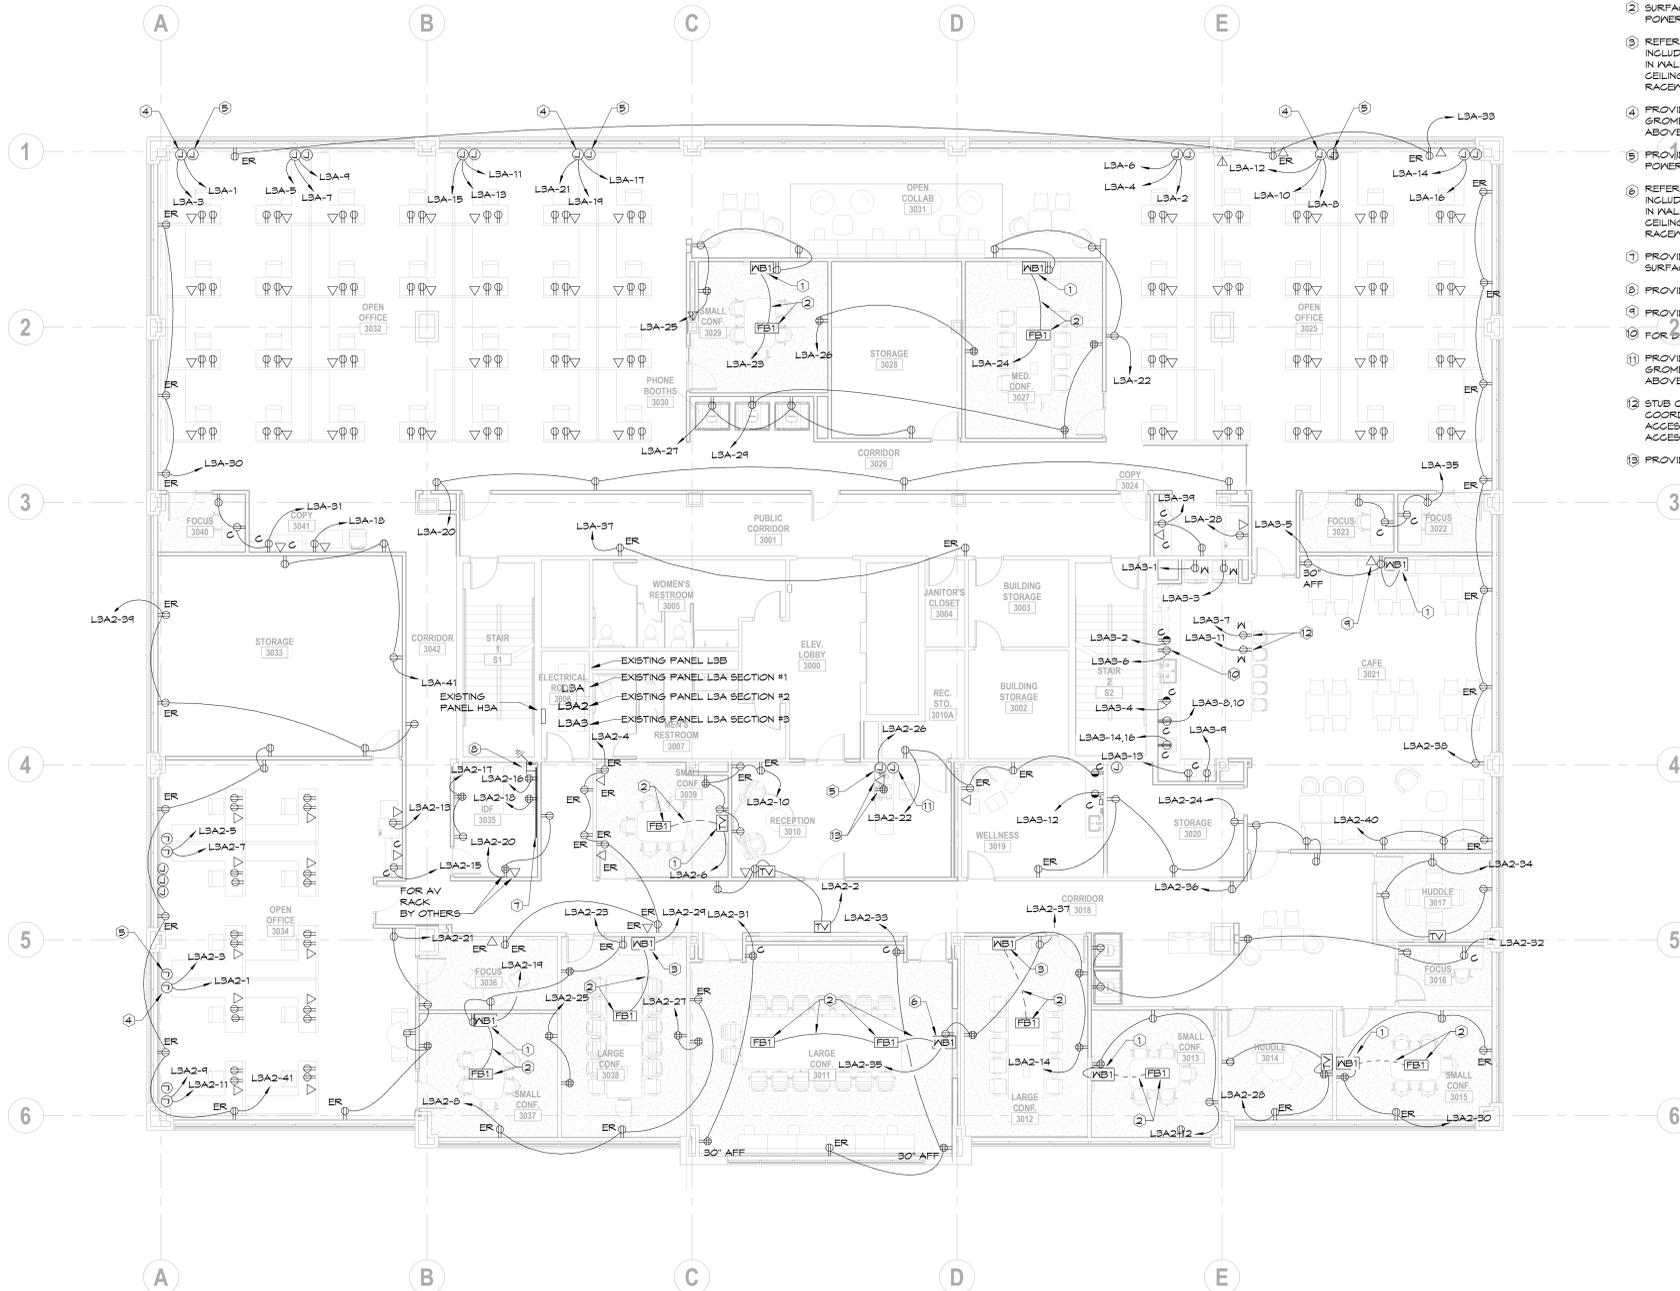

1 POWER PLAN
1/8" = 1'-0"



HSA Engineering
501 / 327 / 5757 office
515 Locust Avenue
Conway, Arkansas 72034
HSAConsultants.com

**POWER PLAN
E2.2**

Owner Approval _____
05SCJIS.0037.000 1/8" = 1'-0"
Job No. Scale

©2025 INTERIOR ARCHITECTS, P.C., A NEW YORK PROFESSIONAL SERVICES CORPORATION. ALL DRAWINGS AND WRITTEN MATERIALS HEREIN CONSTITUTE THE ORIGINAL AND UNPUBLISHED WORK OF THE ARCHITECT, AND THE SAME MAY NOT BE DUPLICATED, USED, OR DISCLOSED WITHOUT THE WRITTEN CONSENT OF THE ARCHITECT.