




**HVAC DEMO KEYED NOTES
(THIS SHEET ONLY)**

- ① REMOVE EXISTING SUPPLY GRILLE
- ② REMOVE EXISTING RETURN GRILLE
- ③ REMOVE & RETAIN EXISTING THERMOSTAT FOR RELOCATION
- ④ RELOCATED & RETAIN EXISTING MINI-SPLIT FOR RELOCATION. EXTEND PIPING AND ELECTRICAL CONNECTIONS TO NEW LOCATION AS SHOWN ON 1/MS.1.
- ⑤ REMOVE EXISTING BRANCH DUCTWORK.
- ⑥ REMOVE EXISTING FIRE SUPPRESSION HOOD ABOVE RESIDENTIAL RANGE.
- ⑦ REMOVE EXISTING FIRE SUPPRESSION PULL STATION.

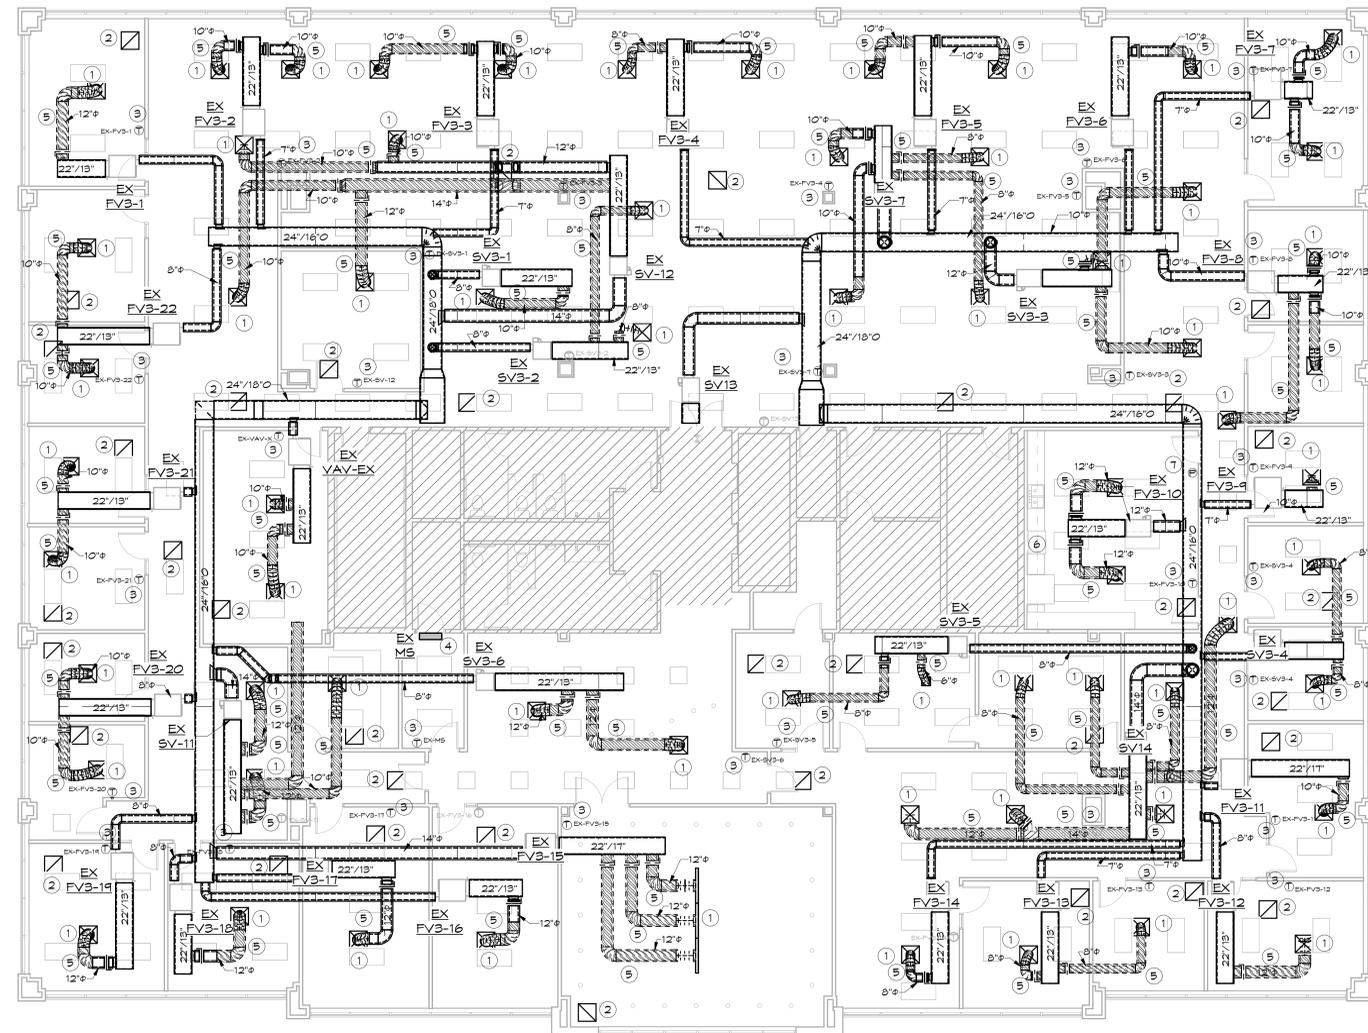

① HVAC DEMOLITION PLAN
1/8" = 1'-0"



NOTES:
REFER TO SHEET M1.1 FOR HVAC LEGEND, SCHEDULE, DETAILS, GENERAL AND KEYED NOTES.
REFER TO SHEETS M2.1 FOR HVAC PLANS.
REFER TO SHEETS MD2.1 FOR HVAC DEMOLITION PLANS.

HSA Engineering
501 / 327 / 5757 office
515 Locust Avenue
Conway, Arkansas 72034
HSAConsultants.com

HSA JOB #25-170

DELTA	ISSUE	DESCRIPTION	DATE

IA INTERIOR ARCHITECTS

NEW YORK
100 BROADWAY 12th FLOOR
NEW YORK CITY, NY 10005
TEL 212-682-6909

©2025 INTERIOR ARCHITECTS, P.C. A NEW YORK PROFESSIONAL SERVICES CORPORATION.
ALL DRAWINGS AND WRITTEN MATERIALS HEREIN CONSTITUTE THE ORIGINAL AND UNPUBLISHED WORK
OF THE ARCHITECT, AND THE SAME MAY NOT BE DUPLICATED, USED, OR DISCLOSED WITHOUT THE
WRITTEN CONSENT OF THE ARCHITECT.

Owner Approval _____
05SCJIS.0037.000 1/8" = 1'-0"
Job No. _____ Scale _____

MECHANICAL DEMO PLAN
MD2.1