

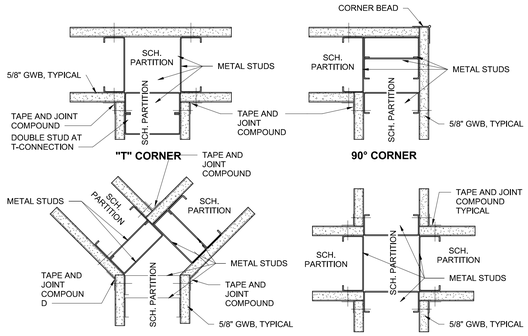


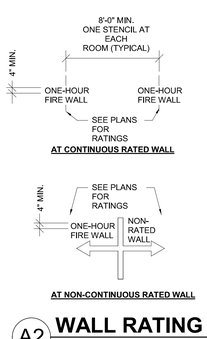



A2 WALL RATING LABELING


NOT TO SCALE

B1 PARTITION FRAMING DETAILS

3" = 1'-0"


PARTITION PRIORITIES (HIGHEST TO LOWEST):

1. 4-HOUR
2. 2-HOUR FIRE/SMOKE
3. 2-HOUR FIRE
4. 1-HOUR FIRE/SMOKE
5. 1-HOUR FIRE
6. NON-RATED SMOKE
7. NON-RATED

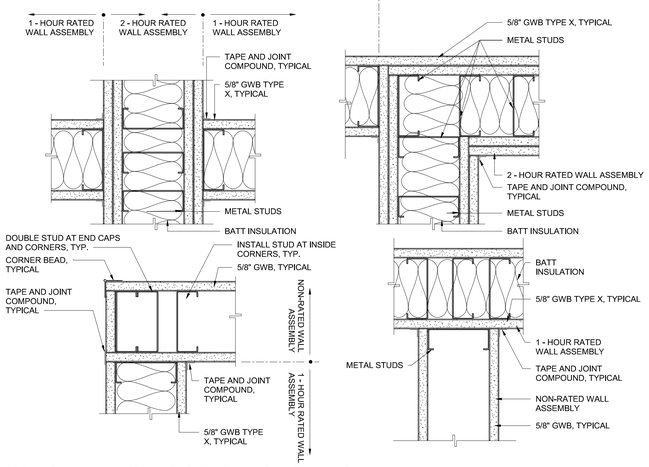



C1 PARTITION PRIORTY LEGEND

3" = 1'-0"

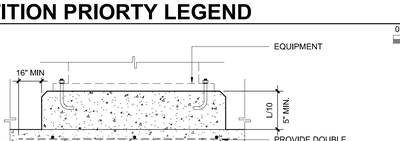


SECTION A-A (PAD POURED WITH SLAB)



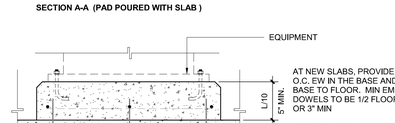

SECTION A-A (PAD NOT POURED WITH SLAB)




NOTES:

1. L & W TO BE 6" GREATER THAN THE EQUIPMENT MOUNTING PLATE / FOOTPRINT
2. PROVIDE 3/4" CHAMFER AROUND ENTIRE UPPER EDGE
3. PAINT ENTIRE PAD SAFETY YELLOW

VA STANDARD DETAIL SD230541-03

D1 EQUIPMENT PAD

1 1/2" = 1'-0"

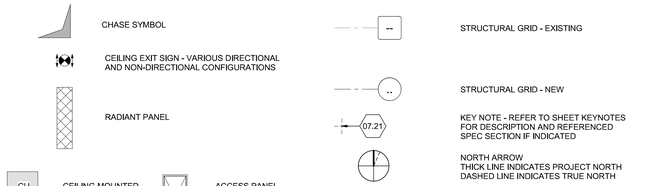

PARTITION GRAPHICS - PHASING

- EXISTING PARTITION / BARRIER / WALL TO REMAIN
- EXISTING PARTITION / BARRIER / WALL TO BE REMOVED
- NEW PARTITION / BARRIER / WALL
- TEMPORARY PARTITION

PARTITION GRAPHICS - RATINGS

- NO RATING
- NON-RATED CMU
- SMOKE-RESISTIVE PARTITION - NON RATED
- 1 HOUR FIRE BARRIER
- 1 HOUR FIRE/SMOKE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE BARRIER

D2 STANDARD SYMBOLS

1/4" = 1'-0"

GENERAL FLOOR PLAN NOTES

1. REFER TO SHEET GI001 FOR REQUIRED COORDINATION NOTES.
2. REFER TO SHEET GI501 FOR PARTITION TYPES, LEGENDS AND NOTES.
3. REFER TO SHEETS GI100 SERIES FOR PROJECT-WIDE LIFE SAFETY SCOPE OF RATED WALLS, BARRIERS, SMOKE RESISTENT PARTITIONS, SUITE DESIGNATIONS, EGRESS AND EXIT DISCHARGE INFORMATION.
4. REFER TO QH102 - QH106 FOR ENLARGED FLOOR PLANS AND AE410 & AE411 FOR 3D VIEWS INCLUDING MEDICAL EQUIPMENT NOT SHOWN IN AE100 SERIES PLANS.
5. DIMENSIONS ARE TO FINISH FACE OF WALL OR SOFFIT AND TO COLUMN CENTERLINE UON.
6. PROVIDE 3" GROMMETS 48" O.C. IN ALL COUNTERTOPS ABOVE OPEN KNEE SPACE. CENTER ON OUTLETS BELOW.
7. PARTITION TYPES AS NOTED BY THE SYMBOL CONTINUE BETWEEN ROOM/SPACE CORNERS OR ANY INTERSECTING PARTITION.
8. DIFFERING PARTITION TYPES SHALL ALIGN SO THAT WALL PLANES CONTINUE UNBROKEN WITHIN/ACROSS ROOMS AND/OR SPACES.
9. REFER TO SHEETS AE601 - AE602 FOR DOOR SCHEDULE & WINDOW TYPES.
10. DISTANCE FROM HINGE SIDE OF DOOR TO INTERSECTING STUD WALL SHALL BE 4" UNLESS NOTED OR DETAILED OTHERWISE (MEASURED FROM OUTSIDE OF FRAME)
11. CONTRACTOR SHALL VERIFY ALL DIMENSIONS NOTED AS "CLR", "CLEAR" OR "MIN". DIMENSIONS NOTED AS "HOLD" ARE CRITICAL TO COORDINATE OTHER WORK (E.G. CEILING GRIDS, LIGHTING, FINISHES).
12. CONTRACTOR SHALL VERIFY ALL DIMENSIONS PRIOR TO INITIATING CONSTRUCTION AND REPORT DISCREPANCIES TO COR PRIOR TO COMMENCING WORK.
13. CONTRACTOR SHALL PROVIDE ALL BLOCKING REQUIRED TO ANCHOR ALL WALL AND CLG MOUNTED ITEMS, INCLUDING BUT NOT LIMITED TO EQUIPMENT BLOCKING REQUIREMENT SCHEDULE ON SHEET QH601.
14. FIRE STOPPING SYSTEMS – REFER TO SPEC SECTION 07 84 00 FOR INFO REGARDING PENETRATIONS OF ALL RATED ASSEMBLIES (BOTH SINGLE AND DOUBLE MEMBRANE PENETRATIONS) INCLUDING BUT NOT LIMITED TO PENETRATIONS FOR DUCTWORK, CONDUIT, PIPING AND SUPPORT FOR WALL MOUNTED EQUIPMENT, CABINETS AND COUNTERTOPS.
15. IN SPACES WITH FLOOR DRAINS, SLOPE FLOORS TO DRAINS UON.

REFLECTED CEILING NOTES

1. CEILING HEIGHTS TO BE 8'-0" UON.
2. DIMENSIONS ARE TO FINISH FACE OF WALL OR SOFFIT UON.
3. RATED WALLS: ARE INDICATED IN PLAN AND RCP WITH GRAPHIC DENOTING HOURLY RATING AND/OR RESISTANT TO PASSAGE OF SMOKE. REFER TO PARTITION TAGS ON FLOOR PLAN SHEETS AE050 - AE109 AND PARTITION SCHEDULE ON SHEET GI501 FOR MORE INFORMATION.
4. GYPSUM BOARD SOFFITS: HEIGHT AFF TO MATCH ADJACENT CEILING OR TOP OF CASEWORK UON ON RCP.
5. CEILING MATERIAL TRANSITIONS, FLUSH AND NON-FLUSH CONDITIONS: REFER TO STANDARD DETAILS.
6. CEILING FINISHES/MATERIALS ARE NOTED ON FINISH SCHEDULE.
7. ACOUSTIC TILE CEILINGS TO BE CENTERED IN BOTH DIRECTIONS IN ROOM TYP. UON OR DIMENSIONED OTHERWISE. IF DIMENSION IS PROVIDED IN ONE DIRECTION ONLY, ASSUME GRID IS CENTERED IN OTHER DIRECTION.
8. CUT TILES SHALL BE NO SMALLER THAN 6 INCHES IN ANY DIRECTION. CLG FINISHES/MATLS NOTED ON TYPICALS FINISH SCHEDULE.
9. PLASTIC LAMINATE (PLAM) CLOSURE PANELS (IN LIEU OF GYP SOFFITS) OVER CASEWORK - SEE INT ELEV SERIES DWGS., REFLECTED CEILING PLAN SHEETS AE120-AE123, AND AE512 DETAILS.
10. CENTER LIGHT FIXTURE AND OTHER CEILING DEVICES WITHIN ACOUSTIC TILE UON. IF ONLY DIMENSIONED IN ONE DIRECTION, ASSUME DEVICE IS CENTERED IN THE OTHER DIRECTION.
11. EXIT SIGNAGE/LIGHTING SHOWN ON ELECTRICAL LIGHTING DRAWINGS.
12. SPRINKLER HEADS, SMOKE DETECTORS, NURSE CALL DEVICES, OTHER MISC ELECTRICAL DEVICES ARE SHOWN & DIMENSIONED ON ARCHITECTURAL RCPS FOR PUBLIC AREAS TYPICALLY, FOR ABOVE NAMED ITEMS NOT SHOWN, ORGANIZE DEVICES IN CENTER OF TILE OF SUSPENDED CLGS & ALIGN MULTIPLE DEVICES DOWN CORRIDORS AND THROUGHOUT LARGE ROOMS. COORD W/ OTHER TRADE'S DEVICES.
13. COORDINATE TOILET COMPARTMENT STEEL SUPPORTS WITH CEILING HEIGHTS.

GENERAL INTERIORS NOTES

1. REFER SHEET GI002 FOR GRAPHIC LEGEND OF WALL DEVICES AND TYPICAL MOUNTING HEIGHT UON.
2. REFER TO SHEETS AF501, AF601, AF602, & AE512 FOR WALL PROTECTION, & CORNER GUARDS (ELEVATIONS, TYPES, DETAILS, LOCATION, AND DEFINITIONS).
3. FOR TOILET ACCESSORIES, REFER TO SHEET GI002 FOR TYPICAL MOUNTING HEIGHT, UON.
4. REFER SHEETS AE514 AND AE515 FOR TYPICAL CASEWORK SECTIONS AND DETAILS.
5. REFER TO SHEETS AE601 AND AE602 FOR DOOR AND WINDOWS SCHEDULES, LEGEND AND DETAILS
6. REFER TO SHEETS AE120-AE123 FOR CEILING HEIGHTS.
7. REFER TO EQUIPMENT DRAWINGS FOR DISPLAY EQUIPMENT TYPES, SCHEDULE, ELEVATIONS AND DETAILS.
8. REFER NURSE EQUIPMENT SHEETS EY101 - EY104 FOR LOCATION AND NURSE CALL EQUIPMENT TYPES.
9. PROVIDE MINIMUM 1" FILLER PANELS AGAINST FINISH WALL PARTITIONS AND WHERE CASEWORK TURNS CORNER @ WALL AND BASE CABINETS, UON.
10. ALL COUNTERS TO BE 25" DEEP UON.
11. ALL WALL CABINETS TO HAVE PLAM SOFFIT, UON.
12. PROVIDE FINISH PANELS ON ALL EXPOSED SIDES AND BACKS OF BASE AND WALL CABINETS.
13. FOR COUNTERTOPS PROVIDE INTEGRAL SIDE SPLASHES AND BACK SPLASHES ON ALL ADJACENT WALLS.

GENERAL FINISH PLAN NOTES

1. NO T-SEAMS OR PARTIAL PIECES ACCEPTED FOR SEAMLESS FLOORING.
2. SEE SPECIFICATIONS IN CONJUNCTION WITH FINISH LEGENDS FOR FINISH INFORMATION.
3. ALL WALLS TO BE PAINTED P-2 UON.
4. ALL METAL DOOR FRAMES AND DOORS TO BE PAINTED DHM-01, SEE SHEET AF602 FOR MATERIALS LEGEND.
5. SEAMS FOR CARPET AND SEAMLESS FLOORING TO NOT BE LOCATED AT DOORWAYS.
6. REFER TO WALL PROTECTION TYPES FOR HEIGHTS, EXTENTS AND CLEARANCES AT OBSTRUCTIONS AND END CONDITIONS, SEE AF501 AND AE512.
7. TYPICAL FLOORING TRANSITIONS TO OCCUR UNDER OR AT CENTERLINE OF DOOR OPENINGS UON. SEE AF500 FOR INFORMATION.
8. LAY FLOORING WITH GRAIN RUNNING PERPENDICULAR TO CORRIDORS, UON.
9. PAINT TO BE SEMI-GLOSS IN TOILET ROOMS; FLAT ELSEWHERE, UON.
10. GROUT JOINTS TO ALIGN WITH FINISHED BASE OF WALL.
11. REFER TO FINISH PLANS FOR EXTENTS OF ACCENT WALL AND FLOORING MATERIALS.
12. ALL CORNER GUARDS TO BE FULL-HEIGHT FROM TOP OF BASE TO CEILING ABOVE (STOP 1/8" BELOW CEILING). REFER TO ELEVATIONS AND REFLECTED CEILING PLANS FOR HEIGHTS.
13. ALL TOILET PARTITIONS TO MATCH P-2 UON.

GENERAL PROJECT NOTES

1. REFER TO GENERAL REQUIREMENTS OF THE PROJECT SPECIFICATIONS FOR REQUIREMENTS RELATED TO WORK RESTRICTIONS, NOISE CONTROL, SECURITY, LIFE SAFETY, INFECTION CONTROL RISK ASSESSMENT.
2. REFER TO COVER SHEET FOR COORDINATION DRAWING REQUIREMENTS.
3. THE EXISTING CONDITIONS AND DEMOLITION WORK INDICATED IS INTENDED TO SHOW THE GENERAL SCOPE OF THE WORK. THE CONTRACTOR IS TO STUDY THE COMPLETE SET OF DOCUMENTS AND PERFORM ANY AND ALL DEMOLITION AND NEW CONSTRUCTION REQUIRED TO COMPLETE THE WORK SHOWN. VERIFY ALL EXISTING DIMENSIONS AND CONDITIONS AND REPORT ANY DISCREPANCIES IN CONDITIONS TO THE COR BEFORE BEGINNING OR CONTINUING WORK.
4. AT PROJECT COMPLETION, THE GENERAL CONTRACTOR SHALL PROVIDE TO THE COR AN "AS BUILT DRAWING" FOR THE WORK, REFER TO GENERAL REQUIREMENTS SECTION OF THE SPECIFICATIONS.
5. VERIFY AND ASCERTAIN THE LOCATION, DEPTH, DIRECTION, SIZE OF ANY AND ALL EXISTING UTILITIES IN THE GENERAL VICINITY OF THE WORK AREA. IT SHALL BE THE GENERAL CONTRACTOR'S RESPONSIBILITY TO REPAIR ANY UTILITY DISRUPTED, BROKEN, OR OTHERWISE RENDERED NON FUNCTIONAL DUE TO THE WORK PERFORMED AT NO ADDITIONAL COST TO THE VETERANS AFFAIRS DURING THIS COURSE OF WORK. THE GENERAL CONTRACTOR SHALL IDENTIFY ANY NON-FUNCTIONING UTILITY/SYSTEM PRIOR TO THE START OF WORK TO THE COR. IDENTIFICATION OF UTILITIES THE START OF WORK SHALL BE DEEMED AS DISTURBED/DAMAGED BY THE GENERAL CONTRACTOR AND SHALL BE REPAIRED AT THE EXPENSE OF THE GENERAL CONTRACTOR.
6. THE GENERAL CONTRACTOR SHALL PROPERLY SUPPORT ANY UTILITY ENCOUNTERED IN THE COURSE OF THIS WORK.
7. THE GENERAL CONTRACTOR SHALL PROVIDE STORAGE FOR MATERIALS. MATERIALS SHALL NOT BE STORED IN DEPARTMENT OF VETERANS AFFAIRS BUILDINGS, UNLESS AGREED TO BY VA.
8. COORDINATE MATERIAL STAGING AREAS WITH THE COR.
9. THE CONTRACTOR SHALL NOT LEAVE THE WORK AREA UNATTENDED FOR ANY REASON, UNLESS SAFETY PARTITIONS, SAFETY FENCING ARE INSTALLED AND SECURED.
10. THE GENERAL CONTRACTOR IS ADVISED THAT ANY RIGGING SHALL BE PERFORMED BY PROFESSIONAL RIGGERS AT THE EXPENSE OF THE GENERAL CONTRACTOR.
11. CONTRACTOR SHALL HAVE A REPRESENTATIVE ON SITE AT ALL TIMES DURING CONSTRUCTION ACTIVITIES.
12. REFER TO SPECIFICATIONS FOR GENERAL REQUIREMENTS OF THE CONTRACT.
13. INFECTION CONTROL, SAFETY AND PHASING: VERIFY REQUIREMENTS RELATED TO INFECTION CONTROL, DUST MITIGATION, SAFETY AND RISK ASSESSMENT. CONTRACTOR TO DEVELOP AND PUBLISH WORK PLAN ADDRESSING INFECTION CONTROL, SAFETY, AND PHASING FOR APPROVAL BY COR PRIOR TO BEGINNING THEIR WORK. PLAN TO INCLUDE MEANS AND METHODS OF DEBRIS STAGING AND REMOVAL, BOTH INTERNALLY AND EXTERNALLY. INFECTON CONTROL PLAN TO INCLUDE TEMPORARY DUST AND DEBRIS BARRIERS AND VESTIBULES AROUND PROJECT WORK AREAS. TEMPORARY BARRIERS ARE NOT TO RESTRICT REQUIRED MEANS OF EGRESS PATHS AND WIDTHS.
14. CONTRACTOR SHALL PROVIDE EGRESS SIGNAGE AS REQUIRED BY THE VA COR.
15. ALL PENETRATIONS THROUGH RATED FLOOR/CEILING ASSEMBLIES AND THROUGH FIRE RATED WALL AND SMOKE BARRIER ASSEMBLIES - THOSE CREATED BY REMOVAL OF DEMOLISHED ITEMS UNDER THIS CONTRACT AND THOSE DISCOVERED DURING CONSTRUCTION UNDER THIS CONTRACT AS A RESULT OF PREVIOUS WORK AND THOSE CREATED BY NEW WORK UNDER THIS CONTRACT - MUST BE SEALED AS PART OF THIS CONTRACT. ALL RATED SEPARATIONS MUST MEET CURRENT CODE REQUIREMENTS.
16. PROTECT EXISTING HORIZONTAL AND VERTICAL FIREPROOFING AND FIRE STOPPING DURING PROJECT. ONCE DEMOLITION IS COMPLETE, CONTRACTOR SHALL REPAIR ALL DAMAGED FIREPROOFING AND RESTORE MISSING FIREPROOFING, WHETHER A RESULT OF DEMOLITION OPERATIONS OR NOT, TO MEET REQUIRED RATING(S).
17. CONTRACTOR IS TO COORDINATE AND ADJUST DIMENSIONS OF HOUSEKEEPING AND EQUIPMENT PADS TO ACCOMMODATE FINAL EQUIPMENT SELECTIONS AT TIME OF SHOP DRAWING REVIEW.
18. INSTALL 24X24 ACCESS PANELS WHERE SHOWN ON DRAWINGS AND ONE (1) PER FLOOR DAMPER IN ADJACENT WALL, FOR RESETTING AND SERVICING DAMPER.

GENERAL DEMOLITION NOTES

1. THE EXISTING CONDITIONS AND DEMOLITION WORK INDICATED IS INTENDED TO SHOW THE GENERAL SCOPE OF THE WORK. THE CONTRACTOR IS TO STUDY THE COMPLETE SET OF DOCUMENTS AND PERFORM ANY AND ALL DEMOLITION AND NEW CONSTRUCTION REQUIRED TO COMPLETE THE WORK SHOWN. VERIFY ALL EXISTING DIMENSIONS AND CONDITIONS AND REPORT ANY DISCREPANCIES IN CONDITIONS TO THE COR BEFORE BEGINNING OR CONTINUING WORK.
2. ALL DEMOLITION WORK SHALL BE PERFORMED WITH "DUE CARE AND DILIGENCE" SO AS TO PREVENT THE ARBITRARY DESTRUCTION OR INTERRUPTION OF CONCEALED UTILITIES WHICH COULD NOT BE PREDETERMINED UNTIL DEMOLITION WAS STARTED. ALL SUCH DISCOVERIES OF UTILITIES DURING THE DEMOLITION PROCESS WHICH ARE IN A LOCATION DIFFERENT FROM FLOOR TO FLOOR, ETC., OR ARE UNIDENTIFIED SHALL BE REPORTED TO THE COR BEFORE REMOVAL FOR FINAL DISPOSITION.
3. REMOVE ALL CONSTRUCTION DESIGNATED TO BE REMOVED AND CLEAR TO RECEIVE NEW WORK AS HEREIN INDICATED.
4. REMOVE PORTIONS OF EXISTING CONSTRUCTION AS DRAWN AND PATCH TO MATCH ADJACENT CONSTRUCTION.
5. WHEREVER EXISTING EQUIPMENT, PIPING, DUCTS, ETC., ARE REQUIRED TO BE REMOVED, SUCH REMOVAL SHALL INCLUDE ALL ANCHORS, HANGERS, BRACING, FOUNDATION, ETC. AFTER REMOVAL, AFFECTED CONSTRUCTION AND SURFACES, SUCH AS FLOORS, WALLS, BASES, AND CEILINGS, SHALL BE FINISHED TO MATCH ADJACENT SURFACES UNLESS OTHERWISE NOTED.
6. NEW WORK AS A RESULT OF PATCHING SHALL ALIGN WITH AND MATCH EXISTING WORK EXCEPT WHERE OTHERWISE DIMENSIONED OR DETAILED.
7. ANY EXISTING CONDITIONS WHICH ARE INCONSISTENT WITH CONTRACT DRAWINGS RELEVANT TO THIS CONTRACT SHALL BE REPORTED TO THE COR.
8. WHERE DEMOLITION OR RELATED WORK LEAVES FLOOR SURFACES WITH IMPERFECTIONS OR NOT LEVEL TO TOLERANCES SPECIFIED FOR NEW WORK, PROVIDE SELF-LEVELING UNDERLAYMENT.
9. WHERE DEMOLITION WORK UNCOVERS OR LEAVES OPENINGS IN PARTITIONS OR INCOMPLETE PARTITIONS, EXTEND, RESTORE, AND/OR CLOSE OPENING IN PARTITION AS INDICATED AND/OR AS REQUIRED TO MAINTAIN FIRE RATINGS, MATCH EXISTING CONSTRUCTION, U.N.O., WITHIN THE LIMITS AND TOLERANCES FOR MATERIALS AS SPECIFIED OR RECOMMENDED BY THE MANUFACTURER. REFINISH SURFACES TO ALIGN FLUSH WITH EXISTING.
10. WHERE DEMOLITION WORK OR RELOCATION OF EXISTING ITEMS LEAVES UNFINISHED SURFACES AND/OR SUBSTRATES, CUT AND PATCH AS REQUIRED TO RESTORE SUBSTRATE AND/OR FINISH MATERIAL EVEN AND FLUSH WITH ADJOINING SURFACES. TEXTURE AND REFINISH TO MATCH EXISTING U.N.O.
11. CONTRACTOR SHALL DISPOSE OF ALL ITEMS PER SPECIFICATIONS. OWNER RESERVES THE RIGHT TO SELECT SPECIFIC ITEMS FOR SALVAGE. THESE ITEMS SHALL BE IDENTIFIED DURING A PRECONSTRUCTION WALKTHROUGH.
12. WALK-OFF MATS, THE CONSTUCTION BARRIER, AND NEGATIVE PRESSURE BY HEPA FILTRATION SHALL BE IN PLACE PRIOR TO START DEMOLITION AT THE MINIMUM AND PER THE ICRA.
13. HAZARDOUS MATERIAL ABATEMENT IS REQUIRED IN PROJECT SCOPE. REF. HA050 - HA102 FOR ADDITIONAL INFORMATION.
14. ALL OPENINGS AND SURFACES MADE BARE BY DEMOLITION AND/OR REMOVAL OF MATERIALS SHALL BE REPAIRED AND/OR PATCHED TO MATCH ADJACENT FINISH. PREPARE SURFACES TO RECEIVE NEW FINISH(S).
15. DISTURBANCE OF EXISTING MATERIALS ARE THE RESPONSIBILITY OF THE CONTRACTOR WITH REFERENCE TO PROPER LEGAL DISPOSAL, LEGAL ABATEMENT, PATCHING AND FINISHING. ALL DISTURBED AREAS AND MATERIALS SHALL MATCH EXISTING CONDITIONS.
16. COORDINATE WITH M/E/P DRAWINGS FOR ADDITIONAL DEMOLITION IN FLOORS, WALLS AND ROOFS & RELATED ITEMS AS REQUIRED TO ACCOMODATE NEW CONSTRUCTION OR UTILITIES ON THESE FLOORS OR RELATED ADJACENT FLOORS. PATCH/REPAIR BY EACH RESPECTIVE DISCIPLINE. COORDINATE DEMOLITION WITH OTHER DISCIPLINES. HOLES/PENETRATIONS IN RATED WALLS CREATED WHEN DEMOLITION OCCURS ARE TO BE FILLED TO MATCH THE EXISTING RATED CONDITION OR BETTER.
17. WHERE TILE FLOORING OR TERRAZO FLOOR AND BASE ARE REMOVED, PROVIDE FLOOR LEVELING AS REQUIRED TO CREATE A LEVEL FLOOR SURFACE WITH THE FLOORS THAT ARE TO REMAIN. PREPARE NEW SURFACE TO RECEIVE NEW FINISHES.
18. WHERE EXISTING WALL IS REMOVED, PROVIDE FLOOR LEVELING AS REQUIRED TO CREATE A LEVEL FLOOR SURFACE WITH THE FLOOR LEVELS AT EACH SIDE OF THE DEMO-ED WALL LOCATION. PREPARE NEW SURFACE TO RECEIVE NEW FINISHES.
19. DURING DEMOLITION AND CONSTRUCTION PHASES, MAINTAIN ALL REQUIRED EXISTING WALL RATINGS AT WALLS TO REMAIN, AS ARE INDICATED ON DRAWINGS. REMOVE ALL MISC, FASTENING ANCHORS, CLIPS, CONDUIT, PIPING AND RELATED ITEMS THAT ARE NOT IN USE.
20. COORDINATE THE EXACT PHASING OF THE DEMOLITION FOR SPECIFIC STRUCTURAL MEMBERS WITH STRUCTURAL DRAWINGS.
21. DO NOT CORE THROUGH STRUCTURAL MEMBERS, INCLUDING CONCRETE BEAMS, JOISTS, AND STEMS. ONLY CORE THROUGH THE DECK BETWEEN SUPPORTING MEMBERS.
22. 1-HOUR TEMPORARY WALLS EXTENDING FROM FLOOR TO STRUCTURAL DECK ARE REQUIRED TO SEPARATE CONSTRUCTION AREAS FROM OCCUPIED AREAS, UNLESS NOTED OTHERWISE. SPRINKLERED SYSTEM TO REMAIN ACTIVE IN CONSTRUCTION AREAS, IN THE CONSTRUCTION AREA, IF THE SPRINKLERED SYSTEM REMAINS ACTIVE AND HEADS ARE TURNED UPRIGHT, THE 1-HOUR RATED WALLS DO NOT NEED TO EXTEND ABOVE THE EXISTING CEILING. IF SPRINKLERED HEADS REMAIN POINTED DOWNWARD IN THE CONSTRUCTION AREAS, THEN THE 1-HOUR RATED TEMPORARY WALLS MUST PENETRATE THROUGH CEILINGS AND EXTEND UP TO STRUCTURE.

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC
consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. CLARK REGISTERED ARCHITECT 15080 NORTH CAROLINA CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **NOTES AND LEGENDS**

Project Title: **RENOVATE MED SURGE WARDS**

Project Number: 564-17-140

Building Number: 1

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: MS

Drawing Number: **AI001**

Sheet 29 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

BIM 360://18002 Fayetteville AR Renovate Med Surge Ward/18002 ARCH 2020.rvt

A	
A LABEL	CLASS A DOOR
A/C	AIR CONDITIONING
A/C UNIT	AIR CONDITIONING UNIT
A/E	ARCHITECT/ENGINEER
AAMA	AMERICAN ARCHITECTURAL MANUFACTURERS ASSOCIATION
AB	ANCHOR BOLT
ABA	ARCHITECTURAL BARRIERS ACT
ABC	AGGREGATE BASE COURSE
AC	ASBESTOS CEMENT OR ASPHALTIC CONCRETE
ACI	AMERICAN CONCRETE INSTITUTE
ACS DR	ACCESS DOOR
ACS FLR	ACCESS FLOOR
ACS PNL	ACCESS PANEL
ACST	ACOUSTIC
ACT	ACOUSTICAL CEILING TILE
AD	AREA DRAIN
ADA	AMERICANS WITH DISABILITIES ACT
ADB	AUTOMATIC DOOR BOTTOM
ADC	AUTOMATIC DOOR CLOSER
ADDL	ADDITIONAL
ADDN	ADDITION
ADH	ADHESIVE
ADJ	ADJACENT, ADJOINING, OR ADJUSTABLE
ADMIN	ADMINISTRATION
AED	AUTOMATED EXTERNAL DIFIBRILATOR CABINET
AFC	ABOVE FINISHED COUNTER
AFF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
AFS	ABOVE FINISHED SLAB
AGA	AMERICAN GAS ASSOCIATION, ASSOCIATED GENERAL CONTRACTORS
AGGR	AGGREGATE
AHJ	AUTHORITY HAVING JURISDICION
AHR	ANCHOR
AHU	AIR HANDLING UNIT
AIA	AMERICAN INSTITUTE OF ARCHITECTS
AISC	AMERICAN INSTITUTE OF STEEL CONSTRUCTION
ALT	ALTERNATE, ALTERNATIVE
ALT NO	ALTERNATE NUMBER
ALUM	ALUMINUM
AMP	AMPERE
AMT	AMOUNT
ANOD	ANODIZE
ANSI	AMERICAN NATIONAL STANDARDS INSTITUTE
ANT	ANTENNA
APA	AMERICAN PLAYWOOD ASSOCIATION
APPD	APPROVED
APPROX	APPROXIMATE, APPROXIMATELY
APT	APARTMENT
AR	AS REQUIRED
ARCH	ARCHITECT, ARCHITECTURAL
ASB	ASBESTOS
ASI	ARCHITECT'S SUPPLEMENTAL INSTRUCTION
ASKLR	AUOMATIC SPRINKLER
ASPH	ASPHALT
ASSN	ASSOCIATION
ASTM	AMERICAN SOCIETY FOR TESTING AND MATERIALS
AT (SP)	ACOUSTICAL CEILING TILE (SPECIAL FACED)
ATCH	ATTACHMENT
ATM	AUTOMATIC TELLER MACHINE
ATS	AUTOMATIC TRANSFER SWITCH
AUTO	AUTOMATIC
AUX	AUXILIARY
AV	AUDIO-VISUAL
AVE	AVENUE
AVG	AVERAGE
AW	ACID WASTE
AWI	ARCHITECTURAL WOODWORKING INSTITUTE
AWPA	AMERICAN WOOD PRESERVERS'S ASSOCIATION
AWS	AMERICAN WELDING SOCIETY
AWT	ACOUSTICAL WALL TREATMENT
B	
B LABEL	CLASS B DOOR
B PL	BASE PLATE
BALC	BALCONY
BAT	BATTEN
BB	BULLETIN BOARD
BD	BOARD
BD FT	BOARD FEET (FOOT)
BEV	BEVEL
BHMA	BUILDER'S HARDWARE MANUFACTURER'S ASSOCIATION
BI FLD DR	BIFOLDING DOORS
BITUM	BITUMINOUS
BKG	BACKING
BLD	BUILD
BLDG	BUILDING
BLKG	BLOCKING
BLKT	BLANKET
BLVD	BOULEVARD
BM	BEAM OR BENCHMARK
BOT	BOTTOM
BR	BEDROOM
BRCG	BRACING
BRDG	BRIDGING
BRDG JST	BRIDGING JOIST
BRG	BEARING
BRG PL	BEARING PLATE
BRKT	BRACKET
BRZ	BRONZE
BSMT	BASEMENT
BTWN	BETWEEN
BU	BUSHEL
BUR	BUILT-UP ROOFING
C	
C	CELSIUS CHANNEL OR CHANNEL CELSIUS
C CONC	CAST CONCRETE
C LABEL	CLASS C DOOR
C TO C	CENTER TO CENTER
CAB	CABINET
CAC	CEILING ATENUATION CLASS
CB	CATCH BASIN OR CORNER BEAD
CBB	CEMENTITIOUS (BACKER) BOARD
CC	CUBIC CENTIMETER; CONTRACTOR FURNISHED/ CONTRACTOR INSTALLED
CCTV	CLOSED CIRCUIT TELEVISION
CCW	COUNTERCLOCKWISE
CD	CONSTRUCTION DOCUMENTS OR CONTRACT DOCUMENTS
CEM	CEMENT, CEMENTITIOUS
CEM PLAS	CEMENT PLASTER
CER	CERAMIC
CF	CONTRACTOR FURNISHED
CFLG	COUNTERFLASHING
CFM	CUBIC FEET PER MINUTE
CFMF	COLD-FORMED METAL FRAMING
CFS	CUBIC FEET PER SECOND
CG	CENTER OF GRAVITY OR CORNER GUARD
CGSFU	CERAMIC GLAZED STRUCTURAL FACING UNITS
CH BD	CHALKBOARD
CHEM	CHEMICAL
CHFR	CHAMFER
CHK	CHECK
CI	CAST IRON
CIP	CAST-IN-PLACE
CIR	CIRCLE
CIRC	CIRCULATING, CIRCULAR
CIRC	CIRCULAR
CJ	CONSTRUCTION JOINT OR CONTROL JOINT
CL	CENTER LIINE
CLDG	CLADDING
CLG	CEILING
CLG HT	CEILING HEIGHT
CLR	CLEAR

CM	CONSTRUCTION MANAGER
cm2	SQUARE CENTIMETER
cm3	CUBIC CENTIMETER
CMU	CONCRETE MASONRY UNIT
CNR	CORNER
CNTR	COUNTER
CO	CARBON MONOXIDE, CERTIFICATE OF OCCUPANCY, CLEAN OUT, OR COMPANY
co2	CARBON DIOXIDE
COL	COLUMN
COM	COMMON
COMB	COMBINAION, COMBINED
COMM	COMMUNICATION
COMP	COMPONENT
CONC	CONCRETE
CONC FLR	CONCRETE FLOOR
COND	CONDENSER OR CONDITION
CONF	CONFERENCE
CONN	CONNECTION
CONSTR	CONSTRUCTION
CONT	CONTINUOUS, CONTINUE
CONTR	CONTRACTOR
COORD	COORDINATE
COR	COORDINATION OFFICER
CORR	CORRIDOR
CPM	CRITICAL PATH METHOD
CPOT	COMMON PATH OF TRAVEL
CPRS	COMPRESSIBLE
CPT	CARPET
CR	CARD READER
CRS	COLD ROLLED STEEL
CRSI	CONCRETE REINFORCING STEEL
CSB	CONCRETE SPLASH BLOCK
CSG	CASING
CSI	CONSTRUCTION SPECIFICATIONS INSTITUTE
CSK	COUNTER SUNK
CSMT	CASEMENT
CSWK	CASEWORK
CT	CERAMIC TILE
CTB	CERAMIC TILE BASE
CTF	CERAMIC TILE FLOOR
CTG	COATING
CTR	CENTER CONTOUR
CTRL	CONTROL
CTV	CABLE TELEVISION
CU	COPPER C
CU FT	CUBIC FEET
CU IN	CUBIC INCH
CU YD	CUBIC YARD
CURT	CURTAIN
CYL	CYLINDER
CYL L	CTLINDER LOCK
D	
D	DEPTH OR PENNY (NAIL)
D LABEL	CLASS D DOOR
DAT	DATUM
DB	DECIBEL
DBL	DOUBLE
DBL GLZ	DOUBLE GLAZE
DC	DIRECT CURRENT
DEG	DEGREE
DEL	DELETE
DEMO	DEMOLITION
DEPT	DEPARTMENT
DET	DETAIL
DF	DRINKING FOUNTAIN
DIA	DIAMETER
DIAG	DIAGONAL DIAGRAM OR DIAGRAM DIAGONAL
DIFF	DIFFERENCE OR DIFFUSER
DIM	DIMENSION
DIR	DIRECTION
DISP	DISPENSER
DIST	DISTANCE
DIV	DIVIDE OR DIVISION
DL	DEAD LOAD
DOC	DOCUMENT
DOUG FIR	DOUGLAS FIR
DOZ	DOZEN
DR	DOOR, DRAIN, DRESSING ROOM, OR DRIVE
DR CL	DOOR CLOSER
DR FR	DOOR FRAME
DR OPNG	DOOR OPENING
DS	DOWNSPOUT
DSGN	DESIGN
DW	DISHWASHER
DWG	DRAWING
DWTR	DUMBWAITER
E	
E	EAST
E LABEL	CLASS E DOOR
EA	EACH
EFF	EFFICIENCY
EFS	EXTERIOR FINISH SYSTEM
EIFS	EXTERIOR INSULATION AND FINISH SYSTEM
EJ	EXPANSION JOINT
EL	ELEVATION
ELAST	ELASTOMERIC
ELEC	ELECTRIC, ELECTRICAL
ELEC DR OP	ELECTRIC DOOR OPENER
ELEV	ELEVATOR
ELEVS	ELEVATIONS
EMER	EMERGENCY
EMER SHR	EMERGENCY SHOWER
ENCL	ENCLOSURE
ENGR	ENGINEER
ENVIR	ENVIRONMENT
EPA	ENVIRONMENTAL PROTECTION AGENCY
EPDM	ETHYLENE PROPYLENE DIENE
EPO	EMERGENCY POWER OFF
EPS	EXPANDED POLYSTYRENE BOARD (INSULATION)
EQ	EQUAL
EQL SP	EQUALLY SPACED
EQUIP	EQUIPMENT
EQUIV	EQUIVALENT
ERD	EXISTING ROOF DRAIN
ESC	ESCAPE OR ESCUTCHEON
ESCAL	ESCALATOR
ESMT	EASEMENT
ESP	ESPECIALLY
EST	ESTIMATE
ETC	AND SO FORTH OR ET CETERA
ETR	EXISTING TO REMAIN
EW	EACH WAY
EWC	ELECTRIC WATER COOLER
EWS	EYE WASH STATION
EXC.	EXCEPTION
EXH	EXHAUST
EXIST	EXISTING
EXP	EXPANSION OR EXPOSED
EXP BT	EXPANSION BOLT
EXST GR	EXISTING GRADE
EXT	EXTERIOR, EXTERNAL, OR EXTINGUISHER
EXT GR	EXTERIOR GRADE
F	
F	FAHRENHEIT OR FEMALE
FA	FIRE ALARM
FAB	FABRIC
FAC	FACTOR
FACIL	FACILITY
FAS	FASCIA
FAS BD	FASCIA BOARD

FCO	FLOOR CLEANOUT
FCTY	FACTORY
FD	FLOOR DRAIN
FDC	FIRE DEPARTMENT CONNECTION
FDTN	FOUNDATION
FE	FIRE EXTINGUISHER
FEC	FIRE EXTINGUISHER CABINET
FF	FINISH FACE
FF EL	FINISH FLOOR ELEVATION
FF&E	FURNITURE, FIXTURE, AND EQUIPMENT
FH	FLAT HEAD OR FLAT HEAD SCREWS
FHC	FIRE HOSE CABINET
FHMS	FLAT HEAD MACHINE SCREW
FHP	FULL HEIGHT PARTITION
FHWS	FLAT HEAD WOOD SCREW
FIG	FIGURE
FIL	FILLET
FIN	FINISH
FIN FLR	FINISH FLOOR
FIN GR	FINISH GRADE
FIN WD	FINISH WOOD
FIXT	FIXTURE
FL	FLOORLINE
FLASH	FLASHING
FLDG	FOLDING
FLEX	FLEXIBLE
FLG	FLOORING
FLR	FLOOR
FLR FIN	FLOOR FINISH
FLR SK	FLOOR SINK
FLUOR	FLUORESCENT
FLUOR FIX	FLUORESCEN FIXTURE
FM	FACTORY MUTUAL
FM-G	FACTORY MUTUAL GLOBAL
FO	FINISHED OPENING
FOC	FACE OF CONCRETE OR FACE OF CURB
FOF	FACE OF FINISH
FOM	FACE OF MASONRY
FOS	FACE OF SLAB OR FACE OF CURB
FOUNT	FOUNTAIN
FOW	FACE OF WALL
FP	FIRE PROTECTION OR FIREPROOF
FPM	FEET PER MINUTE
FPS	FEET PER SECOND
FR	FIRE RATING, FIRE RESISTANT, OR FRAME
FR SNK	FLUSHING RIM SINK
FREQ	FREQUENCY
FRMG	FRAMING
FRP	FIBER REINFORCED POLYESTER OR FIBERGLASS REINFORCED PLASTIC
FRT	FIRE-RETARDANT TREATED
FRZ	FREEZER
FS	FEDERAL SPECIFICATION
FSTNR	FASTENER
FT	FEET OR FOOT
FTG	FOOTING
FURG	FURRING
FURN	FURNISH OR FURNITURE
FUT	FUT
FV	FIELD VERIFY
FWC	FABRIC WALL COVERING
G	
GA	GAGE OR GYPSUM ASSOCIATION
GAL	GALLON, GALLONS
GALV	GALVANIC OR GALVANIZED
GALV STL	GALVANIZED STEEL
GB	GRAB BAR
GC	GENERAL CONTRACTOR
GCJ	GWB CONTROL JOINT
GD	GUARD
GDR	GUARD RAIL
GEN	GENERAL OR GENERATOR
GFRC	GLASS-FIBER-REINFORCED
GFRG	GLASS-FIBER-REINFORCED
GFRP	GLASS-FIBER-REINFORCED PLASTIC
GI	GALVANIZED IRON
GL	GLASS
GL BLK	GLASS BLOCK
GLU LAM	GLUED LAMINATED WOOD
GPR	GROUND PENETRATING RADAR
GR FL	GROUND FLOOR
GRAN	GRANITE
GRTG	GRATING
GSB	GYPSUM SHEATHING BOARD
GSM	GALVANIZED SHEET METAL
GSU	GLAZED STRUCTURAL UNIT
GT	GROUT
GUAR	GUARANTEE
GUT	GUTTER
GWB (SC)	GYPSUM BOARD - HIGH BUILD GLAZED COATING (SPECIAL COATING)
GYP	GYPSUM
GYP BD	GYPSUM BOARD
GYP PLAS	GYPSUM PLASTER
H	
H	HIGH
H PLAM	HIGH PRESSURE PLASTIC LAMINATE
HAZ MAT	HAZARDOUS MATERIALS
HB	HOSE BIBB
HC	HOLLOW CORE
HCWD	HOLLOW CORE WOOD DOOR
HDBD	HARDBOARD
HDNR	HARDENER
HDO	HIGH DENSITY OVERLAY
HDR	HEADER
HDW	HARDWARE
HDWD	HARDWOOD
HEPA	HIGH EFFICIENCY PARTICULATE AIR (FILTER)
HEX	HEXAGON
HF	HIGH FREQUENCY
HGR	HANGAR
HM	HOLLOW METAL OR HECTOMETER
HMD	HOLLOW METAL DOOR
HMDF	HOLLOW METAL DOOR AND FRAME
HMF	HOLLOW METAL FRAME
HNDRL	HANDRAIL
HO	HOLD OPEN
HORIZ	HORIZONTAL
HOSP	HOSPITAL
HP	HIGH PRESSURE OR HORSEPOWER
HQ	HEADQUARTERS
HR	HOUR
HRS	HOURS
HS	HEAT-STRENGTHENED (GLASS) OR HIGH STRENGTH
HSE	HOUSE
HSKPG	HOUSEKEEPING
HST	HOIST
HT	HEIGHT
HVAC	HEATING, VENTILATION, AND AIR CONDITIONING
HVY	HEAVY
HW	HOT WATER
HYD	HYDRANT
HYDR	HYDRAULIC
I	
I	INTERSTATE (HIGHWAY) OR MOMENT OF INERTIA
IAQ	INDOOR AIR QUALITY
IBC	INTERNATIONAL BUILDING CODE
ID	IDENTIFICATION, INSIDE DIAMETER, OR INTERIOR DESIGN
ID NO	IDENTIFICATION NUMBER
ILLUM	ILLUMINATION
INCL	INCLUDED
IND	INDEPENDENT OR INDUSTRIAL

INFO	INFORMATION
INSUL	INSULATED, INSULATION
INT	INTERIOR
INTERCOM	INTERCOMMUNICATION
INTL	INTERNATIONAL
IRMA	INVERTED ROOF MEMBRANE ASSEMBLY
IWH	INSTANANEOUS WATER HEATER
K	
KD	KILN DRIED OR KNOCKED DOWN
KIT	KITCHEN
KO	KNOCKOUT
KPL	KICKPLATE
L	
L	ANGLE
LAB	LABORATORY
LAD	LADDER
LAM	LAMINATE
LAM GL	LAMINATED GLASS
LAU	LAUNDRY
LAV	LAVATORY
LBR	LUMBER
LBS	POUND
LD BRG	LOAD-BEARING
LDR	LEADER
LED	LIGHT EMITTING DIODE
LF	LINEAR FEET (FOOT)
LH	LEFT HAND
LHR	LEFT HAND REVERSE OR LATENT HEAT RATIO
LIB	LIBRARY
LIN	LINEAR
LINO	LINOLEUM
LIQ	LIQUID
LKR	LOCKER
LKR RM	LOCKER ROOM
LKWASH	LOCKWASHER
LL	LEAD LINED
LLH	LONG LEG HORIZONTAL
LLV	LONG LEG VERTICAL
LMST	LIMESTONE
LNDSCP	LANDSCAPE
LR	LIVING ROOM
LRG	LARGE
LRV	LOUVERED ROOF VENT
LS	LUMP SUM
LT	LIGHT
LT GA	LIGHT GAGE
LT WT	LIGHTWEIGHT
LTG	LIGHTING
LTNG	LIGHTNING
LVD	LOUVERED
LVR	LOUVER
LWC	LIGHTWEIGHT CONCRETE
LWIC	LIGHTWEIGHT INSULATING CONCRETE
LYR	LAYER
M	
MACH	MACHINE
MACH RM	MACHINE ROOM
MAINT	MAINTAIN, MAINTENANCE
MAN	MANUAL
MATL	MATERIAL
MATV	MASTER ANTENNA TELEVISION SYSTEM
MAX	MAXIMUM
MB	MACHINE BOLT
MCB	METAL CORNER BEAD
MCJ	MASONRY CONTROL JOINT
MD	DECK
ME	MECHANICAL ENGINEER
MEAS	MEASURE
MECH	MECHANICAL
MECH RM	MECHANICAL ROOM
MED	MEDICAL MEDIUM O MEDIUM MEDICAL
MEK	METHYL ETHYL KETONE
MEL	MELAMINE
MEMBO	MEMORANDUM
MEZZ	MEZZANINE
MF	MILL FINISH
MFD	MANUFACTURED
MFG	MANUFACTURING
MFR	MANUFACTURER
MFR REC	MANUFACTURER'S RECOMMENDATION
MGT	MANAGEMENT
MH	MANHOLE
MIC	MICROPHONE
MID	MIDDLE
MIL STD	MILITARY STANDARD
MIN	MINIMUM
MIN	MINIMUM MINUTE OR MINUTE MINIMUM
MIRR	MIRROR
MISC	MISCELLANEOUS
MISC	MISCELLANEOUS
MIT	MITER
MKR	MARKER
ML	METAL LATH
MLDG	MOLDING (MOULDING)
MLWK	MILLWORK
mm	MILLIMETER
MO	MASONRY OPENING OR MOTOR OPERATED
MO	MASONRY OPENING OR MOTOR OPERATED
MOD	MODEL, MODIFY OR MODULE
MOD BIT	MODIFIED BITUMEN
MON	MONITOR
MOPR	MOP RACK
MR	MOISTURE RESISTANT
MS	MACHINE SCREW OR MOP SINK
MTD	MOUNTED
MTG	MOUNTING
MTL	METAL
MULL	MULLION
MW	MICROWAVE
MWP	MEMBRANE WATERPROOFING
N	
N	NORTH
NA	NOT APPLICABLE
NAAMM	NATIONAL ASSOCIATION OF ARCHITECTURAL METAL MANUFACTURERS
NAT	NATURAL
NATL	NATIONAL
NC	NOISE CRITERIA
NCOMBL	NONCOMBUSTIBLE
NEC	NATIONAL ELECTRICAL CODE
NEG	NEGATIVE
NEMA	NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION
NEUT	NEUTRAL
NFC	NATIONAL FIRE CODE
NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
NIC	NOT IN CONTRACT
NO	NUMBER
NOM	NOMINAL
NR	NOISE REDUCTION
NRC	NOICE REDUCTION COEFFICIENT
NRCA	NATIONAL ROOFING CONTRACTORS ASSOCIATION
NRP	NONREMOVABLE
NRST	NON-RATED, SMOKE TIGHT
NS	NARROW STILE
NUM	NUMERAL

O	
O	OXYGEN
O/H	OVER HEAD
O/O	OUT TO OUT
OA	OUTSIDE AIR OR OVERALL
OC	ON CENTER
OCC	OCCUPY
OCT	OCTAGON
OD	OUTSIDE DIAMETER OR OUTSIDE DIMENSION
OFD	OVERFLOW DRAIN
OFF	OFFICE
OH	OVERHANG
OH DR	OVERHEAD (COILING) DOOR
OPH	OPPOSIE HAND
OPNG	OPENING
OPP	OPPOSITE
OPR	OPERABLE
OPT	OPTIONAL
OR	OPERATING ROOM OR OUTSIDE RADIUS
ORD	ORDNANCE OR OVERFLOW ROOF DRAIN
ORG	ORGANIC
ORIG	ORIGINAL
ORN	ORNAMENTAL
OSHA	OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION
OUT	OUTLET
OZ	OUNCE
P	
PACS	PHYSICAL ACCESS SECURITY SYSTEM
PAR	PARALLEL OR PARAPET
PARA	PARAGRAPH
PART	PARTIAL
PAT	PATTERN
PB	PUSHBUTTON
PBD	PARTICLEBOARD
PC	PIECE, POLYCARBONATE OR PORTLAND CEMENT
PCA	PORTLAND CEMENT ASSOCIATION
PCC	PRECAST CONCRETE
PCCP	CONCRETE PAVEMENT
PCD	PAPER CUP DISPENSER
PCF	POUNDS PER CUBIC FOOT
PCP	PORTLAND CEMENT PLASTER
PED	PEDESTAL
PEN	PENETRATE
PEND	PENDANT
PERF	PERFORATED
PERIM	PERIMETER
PERP	PERPENDICULAR
PGBD	PEGBOARD
PHAR	PHARMACY
PHOTO	PHOTOGRAPH
PHS	PHILLIPS HEAD SCREW
PKG	PACKAGE
PL	PROPERTYLINE
PL GL	PLATE GLASS
PLAM	PLASTIC LAMINATE
PLAM	PLASTIC LAMINATE
PLAS	PLASTER OR PLASTIC
PLBG	PLUMBING
PLYWD	PLYWOOD
PMTL	PAINTED METAL
PNEU	PNEUMATIC
PNL	PANEL
PO	POST OFFICE PURCHASE ORDER OR PURCHASE ORDER POST OFFICE
POLY	POLYETHYLENE (PLASTIC)
PR	PAIR
PRCST	PRECAST
PREFAB	PREFABRICATE
PREFIN	PREFINISH
PRELIM	PRELIMINARY
PREP	PREPARATION
PRESS	PRESSURE
PREV	PREVIOUS
PRKG	PARKING
PRMLD	PREMOLDED
PROJ	PROJECT
PROP	PROPERTY
PSF	POUNDS PER SQUARE FOOT
PSI	POUNDS PER SQUARE INCH
PT	PAINT, PNEUMATIC TUBE, OR PRESSURE TREATED
PTD	PAPER TOWEL DISPENSER
PTN	PARTITION
PVC	POLYVINYL CHLORIDE (PLASTIC)
PVG	PAVING
PWR	POWER
Q	
QA	QUALITY ASSURANCE
QC	QUALITY CONTROL
QRY	QUARRY
QT	QUARRY TILE OR QUART
QTB	QUARRY TILE BASE
QTF	QUARRY TILE FLOOR
QTR	QUARTER
QTY	QUANTITY
QUAD	QUADRANT
QUAL	QUALITY
R	
R	RADIUS OR RISER
RA	RETURN AIR
RA	RETURN AIR
RAD	RADIATOR
RB	RESILIENT BASE OR RUBBER BASE
RB HK	ROBE HOOK
RBM	REINFORCED BRICK MASONRY
RBR	RUBBER
RC	REMOTE CONTROL
RCP	REFLECTED CEILING PLAN
RCVR	RECEIVER
RD	ROAD OR ROOF DRAIN
REC	RECESSED
RECD	RECEIVED
RECPT	RECEPTACLE
RECT	RECTANGLE
REF	REFERENCE OR REFRIGERATOR
REFR	REFRACTORY REFRIGERATION OR REFRIGERATION REFRACTORY
REG	REGISTER
REINF	REINFORCE, REINFORCED, OR REINFORCING
REP	REPAIR
REPL	REPLACE
REQ	REQUIRE
REQD	REQUIRED
RESIL	RESILIENT
RET	RETURN
REV	REVISION
RF	RADIO FREQUENCY
RFG	ROOFING
RFI	REQUEST FOR INFORMATION
RFP	REQUEST FOR PROPOSAL
RH	RIGHT HAND
RHMS	ROUND HEAD MACHINE SCREW
RHR	RIGHT HAND REVERSE
RHWS	ROUND HEAD WOOD SCREW
RL	ROOF LEADER
RLG	RAILING
RM	ROOM
RND	ROUND
RO	ROUGH OPENING
ROW	RIGHT OF WAY
RPM	REVOLUTIONS PER MINUTE
RS	ROUGH SAWN
RT	RIGHT

RV	ROOF VENT
RVS	REVERSE
RWD	REDWOOD
RWL	RAIN WATER LEADER
S	
SA	SUPPLY AIR
SALV	SALVAGE
SAMP	SAMPLE
SAN	SANITARY
SAT	SUSPENDED ACOUSTICAL TILE
SATC	SUSPENDED ACOUSTICAL TILE CEILING
SB	SPLASH BLOCK
SBS	STYRENE BUTADIEN STYRENE
SBSTR	SUBSTRATE
SC	SHADING COEFFICIENT OR SOLID CORE
SCH	SCHOOL
SCHED	SCHEDULE, SCHEDULED
SCHEM	SCHEMATIC
SCP	SCUPPER
SCRN	SCREEN
SCT	STRUCTURAL CLAY TILE
SCWD	SOLID CORE WOOD DOOR
SD	SHOP DRAWINGS, SMOKE DETECTOR, OR SOAP DISPENSER
SDG	SIDING
SECT	SECTION
SEG	SEGMENT
SEL	SELECT
SEP	SEPARATE
SF	SQUARE FOOT (FEET)
SFTWD	SOFTWOOD
SGD	SLIDING GLASS DOOR
SGL	SINGLE
SHR	SHOWER
SHR HD	SHOWER HEAD
SHRD	SHOWER DRAIN
SHT	SHEET
SHT MTL	SHEET METAL (FLASHING)
FLASH	
SHTHG	SHEATHING
SIM	SIMILAR
SJ	SCORED JOINT
SJ	SCORED JOINT
SJI	STEEL JOIST SLIDING WINDOW
SK	SKETCH
SKLT	SKYLIGHT
SLD WDW	HORIZONTAL SLIDING WINDOW
SLDG	SLIDING
SLNT	SEALANT
SM	SHEET METAL
SMK	SMOKE
SMS	SHEET METAL SCREW
SND	SANITARY NAPKIN DISPENSER
SND INS	SOUND INSULATION
SNDU	SANITARY NAPKIN DISPOSAL UNIT
SPEC	SPECIFICATION
SPKLR	SPRINKLER
SPKR	SPEAKER
SPLY	SUPPLY
SQ	SQUARE
SQ IN	SQUARE INCH
SQ YD	SQUARE YARD
SS	SANITARY SEWER, SERVICE SINK OR SOLID SURFACING
SST	STAINLESS STEEL
ST	STAIRS OR STREET
STC	SOUND TRANSMISSION CLASSIFICATION
STIF	STIFFENER
STL	STEEL
STL JST	STEEL JOIST
STL LNTL	STEEL LINTEL
STL PL	STEEL PLATE
STL RF DK	STEEL ROOF DECK
STL TB	STEEL TUB
STL TR	STEEL TRUSS
STNLS	STAINLESS
STOR	STORAGE
STR	STRINGERS
STRUCT	STRUCTURAL
STRUCT STL	STRUCTURAL STEEL
SUB	SUBSTITUTE
SURF	SURFACE
SUSP	SUSPENDED
SUSP CLG	SUSPENDED CEILING
SV	SHEET VINYL
SW	SWITCH
SWDR	SWING DOOR
SYM	SYMBOL
SYNTH	SNTHETIC
SYS	SYSTEM
T	
T	TREAD
T&G	TONGUE AND GROOVE
T&M	TIME AND MATERIALS
TB	THROUGH BOLT OR TOWEL BAR
TCA	TILE COUNCIL OF AMERICA
TCP	TELEPHONE CONTROL PANEL, TEMPERATURE CONTROL PANEL, OR TRAFFIC CONTROL PLAN
TD	TRAVEL DISTANCE
TECH	TECHNICAL
TEL	TELEPHONE
TEMP	TEMPERATURE OR TEMPORARY
TER	TERRAZZO
THD	THREAD
THERM	THERMAL
THK	THICKNESS
THRES	THRESHOLD
THRU	THROUGH
THRUOUT	THROUGHOUT
TK BD	TACKBOARD
TLT	TOILET
TMPD	TEMPERED
TMPD GL	TEMPERED GLASS
TN	TRUE NORTH
TO	TOP OF __
TO FDN	TOP OF FOUNDATION
TOB	TOP OF BEAM
TOM	TOP OF MASONRY
TOP	TOP OF PARAPET
TOS	TOP OF STEEL
TYP	TYPICAL
U	
U.N.O.	UNLESS NOTED OTHERWISE
U.O.N.	UNLESS OTHERWISE NOTED
V	
VC	VA FURNISHED / CONTRACTOR INSTALLED
VCT	VINYL COMPOSITION TILE OR VITRIFIED CLAY TILE
VENT	VENTILATION
VERT	VERTICAL
VIF	VERIFY IN FIELD
VV	VA FURNISHED / VA INSTALLED
W	
W/	WITH
WD	WOOD
WP	WALL PROTECTION / WEATHERPROOF

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC
consulting engineers

8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. OAKS REGISTERED ARCHITECT 31080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL
• DESIGN GROUP, PC •

8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833

HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title:
ARCHITECTURAL ABBREVIATIONS

Project Title:
RENOVATE MED SURGE WARDS

Project Number: 564-17-140

Building Number: 1

Project Phase:
BID DOCUMENTS

FULLY SPRINKLERED


Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: MS

Drawing Number: **AI002**

Sheet 30 of 162


Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

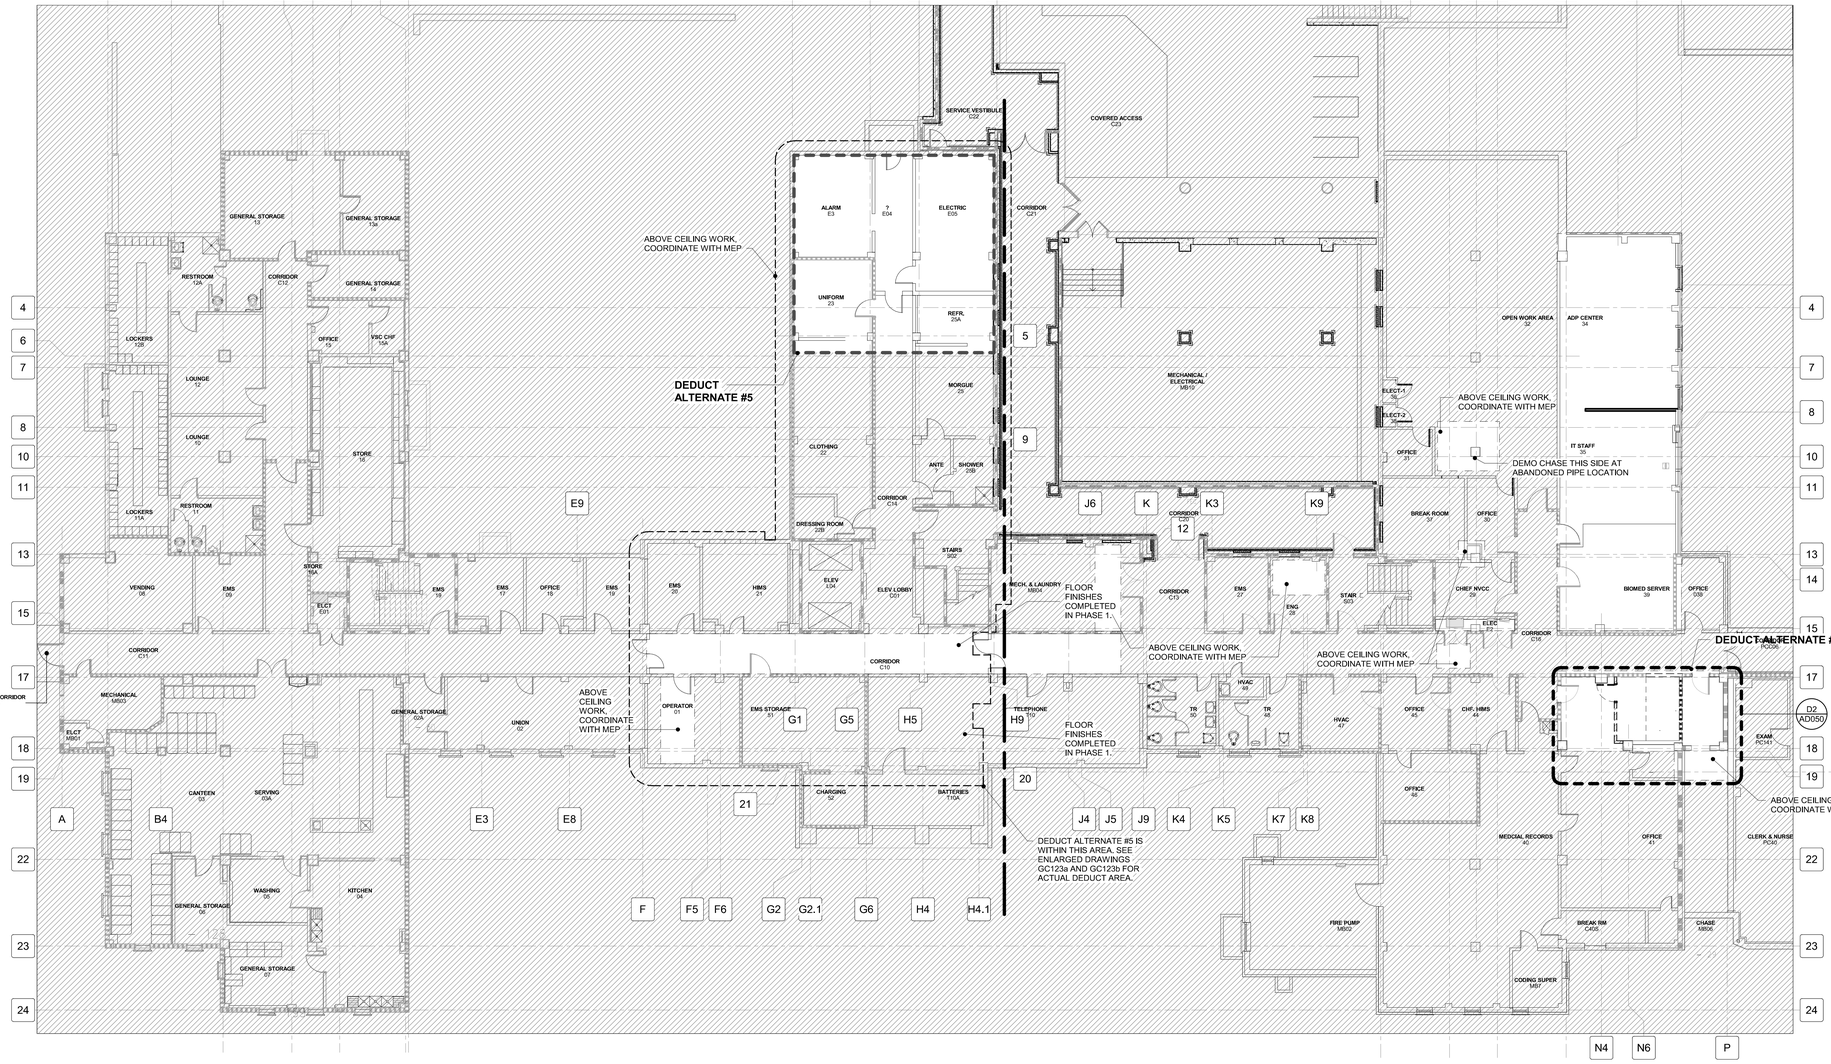

C2 BASEMENT FLOOR DEMOLITION PLAN - PHASE 1

3/32" = 1'-0"

0 5' 10' 20'

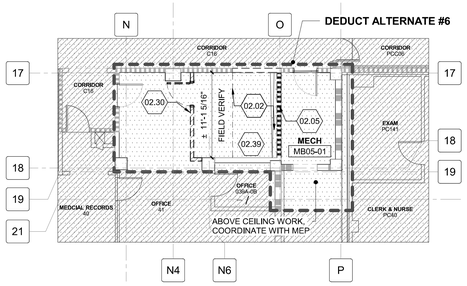

D2 BASEMENT FLOOR ENLARGED - DEMOLITION PLAN (DETAIL)

1/8" = 1'-0"

0 4' 8' 16'

GENERAL SHEET NOTES

NOTE: REFER TO ALL PHASING SHEETS. GENERAL CONTRACTOR SHALL ENSURE THAT ALL CONTRACTORS ARE RESPONSIBLE FOR COORDINATION ACROSS ENTIRE SET OF CONSTRUCTION DOCUMENTS.

A. DEMOLITION DRAWINGS ARE DIAGRAMMATIC AND DO NOT INTEND TO SHOW THE FULL EXTENT OF ALL AREAS EFFECTED BY UTILITY DEMOLITION AND RECONSTRUCTION. DEMOLITION SHALL INCLUDE ALL ITEMS INDICATED ON THE DEMOLITION PLANS AND ALL OTHER ITEMS REQUIRED TO BE DEMOLISHED TO ACCOMPLISH NEW CONSTRUCTION.

B. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR CUTTING, PATCHING, AND REPAIR OF ALL EXISTING CONSTRUCTION AND FINISHES REQUIRED FOR THE DEMOLITION AND RECONSTRUCTION OF UTILITIES.

C. ALL PENETRATIONS REMAINING FROM DEMOLITION SHALL BE SEALED, AND IF IN ACOUSTIC, SMOKE, AND / OR FIRE RATED CONSTRUCTION, SEALED TO MATCH THE RATING OF THE ADJACENT CONSTRUCTION, BY THE GENERAL CONTRACTOR.

D. SEE ALL DISCIPLINES AND PHASING DRAWINGS FOR ADDITIONAL DEMOLITION, RECONSTRUCTION, AND PROTECTION INFORMATION.

E. VERIFY ALL DIMENSIONS AND CONDITIONS AT JOB SITE. PORTIONS OF EXISTING WALLS, CEILINGS, ETC. MAY HAVE BEEN PREVIOUSLY REMOVED.

F. UTILITY SHUTDOWN SHALL BE SCHEDULED WITH AND APPROVED BY COR WITH 2 WEEKS MINIMUM WRITTEN NOTICE.

G. CONTRACTOR SHALL COORDINATE WITH COR THE SCHEDULING OF NOISY OR OTHERWISE INTERRUPTIVE OPERATIONS TO MINIMIZE IMPACT ON THE MEDICAL CENTER.

H. REPAIR AND REPLACE AND/OR PATCH ADJACENT FINISHES TO PROVIDE A SMOOTH AND CONTINUOUS FINISH.

I. DEMOLITION SHALL BE PHASED AND AFTER NORMAL BUSINESS HOURS TO ALLOW OWNER OCCUPANCY OF FLOORS ABOVE AND BELOW PROJECT AREA.

J. PROVIDE A SECURED CONSTRUCTION AREA FOR DURATION OF PROJECT.

K. REFER TO PHASING SHEETS FOR ADDITIONAL INFORMATION.

L. ANY EXISTING CONSTRUCTION DISCOVERED DURING DEMOLITION THAT IS NOT NOTED TO BE DEMOLISHED, BUT IS NOT IN USE OR INTENDED TO REMAIN IN USE, SHALL BE REMOVED IN ITS ENTIRETY TO THE POINT OF CONNECTION WITH EXISTING CONSTRUCTION TO REMAIN.

M. APPLY SELF-LEVELING COMPOUND AT ALL REMOVED WALLS.

N. APPLY LEVELING COMPOUND AFTER FLOOR DEMO TO INFILL GOUGES, PITS, AND CRACKS. SCARIFY EXISTING SLAB.

O. CONTRACTOR TO ENSURE BEFORE ANY DEMOLITION STARTS THAT ALL IMPACTED SIGNAGE IN PROJECT LIMITS IS CAREFULLY REMOVED AND STORED AT A SAFE LOCATION FOR REUSE, PER COR.

P. REFER TO SHEET AD01 FOR GENERAL DEMOLITION NOTES.

Q. REFER TO HA DRAWINGS FOR HAZARDOUS ABATEMENT.

R. SEE ELECTRICAL DRAWINGS FOR REQUIRED CIRCUIT TRACE REPORT. REPORT MUST BE SUBMITTED PRIOR TO DEMOLITION ACTIVITIES.

S. REPLACE CRACKED, CHIPPED OR FADED CEILING TILES WITH NEW MATCHING CEILING TILES, AFTER FINISHING WORK.

T. FOR DRYWALL CEILINGS, REMOVE PORTIONS OF DRYWALL TO PERFORM ABOVE CEILING WORK. REPLACE DRYWALL AND RUNNERS. INSTALL NEW TAPE AND MUD, THEN SAND AND PAINT.

U. GC TO PROVIDE TEMPORARY SMOKE TIGHT CONSTRUCTION PARTITIONS TO SEPARATE ALL OCCUPIED AREAS FROM DEMOLITION AND CONSTRUCTION. PARTITIONS SHALL BE 1-HOUR FIRE-RATED FULL HEIGHT, EXTENDING THROUGH SUSPENDED CEILINGS TO THE FLOOR SLAB OR ROOF DECK, UNLESS SPRINKLERS ARE OPERATIONAL ON BOTH SIDES OF THE TEMPORARY PARTITION THEN PARTITION MAY BE PERMITTED TO TERMINATE AT THE CEILING.

V. GC TO PROVIDE ADHESIVE MAT FOR INFECTION CONTROL.

W. AT ALL ABANDONED THRU-WALL PENETRATIONS, INFILL WITH MATCHING EXTERIOR FACE BRICK AND MORTAR, TOOTH IN BRICK TO MATCH EXISTING COURSING.

X. DEMO EXISTING TERRAZZO WALL BASE AND 12-INCH FLOOR PERIMETER IN PROJECT AREAS.

SHEET KEYNOTES

02.02 REMOVE EXISTING FLOORING IN ITS ENTIRETY INCLUDING ALL TRIM, ADHESIVES, GROUT, MORTAR, ETC., TO FINISH FLOOR SLAB. CLEAN EXISTING SLAB TO REMOVE ANY RESIDUAL MATERIAL THAT MAY BE DETRIMENTAL TO INSTALLATION OF NEW FLOORING.SEE DRAWINGS FOR EXTENTS.

02.05 REMOVE EXISTING WALLS IN THEIR ENTIRETY INCLUDING STRUCTURE, BRACING, FACINGS, FASTENERS, SEALANT, ETC., FROM FINISH FLOOR SLAB TO UNDERSIDE OF STRUCTURE ABOVE. REPAIR ALL DAMAGE TO EXISTING CONSTRUCTION THAT IS TO REMAIN, READY TO RECEIVE NEW CONSTRUCTION WITHIN PROJECT LIMITS / PHASE BOUNDARIES U.N.O.

02.30 INSTALL NEW TEMPORARY 1 HOUR RATED WALL AND 3/4 HOUR RATED 3' - 0" x 7' - 0" DOOR.

02.39 REMOVE EXISTING CEILING ITS ENTIRETY REPAIR ALL DAMAGE TO EXISTING CONSTRUCTION THAT IS TO REMAIN, READY TO RECEIVE NEW CONSTRUCTION. DISCONNECT AND STORE EXISTING LIGHT FIXTURES.

SYMBOLS LEGEND

INDICATES AREA NOT IN SCOPE OF WORK

PARTITION GRAPHICS


PARTITION PHASING

- EXISTING ELEMENT TO REMAIN
- EXISTING ELEMENT TO BE DEMOLISHED
- TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

- NO RATING
- SMOKE RESISTIVE PARTITION - NON RATED
- 1 HOUR FIRE BARRIER
- 1 HOUR FIRE/SMOKE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN

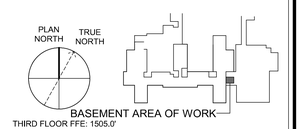

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. OAKS REGISTERED ARCHITECT 11080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **BASEMENT FLOOR DEMOLITION PLAN - PHASE 1**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: MS

Project Number: 564-17-140


Building Number: 1

Drawing Number: **AD050**

Sheet 32 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

BIM 360://18002 Fayetteville AR Renovate Med Surge Ward/18002 ARCH 2020.rvt

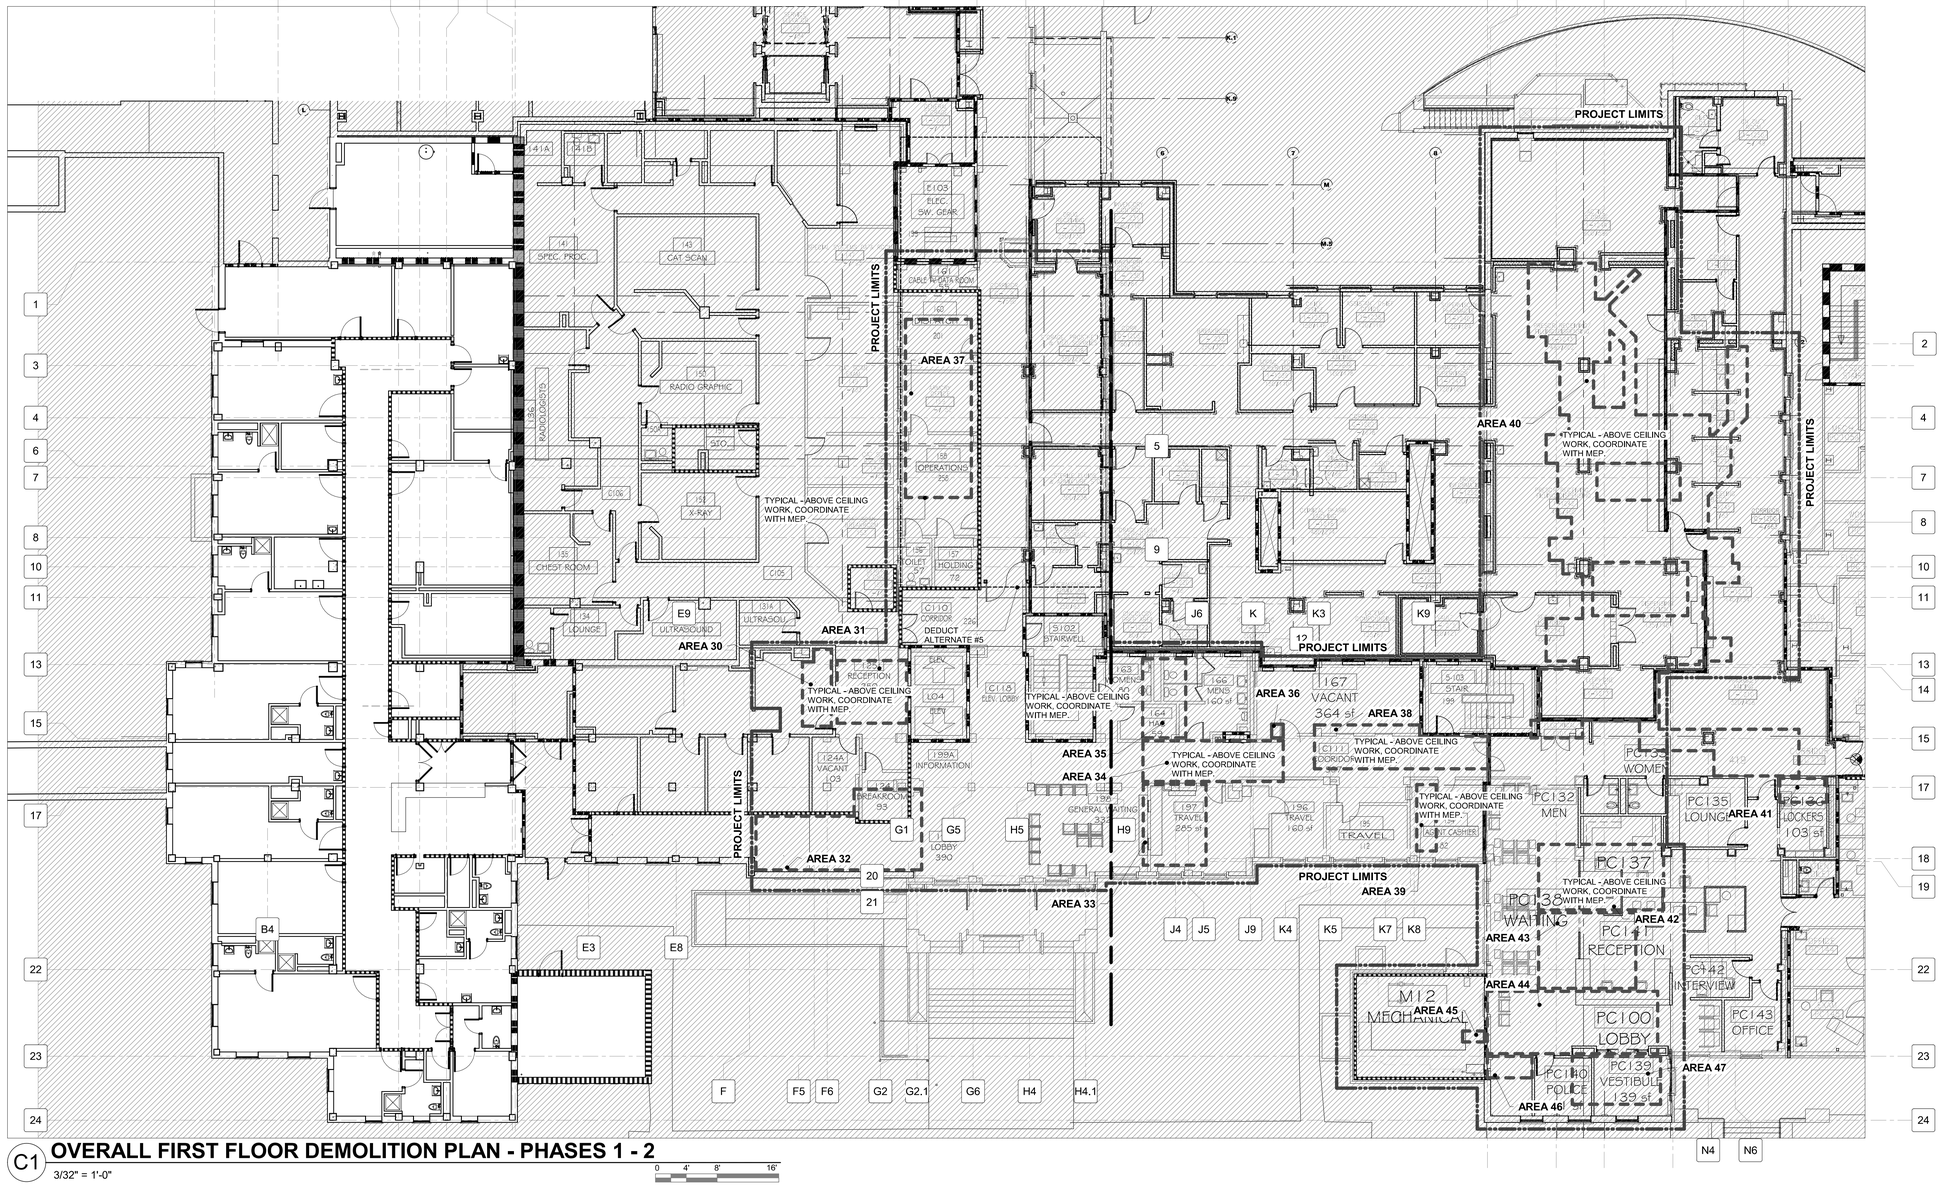

C1 **OVERALL FIRST FLOOR DEMOLITION PLAN - PHASES 1 - 2**

3/32" = 1'-0"

0 4' 8' 16'

GENERAL SHEET NOTES

A. GRADE ELEVATIONS AND EXISTING FLOOR/ROOF ELEVATIONS FOR STAIRS INDICATED ON THESE PLANS ARE APPROXIMATE. CONTRACTOR SHALL OBTAIN A SURVEY TO LOCATE SPOT ELEVATIONS AND EXISTING BUILDING FLOOR AND ROOF ELEVATIONS PRIOR TO STAIR DESIGN AND/OR STARTING CONSTRUCTION.

B. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING PUBLIC AND/OR PRIVATE UTILITY LOCATING SERVICES PRIOR TO STARTING CONSTRUCTION, AND TO DETERMINE AND FIELD VERIFY LOCATIONS.

C. ANY DISCREPANCIES OR CONFLICTS WHICH BECOME APPARENT BEFORE OR DURING CONSTRUCTION, SHALL BE BROUGHT TO THE ATTENTION COR, PRIOR TO CONSTRUCTION SO THAT REDESIGN OR CLARIFICATION MAY OCCUR, WITHOUT ANY CHANGE TO THE CONTRACT.

D. EXTERIOR HANDRAILS/GUARDRAILS/FENCE/GATES ARE TO BE PAINTED BLACK, TO MATCH EXISTING VA FACILITY STANDARD.

E. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTING EXISTING STRUCTURE AND FOUNDATIONS, DURING CONSTRUCTION. SEE SPECIFICATIONS FOR MORE INFORMATION.

F. ANY UTILITIES SHUTDOWN OR AREA CLOSURES ARE TO BE COORDINATED WITH COR.

G. INSTALL NOSING AT ALL EXTERIOR STAIR TREADS

H. NUMBERED AREAS ARE NOT SEQUENTIAL. THEY FOLLOW THE PHASED WORK.

SYMBOLS LEGEND

PROJECT LIMITS

ABOVE CEILING WORK LIMITS

PARTITION GRAPHICS

PARTITION PHASING

EXISTING ELEMENT TO REMAIN

EXISTING ELEMENT TO BE DEMOLISHED

TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

NO RATING

SMOKE RESISTIVE PARTITION - NON RATED


1 HOUR FIRE BARRIER

1 HOUR FIRE/SMOKE BARRIER

2 HOUR FIRE BARRIER

2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN

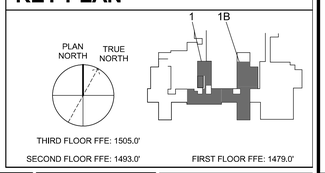

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC consulting engineers

8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. [illegible] REGISTERED ARCHITECT 17108 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •

8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833

HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **OVERALL FIRST FLOOR DEMOLITION PLAN - PHASES 1 - 2**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: DW

Project Number: 564-17-140

Building Number: 1

Drawing Number: **AD051**

Sheet 33 of 162

Engineering Service

VETERANS HEALTH CARE SYSTEM OF THE OZARKS

VA U.S. Department of Veterans Affairs

BIM 360://18002 Fayetteville AR Renovate Med Surge Ward/18002 ARCH 2020.rvt

PARTIAL SECOND FLOOR DEMOLITION PLAN - PHASE 1A (WARD 2)

B1 1/8" = 1'-0"

0 4' 8' 16'

PARTIAL SECOND FLOOR DEMOLITION PLAN WARD 2 - PHASE 1

D3 1/8" = 1'-0"

0 4' 8' 16'

GENERAL SHEET NOTES

NOTE: REFER TO ALL PHASING SHEETS. GENERAL CONTRACTOR SHALL ENSURE THAT ALL CONTRACTORS ARE RESPONSIBLE FOR COORDINATION ACROSS ENTIRE SET OF CONSTRUCTION DOCUMENTS.

A. DEMOLITION DRAWINGS ARE DIAGRAMMATIC AND DO NOT INTEND TO SHOW THE FULL EXTENT OF ALL AREAS EFFECTED BY UTILITY DEMOLITION AND RECONSTRUCTION. DEMOLITION SHALL INCLUDE ALL ITEMS INDICATED ON THE DEMOLITION PLANS AND ALL OTHER ITEMS REQUIRED TO BE DEMOLISHED TO ACCOMPLISH NEW CONSTRUCTION.
B. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR CUTTING, PATCHING, AND REPAIR OF ALL EXISTING CONSTRUCTION AND FINISHES REQUIRED FOR THE DEMOLITION AND RECONSTRUCTION OF UTILITIES.
C. ALL PENETRATIONS REMAINING FROM DEMOLITION SHALL BE SEALED, AND IF IN ACOUSTIC, SMOKE, AND / OR FIRE RATED CONSTRUCTION, SEALED TO MATCH THE RATING OF THE ADJACENT CONSTRUCTION, BY THE GENERAL CONTRACTOR.
D. SEE ALL DISCIPLINES AND PHASING DRAWINGS FOR ADDITIONAL DEMOLITION, RECONSTRUCTION, AND PROTECTION INFORMATION.
E. VERIFY ALL DIMENSIONS AND CONDITIONS AT JOB SITE. PORTIONS OF EXISTING WALLS, CEILINGS, ETC. MAY HAVE BEEN PREVIOUSLY REMOVED.
F. UTILITY SHUTDOWN SHALL BE SCHEDULED WITH AND APPROVED BY COR WITH 2 WEEKS MINIMUM WRITTEN NOTICE.
G. CONTRACTOR SHALL COORDINATE WITH COR THE SCHEDULING OF NOISY OR OTHERWISE INTERRUPTIVE OPERATIONS TO MINIMIZE IMPACT ON THE MEDICAL CENTER.
H. REPAIR AND REPLACE AND/OR PATCH ADJACENT FINISHES TO PROVIDE A SMOOTH AND CONTINUOUS FINISH.
I. DEMOLITION SHALL BE PHASED AND AFTER NORMAL BUSINESS HOURS TO ALLOW OWNER OCCUPANCY OF FLOORS ABOVE AND BELOW PROJECT AREA.
J. PROVIDE A SECURED CONSTRUCTION AREA FOR DURATION OF PROJECT.
K. REFER TO PHASING SHEETS FOR ADDITIONAL INFORMATION.
L. ANY EXISTING CONSTRUCTION DISCOVERED DURING DEMOLITION THAT IS NOT NOTED TO BE DEMOLISHED, BUT IS NOT IN USE OR INTENDED TO REMAIN IN USE, SHALL BE REMOVED IN ENTIRETY TO THE POINT OF CONNECTION WITH EXISTING CONSTRUCTION TO REMAIN.
M. APPLY SELF-LEVELING COMPOUND AT ALL REMOVED WALLS.
N. APPLY LEVELING COMPOUND AFTER FLOOR DEMO TO INFILL GOUGES, PITS, AND CRACKS. SCARIFY EXISTING SLAB.
O. CONTRACTOR TO ENSURE BEFORE ANY DEMOLITION STARTS THAT ALL IMPACTED SIGNAGE IN PROJECT LIMITS IS CAREFULLY REMOVED AND STORED AT A SAFE LOCATION FOR REUSE, PER COR.
P. REFER TO SHEET A901 FOR GENERAL DEMOLITION NOTES.
Q. REFER TO HA DRAWINGS FOR HAZARDOUS ABATEMENT.
R. SEE ELECTRICAL DRAWINGS FOR REQUIRED CIRCUIT TRACE REPORT. REPORT MUST BE SUBMITTED PRIOR TO DEMOLITION ACTIVITIES.
S. REPLACE CRACKED, CHIPPED OR FADED CEILING TILES WITH NEW MATCHING CEILING TILES, AFTER FINISHING WORK.
T. FOR DRYWALL CEILINGS, REMOVE PORTIONS OF DRYWALL TO PERFORM ABOVE CEILING WORK, REPLACE DRYWALL AND RUNNERS. INSTALL NEW TAPE AND MUD, THEN SAND AND PAINT.
U. GC TO PROVIDE TEMPORARY SMOKE TIGHT CONSTRUCTION PARTITIONS TO SEPARATE ALL OCCUPIED AREAS FROM DEMOLITION AND CONSTRUCTION. PARTITIONS SHALL BE 1-HOUR FIRE-RATED FULL HEIGHT, EXTENDING THROUGH SUSPENDED CEILINGS TO THE FLOOR SLAB OR ROOF DECK. UNLESS SPRINKLERS ARE OPERATIONAL ON BOTH SIDES OF THE TEMPORARY PARTITION THEN PARTITION MAY BE PERMITTED TO TERMINATE AT THE CEILING.
V. GC TO PROVIDE ADHESIVE MAT FOR INFECTION CONTROL.
W. AT ALL ABANDONED THRU-WALL, PENETRATIONS, INFILL WITH MATCHING EXTERIOR FACE BRICK AND MORTAR. TOOTH IN BRICK TO MATCH EXISTING COURSING.
X. DEMO EXISTING TERRAZZO WALL BASE AND 12-INCH FLOOR PERIMETER IN PROJECT AREAS.

SHEET KEYNOTES

07.20 NEW STEEL BEAM OVER EXISTING ROOF. REMOVE EXISTING ROOF ASSEMBLY UP TO EXISTING CONCRETE DECK. GC TO FIELD-VERIFY LOCATIONS OF EXISTING STEEL BEAMS. REROOF AROUND NEW BEAMS TO PROVIDE ADEQUATE SLOPE TO DRAIN TO EXISTING ROOF DRAINS. SEE STRUCTURAL FOR BEAM.

SHEET KEYNOTES

02.02 REMOVE EXISTING FLOORING IN ITS ENTIRETY INCLUDING ALL TRIM, ADHESIVES, GROUT, MORTAR, ETC., TO FINISH FLOOR SLAB. CLEAN EXISTING SLAB TO REMOVE ANY RESIDUAL MATERIAL THAT MAY BE DETRIMENTAL TO INSTALLATION OF NEW FLOORING.SEE DRAWINGS FOR EXTENTS.
02.04 REMOVE EXISTING EXTERIOR WINDOW IN ITS ENTIRETY INCLUDING FASTENERS, ANCHORS, FLASHING, INSULATION, ETC. REPAIR ALL DAMAGE TO EXISTING CONSTRUCTION THAT IS TO REMAIN, READY TO RECEIVE NEW CONSTRUCTION. WITHIN PROJECT LIMITS / PHASE BOUNDARIES U.N.O.
02.05 REMOVE EXISTING WALLS IN THEIR ENTIRETY INCLUDING STRUCTURE, BRACING, FACINGS, FASTENERS, SEALANT, ETC., FROM FINISH FLOOR SLAB TO UNDERSIDE OF STRUCTURE ABOVE. REPAIR ALL DAMAGE TO EXISTING CONSTRUCTION THAT IS TO REMAIN, READY TO RECEIVE NEW CONSTRUCTION WITHIN PROJECT LIMITS / PHASE BOUNDARIES U.N.O.
02.06 REMOVE EXISTING DOOR(S) AND DOOR FRAME IN THEIR ENTIRETY INCLUDING REINFORCING, FASTENERS, ANCHORS, HARDWARE, ETC. REPAIR ALL DAMAGE TO EXISTING CONSTRUCTION THAT IS REMAIN, READY TO RECEIVE NEW CONSTRUCTION, WITHIN PROJECT LIMITS / PHASE BOUNDARIES U.N.O.
02.07 REMOVE EXISTING PLUMBING FIXTURE(S) IN THEIR ENTIRETY INCLUDING ALL ANCHORS, FLANGES, PIPING, ETC. REPAIR ALL DAMAGE TO EXISTING CONSTRUCTION THAT IS TO REMAIN, READY TO RECEIVE NEW CONSTRUCTION, WITHIN PROJECT LIMITS / PHASE BOUNDARIES U.N.O.
02.08 REMOVE EXISTING CASEWORK & FURNITURE IN ITS ENTIRETY INCLUDING ALL ANCHORS, FASTENERS, CONDUIT, ETC. REPAIR ALL DAMAGE TO EXISTING CONSTRUCTION THAT IS TO REMAIN, READY TO RECEIVE NEW CONSTRUCTION AS SHOWN ON DRAWINGS WITHIN PROJECT LIMITS / PHASE BOUNDARIES U.N.O. AND APPROVED BY COR.
02.09 REMOVE EXISTING MECHANICAL ROOM LOUVERS IN ITS ENTIRETY INCLUDING FASTENERS, ANCHORS, FLASHING, INSULATION, ETC. REPAIR ALL DAMAGE TO EXISTING CONSTRUCTION THAT IS TO REMAIN, READY TO RECEIVE NEW CONSTRUCTION, WITHIN PROJECT LIMITS / PHASE BOUNDARIES U.N.O. INSTALL NEW LOUVER IN ORIGINAL OPENING.
02.10 EXTERIOR CHUTE LOCATION - THIS PHASE.
02.12 COORDINATE W/ COR ABOUT RE-IJSE OF PATIENT ROOM LIGHTS IN ADVANCE OF REMOVING EXISTING CLG. REMOVE EXISTING CLG IN ITS ENTIRETY INCLUDING ALL SUPPORTS AND FASTENERS. REPAIR ALL DAMAGE TO EXISTING CONSTRUCTION THAT IS TO REMAIN, READY TO RECEIVE NEW CONSTRUCTION.
02.14 REMOVE EXISTING COLUMN FURRING AND COVER MATERIAL IN THEIR ENTIRETY, INCLUDING ANCHORS, SEALANT, ADHESIVE, ETC. REPAIR ALL DAMAGE TO EXISTING CONSTRUCTION THAT IS TO REMAIN, READY TO RECEIVE NEW CONSTRUCTION.
02.15 REMOVE EXISTING ACCESS DOOR IN ITS ENTIRETY INCLUDING FASTENERS, ANCHORS, ETC., READY TO RECEIVE NEW CONSTRUCTION. COVER OPENING TO PIPE CHASE AFTER REMOVAL UNTIL NEW WORK BEGINS.
02.17 REMOVE ELECTRICAL DEVICES IN EXISTING WALL FOR INSTALLATION OF NEW WALL FINISHES. RESET EXISTING DEVICES IN WALL AFTER INSTALLATION FINISHES.
02.18 CUT OPENING IN EXISTING WALL TO RECEIVE NEW DOOR/WINDOW AS SCHEDULED. SEE STRUCTURAL FOR LINTEL INFORMATION.
02.19 TEMPORARY BARRIER SYSTEM PROVIDED BY GC EXTENTS SHOWN (GC MUST COORDINATE WITH MECHANICAL DRAWINGS SEE SHEET MH102 (ABOVE CEILING WORK ONLY). UPON PROJECT COMPLETION, GC TO DISMANTLE. PACKAGE AND DELIVER TEMPORARY COMPONENTS TO VA. BASIS OF DESIGN: EDGE GUARD http://www.edge-guard.com/
02.21 REMOVE EXISTING WINDOW AND CUT OPENING IN EXISTING WALL BELOW, TO RECEIVE NEW EXTERIOR DOOR. FILL OPENING BETWEEN EXISTING LINTEL AND NEW DOOR, AND PROVIDE NEW BRICK VENEER TO MATCH EXISTING.SEE SPEC SECTION 055000 FOR LINTEL. TOOTH NEW BRICK TO EXISTING WALL FOR INTEGRATED CONSTRUCTION.
02.30 INSTALL NEW TEMPORARY 1 HOUR RATED WALL AND 3/4 HOUR RATED 3' - 0" x 7' - 0" DOOR.
02.32 LOCATION OF TEMPORARY BARRIER WALL, TO BE FURNISHED BY GC.
02.33 REMOVE PORTION OF EXISTING PARAPET/ROOF CURB. SEE DETAILS ON SHEET AE460.
02.34 PREP EXISTING PARAPET/ROOF CURB TO RECEIVE NEW 42" HIGH GUARDRAIL. SEE DETAILS ON SHEET AE460. GC TO FIELD-VERIFY HEIGHT OF PARAPET/ROOF CURB.
02.57 REMOVE EXISTING TERRAZO BASE AT CORRIDOR AND ALL ROOM WALLS, PREPARE FLOOR FOR NEW FINISHES.
02.58 REMOVE EXISTING STEEL PLATE AND PREPARE FLOOR TO RECEIVE NEW FINISHES.
02.60 REMOVE DOOR PANEL DURING THIS PHASE OF CONSTRUCTION, SAFELY STORE AND REINSTALL ONCE CONSTRUCTION PHASE HAS BEEN COMPLETED.
02.61 CONTRACTOR SHALL PATCH ALL PIPE PENETRATIONS OF THE FLOOR SLAB. REFER TO DETAIL D1 ON SHEET AE501.
02.62 DEMO EXISTING TERRAZZO BASE AND FLOOR PERIMETER ON BOTH SIDES OF WALL TO PREPARE FOR NEW CONSTRUCTION.
02.68 AREA WHERE TEMP AHU B AND ROOF ACCESS PATH ARE TO BE INSTALLED.

SYMBOLS LEGEND

INDICATES AREA NOT IN SCOPE OF WORK

PARTITION GRAPHICS


PARTITION PHASING

- EXISTING ELEMENT TO REMAIN
- EXISTING ELEMENT TO BE DEMOLISHED
- TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

- NO RATING
- SMOKE RESISTIVE PARTITION - NON RATED
- 1 HOUR FIRE BARRIER
- 1 HOUR FIRE/SMOKE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN



THIRD FLOOR FFE: 1505.0'
SECOND FLOOR FFE: 1493.0'
FIRST FLOOR FFE: 1479.0'

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC. consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. OAKS REGISTERED ARCHITECT 31080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: PARTIAL SECOND FLOOR DEMOLITION PLAN WARD 2 - PHASE 1

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: RENOVATE MED SURGE WARDS

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: MS


Project Number: 564-17-140

Building Number: 1

Drawing Number: AD052

Sheet 34 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

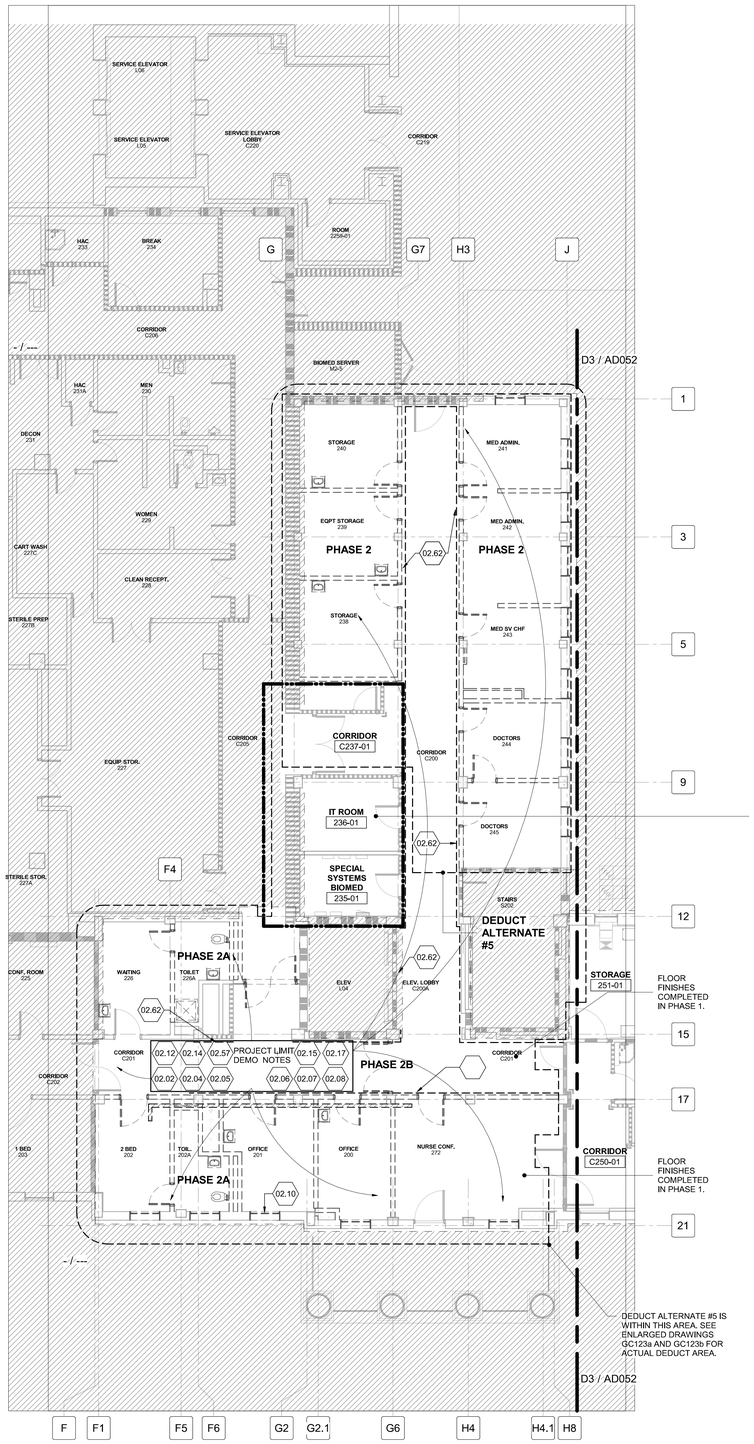

D4 **PARTIAL WARD 2 SECOND FLOOR DEMOLITION PLAN - PHASE 2**

1/8" = 1'-0"

0 4' 8' 16'

GENERAL SHEET NOTES

NOTE: REFER TO ALL PHASING SHEETS. GENERAL CONTRACTOR SHALL ENSURE THAT ALL CONTRACTORS ARE RESPONSIBLE FOR COORDINATION ACROSS ENTIRE SET OF CONSTRUCTION DOCUMENTS.

A. DEMOLITION DRAWINGS ARE DIAGRAMMATIC AND DO NOT INTEND TO SHOW THE FULL EXTENT OF ALL AREAS EFFECTED BY UTILITY DEMOLITION AND RECONSTRUCTION. DEMOLITION SHALL INCLUDE ALL ITEMS INDICATED ON THE DEMOLITION PLANS AND ALL OTHER ITEMS REQUIRED TO BE DEMOLISHED TO ACCOMPLISH NEW CONSTRUCTION.
B. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR CUTTING, PATCHING, AND REPAIR OF ALL EXISTING CONSTRUCTION AND FINISHES REQUIRED FOR THE DEMOLITION AND RECONSTRUCTION OF UTILITIES.
C. ALL PENETRATIONS REMAINING FROM DEMOLITION SHALL BE SEALED, AND IF IN ACOUSTIC, SMOKE, AND / OR FIRE RATED CONSTRUCTION, SEALED TO MATCH THE RATING OF THE ADJACENT CONSTRUCTION, BY THE GENERAL CONTRACTOR.
D. SEE ALL DISCIPLINES AND PHASING DRAWINGS FOR ADDITIONAL DEMOLITION, RECONSTRUCTION, AND PROTECTION INFORMATION.
E. VERIFY ALL DIMENSIONS AND CONDITIONS AT JOB SITE. PORTIONS OF EXISTING WALLS, CEILINGS, ETC. MAY HAVE BEEN PREVIOUSLY REMOVED.
F. UTILITY SHUTDOWN SHALL BE SCHEDULED WITH AND APPROVED BY COR WITH 2 WEEKS MINIMUM WRITTEN NOTICE.
G. CONTRACTOR SHALL COORDINATE WITH COR THE SCHEDULING OF NOISY OR OTHERWISE INTERRUPTIVE OPERATIONS TO MINIMIZE IMPACT ON THE MEDICAL CENTER.
H. REPAIR AND REPLACE AND/OR PATCH ADJACENT FINISHES TO PROVIDE A SMOOTH AND CONTINUOUS FINISH.
I. DEMOLITION SHALL BE PHASED AND AFTER NORMAL BUSINESS HOURS TO ALLOW OWNER OCCUPANCY OF FLOORS ABOVE AND BELOW PROJECT AREA. PROVIDE A SECURED CONSTRUCTION AREA FOR DURATION OF PROJECT.
J. REFER TO PHASING SHEETS FOR ADDITIONAL INFORMATION.
K. ANY EXISTING CONSTRUCTION DISCOVERED DURING DEMOLITION THAT IS NOT NOTED TO BE DEMOLISHED, BUT IS NOT IN USE OR INTENDED TO REMAIN IN USE, SHALL BE REMOVED IN ITS ENTIRETY TO THE POINT OF CONNECTION WITH EXISTING CONSTRUCTION TO REMAIN.
L. APPLY SELF-LEVELING COMPOUND AT ALL REMOVED WALLS.
M. APPLY LEVELING COMPOUND AFTER FLOOR DEMO TO INFILL GOUGES, PITS, AND CRACKS. SCARIFY EXISTING SLAB.
N. CONTRACTOR TO ENSURE BEFORE ANY DEMOLITION STARTS THAT ALL IMPACTED SIGNAGE IN PROJECT LIMITS IS CAREFULLY REMOVED AND STORED AT A SAFE LOCATION FOR REUSE, PER COR.
O. REFER TO SHEET A001 FOR GENERAL DEMOLITION NOTES.
P. REFER TO HA DRAWINGS FOR HAZARDOUS ABATEMENT.
Q. SEE ELECTRICAL DRAWINGS FOR REQUIRED CIRCUIT TRACE REPORT. REPORT MUST BE SUBMITTED PRIOR TO DEMOLITION ACTIVITIES.
R. REPLACE CRACKED, CHIPPED OR FADED CEILING TILES WITH NEW MATCHING CEILING TILES. AFTER FINISHING WORK.
S. FOR DRYWALL CEILINGS, REMOVE PORTIONS OF DRYWALL TO PERFORM ABOVE CEILING WORK. REPLACE DRYWALL AND RUNNERS. INSTALL NEW TAPE AND MUD, THEN SAND AND PAINT.
T. GC TO PROVIDE TEMPORARY SMOKE TIGHT CONSTRUCTION PARTITIONS TO SEPARATE ALL OCCUPIED AREAS FROM DEMOLITION AND CONSTRUCTION. PARTITIONS SHALL BE 1-HOUR FIRE-RATED FULL HEIGHT, EXTENDING THROUGH SUSPENDED CEILINGS TO THE FLOOR SLAB OR ROOF DECK. UNLESS SPRINKLERS ARE OPERATIONAL ON BOTH SIDES OF THE TEMPORARY PARTITION THEN PARTITION MAY BE PERMITTED TO TERMINATE AT THE CEILING.
U. GC TO PROVIDE ADHESIVE MAT FOR INFECTION CONTROL.
V. AT ALL ABANDONED THRU-WALL PENETRATIONS, INFILL WITH MATCHING EXTERIOR FACE BRICK AND MORTAR. TOOTH IN BRICK TO MATCH EXISTING COURSING.
W. DEMO EXISTING TERRAZZO WALL BASE AND 12-INCH FLOOR PERIMETER IN PROJECT AREAS.
X.

SHEET KEYNOTES

02.02 REMOVE EXISTING FLOORING IN ITS ENTIRETY INCLUDING ALL TRIM, ADHESIVES, GROUT, MORTAR, ETC., TO FINISH FLOOR SLAB. CLEAN EXISTING SLAB TO REMOVE ANY RESIDUAL MATERIAL THAT MAY BE DETRIMENTAL TO INSTALLATION OF NEW FLOORING.SEE DRAWINGS FOR EXTENTS.

02.04 REMOVE EXISTING EXTERIOR WINDOW IN ITS ENTIRETY INCLUDING FASTENERS, ANCHORS, FLASHING, INSULATION, ETC, REPAIR ALL DAMAGE TO EXISTING CONSTRUCTION THAT IS TO REMAIN, READY TO RECEIVE NEW CONSTRUCTION. WITHIN PROJECT LIMITS / PHASE BOUNDARIES U.N.O.

02.05 REMOVE EXISTING WALLS IN THEIR ENTIRETY INCLUDING STRUCTURE, BRACING, FACINGS, FASTENERS, SEALANT, ETC., FROM FINISH FLOOR SLAB TO UNDERSIDE OF STRUCTURE ABOVE, REPAIR ALL DAMAGE TO EXISTING CONSTRUCTION THAT IS TO REMAIN, READY TO RECEIVE NEW CONSTRUCTION WITHIN PROJECT LIMITS / PHASE BOUNDARIES U.N.O.

02.06 REMOVE EXISTING DOOR(S) AND DOOR FRAME IN THEIR ENTIRETY INCLUDING REINFORCING, FASTENERS, ANCHORS, HARDWARE, ETC, REPAIR ALL DAMAGE TO EXISTING CONSTRUCTION THAT IS REMAIN, READY TO RECEIVE NEW CONSTRUCTION. WITHIN PROJECT LIMITS / PHASE BOUNDARIES U.N.O.

02.07 REMOVE EXISTING PLUMBING FIXTURE(S) IN THEIR ENTIRETY INCLUDING ALL ANCHORS, FLANGES, PIPING, ETC, REPAIR ALL DAMAGE TO EXISTING CONSTRUCTION THAT IS TO REMAIN, READY TO RECEIVE NEW CONSTRUCTION. WITHIN PROJECT LIMITS / PHASE BOUNDARIES U.N.O.

02.08 REMOVE EXISTING CASEWORK & FURNITURE IN ITS ENTIRETY INCLUDING ALL ANCHORS, FASTENERS, CONDUIT, ETC, REPAIR ALL DAMAGE TO EXISTING CONSTRUCTION THAT IS TO REMAIN, READY TO RECEIVE NEW CONSTRUCTION AS SHOWN ON DRAWINGS WITHIN PROJECT LIMITS / PHASE BOUNDARIES U.N.O. AND APPROVED BY COR.

02.10 EXTERIOR CHUTE LOCATION - THIS PHASE.

02.12 COORDINATE W/ COR ABOUT RE-USE OF PATIENT ROOM LIGHTS IN ADVANCE OF REMOVING EXISTING CLG. REMOVE EXISTING CLG IN ITS ENTIRETY INCLUDING ALL SUPPORTS AND FASTENERS, REPAIR ALL DAMAGE TO EXISTING CONSTRUCTION THAT IS TO REMAIN, READY TO RECEIVE NEW CONSTRUCTION.

02.14 REMOVE EXISTING COLUMN FURRING AND COVER MATERIAL IN THEIR ENTIRETY, INCLUDING ANCHORS, SEALANT, ADHESIVE, ETC. REPAIR ALL DAMAGE TO EXISTING CONSTRUCTION THAT IS TO REMAIN, READY TO RECEIVE NEW CONSTRUCTION.

02.15 REMOVE EXISTING ACCESS DOOR IN ITS ENTIRETY INCLUDING FASTENERS, ANCHORS, ETC., READY TO RECEIVE NEW CONSTRUCTION. COVER OPENING TO PIPE CHASE AFTER REMOVAL UNTIL NEW WORK BEGINS.

02.17 REMOVE ELECTRICAL DEVICES IN EXISTING WALL FOR INSTALLATION OF NEW WALL FINISHES. RESET EXISTING DEVICES IN WALL AFTER INSTALLATION FINISHES.

02.57 REMOVE EXISTING TERRAZO BASE AT CORRIDOR AND ALL ROOM WALLS, PREPARE FLOOR FOR NEW FINISHES.

02.62 DEMO EXISTING TERRAZZO BASE AND FLOOR PERIMETER ON BOTH SIDES OF WALL TO PREPARE FOR NEW CONSTRUCTION.

SYMBOLS LEGEND

INDICATES AREA NOT IN SCOPE OF WORK

PARTITION GRAPHICS


PARTITION PHASING

- EXISTING ELEMENT TO REMAIN
- EXISTING ELEMENT TO BE DEMOLISHED
- TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

- NO RATING
- SMOKE RESISTIVE PARTITION - NON RATED
- 1 HOUR FIRE BARRIER
- 1 HOUR FIRE/SMOKE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN



Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.
JONATHAN K. CLARK REGISTERED ARCHITECT 11080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE
CHARLOTTE, NC 28227
P 704.814.1320
F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **PARTIAL WARD 2 SECOND FLOOR DEMOLITION PLAN - PHASE 2**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: MS

Project Number: 564-17-140

Building Number: 1

Drawing Number: **AD053**

Sheet 35 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

GENERAL SHEET NOTES


NOTE: REFER TO ALL PHASING SHEETS. GENERAL CONTRACTOR SHALL ENSURE THAT ALL CONTRACTORS ARE RESPONSIBLE FOR COORDINATION ACROSS ENTIRE SET OF CONSTRUCTION DOCUMENTS.

A. DEMOLITION DRAWINGS ARE DIAGRAMMATIC AND DO NOT INTEND TO SHOW THE FULL EXTENT OF ALL AREAS EFFECTED BY UTILITY DEMOLITION AND RECONSTRUCTION. DEMOLITION SHALL INCLUDE ALL ITEMS INDICATED ON THE DEMOLITION PLANS AND ALL OTHER ITEMS REQUIRED TO BE DEMOLISHED TO ACCOMPLISH NEW CONSTRUCTION.
B. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR CUTTING, PATCHING, AND REPAIR OF ALL EXISTING CONSTRUCTION AND FINISHES REQUIRED FOR THE DEMOLITION AND RECONSTRUCTION OF UTILITIES.
C. ALL PENETRATIONS REMAINING FROM DEMOLITION SHALL BE SEALED, AND IF IN ACOUSTIC, SMOKE, AND / OR FIRE RATED CONSTRUCTION, SEALED TO MATCH THE RATING OF THE ADJACENT CONSTRUCTION, BY THE GENERAL CONTRACTOR.
D. SEE ALL DISCIPLINES AND PHASING DRAWINGS FOR ADDITIONAL DEMOLITION, RECONSTRUCTION, AND PROTECTION INFORMATION.
E. VERIFY ALL DIMENSIONS AND CONDITIONS AT JOB SITE. PORTIONS OF EXISTING WALLS, CEILINGS, ETC. MAY HAVE BEEN PREVIOUSLY REMOVED.
F. UTILITY SHUTDOWN SHALL BE SCHEDULED WITH AND APPROVED BY COR WITH 2 WEEKS MINIMUM WRITTEN NOTICE.
G. CONTRACTOR SHALL COORDINATE WITH COR THE SCHEDULING OF NOISY OR OTHERWISE INTERRUPTIVE OPERATIONS TO MINIMIZE IMPACT ON THE MEDICAL CENTER.
H. REPAIR AND REPLACE AND/OR PATCH ADJACENT FINISHES TO PROVIDE A SMOOTH AND CONTINUOUS FINISH.
I. DEMOLITION SHALL BE PHASED AND AFTER NORMAL BUSINESS HOURS TO ALLOW OWNER OCCUPANCY OF FLOORS ABOVE AND BELOW PROJECT AREA.
J. PROVIDE A SECURED CONSTRUCTION AREA FOR DURATION OF PROJECT.
K. REFER TO PHASING SHEETS FOR ADDITIONAL INFORMATION.
L. ANY EXISTING CONSTRUCTION DISCOVERED DURING DEMOLITION THAT IS NOT NOTED TO BE DEMOLISHED, BUT IS NOT IN USE OR INTENDED TO REMAIN IN USE, SHALL BE REMOVED IN ITS ENTIRETY TO THE POINT OF CONNECTION WITH EXISTING CONSTRUCTION TO REMAIN.
M. APPLY SELF-LEVELING COMPOUND AT ALL REMOVED WALLS.
N. APPLY LEVELING COMPOUND AFTER FLOOR DEMO TO INFILL GOUGES, PITS, AND CRACKS. SCARIFY EXISTING SLAB.
O. CONTRACTOR TO ENSURE BEFORE ANY DEMOLITION STARTS THAT ALL IMPACTED SIGNAGE IN PROJECT LIMITS IS CAREFULLY REMOVED AND STORED AT A SAFE LOCATION FOR REUSE, PER COR.
P. REFER TO SHEET A0001 FOR GENERAL DEMOLITION NOTES.
Q. REFER TO HA DRAWINGS FOR HAZARDOUS ABATEMENT.
R. SEE ELECTRICAL DRAWINGS FOR REQUIRED CIRCUIT TRACE REPORT, REPORT MUST BE SUBMITTED PRIOR TO DEMOLITION ACTIVITIES.
S. REPLACE CRACKED, CHIPPED OR FADED CEILING TILES WITH NEW MATCHING CEILING TILES, AFTER FINISHING WORK.
T. FOR DRYWALL CEILINGS, REMOVE PORTIONS OF DRYWALL TO PERFORM ABOVE CEILING WORK. REPLACE DRYWALL AND RUNNERS. INSTALL NEW TAPE AND MUD, THEN SAND AND PAINT.
U. GC TO PROVIDE TEMPORARY SMOKE TIGHT CONSTRUCTION PARTITIONS TO SEPARATE ALL OCCUPIED AREAS FROM DEMOLITION AND CONSTRUCTION. PARTITIONS SHALL BE 1-HOUR FIRE-RATED FULL HEIGHT, EXTENDING THROUGH SUSPENDED CEILINGS TO THE FLOOR SLAB OR ROOF DECK. UNLESS SPRINKLERS ARE OPERATIONAL ON BOTH SIDES OF THE TEMPORARY PARTITION THEN PARTITION MAY BE PERMITTED TO TERMINATE AT THE CEILING.
V. GC TO PROVIDE ADHESIVE MAT FOR INFECTION CONTROL.
W. AT ALL ABANDONED THRU-WALL, PENETRATIONS, INFILL WITH MATCHING EXTERIOR FACE BRICK AND MORTAR. TOOTH IN BRICK TO MATCH EXISTING COURSING.
X. DEMO EXISTING TERRAZZO WALL BASE AND 12-INCH FLOOR PERIMETER IN PROJECT AREAS.

SHEET KEYNOTES

02.21 REMOVE EXISTING WINDOW AND CUT OPENING IN EXISTING WALL BELOW, TO RECEIVE NEW EXTERIOR DOOR. FILL OPENING BETWEEN EXISTING LINTEL AND NEW DOOR, AND PROVIDE NEW BRICK VENEER TO MATCH EXISTING.SEE SPEC SECTION 055000 FOR LINTEL, TOOTH NEW BRICK TO EXISTING WALL FOR INTEGRATED CONSTRUCTION.

08.13 GLAZING AT EXISTING WINDOW TO BE REPLACED BY NEW 60-MIN FIRE-RATED GLASS.

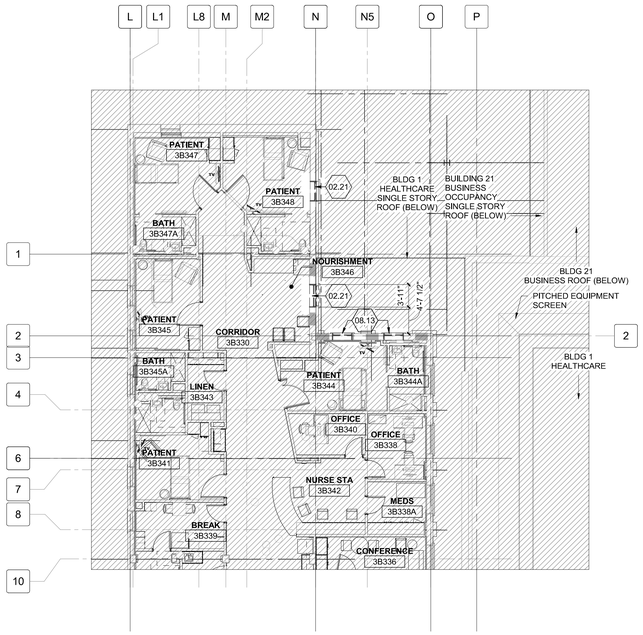

D5 THIRD FLOOR DEMOLITION PLAN - WARD 3B

3/32" = 1'-0"

0 5' 10' 20'

SYMBOLS LEGEND

INDICATES AREA NOT IN SCOPE OF WORK

PARTITION GRAPHICS


PARTITION PHASING

- EXISTING ELEMENT TO REMAIN
- EXISTING ELEMENT TO BE DEMOLISHED
- TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

- NO RATING
- SMOKE RESISTIVE PARTITION - NON RATED
- 1 HOUR FIRE BARRIER
- 1 HOUR FIRE/SMOKE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN



Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC. consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signatures not valid without Certificate below seal.

JONATHAN M. OAKS REGISTERED ARCHITECT 31080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE CHARLOTTE, NC 28227
P 704.814.1320
F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **PARTIAL THIRD FLOOR DEMOLITION PLAN - WARD 3B**

Project Title: **RENOVATE MED SURGE WARDS**

Project Number: 564-17-140
Building Number: 1

Project Phase: BID DOCUMENTS
FULLY SPRINKLERED

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS
Date: MARCH 24, 2024
Checked: JC/LK
Drawn: DW

Drawing Number: **AD054**
Sheet 36 of 162


Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

GENERAL SHEET NOTES

A. REFER TO SHEET AI001 FOR GENERAL FLOOR PLAN NOTES AND SYMBOLS.
B. FOR PATIENT BED, HEADWALL, & PATIENT LIFT COORDINATION, SEE REFLECTED CEILING PLAN SHEETS , QH102 - QH104, AND PATIENT LIFT SUPPORT A3 / AE501.
C. FOR TYPICAL PATIENT BEDROOM / TOILET ROOM LAYOUT, SEE TYPICAL PLANS ON AE404.
D. ALL RATED PENETRATIONS TO BE SEALED WITH RED FIRE RATED CAULKING. USE ACOUSTICAL CAULKING ON ALL OTHER WALL PENETRATIONS.
E. FOR DOOR INFORMATION SEE AE400 SERIES SHEETS & AE601.
F. FOR PARTITION TYPES SEE GI501, AND WALL IDENTIFICATION TAGS, SEE AE400 SERIES SHEETS.
G. FOR RAISED FLOOR LAYOUT SEE SHEETS AE106.
H. FOR WINDOW TYPES & DETAILS, SEE AE602 FOR INFORMATION.


SHEET KEYNOTES

22.02 NEW BOOSTER PUMP, SEE PLUMBING DRAWINGS PL100 FOR INFORMATION.

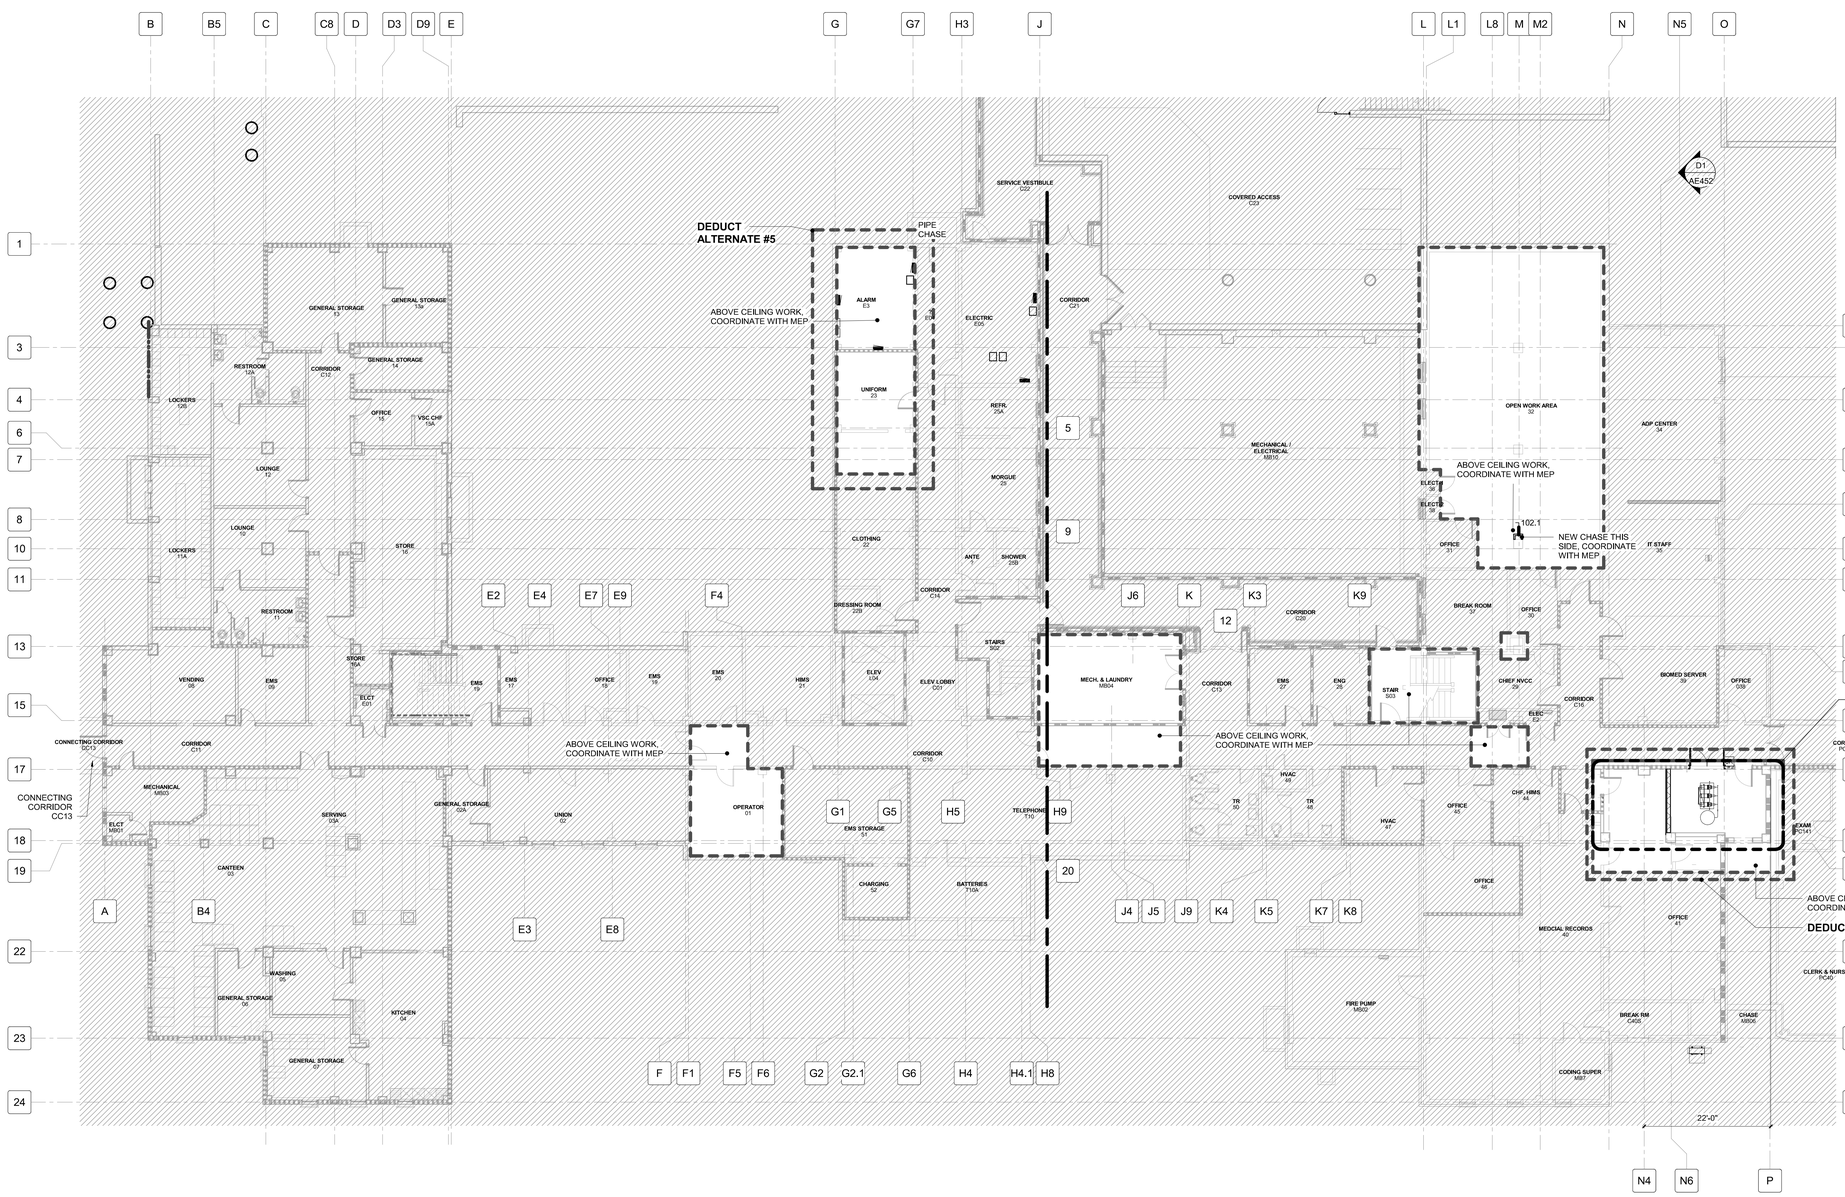

D1 BASEMENT FLOOR PLAN - PHASES 1-3

3/32" = 1'-0"

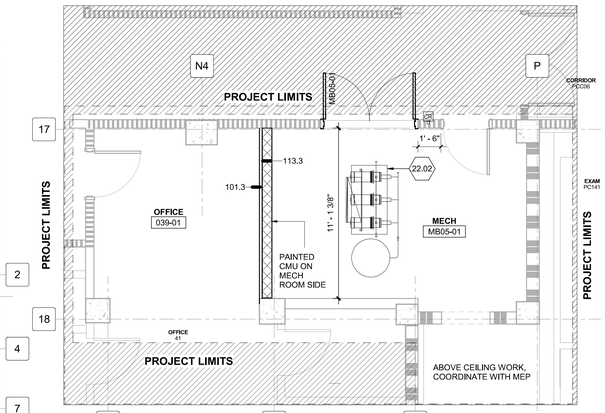

B6 ENLARGED BASEMENT PARTIAL PLAN

1/4" = 1'-0"

SYMBOLS LEGEND

INDICATES AREA NOT IN SCOPE OF WORK

INDICATES AREA OF ABOVE CEILING WORK

PARTITION GRAPHICS

PARTITION PHASING

EXISTING ELEMENT TO REMAIN

EXISTING ELEMENT TO BE DEMOLISHED

TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

NO RATING

SMOKE RESISTIVE PARTITION - NON RATED


1 HOUR FIRE BARRIER

1 HOUR FIRE/SMOKE BARRIER

2 HOUR FIRE BARRIER

2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN



Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.
JONATHAN M. CRAIG — REGISTERED ARCHITECT — 11080 — CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE
CHARLOTTE, NC 28227
P 704.814.1320
F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: BASEMENT FLOOR PLAN - PHASES 1-3

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: RENOVATE MED SURGE WARDS

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: MS

Project Number: 564-17-140


Building Number: 1

Drawing Number: AE050

Sheet 37 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

BIM 360://18002 Fayetteville AR Renovate Med Surge Ward/18002 ARCH 2020.rvt

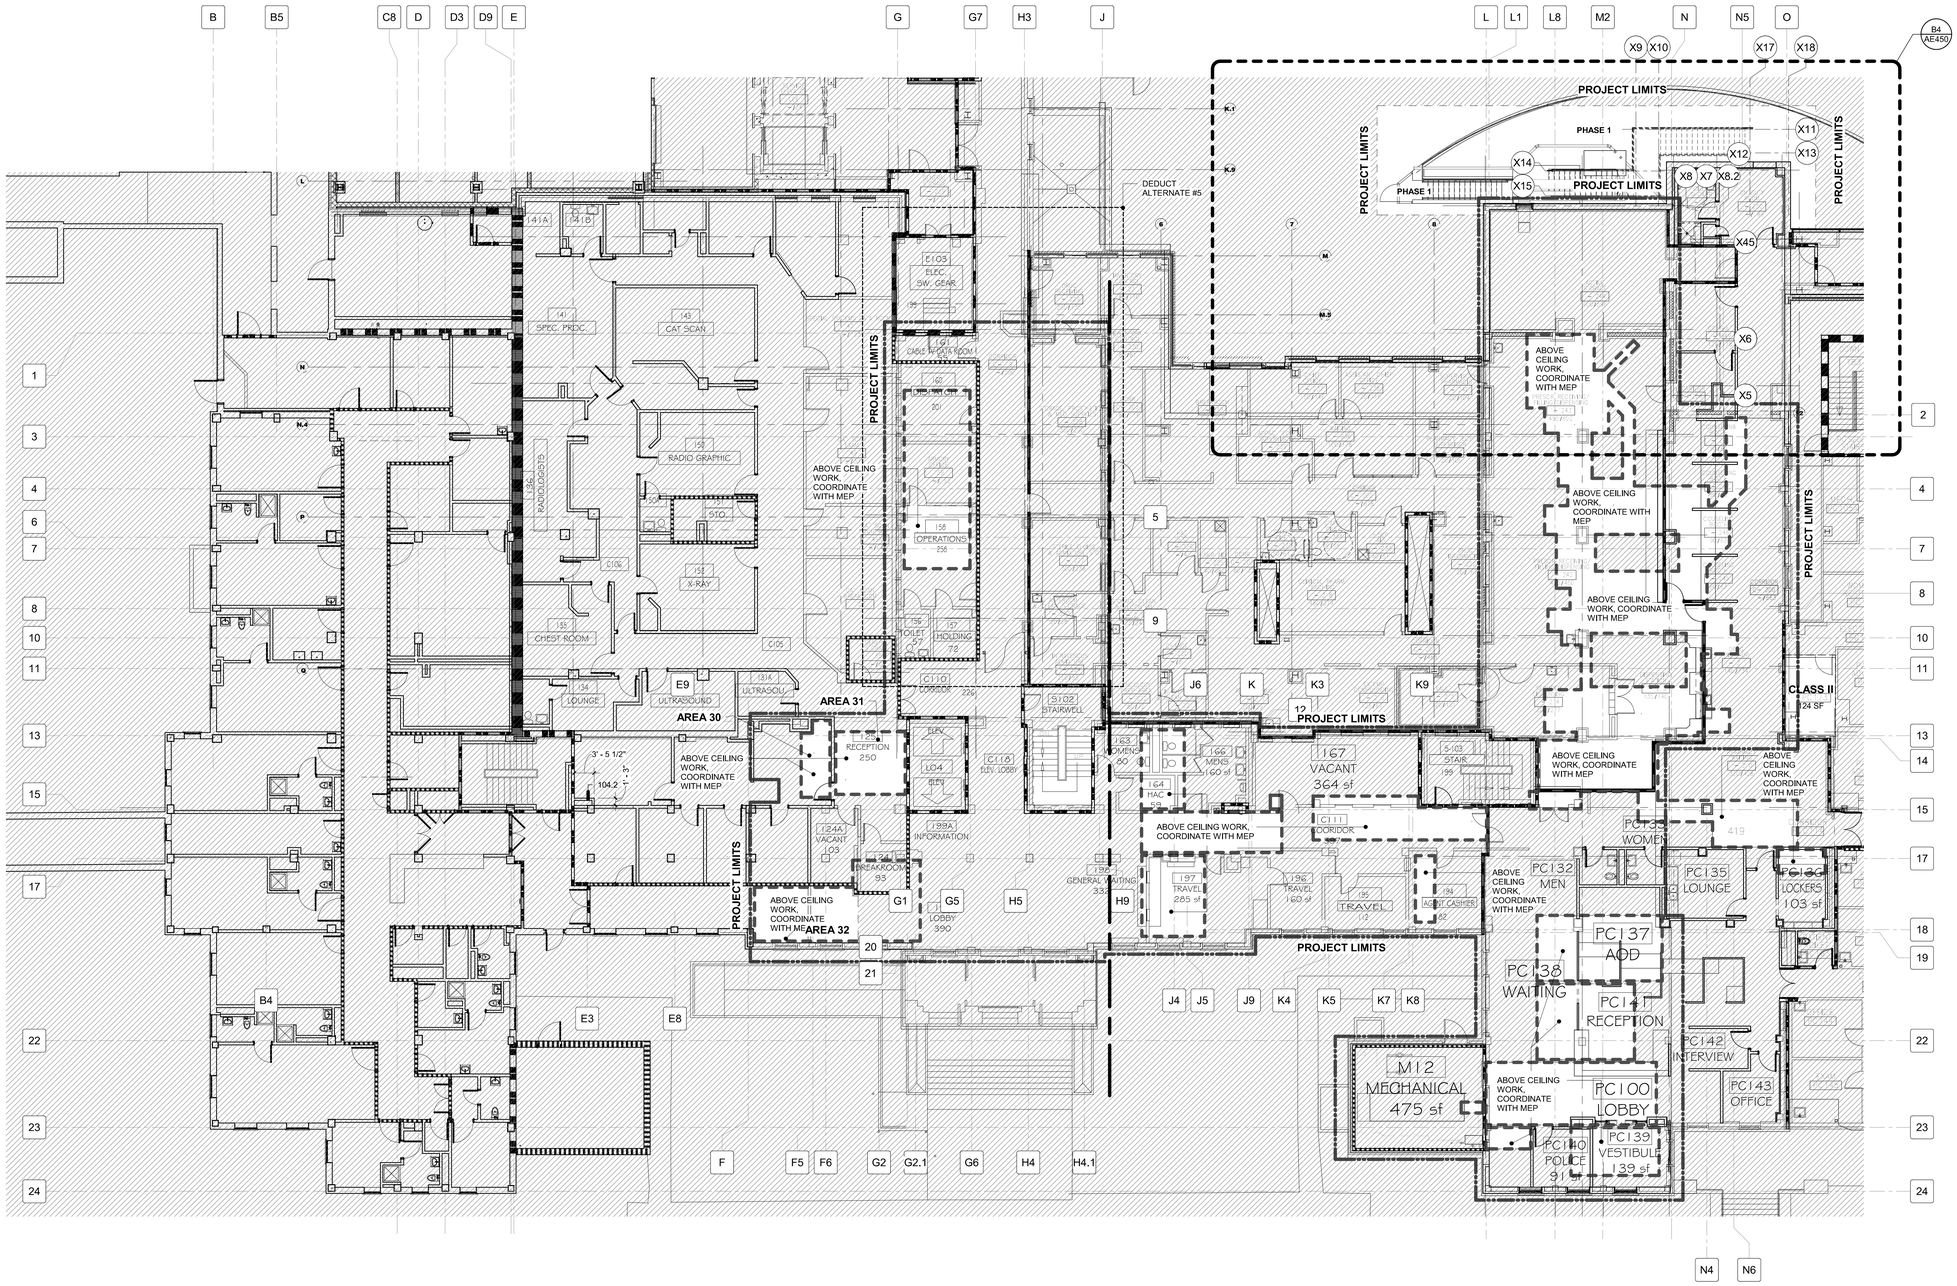

D2 OVERALL FIRST FLOOR PLAN - PHASES 1 - 2

3/32" = 1'-0"

0 5' 10' 20'

GENERAL SHEET NOTES

A. REFER TO SHEET AI001 FOR GENERAL FLOOR PLAN NOTES AND SYMBOLS.
B. FOR PATIENT BED, HEADWALL, & PATIENT LIFT COORDINATION, SEE REFLECTED CEILING PLAN SHEETS , QH102 - QH104, AND PATIENT LIFT SUPPORT A3 / AE501.
C. FOR TYPICAL PATIENT BEDROOM / TOILET ROOM LAYOUT, SEE TYPICAL PLANS ON AE404.
D. ALL RATED PENETRATIONS TO BE SEALED WITH RED FIRE RATED CAULKING. USE ACOUSTICAL CAULKING ON ALL OTHER WALL PENETRATIONS.
E. FOR DOOR INFORMATION SEE AE400 SERIES SHEETS & AE601.
F. FOR PARTITION TYPES SEE GI501, AND WALL IDENTIFICATION TAGS, SEE AE400 SERIES SHEETS.
G. FOR RAISED FLOOR LAYOUT SEE SHEETS AE106.
H. FOR WINDOW TYPES & DETAILS, SEE AE602 FOR INFORMATION.

SHEET KEYNOTES

REFER TO SHEET AI001 FOR GENERAL DEMOLITION NOTES.

SYMBOLS LEGEND

- INDICATES AREA NOT IN SCOPE OF WORK
- INDICATES FUTURE WORK WARD 2A BOUNDARY
- INDICATES AREA OF ABOVE CEILING WORK

PARTITION GRAPHICS


PARTITION PHASING

- EXISTING ELEMENT TO REMAIN
- EXISTING ELEMENT TO BE DEMOLISHED
- TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

- NO RATING
- SMOKE RESISTIVE PARTITION - NON RATED
- 1 HOUR FIRE BARRIER
- 1 HOUR FIRE/SMOKE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN



Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC. consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN E. CARR REGISTERED ARCHITECT 11088 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: OVERALL FIRST FLOOR PLAN - PHASES 1 - 2

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: RENOVATE MED SURGE WARDS

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: DW


Project Number: 564-17-140

Building Number: 1

Drawing Number: AE100

Sheet 38 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

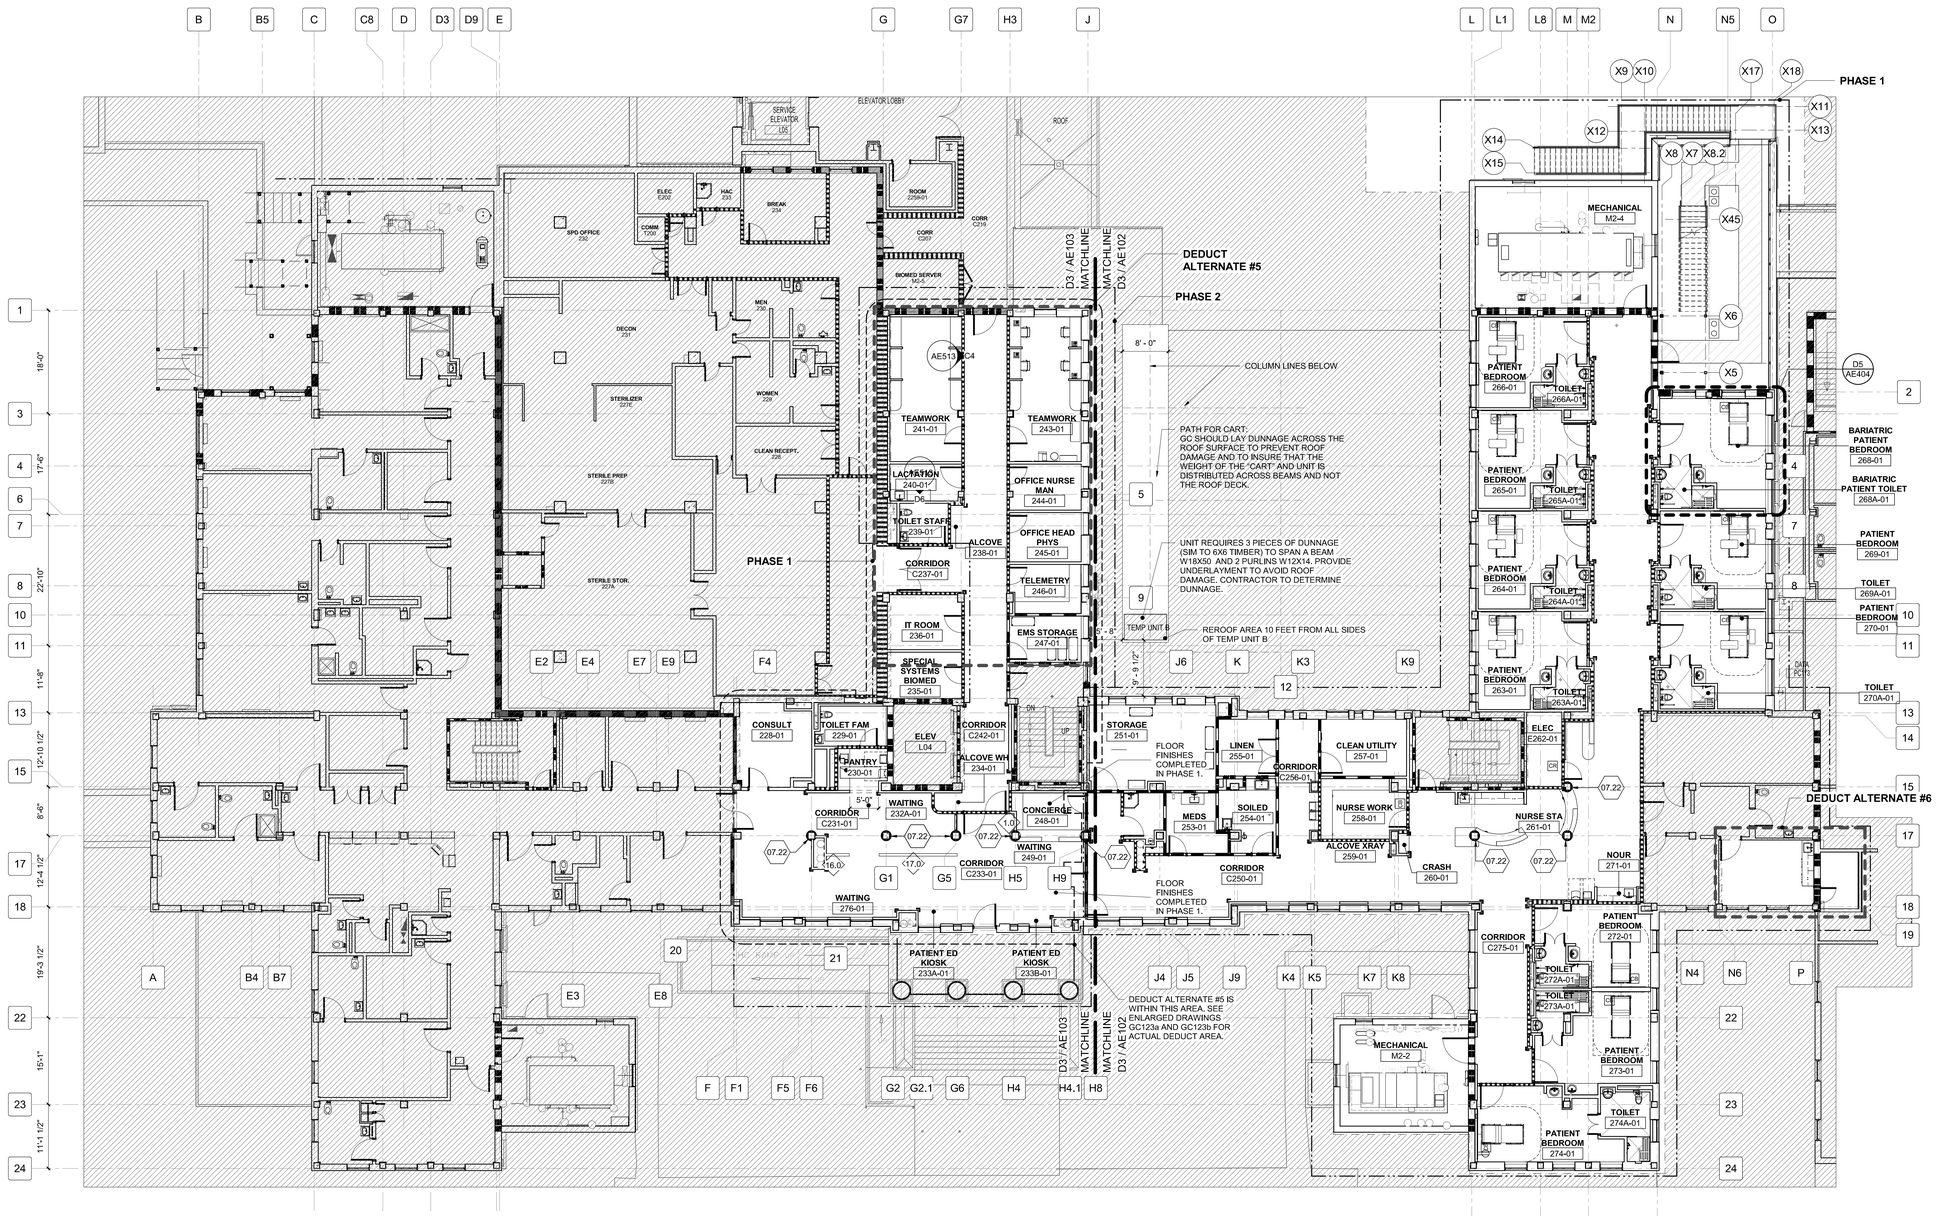

D2 OVERALL SECOND FLOOR PLAN - NEW WORK

3/32" = 1'-0"

0' 5' 10' 20'

GENERAL SHEET NOTES

A. REFER TO SHEET A001 FOR GENERAL FLOOR PLAN NOTES AND SYMBOLS.
B. FOR PATIENT BED, HEADWALL, & PATIENT LIFT COORDINATION, SEE REFLECTED CEILING PLAN SHEETS , QH102 - QH104, AND PATIENT LIFT SUPPORT A3 / AE501.
C. FOR TYPICAL PATIENT BEDROOM / TOILET ROOM LAYOUT, SEE TYPICAL PLANS ON AE404.
D. ALL RATED PENETRATIONS TO BE SEALED WITH RED FIRE RATED CAULKING. USE ACOUSTICAL CAULKING ON ALL OTHER WALL PENETRATIONS.
E. FOR DOOR INFORMATION SEE AE400 SERIES SHEETS & AE601.
F. FOR PARTITION TYPES SEE GI501, AND WALL IDENTIFICATION TAGS, SEE AE400 SERIES SHEETS.
G. FOR RAISED FLOOR LAYOUT SEE SHEETS AE106.
H. FOR WINDOW TYPES & DETAILS, SEE AE602 FOR INFORMATION.

SHEET KEYNOTES

07.22 SEE C1/AE511 FOR COLUMN COVERS, TYPICAL.

SYMBOLS LEGEND

INDICATES AREA NOT IN SCOPE OF WORK

INDICATES EGRESS WALKWAY AT EXTERIOR STAIR

PARTITION GRAPHICS

PARTITION PHASING

EXISTING ELEMENT TO REMAIN

EXISTING ELEMENT TO BE DEMOLISHED

TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

NO RATING

SMOKE RESISTIVE PARTITION - NON RATED


1 HOUR FIRE BARRIER

1 HOUR FIRE/SMOKE BARRIER

2 HOUR FIRE BARRIER

2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN

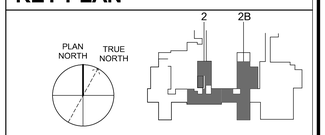

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.
JONATHAN M. CARR REGISTERED ARCHITECT 31080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **OVERALL SECOND FLOOR PLAN - NEW WORK**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: MS


Project Number: 564-17-140

Building Number: 1

Drawing Number: **AE101**

Sheet 39 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

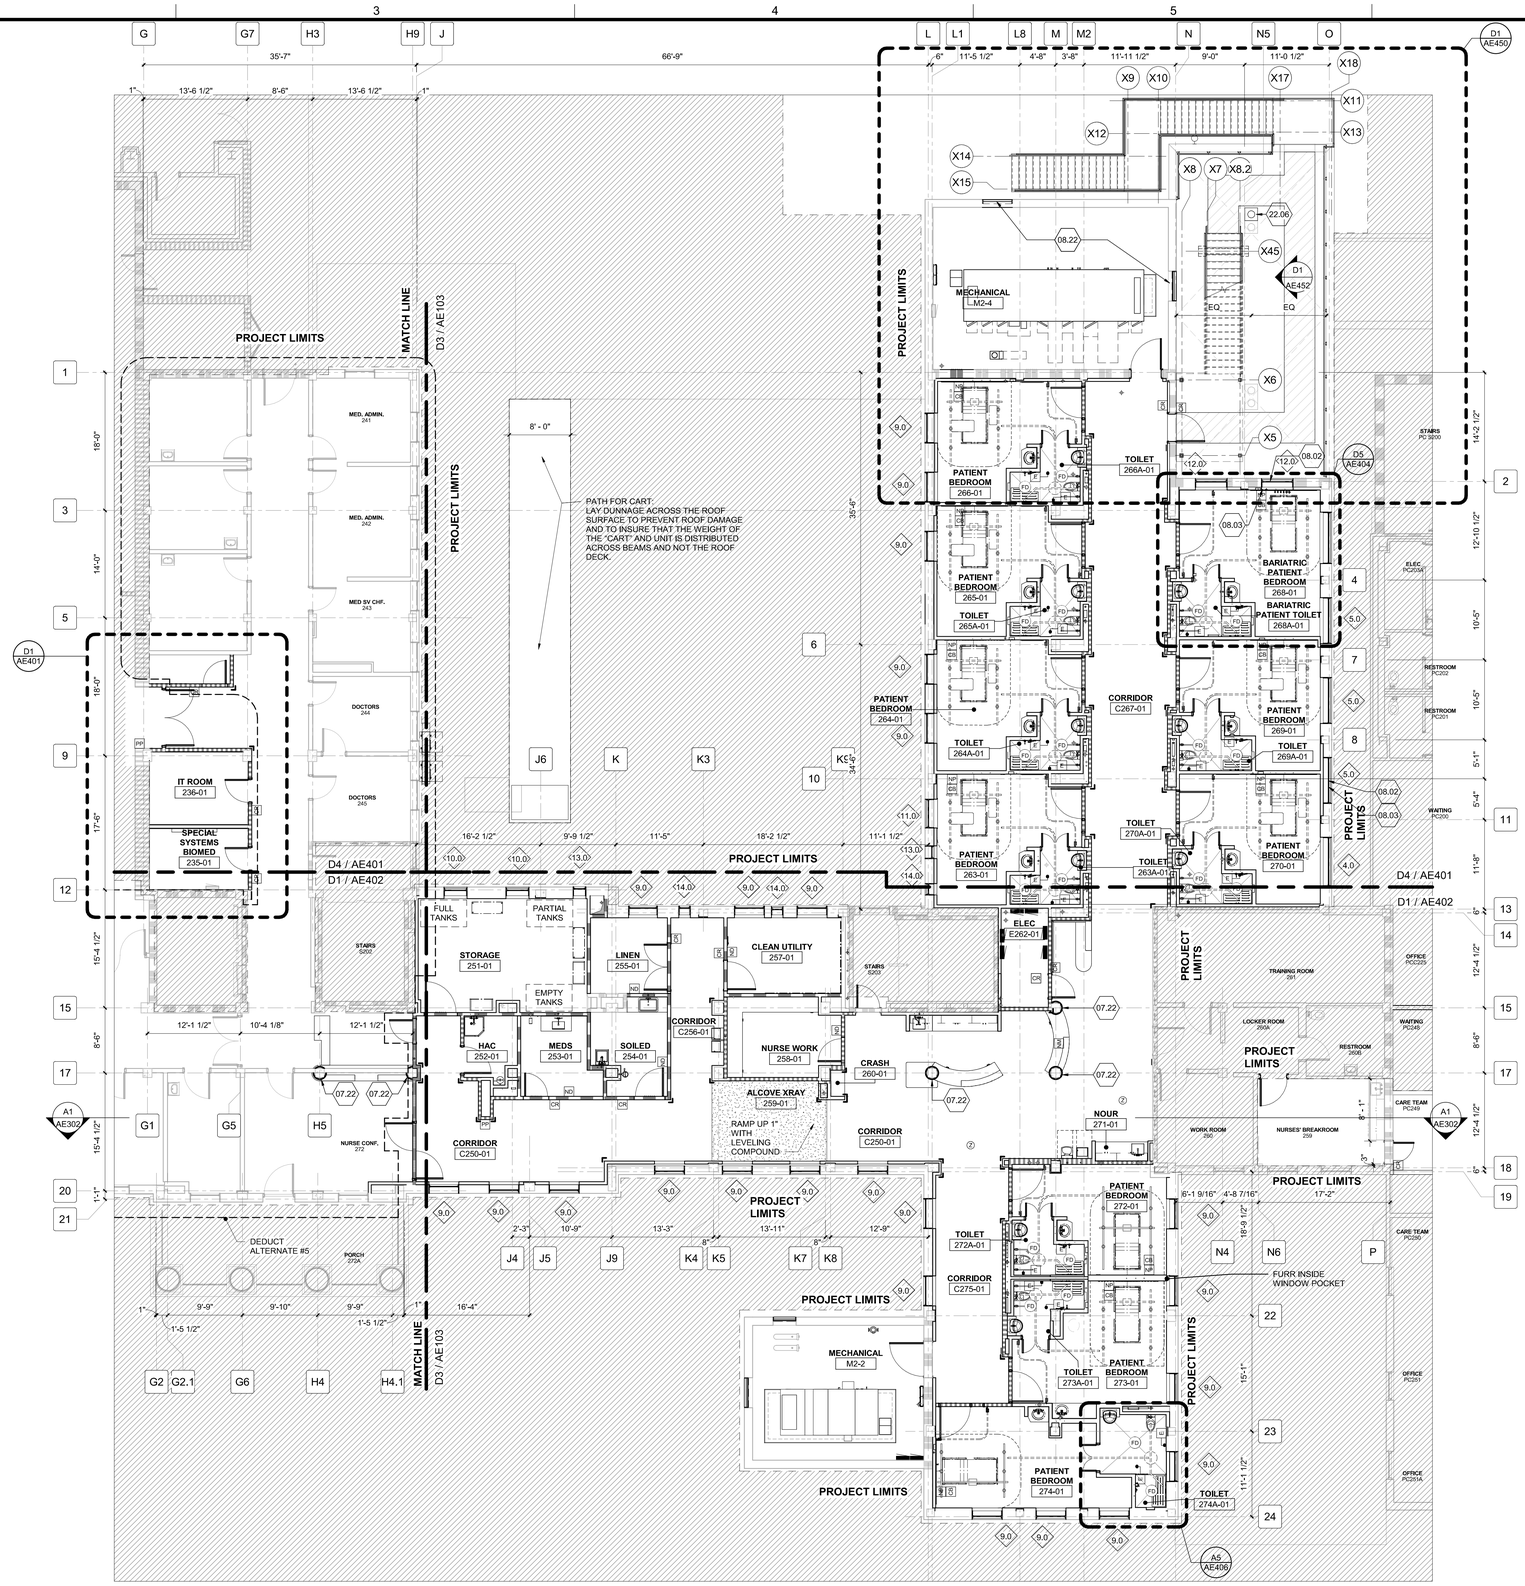

D3 PARTIAL WARD 2B SECOND FLR CONSTRUCTION PLAN - PHASE 1

1/8" = 1'-0"

REFERENCE: D2 / AE101

0 4" 8" 16"

GENERAL SHEET NOTES

A. REFER TO SHEET AI001 FOR GENERAL FLOOR PLAN NOTES AND SYMBOLS.
B. FOR PATIENT BED, HEADWALL, & PATIENT LIFT COORDINATION, SEE REFLECTED CEILING PLAN SHEETS , QH102 - QH104, AND PATIENT LIFT SUPPORT A3 / AE501.
C. FOR TYPICAL PATIENT BEDROOM / TOILET ROOM LAYOUT, SEE TYPICAL PLANS ON AE404.
D. ALL RATED PENETRATIONS TO BE SEALED WITH RED FIRE RATED CAULKING. USE ACOUSTICAL CAULKING ON ALL OTHER WALL PENETRATIONS.
E. FOR DOOR INFORMATION SEE AE400 SERIES SHEETS & AE601.
F. FOR PARTITION TYPES SEE GI501, AND WALL IDENTIFICATION TAGS, SEE AE400-SERIES SHEETS.
G. FOR RAISED FLOOR LAYOUT SEE SHEETS AE106.
H. FOR WINDOW TYPES & DETAILS, SEE AE602 FOR INFORMATION.

SHEET KEYNOTES

07.22 SEE C1/AE511 FOR COLUMN COVERS, TYPICAL.
08.02 SPANDREL GLASS AT THESE WINDOWS.
08.03 FURR OUT TO CLOSE-IN WINDOW INTERIOR-SIDE AT OPENING.
08.22 TEMPORARY INFILL LOUVER OPENING WITH EXTERIOR GRADE PLYWOOD FOR TEMPORARY AHU DUCTWORK. REINSTALL EXISTING LOUVER ONCE NEW AHU IS OPERATIONAL.
22.06 USE NEW ROOF DRAIN AND ROOF LEADER CONNECTING TO EXISTING PIPING. SEE PLUMBING DRAWINGS FOR INFORMATION. GC SHALL MAINTAIN ROOF SLOPE TO DRAINS.

SYMBOLS LEGEND

PROJECT LIMITS

NOT IN SCOPE
AREA OUTSIDE OF PROJECT LIMITS

INDICATES EGRESS WALKWAY AT EXTERIOR STAIR

PARTITION GRAPHICS


PARTITION PHASING

EXISTING ELEMENT TO REMAIN
EXISTING ELEMENT TO BE DEMOLISHED
TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

NO RATING
SMOKE RESISTIVE PARTITION - NON RATED
1 HOUR FIRE BARRIER
1 HOUR FIRE/SMOKE BARRIER
2 HOUR FIRE BARRIER
2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN



Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.
JONATHAN M. OAKES REGISTERED ARCHITECT 31080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023


Drawing Title: PARTIAL WARD 2B SECOND FLOOR CONSTRUCTION PLAN - PHASE 1
Project Phase: BID DOCUMENTS
FULLY SPRINKLERED

Project Title: RENOVATE MED SURGE WARDS
Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS
Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: MS

Project Number: 564-17-140
Building Number: 1
Drawing Number: AE102
Sheet 40 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

BIM 360://18002 Fayetteville AR Renovate Med Surge Ward/18002 ARCH 2020.rvt

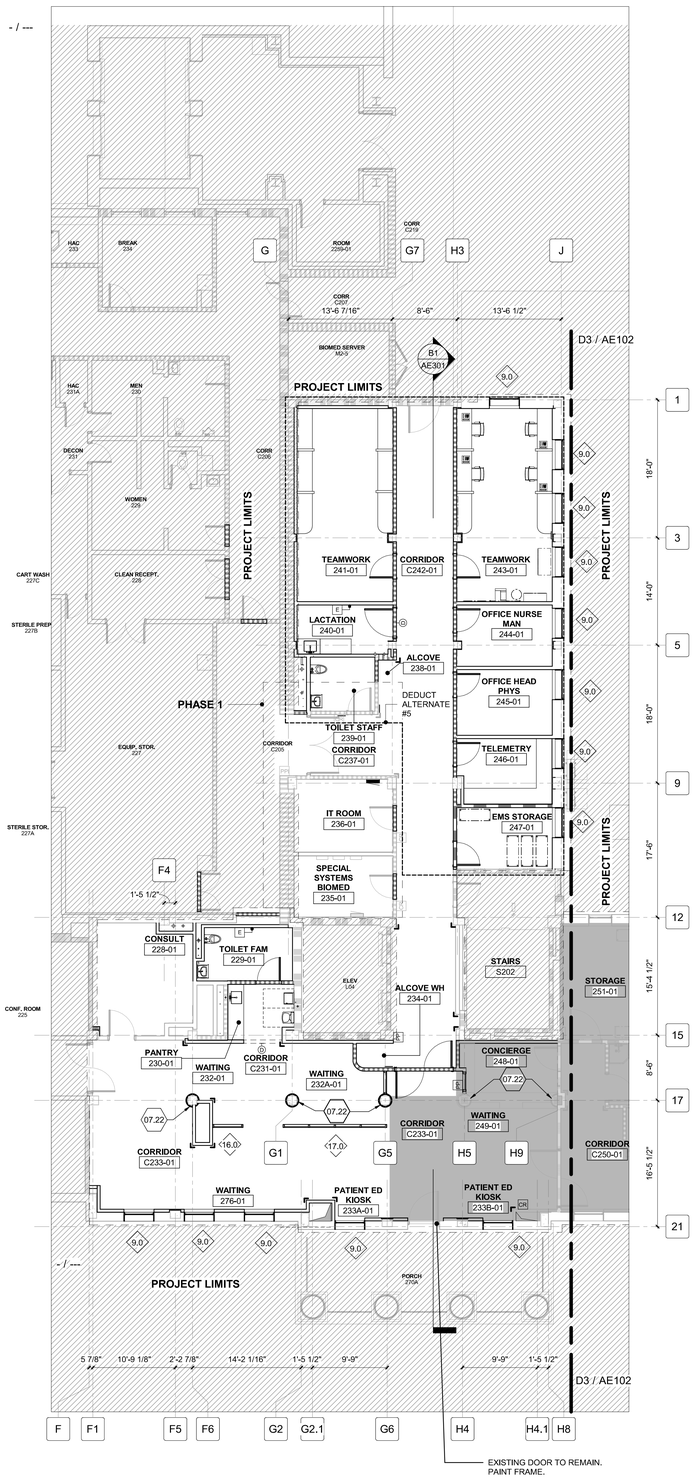

D3 PARTIAL WARD 2 SECOND FLOOR CONSTRUCTION PLAN - PHASE 2

1/8" = 1'-0"

REFERENCE: D2 / AE101

0 4' 8' 16'

GENERAL SHEET NOTES

A. REFER TO SHEET A0001 FOR GENERAL FLOOR PLAN NOTES AND SYMBOLS.
B. FOR PATIENT BED, HEADWALL, & PATIENT LIFT COORDINATION, SEE REFLECTED CEILING PLAN SHEETS , QH102 - QH104, AND PATIENT LIFT SUPPORT A3 / AE501.
C. FOR TYPICAL PATIENT BEDROOM / TOILET ROOM LAYOUT, SEE TYPICAL PLANS ON AE404.
D. ALL RATED PENETRATIONS TO BE SEALED WITH RED FIRE RATED CAULKING. USE ACOUSTICAL CAULKING ON ALL OTHER WALL PENETRATIONS.
E. FOR DOOR INFORMATION SEE AE400 SERIES SHEETS & AE601.
F. FOR PARTITION TYPES SEE GI501, AND WALL IDENTIFICATION TAGS, SEE AE400 SERIES SHEETS.
G. FOR RAISED FLOOR LAYOUT SEE SHEETS AE106.
H. FOR WINDOW TYPES & DETAILS, SEE AE602 FOR INFORMATION.

SHEET KEYNOTES

07.22 SEE C1/AE511 FOR COLUMN COVERS, TYPICAL.

SYMBOLS LEGEND

PROJECT LIMITS

NOT IN SCOPE
AREA OUTSIDE OF PROJECT LIMITS

PHASE 1

PARTITION GRAPHICS

PARTITION PHASING

EXISTING ELEMENT TO REMAIN

EXISTING ELEMENT TO BE DEMOLISHED

TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

NO RATING

SMOKE RESISTIVE PARTITION - NON RATED


1 HOUR FIRE BARRIER

1 HOUR FIRE/SMOKE BARRIER

2 HOUR FIRE BARRIER

2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN



Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC. consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. CLARK REGISTERED ARCHITECT 11099 NORTH CAROLINA CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE
CHARLOTTE, NC 28227
P 704.814.1320
F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: PARTIAL WARD 2 SECOND FLOOR CONSTRUCTION PLAN - PHASE 2

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: RENOVATE MED SURGE WARDS

Project Number: 564-17-140

Building Number: 1

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Drawing Number: AE103

Date: MARCH 24, 2024


Checked: JC/LK

Drawn: MS

Sheet 41 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

BIM 360://18002 Fayetteville AR Renovate Med Surge Ward/18002 ARCH 2020.rvt

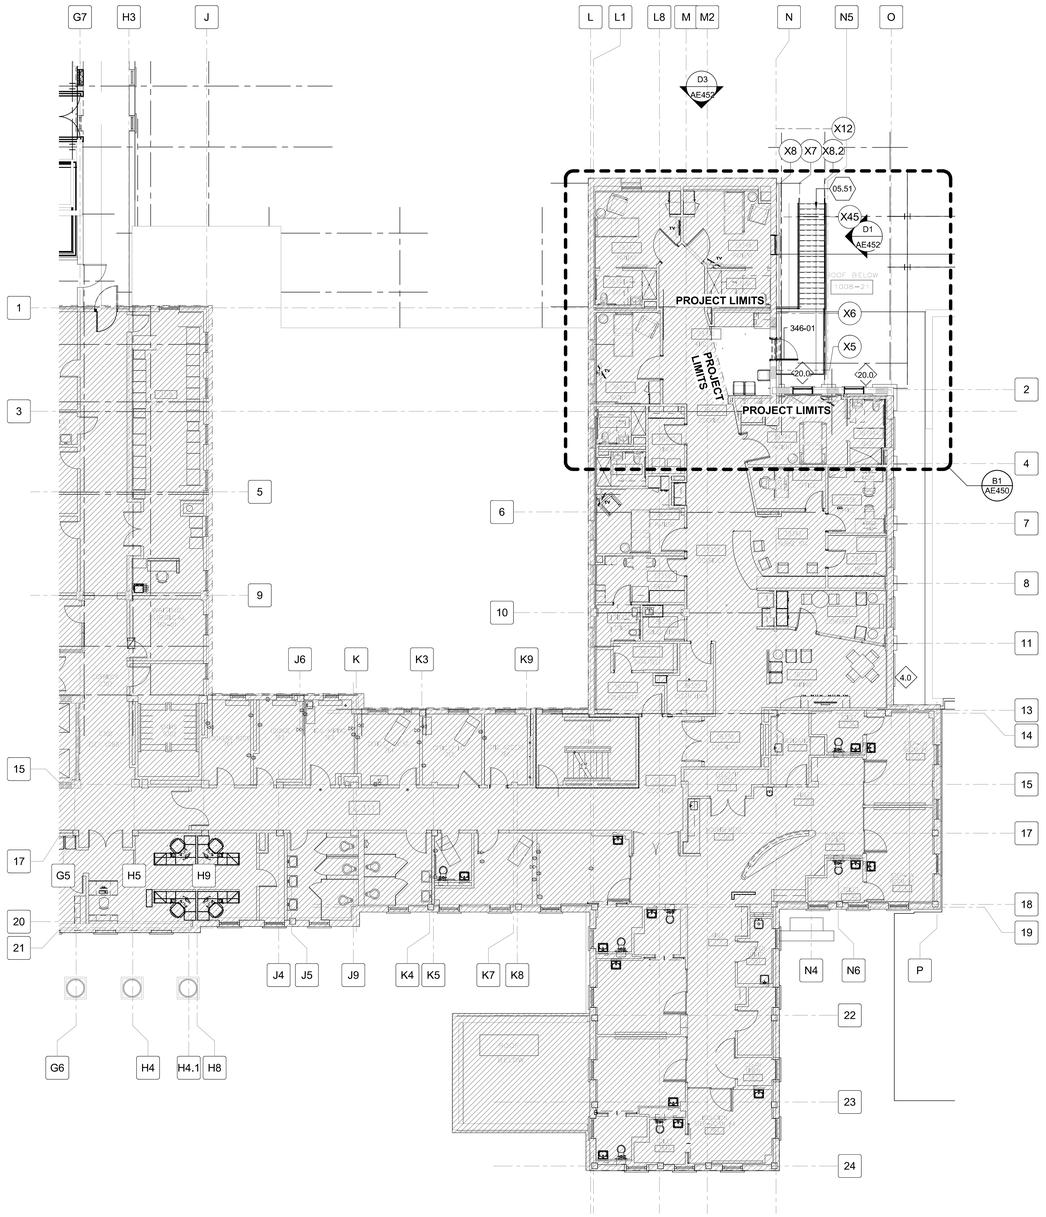

D4 **OVERALL THIRD FLOOR CONSTRUCTION PLAN - PHASE 1**

3/32" = 1'-0"

0 5' 10' 20'

GENERAL SHEET NOTES

A. REFER TO SHEET AI001 FOR GENERAL FLOOR PLAN NOTES AND SYMBOLS.
B. FOR PATIENT BED, HEADWALL, & PATIENT LIFT COORDINATION, SEE REFLECTED CEILING PLAN SHEETS , QH102 - QH104, AND PATIENT LIFT SUPPORT A3 / AE501.
C. FOR TYPICAL PATIENT BEDROOM / TOILET ROOM LAYOUT, SEE TYPICAL PLANS ON AE404.
D. ALL RATED PENETRATIONS TO BE SEALED WITH RED FIRE RATED CAULKING. USE ACOUSTICAL CAULKING ON ALL OTHER WALL PENETRATIONS.
E. FOR DOOR INFORMATION SEE AE400 SERIES SHEETS & AE601.
F. FOR PARTITION TYPES SEE GI501, AND WALL IDENTIFICATION TAGS, SEE AE400 SERIES SHEETS.
G. FOR RAISED FLOOR LAYOUT SEE SHEETS AE106.
H. FOR WINDOW TYPES & DETAILS, SEE AE602 FOR INFORMATION.

SHEET KEYNOTES

05.51 NEW EXTERIOR EGRESS METAL STAIRS, SEE SHEETS AE450-AE460 FOR ENLARGED PLANS AND DETAILS. ALSO REFER TO STRUCTURAL.

SYMBOLS LEGEND

PROJECT LIMITS

NOT IN SCOPE
AREA OUTSIDE OF PROJECT LIMITS

PARTITION GRAPHICS

PARTITION PHASING

EXISTING ELEMENT TO REMAIN

EXISTING ELEMENT TO BE DEMOLISHED

TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

NO RATING

SMOKE RESISTIVE PARTITION - NON RATED


1 HOUR FIRE BARRIER

1 HOUR FIRE/SMOKE BARRIER

2 HOUR FIRE BARRIER

2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN

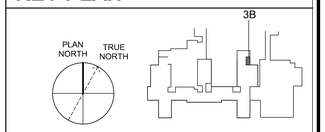

THIRD FLOOR FFE: 1505.0'

SECOND FLOOR FFE: 1493.0' FIRST FLOOR FFE: 1479.0'

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC. consulting engineers

8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signatures not valid without Certificate below seal.

JONATHAN M. OAKS REGISTERED ARCHITECT 31080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •

8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833

HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **OVERALL THIRD FLOOR CONSTRUCTION PLAN - PHASE 1**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: DW


Project Number: 564-17-140

Building Number: 1

Drawing Number: **AE104**

Sheet 42 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

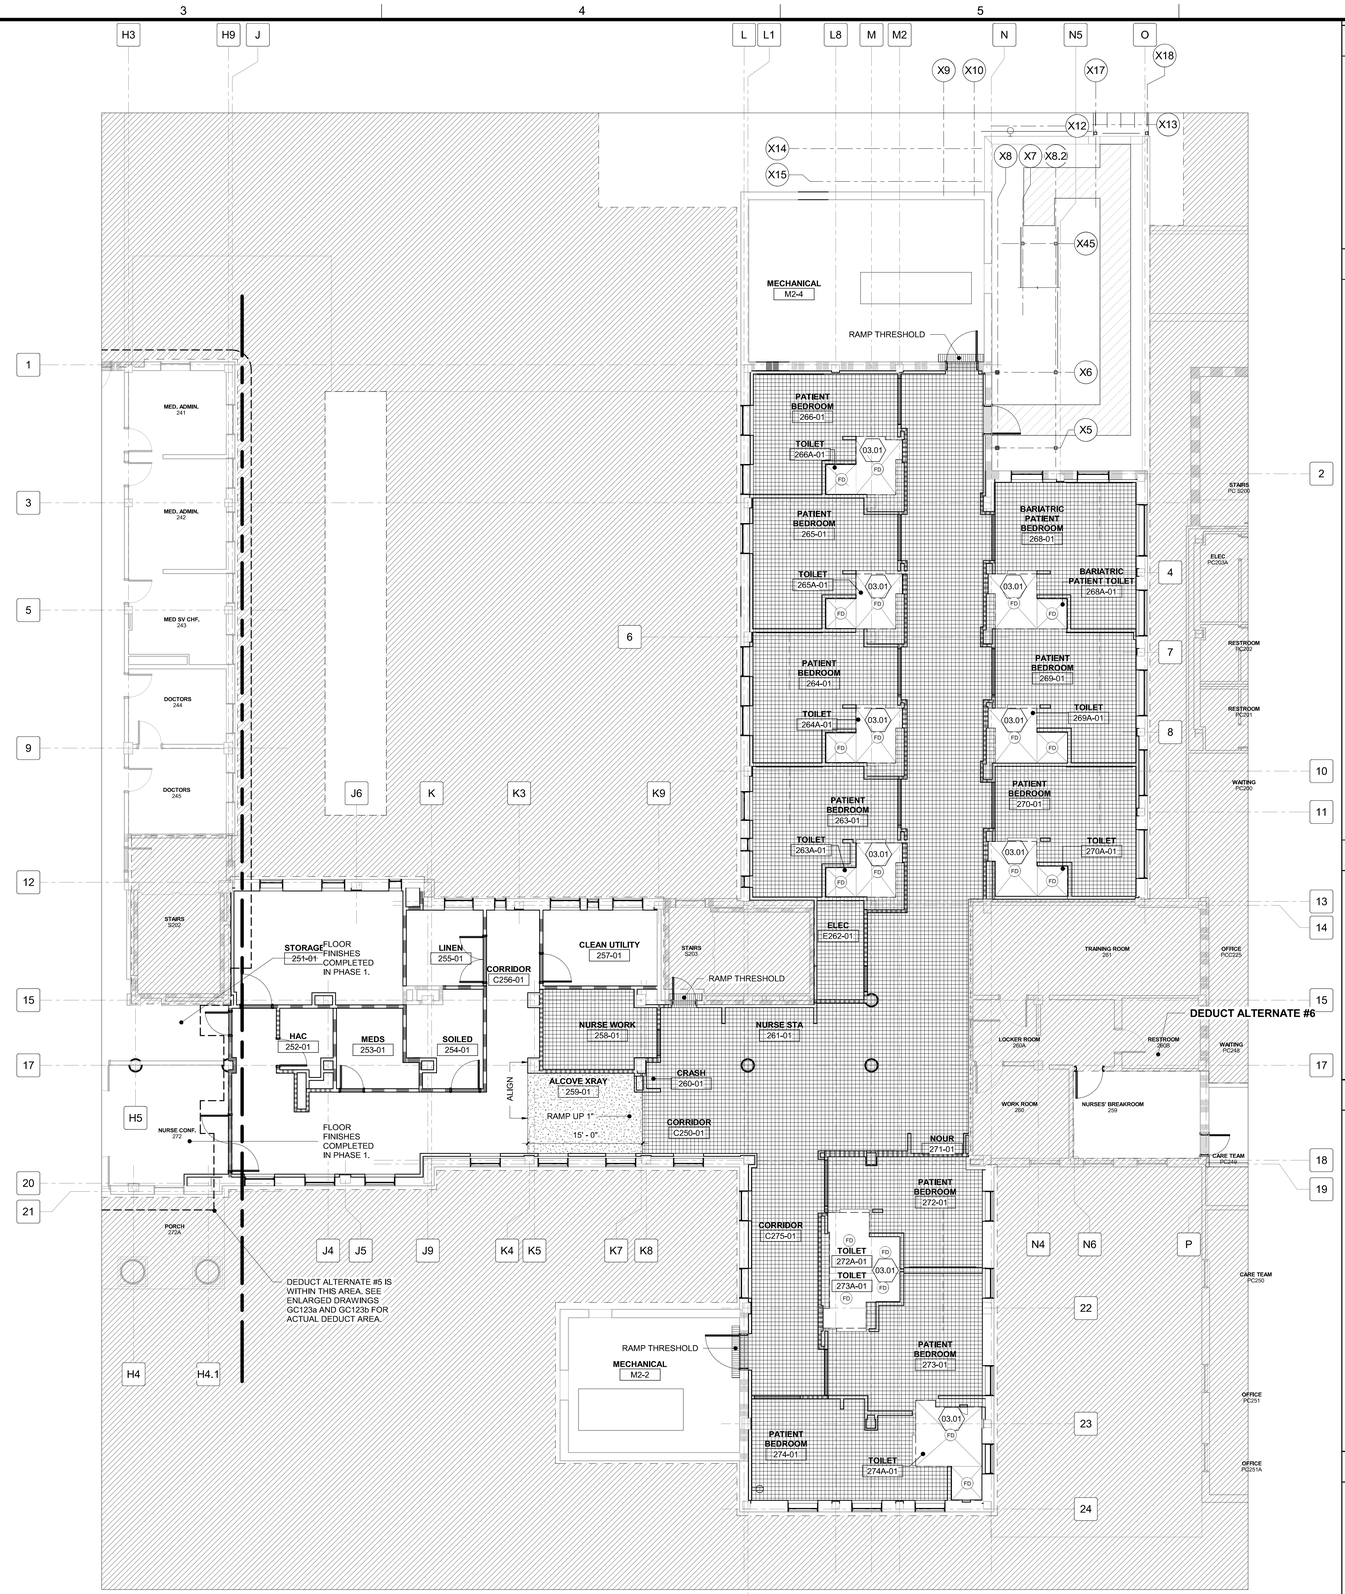

D3 **PARTIAL WARD 2B SECOND FLOOR TOPPING PLAN - PHASE 1**

1/8" = 1'-0"

0 4' 8' 16'

GENERAL SHEET NOTES

A. REFER TO SHEET AI001 FOR GENERAL FLOOR PLAN NOTES AND SYMBOLS.
B. FOR RAMP THRESHOLD DETAILS, SEE SHEET AF500.

SHEET KEYNOTES

03.01 BLOCK OUT THIS AREA FOR SLOPED RESINOUS FLOORING SEE MATERIAL FINISH LEGEND SHEET AF602 AND SPECIFICATION 09 67 23.50 FOR INFORMATION.

SYMBOL LEGEND

- ROOF WALKWAY PATH
- RAMP UP TO RAISED FLOOR LEVEL, ARDEX ERM, OR EQUAL
- RAMP THRESHOLD (AT DOOR / OPENING) WHERE OCCURS IN PLAN
- RAISED FLOOR ARDEX K 301 SELF-LEVELING COMPOUND, OR EQUAL
- NOT IN SCOPE AREA OUTSIDE OF PROJECT LIMITS

PARTITION GRAPHICS


PARTITION PHASING

- EXISTING ELEMENT TO REMAIN
- EXISTING ELEMENT TO BE DEMOLISHED
- TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

- NO RATING
- SMOKE RESISTIVE PARTITION - NON RATED
- 1 HOUR FIRE BARRIER
- 1 HOUR FIRE/SMOKE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN

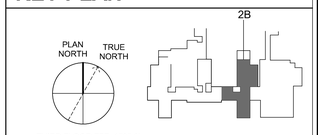

THIRD FLOOR FFE: 1505.0'
SECOND FLOOR FFE: 1493.0'
FIRST FLOOR FFE: 1479.0'

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES PLLC
consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. CARR REGISTERED ARCHITECT 31080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: PARTIAL WARD 2B SECOND FLOOR TOPPING PLAN - PHASE 1

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: RENOVATE MED SURGE WARDS

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: MS


Project Number: 564-17-140

Building Number: 1

Drawing Number: AE105

Sheet 43 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

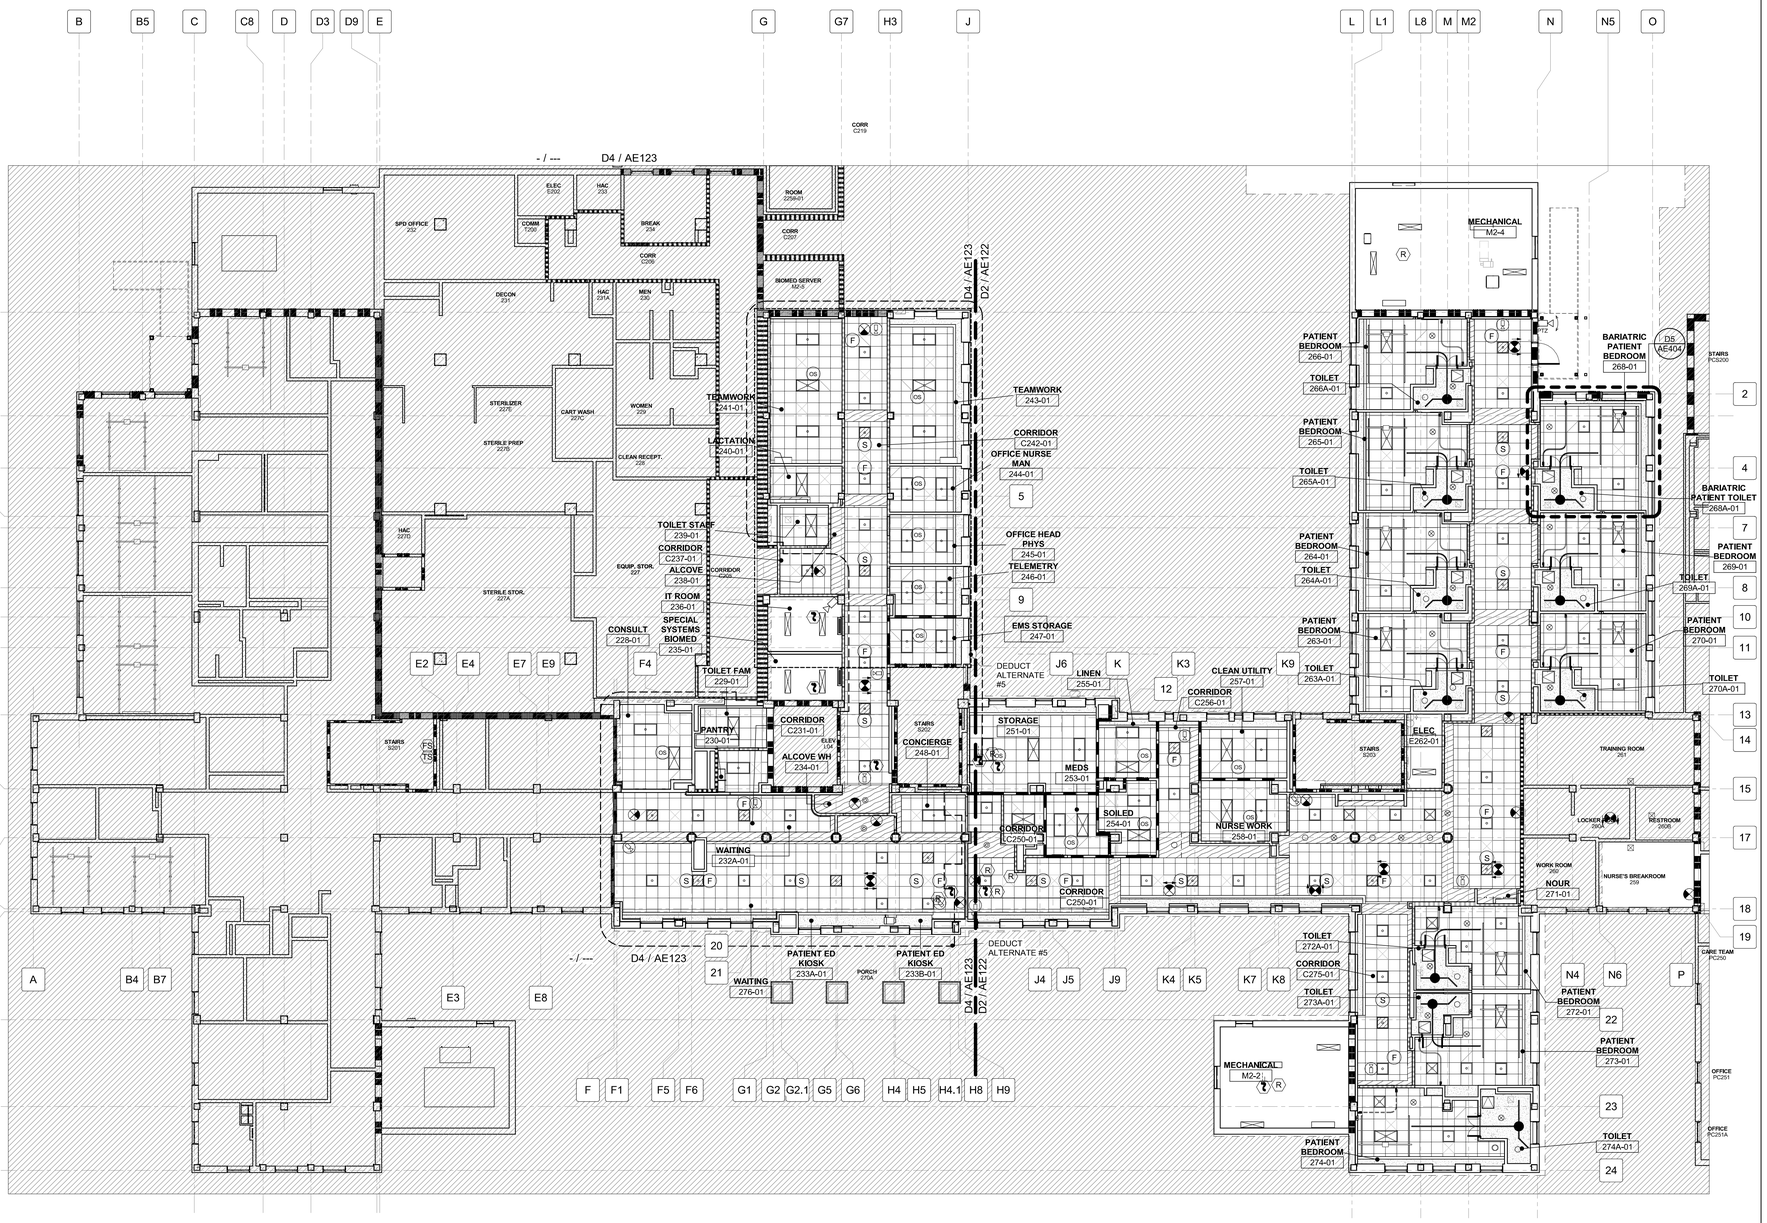

D2 OVERALL SECOND FLOOR REFLECTED CEILING PLAN

3/32" = 1'-0"

0 5' 10' 20'

REFLECTED CEILING LEGEND

- 2' x 4' TROFFER LIGHT LIFE SAFETY
- 2' x 4' TROFFER LIGHT CRITICAL
- 2' x 4' TROFFER LIGHT
- OCCUPANCY SENSOR
- NURSE CALL DOME LIGHT, AND WALL MOUNTED NURSE CALL DOME LIGHT
- SPEAKER - COMMUNICATIONS
- WAP — CEILING MOUNTED - WIRELESS ACCESS POINT
- PTZ / FIXED — CAMERA CEILING MOUNTED PATIENT OBSERVATION - FIXED DOME NETWORK / PAN TILT ZOOM
- RECESSED DOWNLIGHT - LIFE SAFETY / CRITICAL / NORMAL
- PENDANT LIGHT DISK
- SUPPLY DIFFUSER
- EXHAUST GRILLE
- DIRECTION OF PLAM GRAIN
- RETURN GRILLE
- CURTAIN & ROD
- CHASE SYMBOL
- CEILING EXIT SIGN - VARIOUS DIRECTIONAL AND NON-DIRECTIONAL CONFIGURATIONS
- RADIANT PANEL
- CU — CEILING MOUNTED CASSETTE UNIT
- ACCESS PANEL - 18" x 18" UON
- PLAM SOFFIT
- GYP BD. SOFFIT
- LINEAR CEILING DIFFUSER
- F — CEILING MOUNTED COMBINATION FIRE ALARM SPEAKER/STROBE DEVICE
- F — CEILING MOUNTED FIRE ALARM SPEAKER DEVICE
- FIRE ALARM SMOKE DETECTOR
- FIRE ALARM HEAT DETECTOR
- FIRE ALARM SYSTEM CEILING MONTED SMOKE DETECTOR FOR ELEVATOR RECALL
- R — FIRE ALARM CONNECTION RELAY
- CEILING MOUNTED CAMERA
- STRUC — EXPOSED TO STRUCTURE
- PATIENT CEILING LIFT W/ TURNTABLE

GENERAL SHEET NOTES

A. FOR REFLECTED CEILING PLAN NOTES SEE SHEET AI001.
B. FOR TYPICAL PATIENT BEDROOM / TOILET LAYOUTS AND REFLECTED CEILINGS, SEE AE404 WITH EXCEPTIONS INCLUDING BUT NOT LIMITED TO LOCATION OF PATIENT BED VARIES AND ROOM SPECIFIC CONDITION CITED ON PLAN TAKE PRECEDENCE.
C. REFER TO SHEET AF601 FOR MATERIALS INFORMATION.
D. CEILING HEIGHTS TYPICAL U.N.O. 8'-0" AFF, AND DROPPED CEILING TYPICAL U.N.O. 7'-8" AFF. SEE DETAILS A1, B1, AND/OR C1 ON SHEET AE512 FOR INFORMATION.
E. SEE COVER SHEET GI001 FOR INFORMATION ON DEDUCT ALTERNATES.
F. ROOMS TAGGED 'STRUCT' ARE EXPOSED STRUCTURE ROOMS WITH NO CEILING. FOG PAINT EXPOSED STRUCTURE P-4. SEE FINISH MATERIALS LEGEND AF602 FOR INFORMATION.
G. REFER TO AE512 FOR PLASTIC LAMINATED WOOD SOFFIT INFORMATION.
H. FOR TYPICAL ACT TO GWB CEILING CONDITION @ WINDOWS OF EXTERIOR WALL, SEE DETAIL C2 / AE602.
I. REFER TO GC122-GC123b FOR PHASING INSTRUCTIONS.

SHEET KEYNOTES

11.01 CENTER-LINE OF PATIENT BED.


PARTITION GRAPHICS

PARTITION PHASING

- EXISTING ELEMENT TO REMAIN
- EXISTING ELEMENT TO BE DEMOLISHED
- TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE


PARTITION RATING

- NO RATING
- SMOKE RESISTIVE PARTITION - NON RATED
- 1 HOUR FIRE BARRIER
- 1 HOUR FIRE/SMOKE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/ SMOKE BARRIER



NOTE:
FOR PATIENT BED, HEADWALL, AND PATIENT LIFT SUPPORT COORDINATION AND INFORMATION, SEE REFLECTED CEILING PLAN SHEETS AE122 TO AE123, PATIENT LIFT SUPPORTS SHEET AE501, AND EQUIPMENT SCHEDULE SHEET QH601.

KEY PLAN

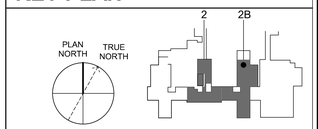

THIRD FLOOR FFE: 1505.0'
SECOND FLOOR FFE: 1493.0'
FIRST FLOOR FFE: 1479.0'

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.
JONATHAN E. CARR REGISTERED LANDSCAPE ARCHITECT 1109 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023


Drawing Title: OVERALL SECOND FLOOR REFLECTED CEILING PLAN
Project Phase: BID DOCUMENTS
FULLY SPRINKLERED

Project Title: RENOVATE MED SURGE WARDS
Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS
Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: MS

Project Number: 564-17-140
Building Number: 1
Drawing Number: AE120
Sheet 44 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs



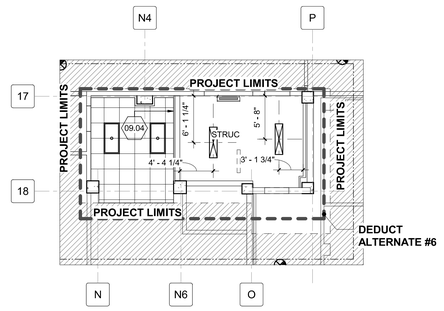

ENLARGED BASEMENT REFLECTED CEILING PLAN

C5

1/8" = 1'-0"

0 4' 8' 16'

REFELECTED CEILING LEGEND

- 2' x 4' TROFFER LIGHT LIFE SAFETY
- 2' x 4' TROFFER LIGHT CRITICAL
- 2' x 4' TROFFER LIGHT
- OCCUPANCY SENSOR
- NURSE CALL DOME LIGHT, AND WALL MOUNTED NURSE CALL DOME LIGHT
- SPEAKER - COMMUNICATIONS
- CEILING MOUNTED - WIRELESS ACCESS POINT
- CAMERA CEILING MOUNTED PATIENT OBSERVATION - FIXED DOME NETWORK / PAN TILT ZOOM
- RECESSED DOWNLIGHT - LIFE SAFETY / CRITICAL / NORMAL
- PENDANT LIGHT DISK
- SUPPLY DIFFUSER
- EXHAUST GRILLE
- DIRECTION OF PLAM GRAIN
- RETURN GRILLE
- CURTAIN & ROD
- CHASE SYMBOL
- CEILING EXIT SIGN - VARIOUS DIRECTIONAL AND NON-DIRECTIONAL CONFIGURATIONS
- RADIANT PANEL
- CU — CEILING MOUNTED CASSETTE UNIT
- ACCESS PANEL - 18" x 18" UON
- PLAM SOFFIT
- GYP BD. SOFFIT
- LINEAR CEILING DIFFUSER
- CEILING MOUNTED COMBINATION FIRE ALARM SPEAKER/STROBE DEVICE
- CEILING MOUNTED FIRE ALARM SPEAKER DEVICE
- FIRE ALARM SMOKE DETECTOR
- FIRE ALARM HEAT DETECTOR
- FIRE ALARM SYSTEM CEILING MONTED SMOKE DETECTOR FOR ELEVATOR RECALL
- FIRE ALARM CONNECTION RELAY
- CEILING MOUNTED CAMERA
- STRUC — EXPOSED TO STRUCTURE
- PATIENT CEILING LIFT W/ TURNTABLE

GENERAL SHEET NOTES

A. FOR REFLECTED CEILING PLAN NOTES SEE SHEET A0001.
B. FOR TYPICAL PATIENT BEDROOM / TOILET LAYOUTS AND REFLECTED CEILINGS, SEE AE404 WITH EXCEPTIONS INCLUDING BUT NOT LIMITED TO LOCATION OF PATIENT BED VARIES AND ROOM SPECIFIC CONDITION CITED ON PLAN TAKE PRECEDENCE.
C. REFER TO SHEET AF601 FOR MATERIALS INFORMATION.
D. CEILING HEIGHTS TYPICAL U.N.O. 8'-0" AFF, AND DROPPED CEILING TYPICAL U.N.O, 7'-8" AFF. SEE DETAILS A1, B1, AND/OR C1 ON SHEET AE512 FOR INFORMATION.
E. SEE COVER SHEET GI001 FOR INFORMATION ON DEDUCT ALTERNATES.
F. ROOMS TAGGED 'STRUCT' ARE EXPOSED STRUCTURE ROOMS WITH NO CEILING. FOG PAINT EXPOSED STRUCTURE P-4. SEE FINISH MATERIALS LEGEND AF602 FOR INFORMATION.
G. REFER TO AE512 FOR PLASTIC LAMINATED WOOD SOFFIT INFORMATION.
H. FOR TYPICAL ACT TO GWB CEILING CONDITION @ WINDOWS OF EXTERIOR WALL, SEE DETAIL C2 / AE602.
I. REFER TO GC122-GC123b FOR PHASING INSTRUCTIONS.

SHEET KEYNOTES

09.04 TRIM TEES AND ADD NEW WALL RUNNER.

SYMBOLS LEGEND

- DEMARCATES AREAS OF WORK TO SEQUENCE
- PROJECT LIMITS
- NOT IN SCOPE AREA OUTSIDE OF PROJECT LIMITS
- INDICATES EGRESS WALKWAY AT EXTERIOR STAIR

PARTITION GRAPHICS


PARTITION PHASING

- EXISTING ELEMENT TO REMAIN
- EXISTING ELEMENT TO BE DEMOLISHED
- TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

- NO RATING
- SMOKE RESISTIVE PARTITION - NON RATED
- 1 HOUR FIRE BARRIER
- 1 HOUR FIRE/SMOKE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN

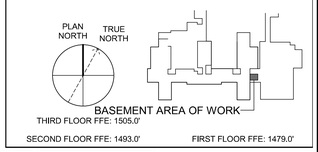

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC consulting engineers

8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN E. CARR REGISTERED ARCHITECT 11080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •

8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833

HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **ENLARGED BASEMENT REFLECTED CEILING PLAN**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: MS


Project Number: 564-17-140

Building Number: 1

Drawing Number: **AE121**

Sheet 45 of 162


Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

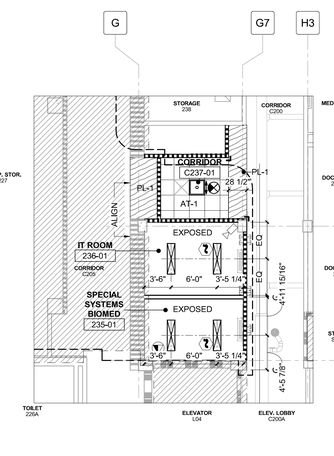

PARTIAL 2 SECOND FLOOR REFLECTED CEILING PLAN - PHASE 1A (WARD 2)

B1 1/8" = 1'-0"

0 4' 8' 16'

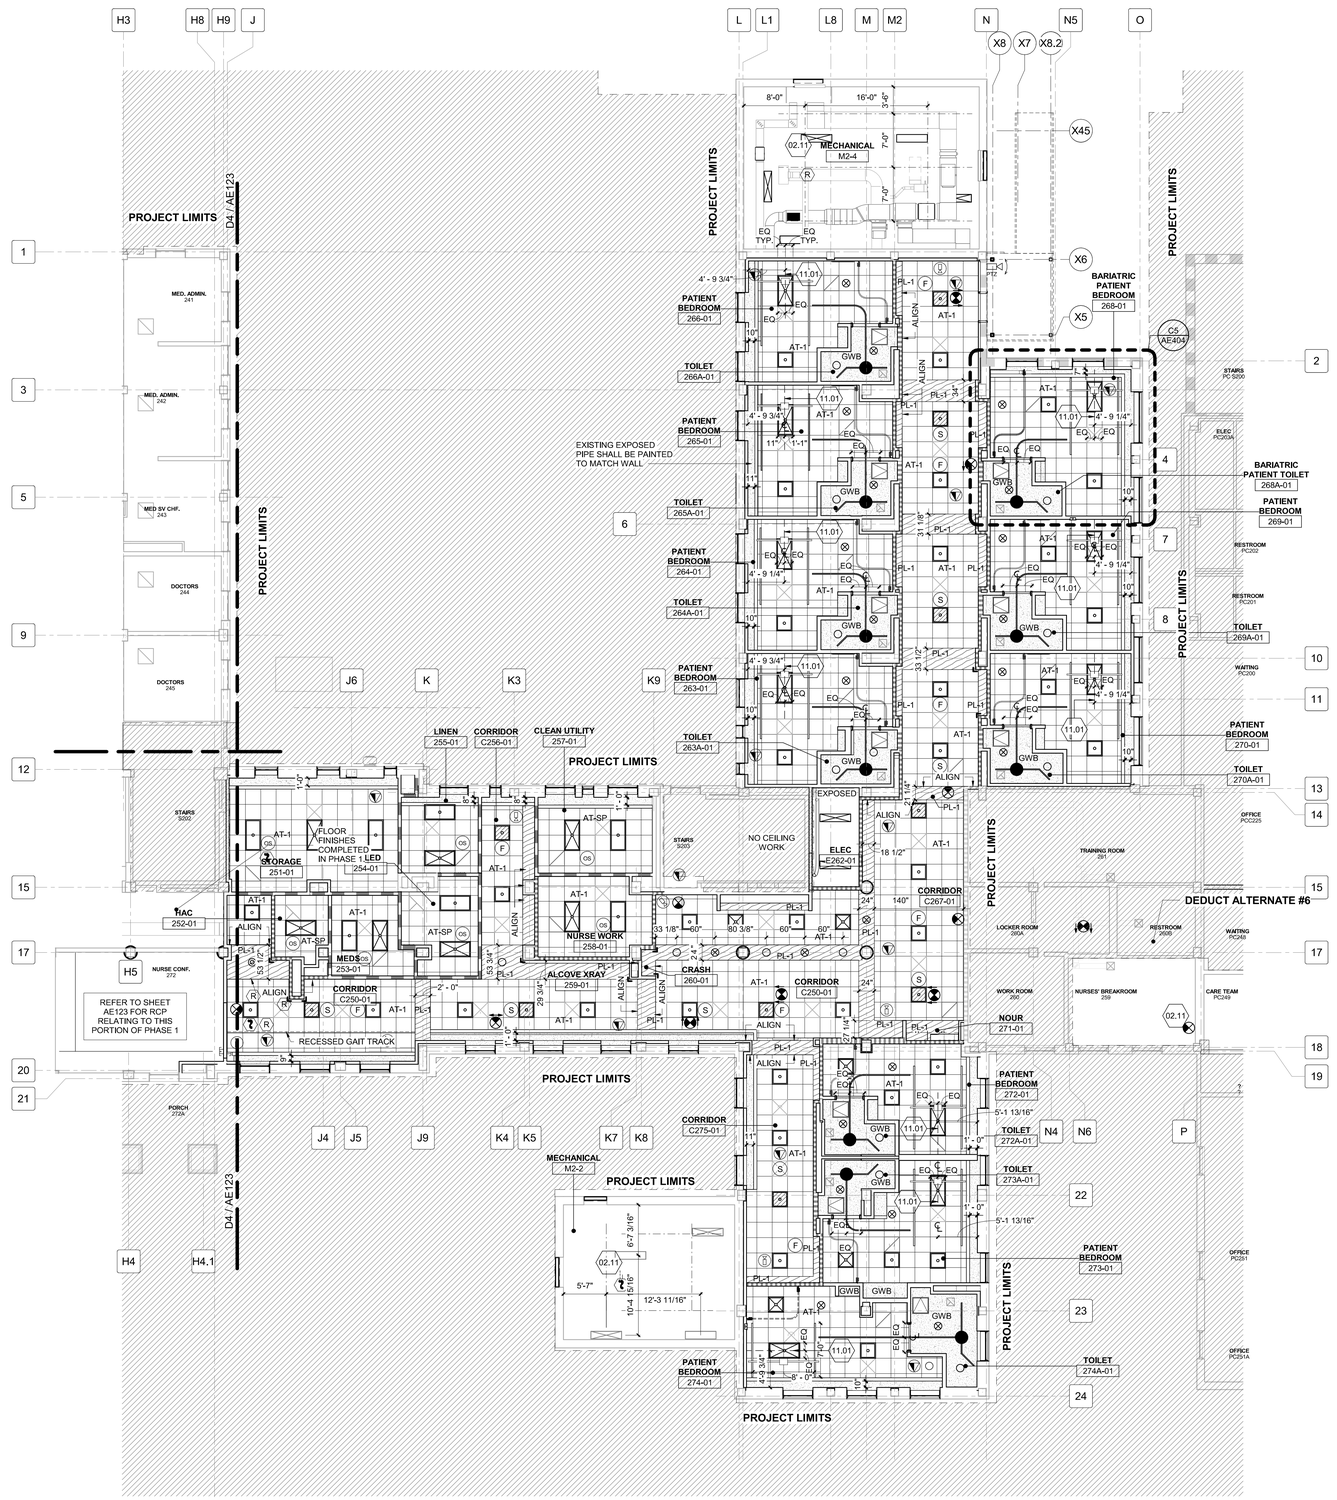

PARTIAL WARD 2B SECOND FLOOR REFLECTED CEILING PLAN - PHASE 1

D2 1/8" = 1'-0"

0 4' 8' 16'

REFLECTED CEILING LEGEND

- 2' x 4' TROFFER LIGHT LIFE SAFETY
- 2' x 4' TROFFER LIGHT CRITICAL
- 2' x 4' TROFFER LIGHT
- OCCUPANCY SENSOR
- NURSE CALL DOME LIGHT, AND WALL MOUNTED NURSE CALL DOME LIGHT
- SPEAKER - COMMUNICATIONS
- CEILING MOUNTED - WIRELESS ACCESS POINT
- CAMERA CEILING MOUNTED PATIENT OBSERVATION - FIXED DOME NETWORK / PAN TILT ZOOM
- RECESSED DOWNLIGHT - LIFE SAFETY / CRITICAL / NORMAL
- PENDANT LIGHT DISK
- SUPPLY DIFFUSER
- EXHAUST GRILLE
- DIRECTION OF PLAM GRAIN
- RETURN GRILLE
- CURTAIN & ROD
- CHASE SYMBOL
- CEILING EXIT SIGN - VARIOUS DIRECTIONAL AND NON-DIRECTIONAL CONFIGURATIONS
- RADIANT PANEL
- CU CEILING MOUNTED CASSETTE UNIT
- ACCESS PANEL - 18" x 18" UON
- PLAM SOFFIT
- GYP BD. SOFFIT
- LINEAR CEILING DIFFUSER
- CEILING MOUNTED COMBINATION FIRE ALARM SPEAKER/STROBE DEVICE
- CEILING MOUNTED FIRE ALARM SPEAKER DEVICE
- FIRE ALARM SMOKE DETECTOR
- FIRE ALARM HEAT DETECTOR
- FIRE ALARM SYSTEM CEILING MONTED SMOKE DETECTOR FOR ELEVATOR RECALL
- FIRE ALARM CONNECTION RELAY
- CEILING MOUNTED CAMERA
- STRUC EXPOSED TO STRUCTURE
- PATIENT CEILING LIFT W/ TURNTABLE
- INDICATES 'GAIT' PATIENT LIFT TRACK (STRAIGHT RUN)
- INDICATES PATIENT LIFT TRACK

NOTE:
FOR PATIENT BED, HEADWALL, AND PATIENT LIFT SUPPORT COORDINATION AND INFORMATION, SEE REFLECTED CEILING PLAN SHEETS AE122 TO AE123, PATIENT LIFT SUPPORTS SHEET AE501, AND EQUIPMENT SCHEDULE SHEET QH601.

GENERAL SHEET NOTES

A. FOR REFLECTED CEILING PLAN NOTES SEE SHEET AI001.
B. FOR TYPICAL PATIENT BEDROOM / TOILET LAYOUTS AND REFLECTED CEILINGS, SEE AE404 WITH EXCEPTIONS INCLUDING BUT NOT LIMITED TO LOCATION OF PATIENT BED VARIES AND ROOM SPECIFIC CONDITION CITED ON PLAN TAKE PRECEDENCE.
C. REFER TO SHEET AF601 FOR MATERIALS INFORMATION.
D. CEILING HEIGHTS TYPICAL U.N.O. 8'-0" AFF, AND DROPPED CEILING TYPICAL U.N.O. 7'-8" AFF. SEE DETAILS A1, B1, AND/OR C1 ON SHEET AE512 FOR INFORMATION.
E. SEE COVER SHEET GI001 FOR INFORMATION ON DEDUCT ALTERNATES.
F. ROOMS TAGGED 'STRUCT' ARE EXPOSED STRUCTURE ROOMS WITH NO CEILING. FOG PAINT EXPOSED STRUCTURE P-4. SEE FINISH MATERIALS LEGEND AF602 FOR INFORMATION.
G. REFER TO AE512 FOR PLASTIC LAMINATED WOOD SOFFIT INFORMATION.
H. FOR TYPICAL ACT TO GWB CEILING CONDITION @ WINDOWS OF EXTERIOR WALL, SEE DETAIL C2 / AE602.
I. REFER TO GC122-GC123b FOR PHASING INSTRUCTIONS.

SHEET KEYNOTES

02.11 NO CEILING WORK IN THIS SPACE.
11.01 CENTER-LINE OF PATIENT BED.

SYMBOLS LEGEND


- PROJECT LIMITS
- NOT IN SCOPE AREA OUTSIDE OF PROJECT LIMITS
- INDICATES EGRESS WALKWAY AT EXTERIOR STAIR

PARTITION GRAPHICS

PARTITION PHASING
- EXISTING ELEMENT TO REMAIN
- EXISTING ELEMENT TO BE DEMOLISHED
- TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING
- NO RATING
- SMOKE RESISTIVE PARTITION - NON RATED
- 1 HOUR FIRE BARRIER
- 1 HOUR FIRE/SMOKE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN

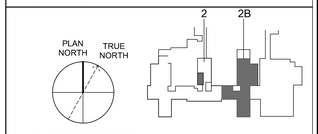

Revisions:

No.	Description	Date
1	AMENDMENT #3	MAY 6, 2022

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC. consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.
JONATHAN M. OAKES REGISTERED ARCHITECT 11080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE
CHARLOTTE, NC 28227
P 704.814.1320
F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: PARTIAL WARD 2 SECOND FLOOR REFLECTED CEILING PLAN - PHASE 1

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: RENOVATE MED SURGE WARDS

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: MS

Project Number: 564-17-140


Building Number: 1

Drawing Number: AE122

Sheet 46 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

BIM 360://18002 Fayetteville AR Renovate Med Surge Ward/18002 ARCH 2020.rvt

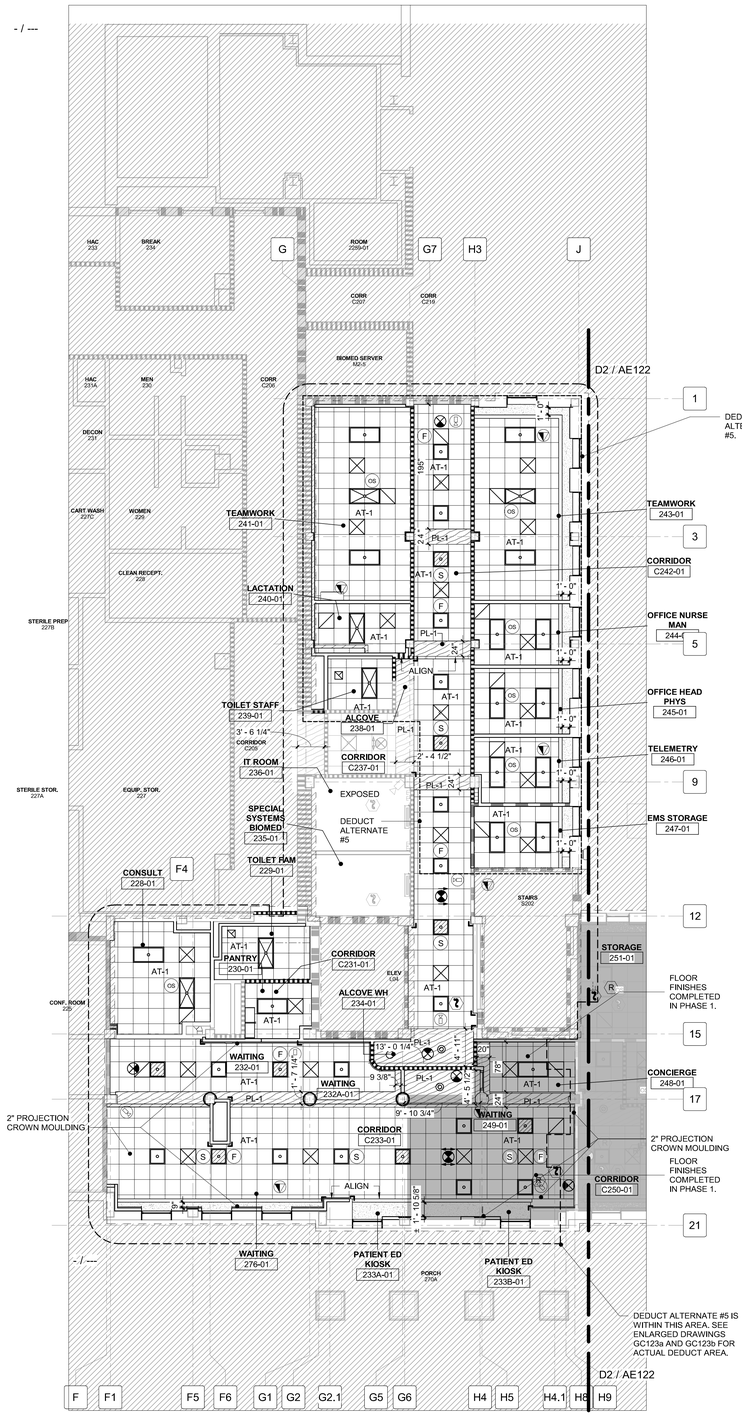

PARTIAL WARD 2 SECOND FLOOR REFLECTED CEILING PLAN - PHASE 2

D4

1/8" = 1'-0"

0 4' 8' 16'

REFELECTED CEILING LEGEND

- 2' x 4' TROFFER LIGHT LIFE SAFETY
- 2' x 4' TROFFER LIGHT CRITICAL
- 2' x 4' TROFFER LIGHT
- OCCUPANCY SENSOR
- NURSE CALL DOME LIGHT, AND WALL MOUNTED NURSE CALL DOME LIGHT
- SPEAKER - COMMUNICATIONS
- CEILING MOUNTED - WIRELESS ACCESS POINT
- CAMERA CEILING MOUNTED PATIENT OBSERVATION - FIXED DOME NETWORK / PAN TILT ZOOM
- RECESSED DOWNLIGHT - LIFE SAFETY / CRITICAL / NORMAL
- PENDANT LIGHT DISK
- SUPPLY DIFFUSER
- EXHAUST GRILLE
- DIRECTION OF PLAM GRAIN
- RETURN GRILLE
- CURTAIN & ROD
- CHASE SYMBOL
- CEILING EXIT SIGN - VARIOUS DIRECTIONAL AND NON-DIRECTIONAL CONFIGURATIONS
- RADIANT PANEL
- CU CEILING MOUNTED CASSETTE UNIT
- ACCESS PANEL - 18" x 18" UON
- PLAM SOFFIT
- GYP BD. SOFFIT
- LINEAR CEILING DIFFUSER
- CEILING MOUNTED COMBINATION FIRE ALARM SPEAKER/STROBE DEVICE
- CEILING MOUNTED FIRE ALARM SPEAKER DEVICE
- FIRE ALARM SMOKE DETECTOR
- FIRE ALARM HEAT DETECTOR
- FIRE ALARM SYSTEM CEILING MONTED SMOKE DETECTOR FOR ELEVATOR RECALL
- FIRE ALARM CONNECTION RELAY
- CEILING MOUNTED CAMERA

STRUC EXPOSED TO STRUCTURE

PATIENT CEILING LIFT W/ TURNTABLE INDICATES 'GAIT' PATIENT LIFT TRACK (STRAIGHT RUN)

INDICATES PATIENT LIFT TRACK

11.01

NOTE:
FOR PATIENT BED, HEADWALL, AND PATIENT LIFT SUPPORT COORDINATION AND INFORMATION, SEE REFLECTED CEILING PLAN SHEETS AE122 TO AE123, PATIENT LIFT SUPPORTS SHEET AE501, AND EQUIPMENT SCHEDULE SHEET QH601.

GENERAL SHEET NOTES

A. FOR REFLECTED CEILING PLAN NOTES SEE SHEET AI001.
B. FOR TYPICAL PATIENT BEDROOM / TOILET LAYOUTS AND REFLECTED CEILINGS, SEE AE404 WITH EXCEPTIONS INCLUDING BUT NOT LIMITED TO LOCATION OF PATIENT BED VARIES AND ROOM SPECIFIC CONDITION CITED ON PLAN TAKE PRECEDENCE.
C. REFER TO SHEET AF601 FOR MATERIALS INFORMATION.
D. CEILING HEIGHTS TYPICAL U.N.O. 8'-0" AFF, AND DROPPED CEILING TYPICAL U.N.O. 7'-8" AFF. SEE DETAILS A1, B1, AND/OR C1 ON SHEET AE512 FOR INFORMATION.
E. SEE COVER SHEET GI001 FOR INFORMATION ON DEDUCT ALTERNATES.
F. ROOMS TAGGED 'STRUCT' ARE EXPOSED STRUCTURE ROOMS WITH NO CEILING. FOG PAINT EXPOSED STRUCTURE P-4. SEE FINISH MATERIALS LEGEND AF602 FOR INFORMATION.
G. REFER TO AE512 FOR PLASTIC LAMINATED WOOD SOFFIT INFORMATION.
H. FOR TYPICAL ACT TO GWB CEILING CONDITION @ WINDOWS OF EXTERIOR WALL, SEE DETAIL C2 / AE602.
I. REFER TO GC122-GC123b FOR PHASING INSTRUCTIONS.

SYMBOLS LEGEND

- PROJECT LIMITS
- NOT IN SCOPE AREA OUTSIDE OF PROJECT LIMITS
- PHASE 1

PARTITION GRAPHICS


PARTITION PHASING

- EXISTING ELEMENT TO REMAIN
- EXISTING ELEMENT TO BE DEMOLISHED
- TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

- NO RATING
- SMOKE RESISTIVE PARTITION - NON RATED
- 1 HOUR FIRE BARRIER
- 1 HOUR FIRE/SMOKE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN



Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.
JONATHAN M. CLARK REGISTERED ARCHITECT 17080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **PARTIAL WARD 2 SECOND FLOOR REFLECTED CEILING PLAN - PHASE 2**

Project Phase: BID DOCUMENTS


FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Project Number: 564-17-140
Building Number: 1
Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS
Drawing Number: **AE123**
Sheet 47 of 162
Date: MARCH 24, 2024
Checked: JC/LK
Drawn: MS

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs


BIM 360://18002 Fayetteville AR Renovate Med Surge Ward/18002 ARCH 2020.rvt

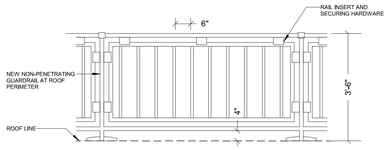

NON-PENETRATING GUARDRAIL ELEVATION, TYPICAL

A5 1/2" = 1'-0"

0 2' 4'

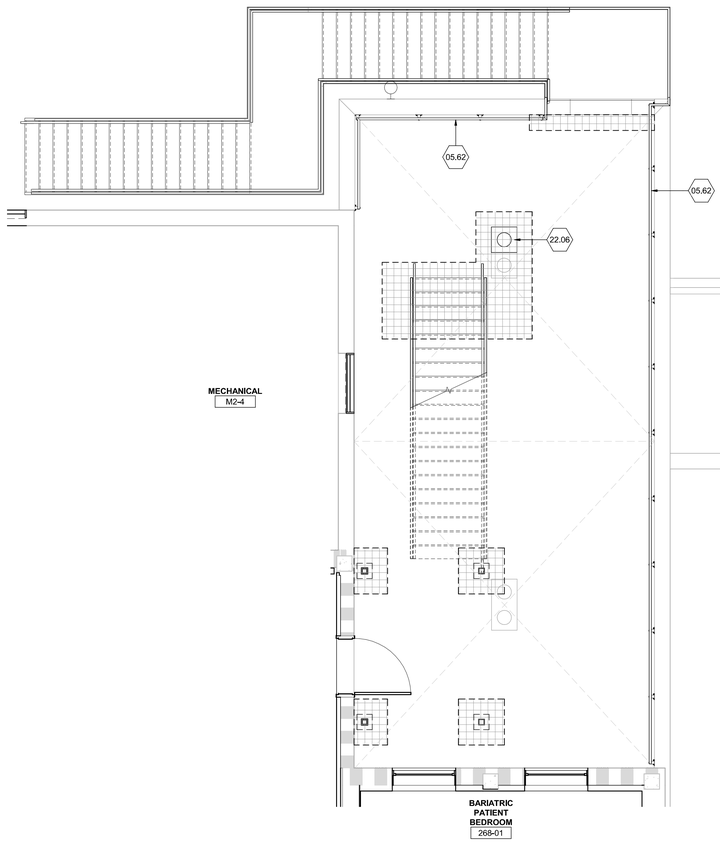

RE-ROOF PLAN - EXTERIOR STAIR EAST SECOND FLOOR

D5 1/4" = 1'-0"

0 2' 4' 8'

GENERAL SHEET NOTES

A. REFER TO STRUCTURAL DRAWINGS AND SPECIFICATIONS FOR STAIR DETAILS AND CONNECTIONS.

SHEET KEYNOTES

05.62 NEW NON-PENETRATING GUARDRAIL AT ROOF PERIMETER. BASIS OF DESIGN: KEEGUARD PERMANENT RAIL. TIE INTO EXISTING LIGHTNING PROTECTION SYSTEM.

22.06 USE NEW ROOF DRAIN AND ROOF LEADER CONNECTING TO EXISTING PIPING, SEE PLUMBING DRAWINGS FOR INFORMATION. GC SHALL MAINTAIN ROOF SLOPE TO DRAINS.

SYMBOLS LEGEND

ROOF WALKWAY PATH

RE-ROOF CUT OPENING EXTENTS, SEE DETAILS FOR INFORMATION. RE-ROOF WITH COMPATIBLE ROOFING IN ACCORDANCE WITH MANUFACTURERS RECOMMENDATIONS.

PARTITION GRAPHICS

PARTITION PHASING

- EXISTING ELEMENT TO REMAIN
- EXISTING ELEMENT TO BE DEMOLISHED
- TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

- NO RATING
- SMOKE RESISTIVE PARTITION - NON RATED
- 1 HOUR FIRE BARRIER
- 1 HOUR FIRE/SMOKE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN



Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC consulting engineers

8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. CLARK REGISTERED ARCHITECT 11080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •

8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833

HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **PARTIAL ROOF PLANS**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: DW

Project Number: 564-17-140

Building Number: 1

Drawing Number: **AE130**

Sheet 48 of 162

Engineering Service

VETERANS HEALTH CARE SYSTEM OF THE OZARKS

VA U.S. Department of Veterans Affairs

SHEET KEYNOTES

22.01 NEW MEDICAL GAS ALARM PANELS, SEE PLUMBING DRAWING PG101 FOR INFORMATION.

GENERAL SHEET NOTES

NOTE: REFER TO ALL PHASING SHEETS. GENERAL CONTRACTOR SHALL ENSURE THAT ALL CONTRACTORS ARE RESPONSIBLE FOR COORDINATION ACROSS ENTIRE SET OF CONSTRUCTION DOCUMENTS.

A. FOR WALL SECTIONS, SILL, AND HEAD HEIGHT ELEVATIONS, SEE SHEET AE602 FOR INFORMATION.
B. REFER TO SHEET A801 FOR GENERAL ELEVATION NOTES.
C. SEE COVER SHEET G001 FOR INFORMATION ON DEDUCT ALTERNATES.

SYMBOLS LEGEND

A — LETTER DENOTES SIGN TYPE

SIGN ELEVATION


FOR SIGNAGE LOCATIONS AND INFORMATION SEE SHEETS QH100 SERIES AND AF501.

P-2 — MATERIAL TAG

FOR MATERIALS SCHEDULE AND INFORMATION, SEE SHEETS AF601 AND AF602.

A1014 — EQUIPMENT TAG

FOR EQUIPMENT SCHEDULE AND INFORMATION, SEE SHEET QH601.

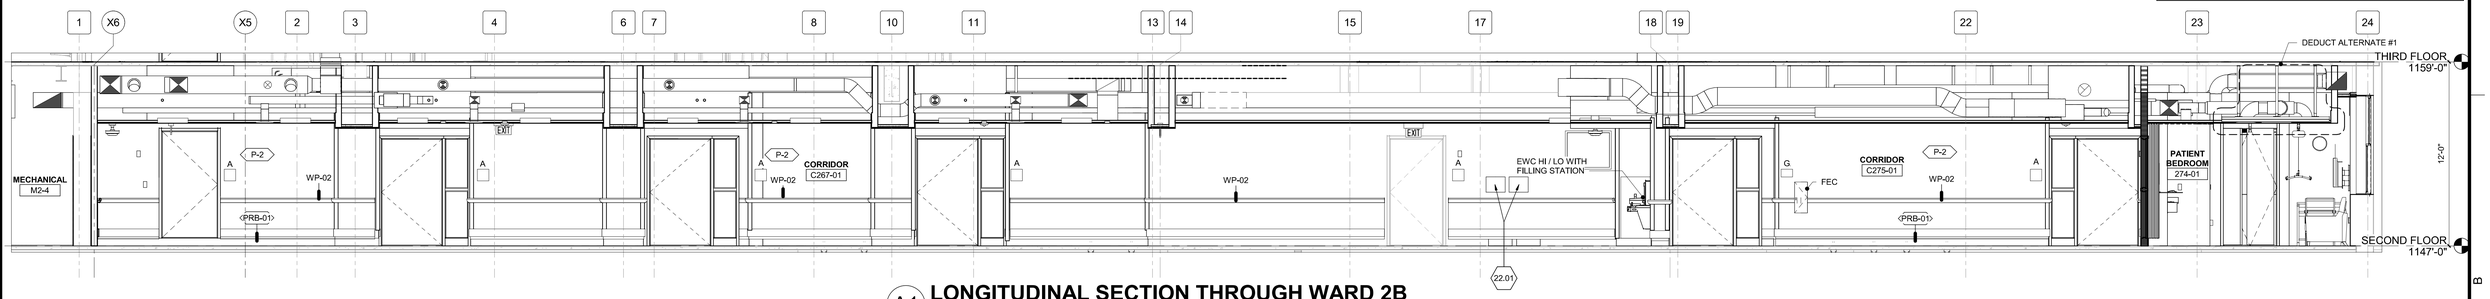

A1 LONGITUDINAL SECTION THROUGH WARD 2B

1/4" = 1'-0"

B1 LONGITUDINAL SECTION THROUGH WARD 2

1/4" = 1'-0"

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. OAK — REGISTERED ARCHITECT — 13080 — CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE
CHARLOTTE, NC 28227
P 704.814.1320
F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **PARTIAL BUILDING SECTIONS**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: MS

Project Number: 564-17-140

Building Number: 1

Drawing Number: **AE301**

Sheet 49 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

SHEET KEYNOTES

03.03	RAMP UP 1" FROM EXISTING FLOOR TO RAISED FLOOR LEVEL WITH ARDEX ERM, OR EQUAL
27.02	NURSE CALL DOME LIGHTS, SEE ELECTRICAL DRAWINGS FOR INFORMATION.

GENERAL SHEET NOTES

NOTE: REFER TO ALL PHASING SHEETS. GENERAL CONTRACTOR SHALL ENSURE THAT ALL CONTRACTORS ARE RESPONSIBLE FOR COORDINATION ACROSS ENTIRE SET OF CONSTRUCTION DOCUMENTS.

A. FOR WALL SECTIONS, SILL, AND HEAD HEIGHT ELEVATIONS, SEE SHEET AE602 FOR INFORMATION.
B. REFER TO SHEET A1001 FOR GENERAL ELEVATION NOTES.
C. SEE COVER SHEET GI001 FOR INFORMATION ON DEDUCT ALTERNATES.

SYMBOLS LEGEND

A — LETTER DENOTES SIGN TYPE

SIGN ELEVATION


FOR SIGNAGE LOCATIONS AND INFORMATION SEE SHEETS QH100 SERIES AND AF501.

P-2 — MATERIAL TAG

FOR MATERIALS SCHEDULE AND INFORMATION, SEE SHEETS AF601 AND AF602.

A1014 — EQUIPMENT TAG


FOR EQUIPMENT SCHEDULE AND INFORMATION, SEE SHEET QH601.

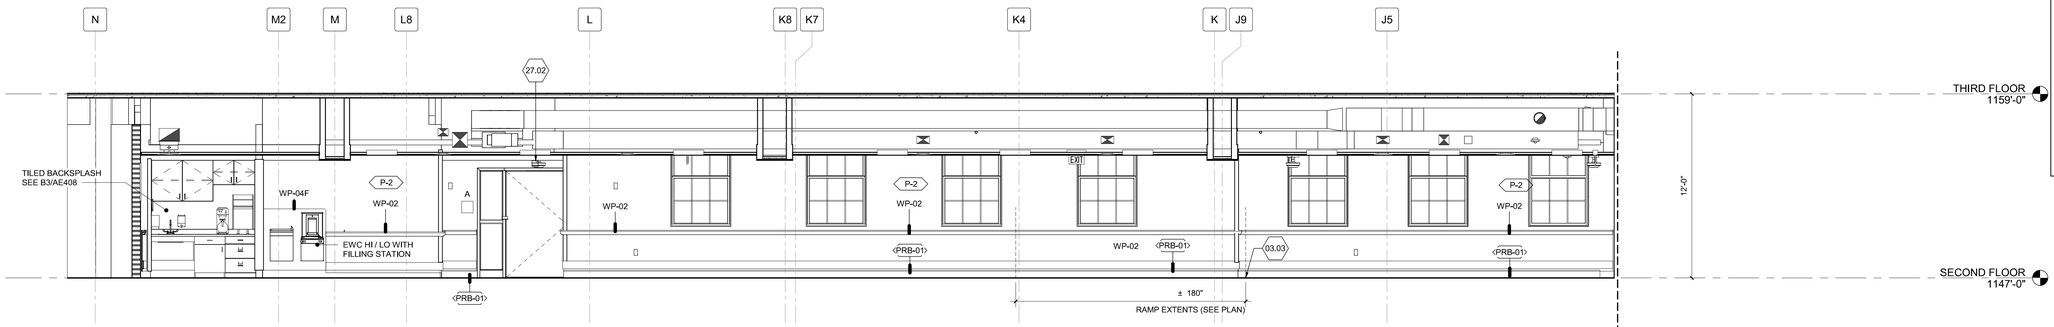

A1 TRAVERSE SECTION 1 THROUGH WARD 2B

1/4" = 1'-0"


0 2' 4' 8'

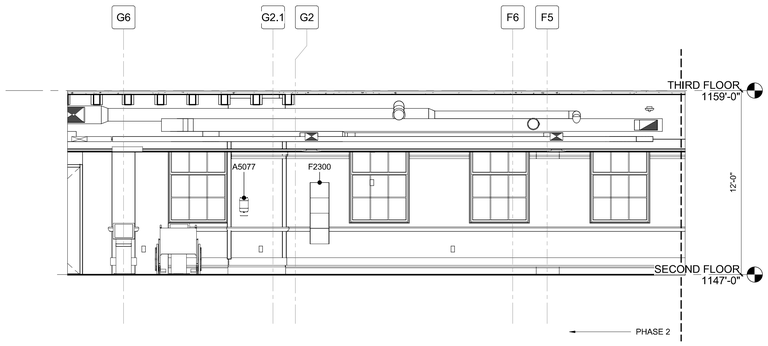

B1 TRAVERSE SECTION 2

1/4" = 1'-0"

0 2' 4' 8'

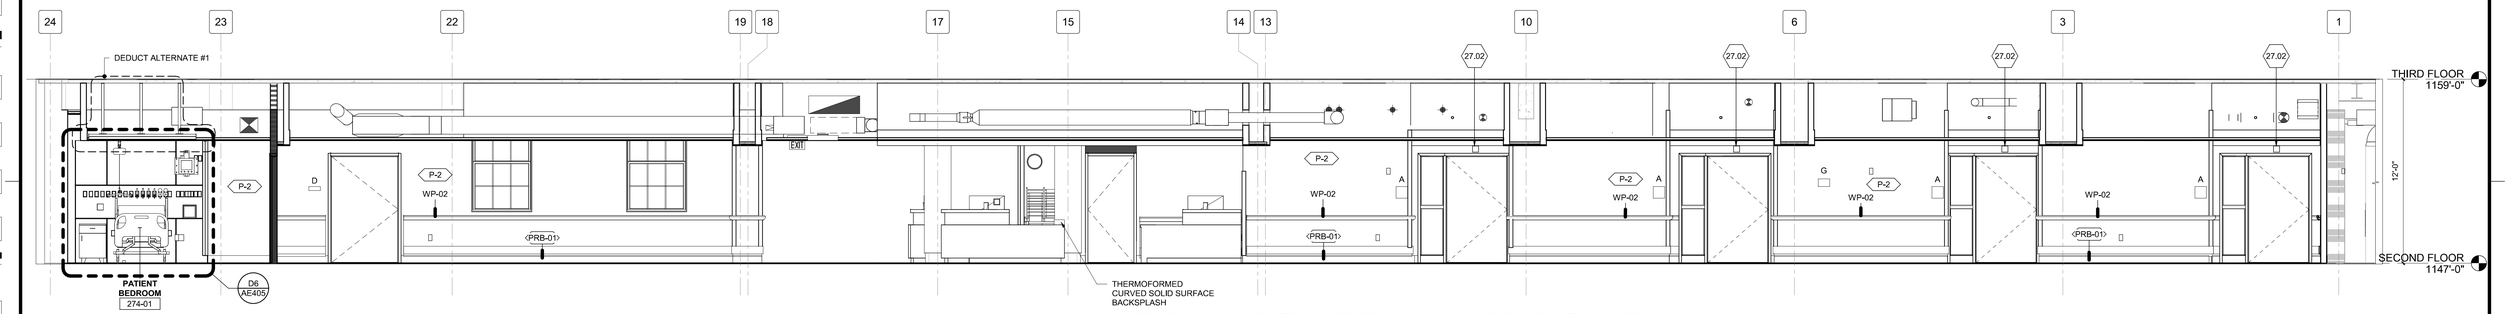

C1 LONGITUDINAL SECTION THROUGH WARD 2B - PHASE 1

1/4" = 1'-0"

0 2' 4' 8'

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC. consulting engineers

8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. CLARK REGISTERED ARCHITECT 110080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •

8016 TOWER POINT DRIVE
CHARLOTTE, NC 28227

P 704.814.1320
F 704.321.0833

HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **PARTIAL BUILDING SECTIONS**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: MS


Project Number: 564-17-140

Building Number: 1

Drawing Number: **AE302**

Sheet 50 of 162


Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

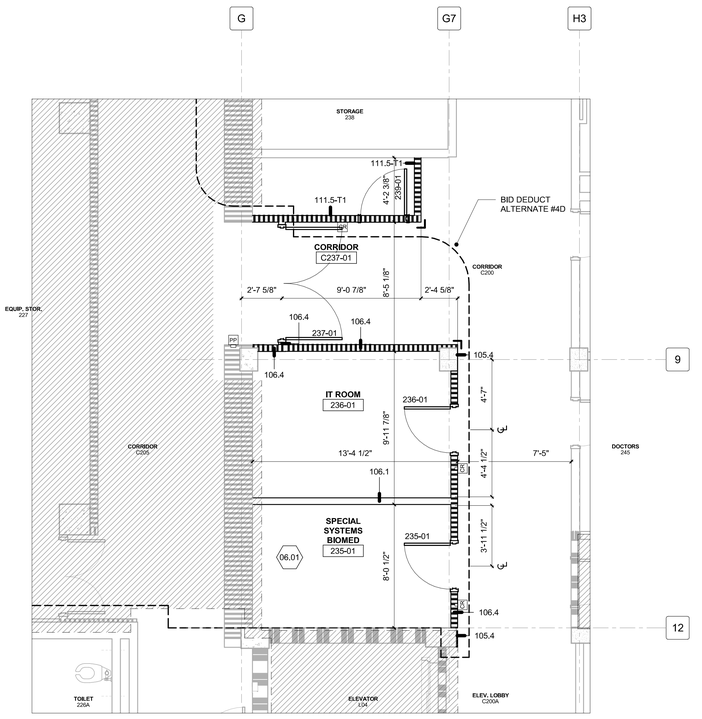

D1 ENLARGED PARTIAL PLAN - PHASE 1 - WARD 2 NORTH

1/4" = 1'-0"

0 2' 4' 8'

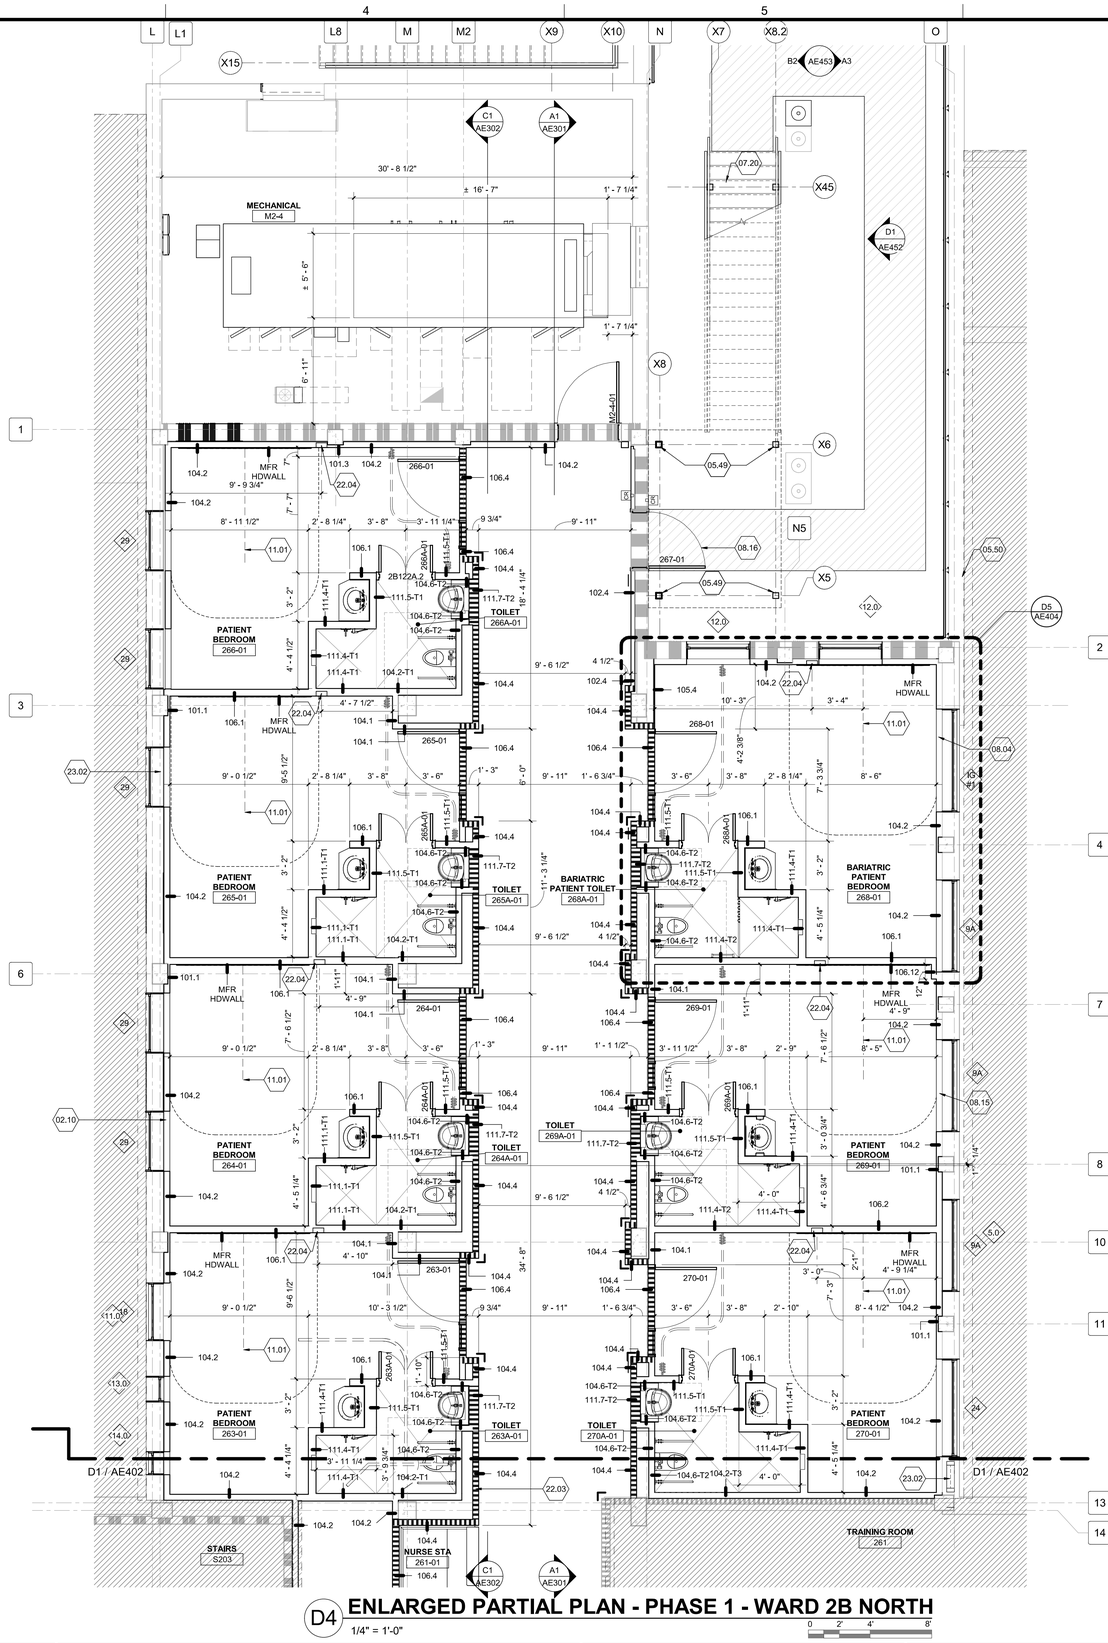

D4 ENLARGED PARTIAL PLAN - PHASE 1 - WARD 2B NORTH

1/4" = 1'-0"

0 2' 4' 8'

GENERAL SHEET NOTES

A. REFER TO SHEET AI001 FOR GENERAL FLOOR PLAN NOTES AND SYMBOLS.
B. FOR PATIENT BED, HEADWALL, AND PATIENT LIFT SUPPORT COORDINATION AND INFORMATION, SEE REFLECTED CEILING PLAN SHEETS AE120 TO AE123. PATIENT LIFT SUPPORTS SHEET AE501, AND TYPICAL HEADWALL ELEVATION ON SHEET D6 / AE405.
C. REFER TO ALL PHASING SHEETS. GENERAL CONTRACTOR MUST ENSURE THAT ALL CONTRACTORS ARE RESPONSIBLE FOR COORDINATION ACROSS ENTIRE SET OF CONSTRUCTION DOCUMENTS.
D. FOR PARTITION TYPE DEFINITIONS, SEE SHEET GI501
E. ALL INTERIOR PARTITION WALLS MUST BE ACOUSTIC RATED AND GO TO THE UNDERSIDE OF STRUCTURE.
F. FOR DOOR SYMBOL LEGEND SEE SHEET AE601.
G. EQUIPMENT NOT SHOWN FOR CLARITY. SEE EQUIPMENT DRAWINGS SHEETS QH102 TO QH601 AND TYPICAL PLAN SHEET AE404 FOR INFORMATION.
H. FOR LOUVER TYPE AND SIZE INFORMATION, SEE SHEET AE602.
I. IN ELECTRICAL AND IT/SYSTEMS ROOMS, PROVIDE AND INSTALL 3/4" TYPE X FIRE RETARDANT PLYWOOD BACKBOARD ON WALLS DESIGNATED FOR EQUIPMENT MOUNTING. PLYWOOD TO BE PAINTED WHITE EXCEPT RATING STAMP. INSTALL PLYWOOD WITH #12 GALVANIZED FLAT HEAD WOOD SCREWS INTO STUDS AT 16" O.C., VERTICAL AND HORIZONTAL.
J. EXISTING WALLS TO REMAIN SHALL RECEIVE A NEW LAYER OF 1/4" GYP. BD. BEFORE APPLYING FINISH.

SHEET KEYNOTES

02.10 EXTERIOR CHUTE LOCATION - THIS PHASE.
05.49 NEW STRUCTURAL STEEL POSTS. SEE SHEETS AE450-AE460 AND STRUCTURAL.
05.50 NEW 42" HIGH GUARDRAIL AT EXISTING PARAPET WALL, MOUNT TO EXISTING STRUCTURE. SEE SHEETS AE450-AE460 FOR ENLARGED PLANS AND DETAILS.
06.01 FIRE-RATED TREATED 3/4" PLYWOOD, 8'- 0" HEIGHT IN SYSTEMS ROOM DESIGNATED FOR WALL MOUNTED EQUIPMENT.
07.20 NEW STEEL BEAM OVER EXISTING ROOF. REMOVE EXISTING ROOF ASSEMBLY UP TO EXISTING CONCRETE DECK. GC TO FIELD-VERIFY LOCATIONS OF EXISTING STEEL BEAMS. REROOF AROUND NEW BEAMS TO PROVIDE ADEQUATE SLOPE TO DRAIN TO EXISTING ROOF DRAINS. SEE STRUCTURAL FOR BEAM.
08.04 MATCH AND EXTEND EXISTING WINDOW SILL OVER NEW FURR-OUT. MATCH EXISTING STYLE AND COLOR, TYPICAL AT 2 & 2B WINDOWS.
08.15 NEW 60-MIN FIRE-RATED WINDOW ASSEMBLY.
08.16 NEW 60-MIN FIRE-RATED DOOR ASSEMBLY.
11.01 CENTER-LINE OF PATIENT BED.
22.03 NEW ZONE VALVE BOX, SEE PLUMBING DRAWING PL100 FOR INFORMATION.
22.04 NEW DIALYSIS BOX, SEE PLUMBING DRAWING PL105 FOR INFORMATION.
23.02 REPAIR WALL, SEE MECHANICAL PLANS AT LOCATION OF NEW EXHAUST FAN.

SYMBOLS LEGEND

PROJECT LIMITS

NOT IN SCOPE
AREA OUTSIDE OF PROJECT LIMITS

INDICATES EGRESS WALKWAY AT EXTERIOR STAIR

RAMP UP TO RAISED FLOOR LEVEL, ARDEX ERM, OR EQUAL

RAMP THRESHOLD (AT DOOR / OPENING) WHERE OCCURS IN PLAN

PARTITION GRAPHICS

PARTITION PHASING

EXISTING ELEMENT TO REMAIN

EXISTING ELEMENT TO BE DEMOLISHED

TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

NO RATING

SMOKE RESISTIVE PARTITION - NON RATED


1 HOUR FIRE BARRIER

1 HOUR FIRE/SMOKE BARRIER

2 HOUR FIRE BARRIER

2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN

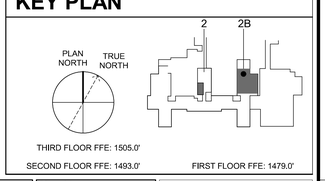

THIRD FLOOR FFE: 1505.0'
SECOND FLOOR FFE: 1493.0'
FIRST FLOOR FFE: 1479.0'

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC. consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. CLARK REGISTERED ARCHITECT 13080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE
CHARLOTTE, NC 28227
P 704.814.1320
F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: ENLARGED PARTIAL PLAN - PHASE 1 - WARD 2 AND 2B NORTH

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: RENOVATE MED SURGE WARDS

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: MS


Project Number: 564-17-140

Building Number: 1

Drawing Number: AE401

Sheet 51 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

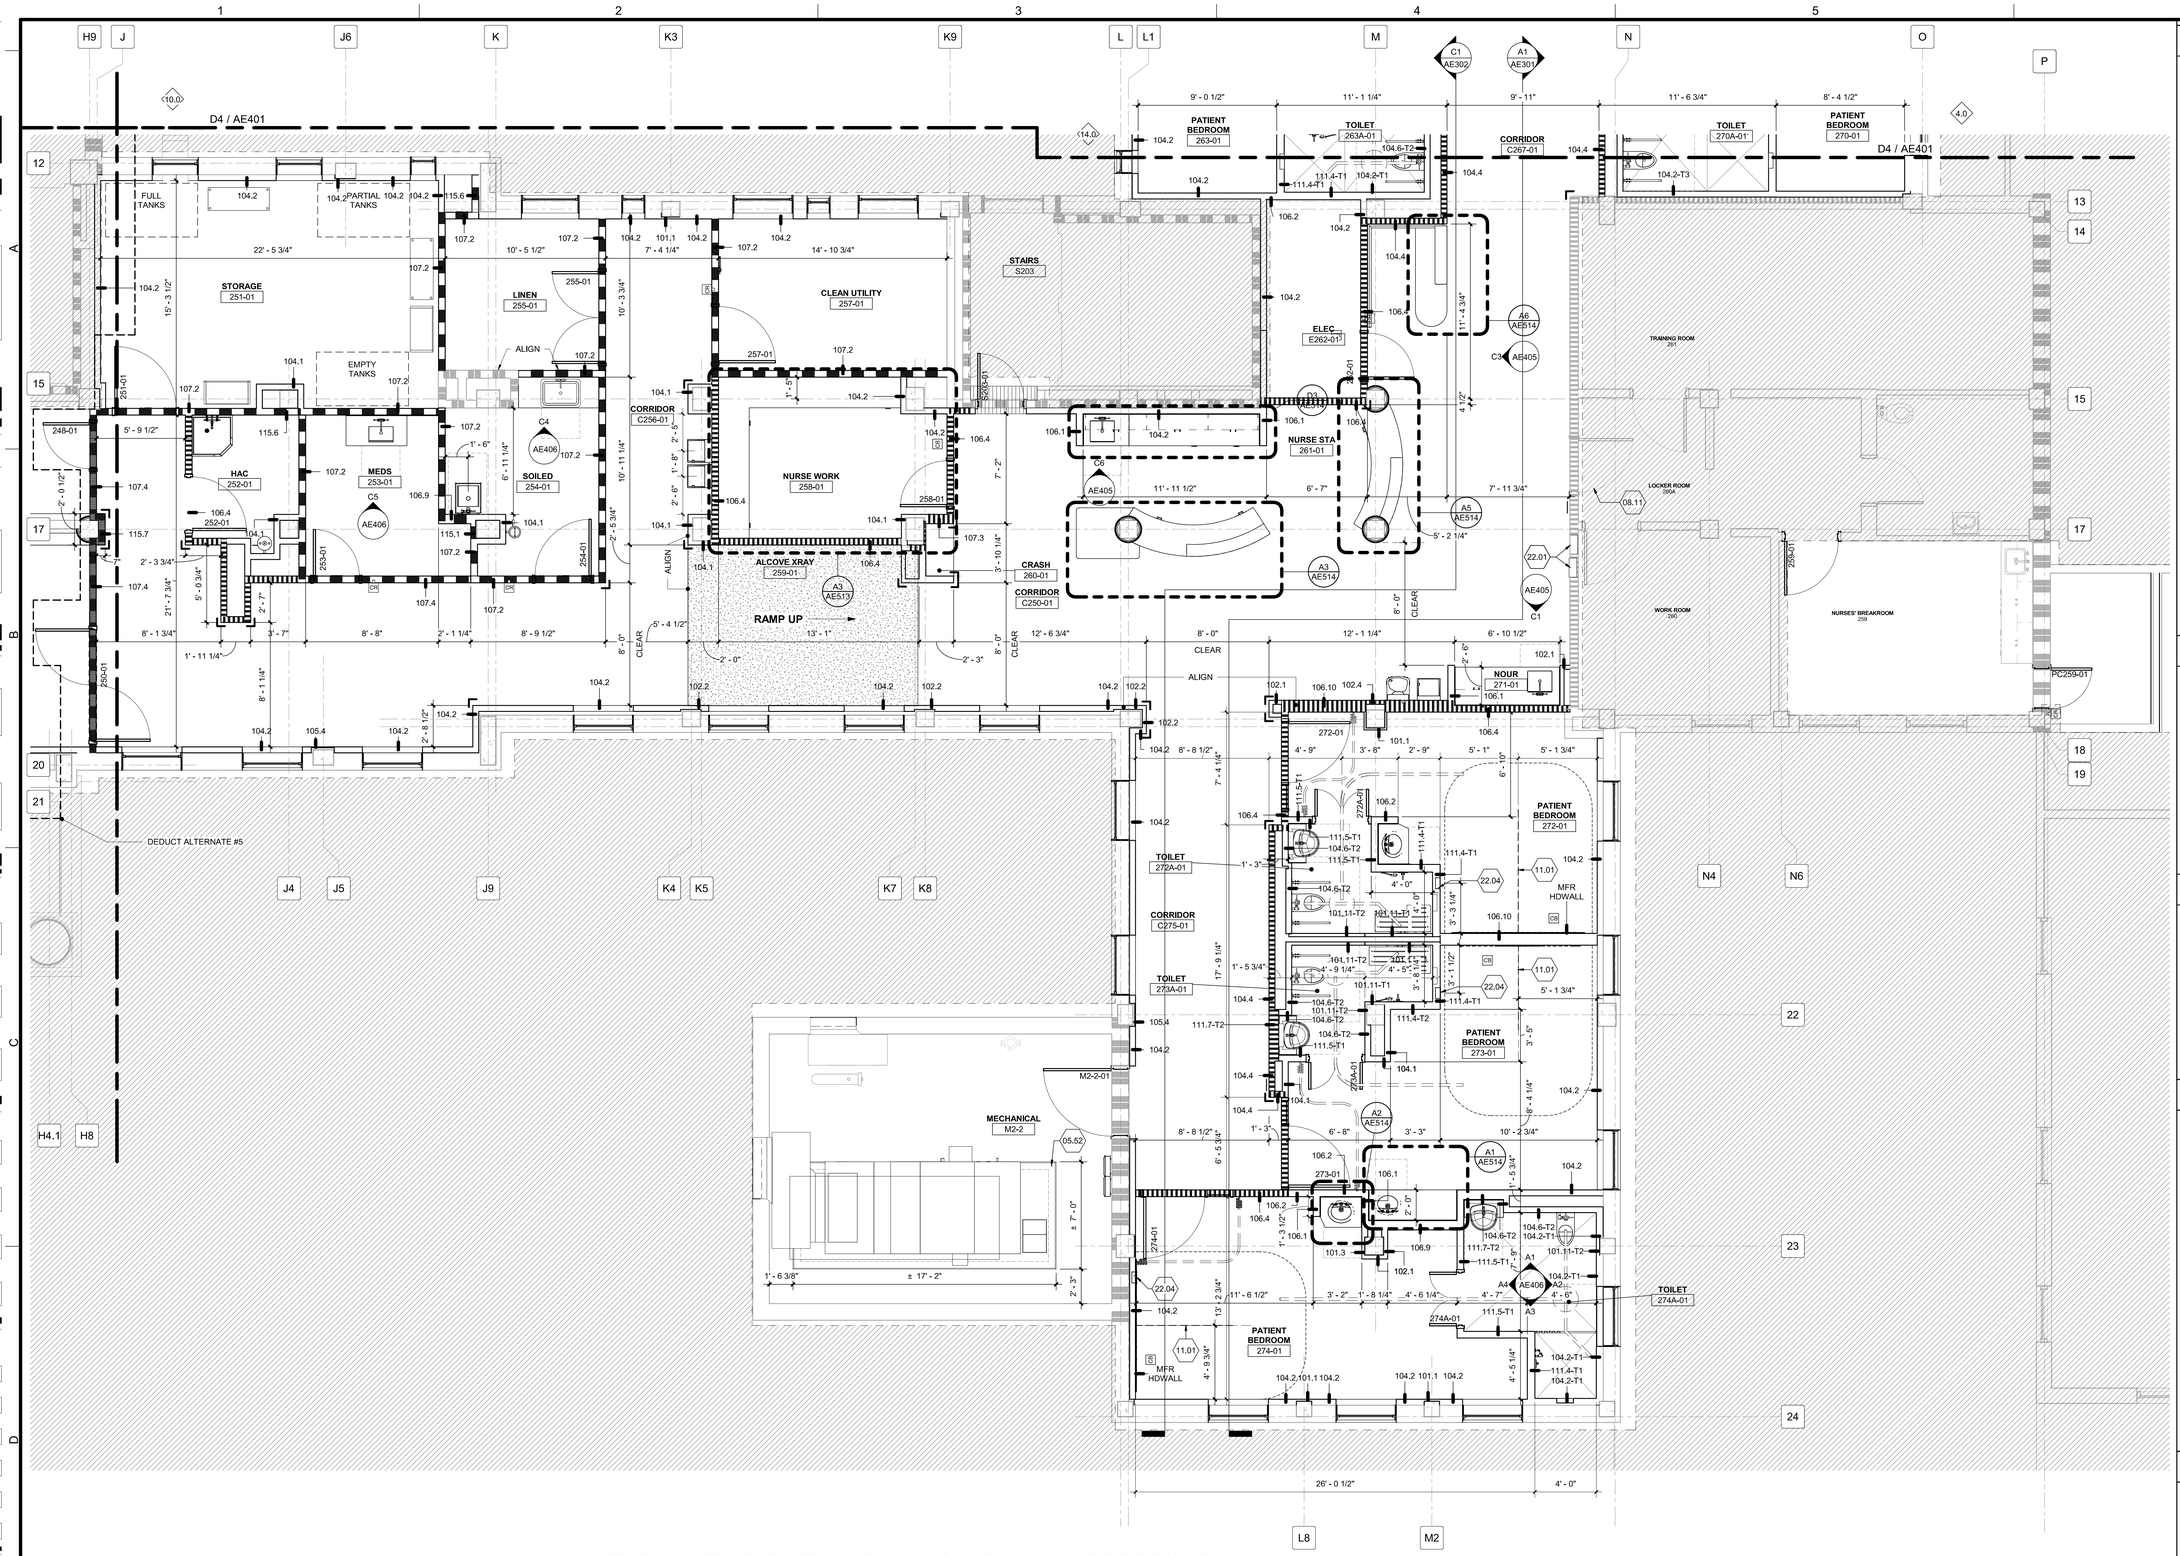

D1 ENLARGED PARTIAL PLAN - PHASE 1 - WARD 2B SOUTH

1/4" = 1'-0"

0 2' 4' 8'

GENERAL SHEET NOTES

A. REFER TO SHEET AI001 FOR GENERAL FLOOR PLAN NOTES AND SYMBOLS.
B. FOR PATIENT BED, HEADWALL, AND PATIENT LIFT SUPPORT COORDINATION AND INFORMATION, SEE REFLECTED CEILING PLAN SHEETS AE120 TO AE123, PATIENT LIFT SUPPORTS SHEET AE501, AND TYPICAL HEADWALL ELEVATION ON SHEET D6 / AE405.
C. REFER TO ALL PHASING SHEETS. GENERAL CONTRACTOR MUST ENSURE THAT ALL CONTRACTORS ARE RESPONSIBLE FOR COORDINATION ACROSS ENTIRE SET OF CONSTRUCTION DOCUMENTS.
D. FOR PARTITION TYPE DEFINITIONS, SEE SHEET GI501
E. ALL INTERIOR PARTITION WALLS MUST BE ACOUSTIC RATED AND GO TO THE UNDERSIDE OF STRUCTURE.
F. FOR DOOR SYMBOL LEGEND SEE SHEET AE601.
G. EQUIPMENT NOT SHOWN FOR CLARITY. SEE EQUIPMENT DRAWINGS SHEETS QH102 TO QH601 AND TYPICAL PLAN SHEET AE404 FOR INFORMATION.
H. FOR LOUVER TYPE AND SIZE INFORMATION, SEE SHEET AE602.
I. IN ELECTRICAL AND IT/SYSTEMS ROOMS, PROVIDE AND INSTALL 3/4" TYPE X FIRE RETARDANT PLYWOOD BACKBOARD ON WALLS DESIGNATED FOR EQUIPMENT MOUNTING. PLYWOOD TO BE PAINTED WHITE EXCEPT RATING STAMP. INSTALL PLYWOOD WITH #12 GALVANIZED FLAT HEAD WOOD SCREWS INTO STUDS AT 16" O.C., VERTICAL AND HORIZONTAL.
J. EXISTING WALLS TO REMAIN SHALL RECEIVE A NEW LAYER OF 1/4" GYP. BD. BEFORE APPLYING FINISH.

SHEET KEYNOTES

05.52 NEW EQUIPMENT PAD, SEE D1/AI001. COORDINATE FINAL DIMENSIONS OF PAD WITH EQUIPMENT SIZE.
08.11 EXISTING DOOR TO REMAIN. PAINT EXISTING DOOR AND FRAME.
11.01 CENTER-LINE OF PATIENT BED.
22.01 NEW MEDICAL GAS ALARM PANELS, SEE PLUMBING DRAWING PG101 FOR INFORMATION.
22.04 NEW DIALYSIS BOX, SEE PLUMBING DRAWING PL105 FOR INFORMATION.

SYMBOLS LEGEND


PROJECT LIMITS
NOT IN SCOPE
AREA OUTSIDE OF PROJECT LIMITS
RAMP UP TO RAISED FLOOR LEVEL, ARDEX ERM, OR EQUAL
RAMP THRESHOLD (AT DOOR / OPENING) WHERE OCCURS IN PLAN

PARTITION GRAPHICS

PARTITION PHASING
EXISTING ELEMENT TO REMAIN
EXISTING ELEMENT TO BE DEMOLISHED
TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING
NO RATING
SMOKE RESISTIVE PARTITION - NON RATED
1 HOUR FIRE BARRIER
1 HOUR FIRE/SMOKE BARRIER
2 HOUR FIRE BARRIER
2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN

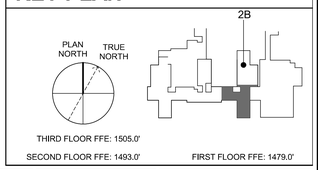

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC. consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:
Digital Signature not valid without Certificate below seal.
JONATHAN M. CLARK REGISTERED ARCHITECT 031080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE
CHARLOTTE, NC 28227
P 704.814.1320
F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023


Drawing Title: ENLARGED PARTIAL PLAN - PHASE 1 - WARD 2B SOUTH
Project Phase: BID DOCUMENTS
FULLY SPRINKLERED

Project Title: RENOVATE MED SURGE WARDS
Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS
Date: MARCH 24, 2024
Checked: JC/LK
Drawn: MS

Project Number: 564-17-140
Building Number: 1
Drawing Number: AE402
Sheet 52 of 162


Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

BIM 360://18002 Fayetteville AR Renovate Med Surge Ward/18002 ARCH 2020.rvt

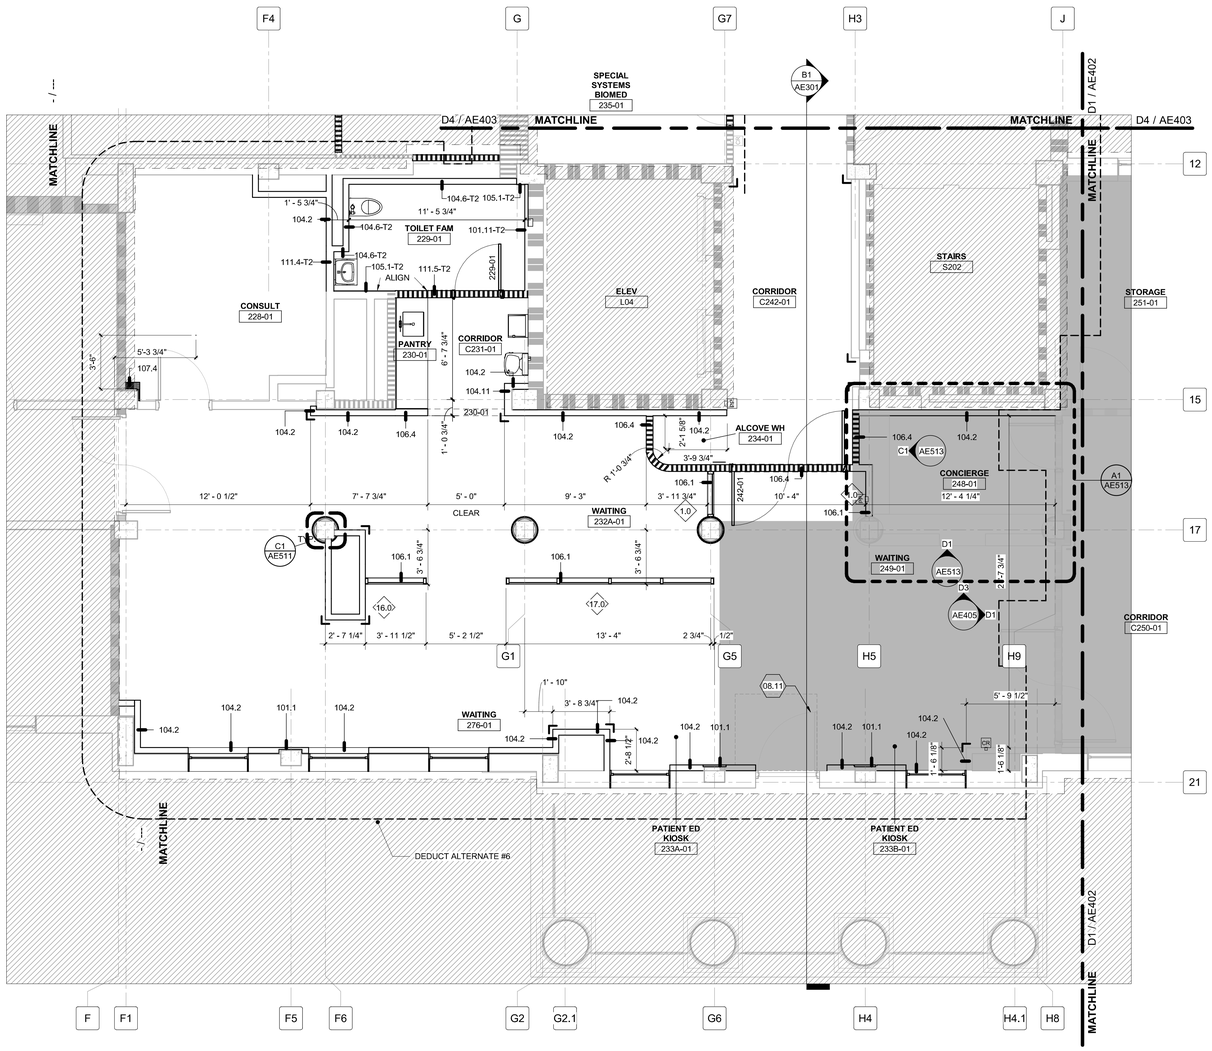

D1 ENLARGED PARTIAL PLAN - PHASE 2 - 2 WARD SOUTH

1/4" = 1'-0"

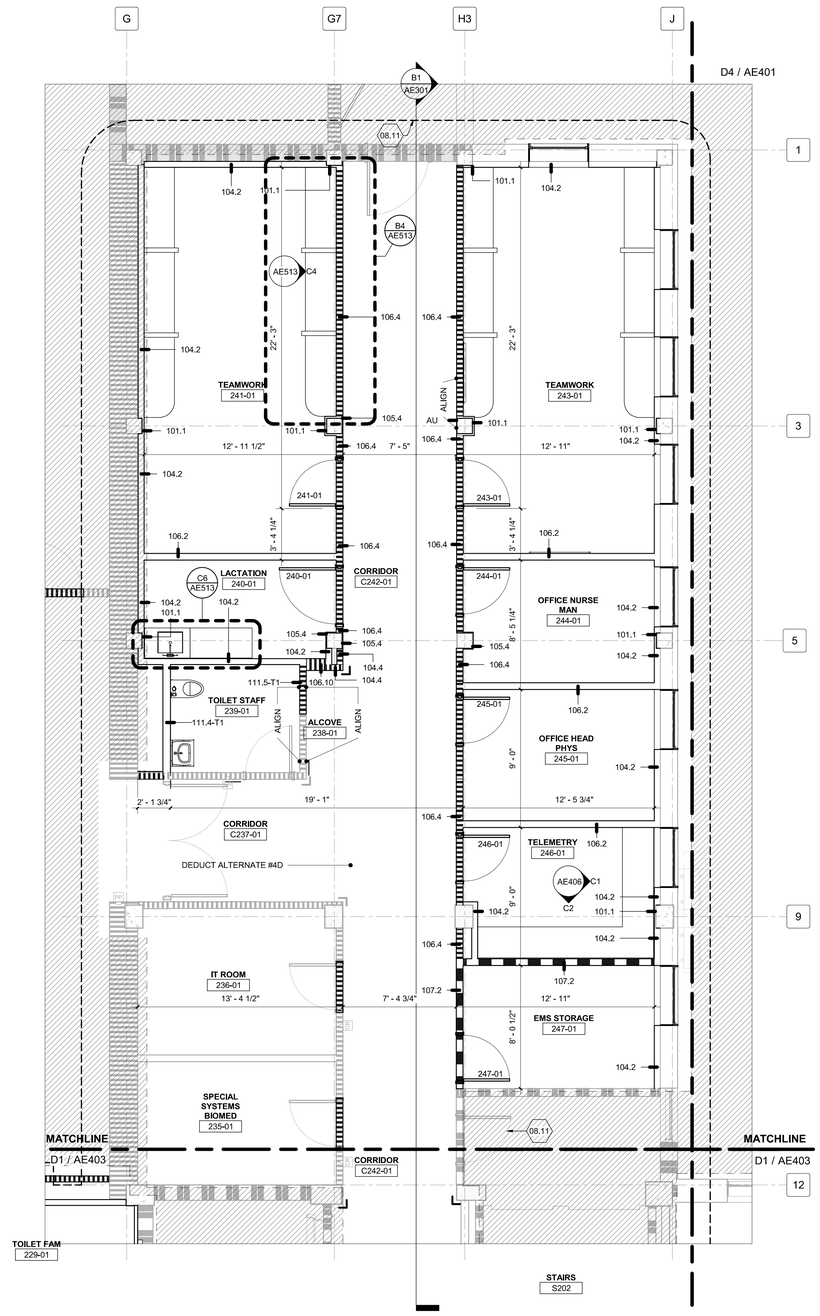

D4 ENLARGED PARTIAL PLAN - PHASE 2 - 2 WARD NORTH

1/4" = 1'-0"

GENERAL SHEET NOTES

A. REFER TO SHEET AI001 FOR GENERAL FLOOR PLAN NOTES AND SYMBOLS.
B. FOR PATIENT BED, HEADWALL, AND PATIENT LIFT SUPPORT COORDINATION AND INFORMATION, SEE REFLECTED CEILING PLAN SHEETS AE120 TO AE123, PATIENT LIFT SUPPORTS SHEET AE501, AND TYPICAL HEADWALL ELEVATION ON SHEET D6 / AE405.
C. REFER TO ALL PHASING SHEETS. GENERAL CONTRACTOR MUST ENSURE THAT ALL CONTRACTORS ARE RESPONSIBLE FOR COORDINATION ACROSS ENTIRE SET OF CONSTRUCTION DOCUMENTS.
D. FOR PARTITION TYPE DEFINITIONS, SEE SHEET GI501
E. ALL INTERIOR PARTITION WALLS MUST BE ACOUSTIC RATED AND GO TO THE UNDERSIDE OF STRUCTURE.
F. FOR DOOR SYMBOL LEGEND SEE SHEET AE601.
G. EQUIPMENT NOT SHOWN FOR CLARITY, SEE EQUIPMENT DRAWINGS SHEETS QH102 TO QH601 AND TYPICAL PLAN SHEET AE404 FOR INFORMATION.
H. FOR LOUVER TYPE AND SIZE INFORMATION, SEE SHEET AE602.
I. IN ELECTRICAL AND IT/SYSTEMS ROOMS, PROVIDE AND INSTALL 3/4" TYPE X FIRE RETARDANT PLYWOOD BACKBOARD ON WALLS DESIGNATED FOR EQUIPMENT MOUNTING. PLYWOOD TO BE PAINTED WHITE EXCEPT RATING STAMP. INSTALL PLYWOOD WITH #12 GALVANIZED FLAT HEAD WOOD SCREWS INTO STUDS AT 16" O.C., VERTICAL AND HORIZONTAL.
J. EXISTING WALLS TO REMAIN SHALL RECEIVE A NEW LAYER OF 1/4" GYP. BD. BEFORE APPLYING FINISH.

SHEET KEYNOTES

08.11 EXISTING DOOR TO REMAIN. PAINT EXISTING DOOR AND FRAME.

SYMBOLS LEGEND

PROJECT LIMITS

NOT IN SCOPE
AREA OUTSIDE OF PROJECT LIMITS

PHASE 1

PARTITION GRAPHICS

PARTITION PHASING

EXISTING ELEMENT TO REMAIN

EXISTING ELEMENT TO BE DEMOLISHED

TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

NO RATING

SMOKE RESISTIVE PARTITION - NON RATED


1 HOUR FIRE BARRIER

1 HOUR FIRE/SMOKE BARRIER

2 HOUR FIRE BARRIER

2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN



Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC. consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.
JONATHAN M. CRAIG — REGISTERED ARCHITECT — 11080 — NORTH CAROLINA — CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE
CHARLOTTE, NC 28227
P 704.814.1320
F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: ENLARGED PARTIAL PLANS - PHASE 2 - WARD 2 NORTH AND SOUTH

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: RENOVATE MED SURGE WARDS

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: MS

Project Number: 564-17-140


Building Number: 1

Drawing Number: AE403

Sheet 53 of 162


Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

BIM 360://18002 Fayetteville AR Renovate Med Surge Ward/18002 ARCH 2020.rvt

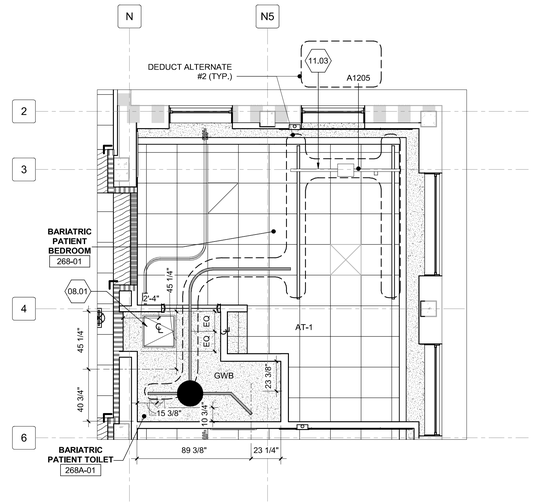

ENLARGED - TYPICAL BARIATRIC PATIENT ROOM REFLECTED CEILING PLAN

C5 1/4" = 1'-0"

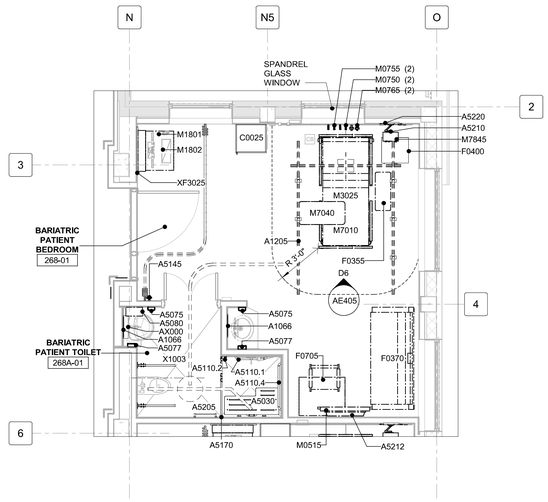

ENLARGED - TYPICAL BARIATRIC PATIENT ROOM

D5 1/4" = 1'-0"

GENERAL SHEET NOTES

A. REFER TO SHEET AI001 FOR GENERAL FLOOR PLAN NOTES AND SYMBOLS.
B. FOR PATIENT BED, HEADWALL, AND PATIENT LIFT SUPPORT COORDINATION AND INFORMATION, SEE REFLECTED CEILING PLAN SHEETS AE120 TO AE123, PATIENT LIFT SUPPORTS SHEET AE501, AND TYPICAL HEADWALL ELEVATION ON SHEET D6 / AE405.
C. REFER TO ALL PHASING SHEETS. GENERAL CONTRACTOR MUST ENSURE THAT ALL CONTRACTORS ARE RESPONSIBLE FOR COORDINATION ACROSS ENTIRE SET OF CONSTRUCTION DOCUMENTS.
D. FOR PARTITION TYPE DEFINITIONS, SEE SHEET GI501
E. ALL INTERIOR PARTITION WALLS MUST BE ACOUSTIC RATED AND GO TO THE UNDERSIDE OF STRUCTURE.
F. FOR DOOR SYMBOL LEGEND SEE SHEET AE601.
G. EQUIPMENT NOT SHOWN FOR CLARITY, SEE EQUIPMENT DRAWINGS SHEETS QH102 TO QH601 AND TYPICAL PLAN SHEET AE404 FOR INFORMATION.
H. FOR LOUVER TYPE AND SIZE INFORMATION, SEE SHEET AE602.
I. IN ELECTRICAL AND IT/SYSTEMS ROOMS, PROVIDE AND INSTALL 3/4" TYPE X FIRE RETARDANT PLYWOOD BACKBOARD ON WALLS DESIGNATED FOR EQUIPMENT MOUNTING. PLYWOOD TO BE PAINTED WHITE EXCEPT RATING STAMP. INSTALL PLYWOOD WITH #12 GALVANIZED FLAT HEAD WOOD SCREWS INTO STUDS AT 16" O.C., VERTICAL AND HORIZONTAL.
J. EXISTING WALLS TO REMAIN SHALL RECEIVE A NEW LAYER OF 1/4" GYP. BD. BEFORE APPLYING FINISH.

SHEET KEYNOTES

08.01 CEILING ACCESS PANEL 24" x 24", TYPICAL.
11.03 A1205 (PATIENT LIFT TRACK), COUPLED WITH A1205.1 (CC).

PARTITION GRAPHICS

PARTITION PHASING

- EXISTING ELEMENT TO REMAIN
- EXISTING ELEMENT TO BE DEMOLISHED
- TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

- NO RATING
- SMOKE RESISTIVE PARTITION - NON RATED
- 1 HOUR FIRE BARRIER
- 1 HOUR FIRE/SMOKE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/ SMOKE BARRIER

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. CLARK REGISTERED ARCHITECT 311080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: ENLARGED - TYPICAL FLOOR AND REFLECTED CEILING PLAN
Project Phase: BID DOCUMENTS
FULLY SPRINKLERED

Project Title: RENOVATE MED SURGE WARDS
Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS
Date: MARCH 24, 2024
Checked: JC/LK
Drawn: MS

Project Number: 564-17-140
Building Number: 1
Drawing Number: AE404
Sheet 54 of 162


Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

GENERAL SHEET NOTES


A. FOR RAISED FLOOR INFORMATION AT PATIENT BATHROOMS, AND PATIENT RAIL INTERSECTION WITH DOOR FRAME AT PATIENT BATHROOM SEE SHEET AE500.
B. FOR CASEWORK / MILLWORK INFORMATION SEE SHEET AE515.
C. TYPICAL PATIENT BEDROOM & BATHROOM INTERIOR ELEVATIONS **ONLY** APPLY TO ROOMS IN SCOPE AS SHOWN ON RELEVANT FLOOR PLANS.
D. FOR TYPICAL EQUIPMENT MOUNTING HEIGHTS, SEE SHEET G802.
E. FOR FINISH SCHEDULE SEE AF602.
F. COORDINATE ALL FINAL EQUIPMENT HEIGHTS AND LOCATIONS WITH CLIENT / END USERS.
G. FOR TYPICAL SHOWER CONTROL WALL @ TRANSFER TYPE SEE A4 / AE406.
H. SEE EQUIPMENT SHEET QH601 FOR EQUIPMENT SCHEDULE.

SHEET KEYNOTES


22.04 NEW DIALYSIS BOX, SEE PLUMBING DRAWING PL105 FOR INFORMATION.
26.01 ELECTRICAL DEVICES, SEE ELECTRICAL DRAWINGS FOR INFORMATION.

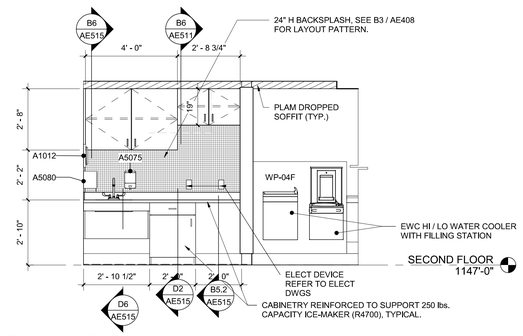


C1 **NOURISHMENT INT ELEV S**
3/8" = 1'-0"

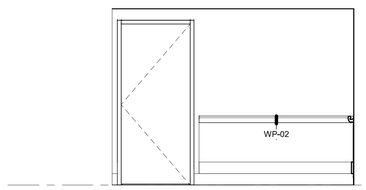


C3 **NURSE STA. INT ELEV W**
3/8" = 1'-0"

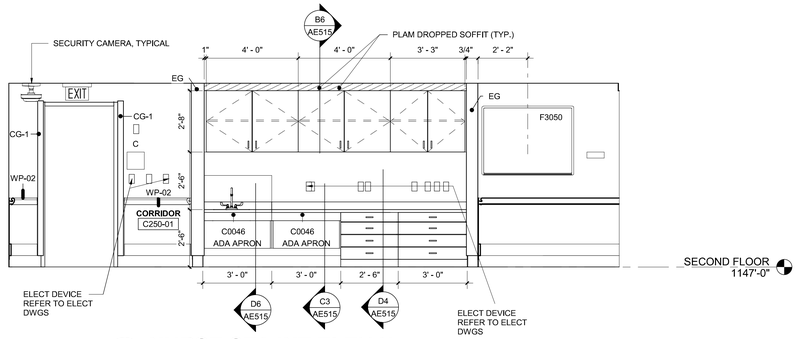

C6 **NURSE STA INT ELEV N**
3/8" = 1'-0"

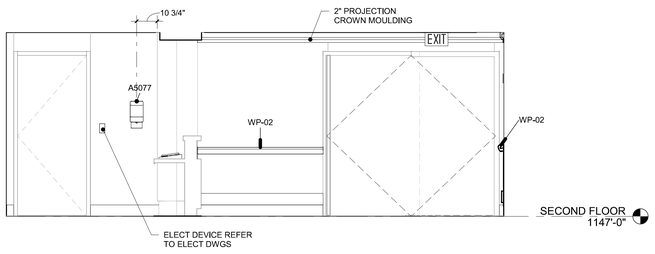

D1 **CONCIERGE INT ELEV E**
3/8" = 1'-0"

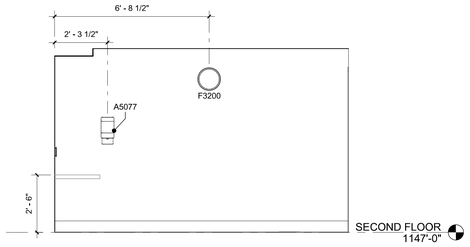


D3 **CONCIERGE INT ELEV N**
3/8" = 1'-0"

SYMBOLS LEGEND

SPECIFICATION 10 25 13

A1	STYLE PATIENT BED SERVICE WALL (PBSW) COORDINATE WITH ELECTRICAL DETAIL D5 / EP501
O	OXYGEN
A	AIR
V	VACUUM
1	EMERGENCY POWER OUTLETS
2	EMERGENCY POWER OUTLETS
3	NORMAL POWER OUTLETS
4	NURSE CALL AUDIO VISUAL
5	SWITCHES FOR OVERHEAD EXAM LIGHT AND NURSE LIGHT
6	AUXILIARY LIGHT WITH HOOD AND SWITCH
7	DATA OUTLET
8	BED PIN OUTLET
9	POWER, DATA, AND CATV FOR PDI ARM (COORDINATE WITH PDI MANUFACTURER
10	BLANK PLATE
11	NORMAL POWER OUTLETS

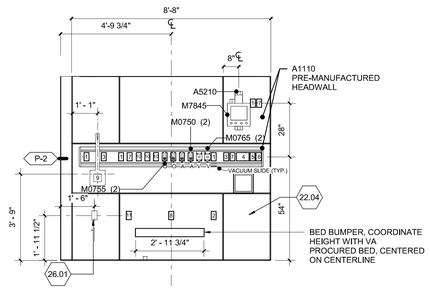

D6 **TYPICAL HEADWALL DETAIL**
3/8" = 1'-0"

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.
JONATHAN M. [illegible] REGISTERED ARCHITECT 17108 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023


Drawing Title: **INTERIOR ELEVATIONS**
Project Phase: BID DOCUMENTS
FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**
Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS
Date: MARCH 24, 2024 | Checked: TR | Drawn: MS

Project Number: 564-17-140
Building Number: 1
Drawing Number: **AE405**
Sheet 55 of 162


Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

BIM 360://18002 Fayetteville AR Renovate Med Surge Ward/18002 ARCH 2020.rvt

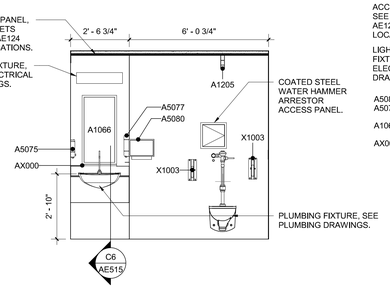


A1 INTERIOR ELEVATION - NORTH TYPICAL

3/8" = 1'-0"

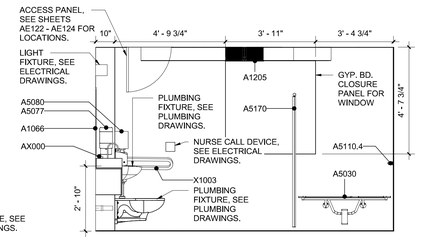


A2 TOILET ELEVATION - EAST TYPICAL

3/8" = 1'-0"




A3 INTERIOR ELEVATION - SOUTH TYPICAL

3/8" = 1'-0"

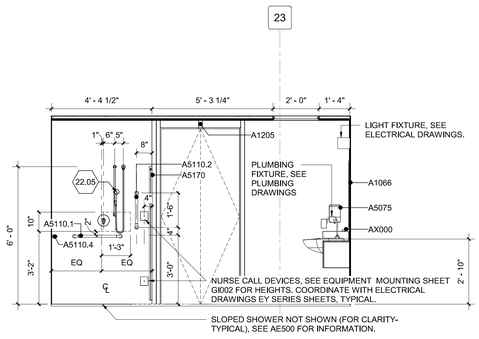

A4 TRANSFER SHOWER CONTROL WALL TYP

3/8" = 1'-0"

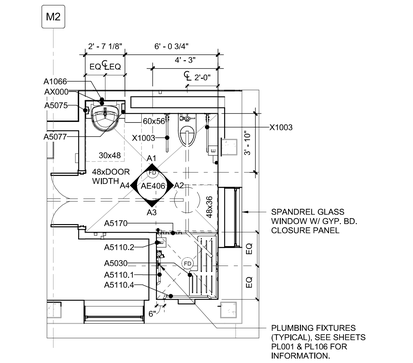

A5 ENLARGED TOILET PLAN - TYPICAL


1/4" = 1'-0"

GENERAL SHEET NOTES

A. FOR RAISED FLOOR INFORMATION AT PATIENT BATHROOMS, AND PATIENT RAIL INTERSECTION WITH DOOR FRAME AT PATIENT BATHROOM SEE SHEET AE500.
B. FOR CASEWORK / MILLWORK INFORMATION SEE SHEET AE515.
C. TYPICAL PATIENT BEDROOM & BATHROOM INTERIOR ELEVATIONS **ONLY** APPLY TO ROOMS IN SCOPE AS SHOWN ON RELEVANT FLOOR PLANS.
D. FOR TYPICAL EQUIPMENT MOUNTING HEIGHTS, SEE SHEET GI002.
E. FOR FINISH SCHEDULE SEE AF602.
F. COORDINATE ALL FINAL EQUIPMENT HEIGHTS AND LOCATIONS WITH CLIENT / END USERS.
G. FOR TYPICAL SHOWER CONTROL WALL @ TRANSFER TYPE SEE A4 / AE406.
H. SEE EQUIPMENT SHEET QH601 FOR EQUIPMENT SCHEDULE.


SHEET KEYNOTES

22.05 PROVIDE AN ADJUSTABLE-HEIGHT HAND-HELD SHOWER SPRAY ON VERTICAL BAR W/ 59" MINIMUM HOSE LENGTH. CAPABILITY TO LOWER TO 48" AFF (AS NEEDED). SEE PLUMBING DRAWING PL001 FOR INFORMATION.




C1 TELEMETRY INT ELEV E

3/8" = 1'-0"

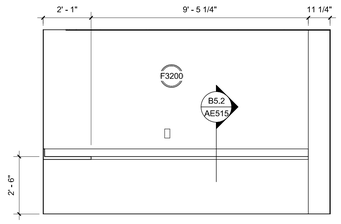


C2 TELEMETRY INT ELEV S

3/8" = 1'-0"

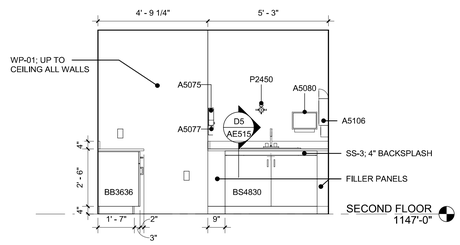

C4 SOILED INT ELEV N

3/8" = 1'-0"

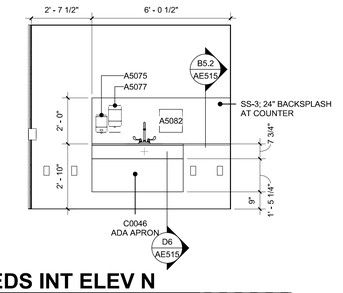

C5 MEDS INT ELEV N

3/8" = 1'-0"

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC. consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. CLARK REGISTERED ARCHITECT 311080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **INTERIOR ELEVATIONS**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: MS


Project Number: 564-17-140

Building Number: 1


Drawing Number: **AE406**

Sheet 56 of 162


Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

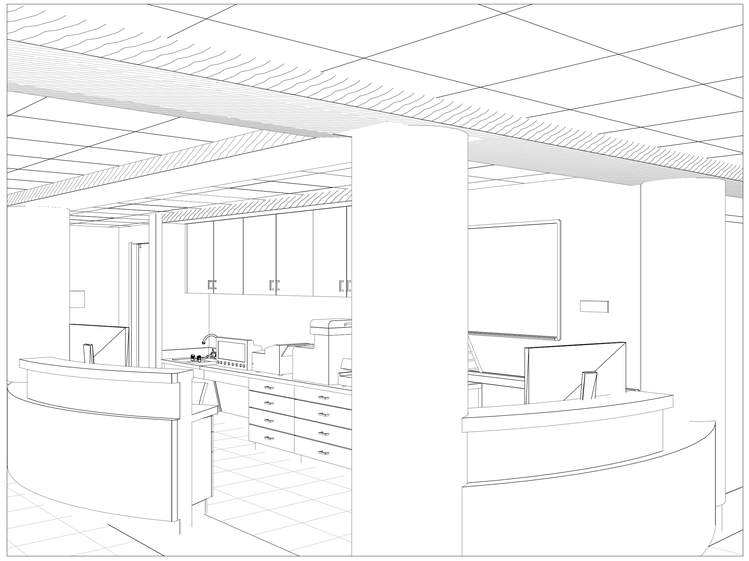


B1 **3D VIEW AT NURSE STATION**

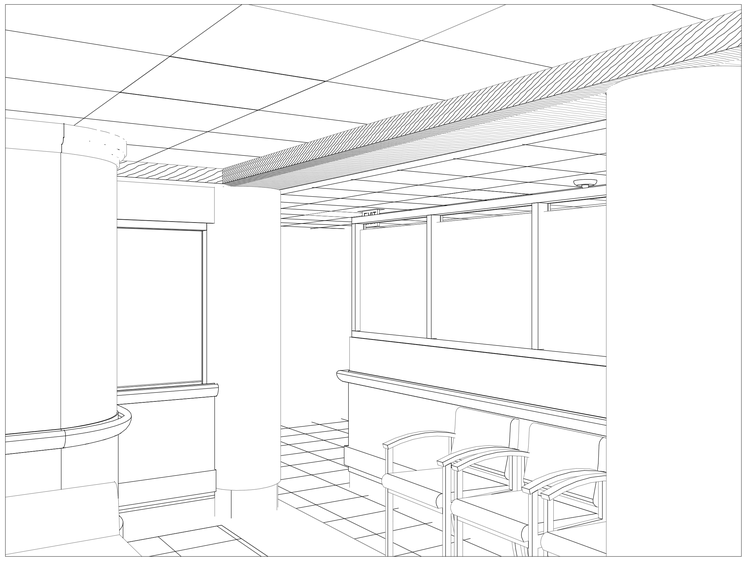

B3 **3D VIEW AT WAITING**

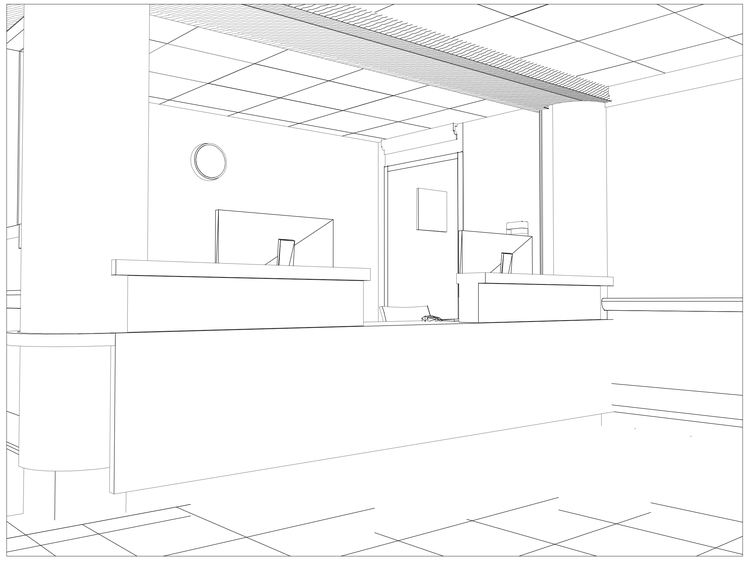

B5 **3D VIEW AT CONCIERGE DESK**

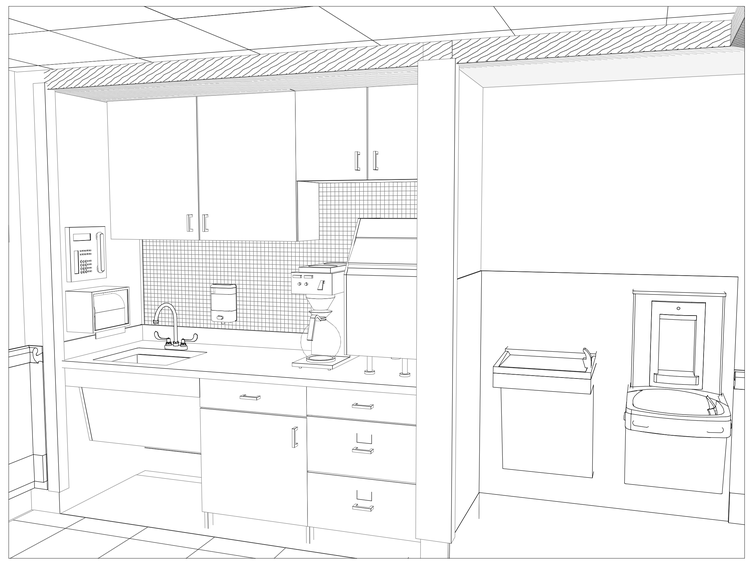

D5 **3D VIEW AT NOURISHMENT STATION**

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC consulting engineers

8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. CLARK REGISTERED ARCHITECT 310080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •

8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833

HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **3D VIEWS - INTERIORS**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: TR | Drawn: MS

Project Number: 564-17-140


Building Number: 1

Drawing Number: **AE410**

Sheet 57 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

BIM 360://18002 Fayetteville AR Renovate Med Surge Ward/18002 ARCH 2020.rvt

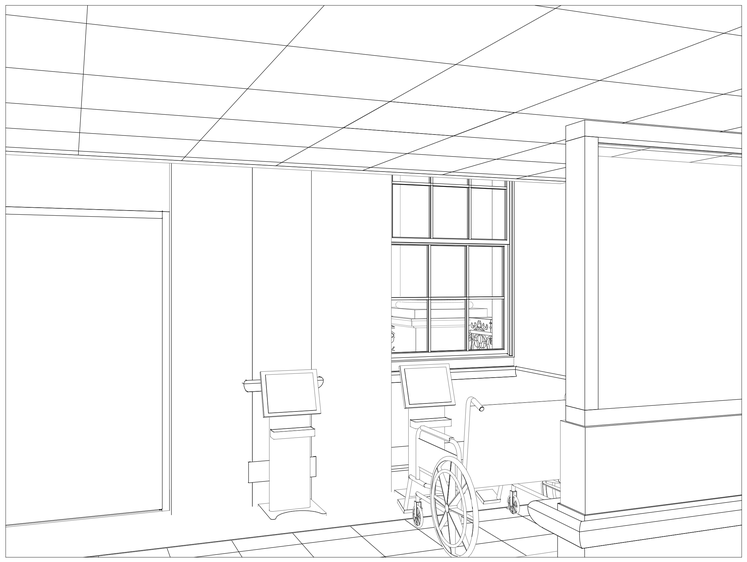

B1 **3D VIEW AT KIOSK STATION**

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC consulting engineers

8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. CLARK REGISTERED ARCHITECT 110080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL
• DESIGN GROUP, PC •

8016 TOWER POINT DRIVE
CHARLOTTE, NC 28227

P 704.814.1320
F 704.321.0833

HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title:
3D VIEWS - INTERIORS

Project Phase:
BID DOCUMENTS

FULLY SPRINKLERED


Project Title:
RENOVATE MED SURGE WARDS

Location:
VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024
Checked: TR
Drawn: MS


Project Number: 564-17-140
Building Number: 1
Drawing Number: **AE411**
Sheet 58 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

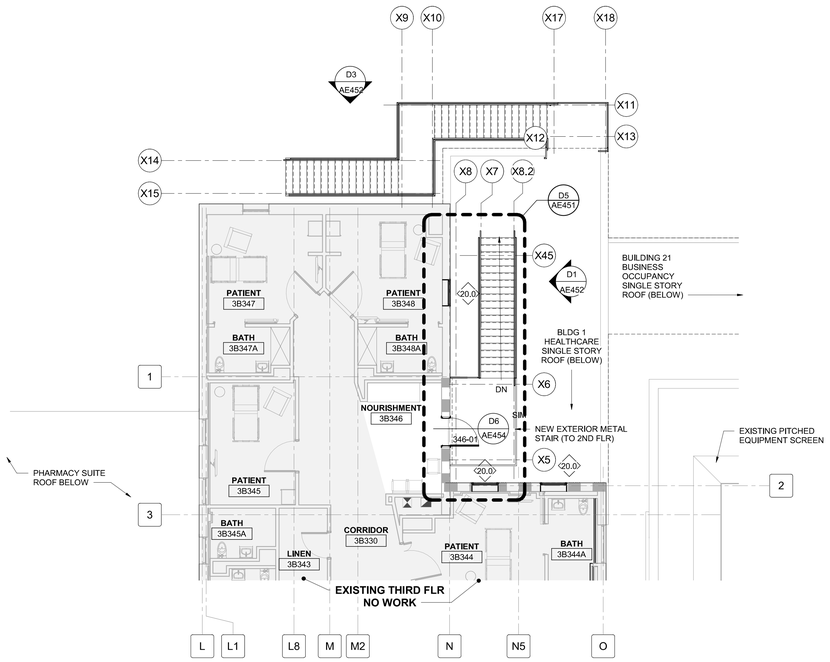


B1 THIRD FLOOR PLAN NEW STAIR EAST

1/8" = 1'-0" REFERENCE: D4 / AE105 0 4' 8' 16'

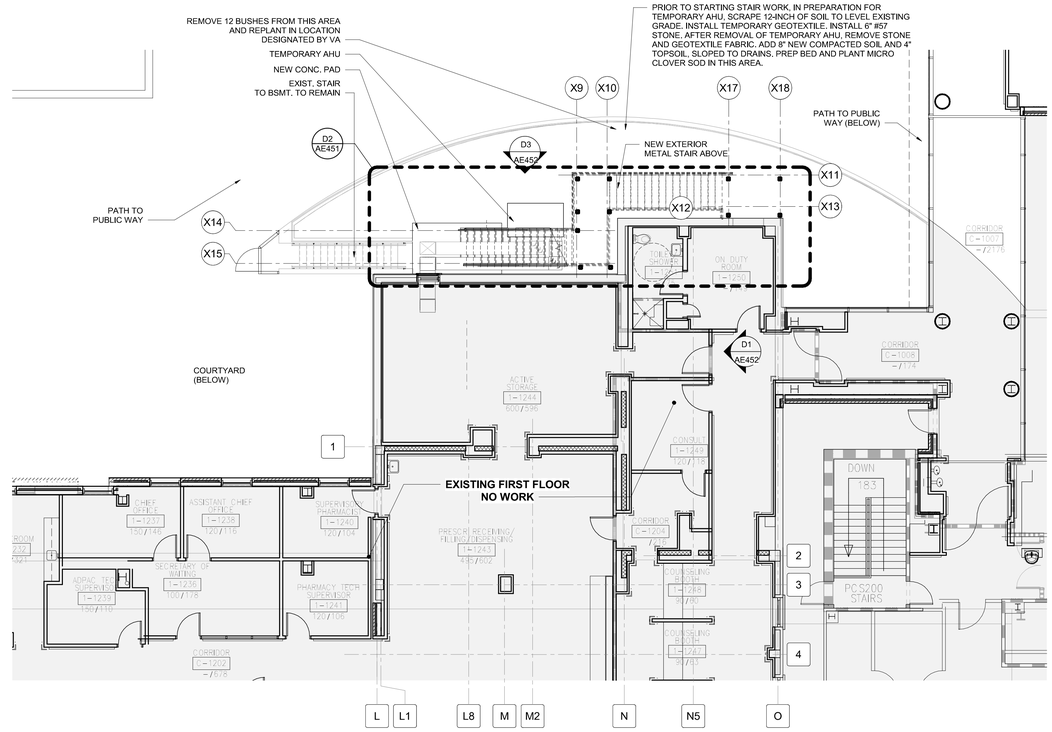


B4 FIRST FLOOR PLAN NEW STAIR EAST

1/8" = 1'-0" REFERENCE: D2 / AE100 0 4' 8' 16'

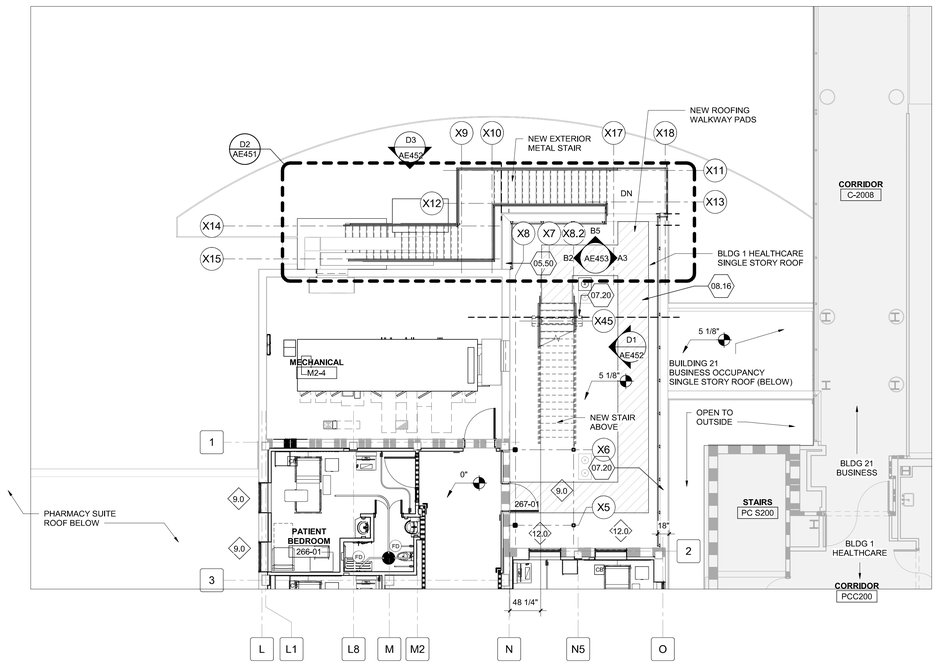

D1 SECOND FLOOR PLAN NEW STAIR EAST

1/8" = 1'-0" REFERENCE: D3 / AE102 0 4' 8' 16'

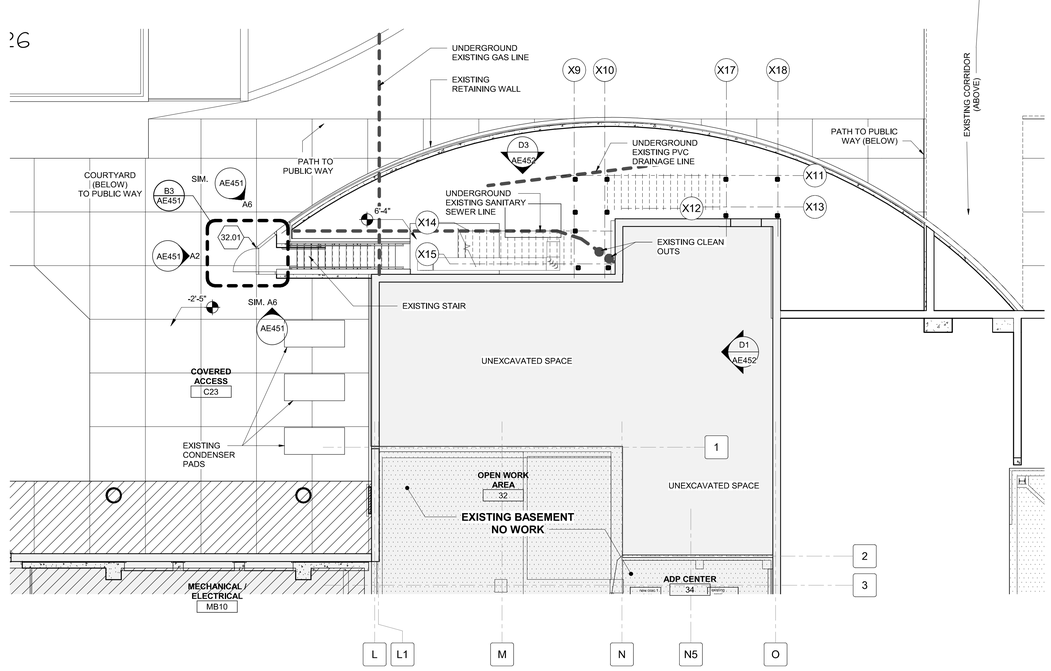

D4 BASEMENT FLOOR PLAN NEW STAIR EAST

1/8" = 1'-0" 0 4' 8' 16'

GENERAL SHEET NOTES

A. GRADE ELEVATIONS AND EXISTING FLOOR/ROOF ELEVATIONS FOR STAIRS INDICATED ON THESE PLANS ARE APPROXIMATE. CONTRACTOR SHALL OBTAIN A SURVEY TO LOCATE SPOT ELEVATIONS AND EXISTING BUILDING FLOOR AND ROOF ELEVATIONS,PRIOR TO STAIR DESIGN AND/OR STARTING CONSTRUCTION.

B. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING PUBLIC AND/OR PRIVATE UTILITY LOCATING SERVICES PRIOR TO STARTING CONSTRUCTION, AND TO DETERMINE AND FIELD VERIFY LOCATIONS.

C. ANY DISCREPANCIES OR CONFLICTS WHICH BECOME APPARENT BEFORE OR DURING CONSTRUCTION, SHALL BE BROUGHT TO THE ATTENTION COR, PRIOR TO CONSTRUCTION SO THAT REDESIGN OR CLARIFICATION MAY OCCUR, WITHOUT ANY CHANGE TO THE CONTRACT.

D. EXTERIOR HANDRAILS/GUARDRAILS/FENCE/GATES ARE TO BE PAINTED BLACK, TO MATCH EXISTING VA FACILITY STANDARD.

E. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTING EXISTING STRUCTURE AND FOUNDATIONS, DURING CONSTRUCTION. SEE SPECIFICATIONS FOR MORE INFORMATION.

F. ANY UTILITIES SHUTDOWN OR AREA CLOSURES ARE TO BE COORDINATED WITH COR.

G. INSTALL NOSING AT ALL EXTERIOR STAIR TREADS

H. NUMBERED AREAS ARE NOT SEQUENTIAL. THEY FOLLOW THE PHASED WORK.

SHEET KEYNOTES

05.50	NEW 42" HIGH GUARDRAIL. AT EXISTING PARAPET WALL, MOUNT TO EXISTING STRUCTURE. SEE SHEETS AE450-AE460 FOR ENLARGED PLANS AND DETAILS.
07.20	NEW STEEL BEAM OVER EXISTING ROOF, REMOVE EXISTING ROOF ASSEMBLY UP TO EXISTING CONCRETE DECK. GC TO FIELD-VERIFY LOCATIONS OF EXISTING STEEL BEAMS. REROOF AROUND NEW BEAMS TO PROVIDE ADEQUATE SLOPE TO DRAIN TO EXISTING ROOF DRAINS. SEE STRUCTURAL FOR BEAM.
08.16	NEW 60-MIN FIRE-RATED DOOR ASSEMBLY.
32.01	NEW 8'-0" SECURITY FENCE W/ CARD READER GATE AND ACCESS TO MATCH EXISTING CAMPUS STANDARD.

PARTITION GRAPHICS


PARTITION PHASING

- EXISTING ELEMENT TO REMAIN
- EXISTING ELEMENT TO BE DEMOLISHED
- TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

- NO RATING
- SMOKE RESISTIVE PARTITION - NON RATED
- 1 HOUR FIRE BARRIER
- 1 HOUR FIRE/SMOKE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN



THIRD FLOOR FFE: 1505.0'

SECOND FLOOR FFE: 1493.0' FIRST FLOOR FFE: 1479.0'

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC. consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.
JONATHAN E. CARR REGISTERED LANDSCAPE ARCHITECT 11098 NORTH CAROLINA CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **EXTERIOR STAIR EAST - PLANS**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Project Number: 564-17-140

Building Number: 1

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS


Drawing Number: **AE450**

Date: MARCH 24, 2024 Checked: JC Drawn: DW

Sheet 59 of 162


Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

BIM 360://18002 Fayetteville AR Renovate Med Surge Ward/18002 ARCH 2020.rvt

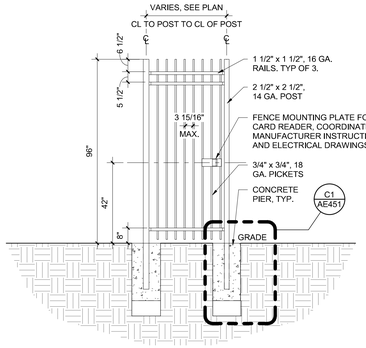


A1 FENCE ELEVATION, ATYPICAL

3/8" = 1'-0"

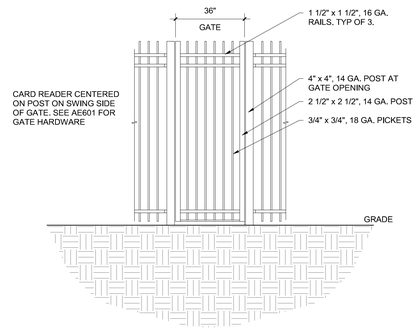


A2 FENCE SINGLE GATE ELEVATION

3/8" = 1'-0"

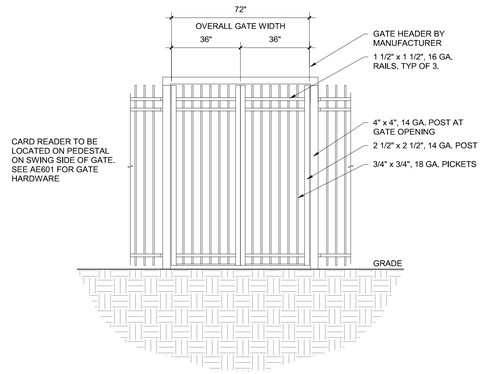

A4 FENCE DOUBLE GATE ELEVATION

3/8" = 1'-0"

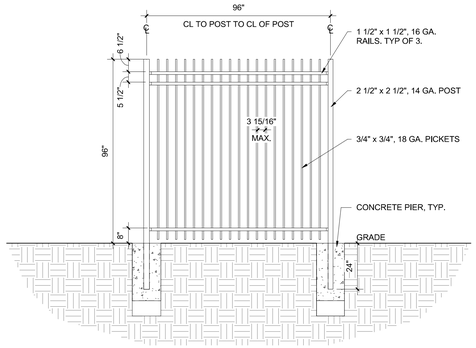


A6 FENCE ELEVATION, TYP.

3/8" = 1'-0"




C1 FENCE FOOTING DETAIL (TYP.)

1 1/2" = 1'-0"

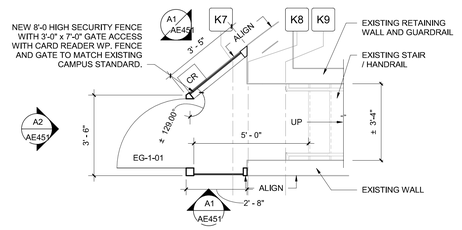


B3 NEW GATE AT EXISTING OUTSIDE STAIR

3/8" = 1'-0"

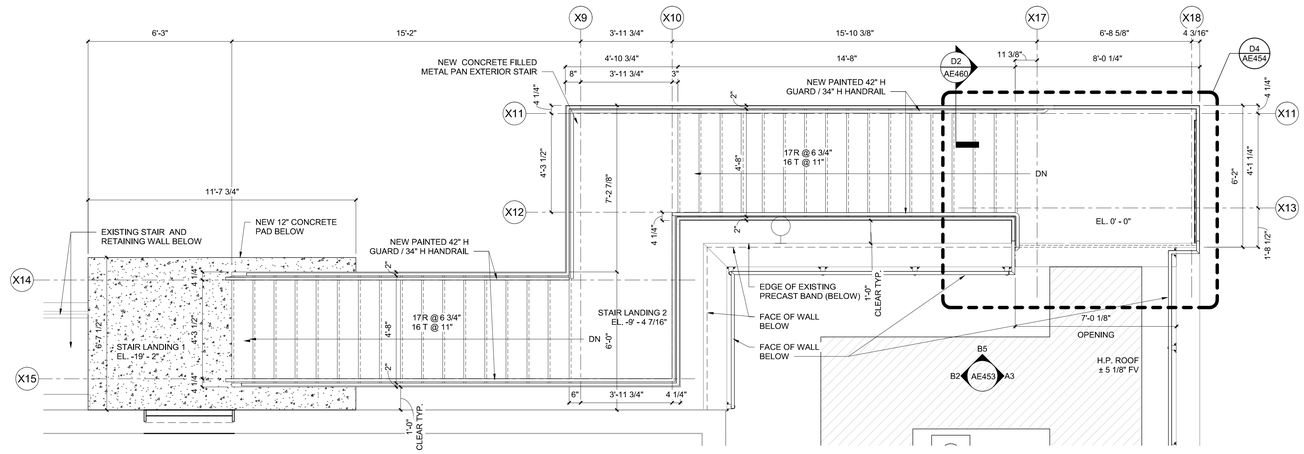

D2 EAST STAIR AT SECOND FLOOR

3/8" = 1'-0"

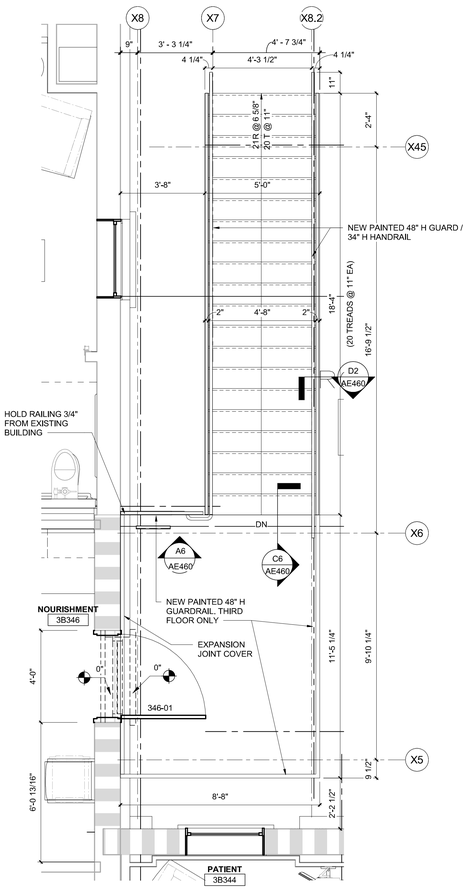

D5 EAST STAIR @ THIRD FLOOR

3/8" = 1'-0"

GENERAL SHEET NOTES

A. GRADE ELEVATIONS AND EXISTING FLOOR/ROOF ELEVATIONS FOR STAIRS INDICATED ON THESE PLANS ARE APPROXIMATE. CONTRACTOR SHALL OBTAIN A SURVEY TO LOCATE SPOT ELEVATIONS AND EXISTING BUILDING FLOOR AND ROOF ELEVATIONS,PRIOR TO STAIR DESIGN AND/OR STARTING CONSTRUCTION.

B. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING PUBLIC AND/OR PRIVATE UTILITY LOCATING SERVICES PRIOR TO STARTING CONSTRUCTION, AND TO DETERMINE AND FIELD VERIFY LOCATIONS.

C. ANY DISCREPANCIES OR CONFLICTS WHICH BECOME APPARENT BEFORE OR DURING CONSTRUCTION, SHALL BE BROUGHT TO THE ATTENTION COR, PRIOR TO CONSTRUCTION SO THAT REDESIGN OR CLARIFICATION MAY OCCUR, WITHOUT ANY CHANGE TO THE CONTRACT.

D. EXTERIOR HANDRAILS/GUARDRAILS/FENCE/GATES ARE TO BE PAINTED BLACK, TO MATCH EXISTING VA FACILITY STANDARD.

E. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTING EXISTING STRUCTURE AND FOUNDATIONS, DURING CONSTRUCTION. SEE SPECIFICATIONS FOR MORE INFORMATION.

F. ANY UTILITIES SHUTDOWN OR AREA CLOSURES ARE TO BE COORDINATED WITH COR.

G. INSTALL NOSING AT ALL EXTERIOR STAIR TREADS

H. NUMBERED AREAS ARE NOT SEQUENTIAL, THEY FOLLOW THE PHASED WORK.

PARTITION GRAPHICS


PARTITION PHASING

- EXISTING ELEMENT TO REMAIN
- EXISTING ELEMENT TO BE DEMOLISHED
- TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

- NO RATING
- SMOKE RESISTIVE PARTITION - NON RATED
- 1 HOUR FIRE BARRIER
- 1 HOUR FIRE/SMOKE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN

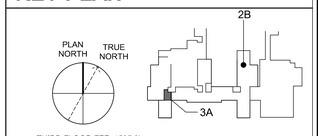

THIRD FLOOR FFE: 1505.0'

SECOND FLOOR FFE: 1493.0'

FIRST FLOOR FFE: 1479.0'

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.
JONATHAN M. OLIVER REGISTERED ARCHITECT 17108 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE CHARLOTTE, NC 28227
P 704.814.1320 F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: ENLARGED STAIR PLANS - EAST

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: RENOVATE MED SURGE WARDS

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: DW

Project Number: 564-17-140

Building Number: 1

Drawing Number: AE451

Sheet 60 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

BIM 360://18002 Fayetteville AR Renovate Med Surge Ward/18002 ARCH 2020.rvt

GENERAL SHEET NOTES

A. GRADE ELEVATIONS AND EXISTING FLOOR/ROOF ELEVATIONS FOR STAIRS INDICATED ON THESE PLANS ARE APPROXIMATE. CONTRACTOR SHALL OBTAIN A SURVEY TO LOCATE SPOT ELEVATIONS AND EXISTING BUILDING FLOOR AND ROOF ELEVATIONS,PRIOR TO STAIR DESIGN AND/OR STARTING CONSTRUCTION.

B. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING PUBLIC AND/OR PRIVATE UTILITY LOCATING SERVICES PRIOR TO STARTING CONSTRUCTION, AND TO DETERMINE AND FIELD VERIFY LOCATIONS.

C. ANY DISCREPANCIES OR CONFLICTS WHICH BECOME APPARENT BEFORE OR DURING CONSTRUCTION, SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER OF RECORD OR COR, PRIOR TO CONSTRUCTION SO THAT REDESIGN OR CLARIFICATION MAY OCCUR, WITHOUT ANY CHANGE TO THE CONTRACT.


D. SCHEDULED LIGHT, SEE ELECTRICAL SHEETS FOR LIGHT SCHEDULE AND LOCATION EG001 AND EL SERIES FOR INFORMATION.

E. FOR WINDOW AND LOUVER TYPE SIZES AND INFORMATION, SEE SHEET AE602.

F. EXTERIOR HANDRAILS/GUARDRAILS/FENCE/GATES ARE TO BE PAINTED BLACK, TO MATCH EXISTING VA FACILITY STANDARD.

SHEET KEYNOTES


02.50 PORTION OF EXISTING WALL ASSEMBLY TO BE CHANGED TO 1-HOUR FIRE-RATED ASSEMBLY.

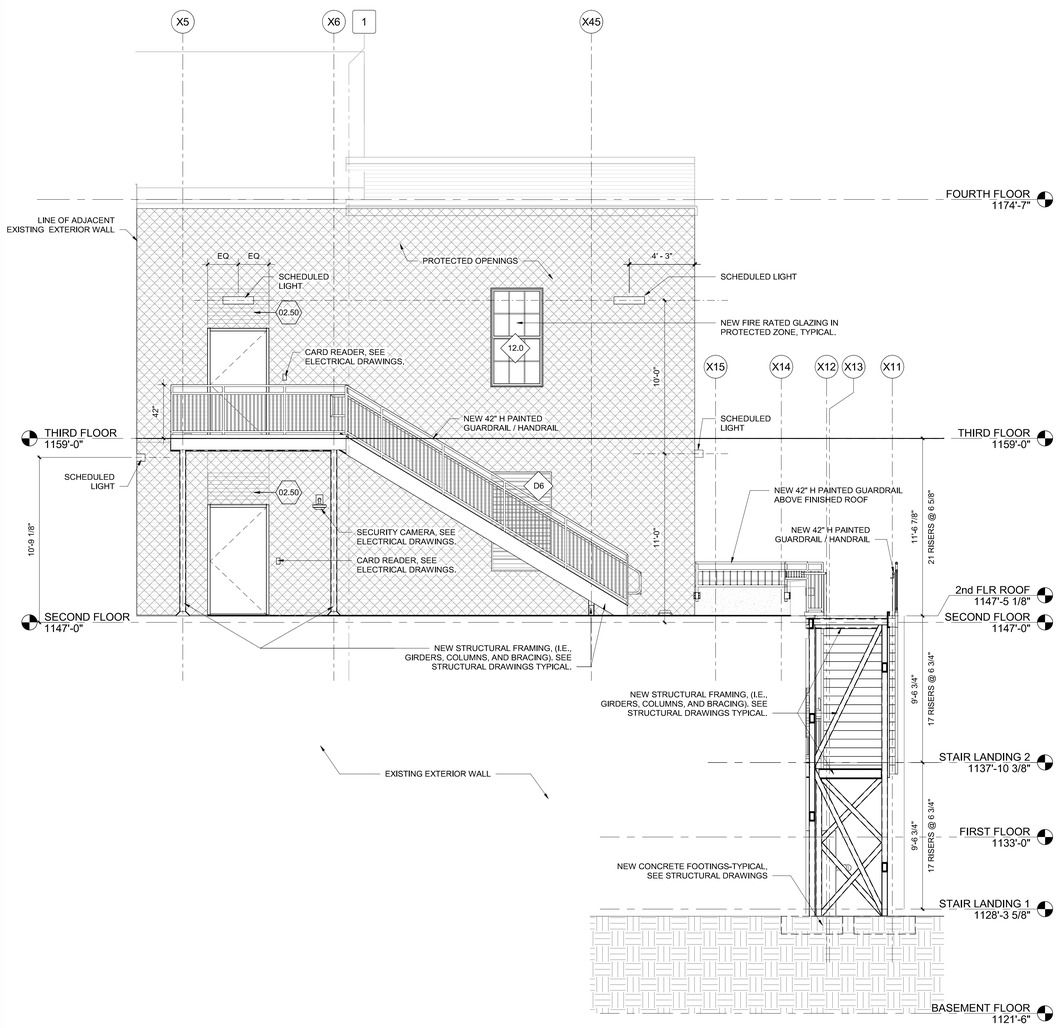

D1 EAST EXTERIOR FIRE STAIR - NORTH EAST ELEVATION

1/4" = 1'-0"

0 2' 4' 8'

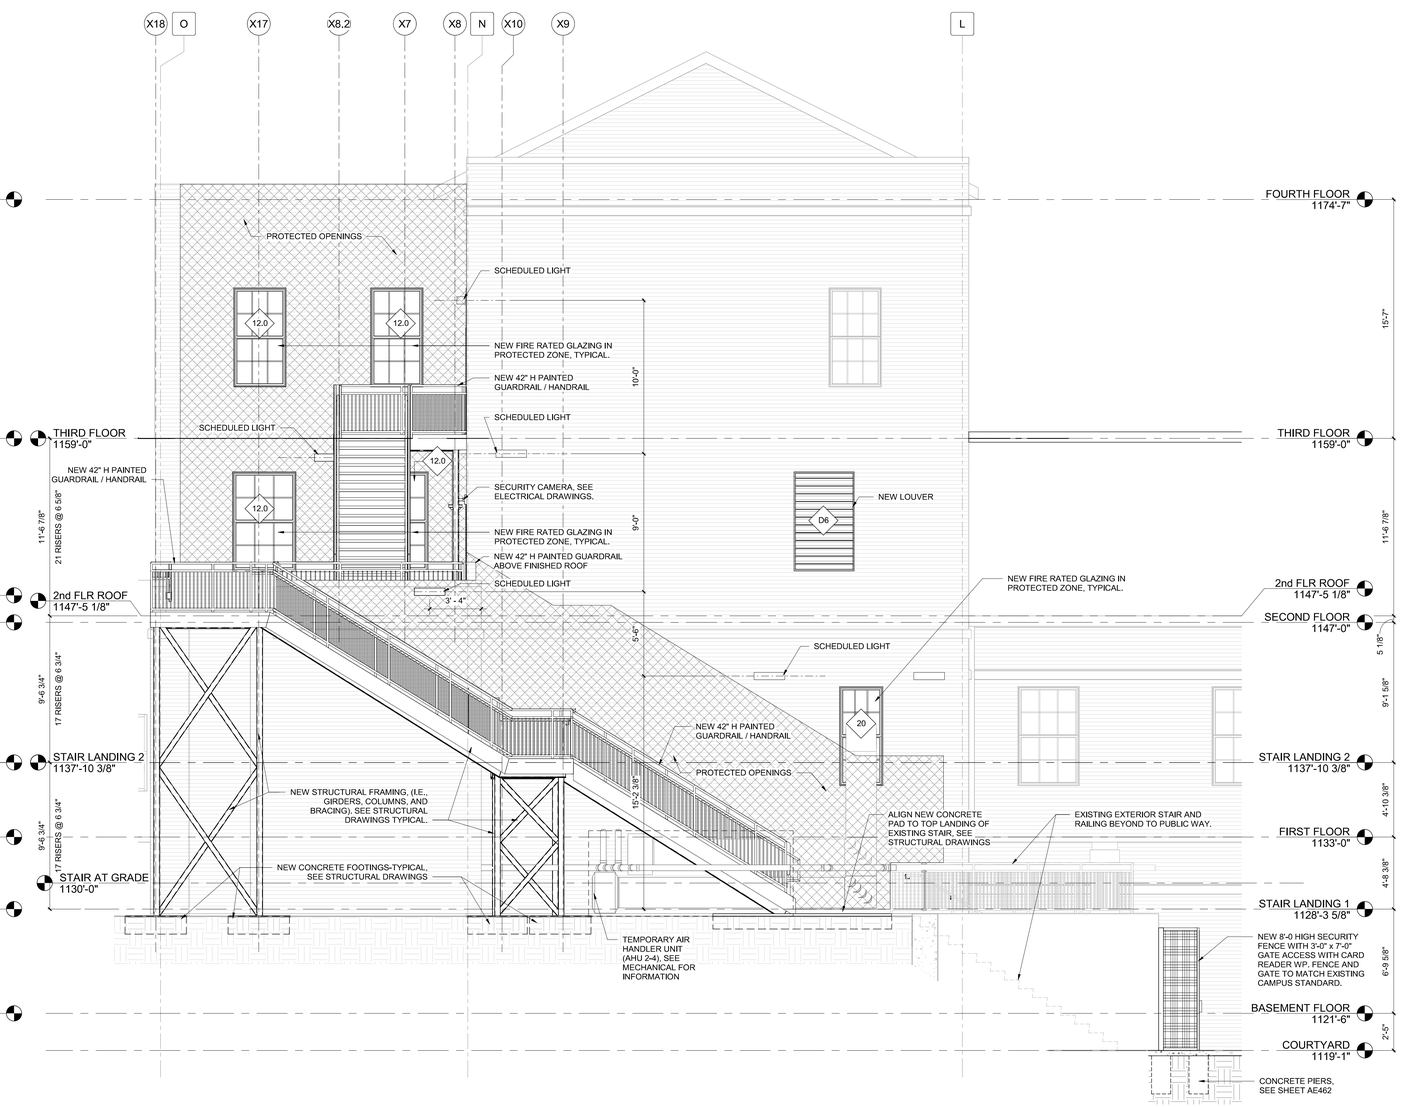

D3 EAST EXTERIOR FIRE STAIR - NORTH WEST ELEVATION

1/4" = 1'-0"

0 2' 4' 8'

Revisions:		
No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC consulting engineers

8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. KOLAR REGISTERED ARCHITECT 11080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •

8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833

HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **EXTERIOR STAIR EAST - ELEVATIONS**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: MS

Project Number: 564-17-140

Building Number: 1

Drawing Number: **AE452**


Sheet 61 of 162

Engineering Service

VETERANS HEALTH CARE SYSTEM OF THE OZARKS

VA U.S. Department of Veterans Affairs


BIM 360://18002 Fayetteville AR Renovate Med Surge Ward/18002 ARCH 2020.rvt

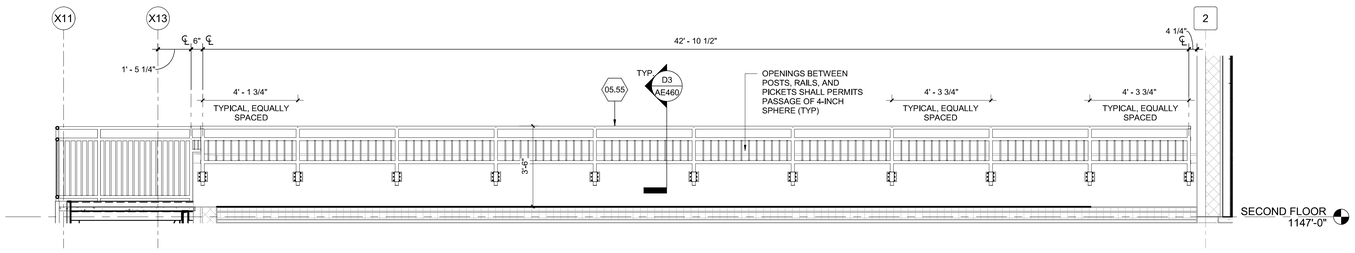

A3 EXTERIOR STAIR EAST FASCIA MOUNTED RAIL EAST

3/8" = 1'-0"


0 2' 4'

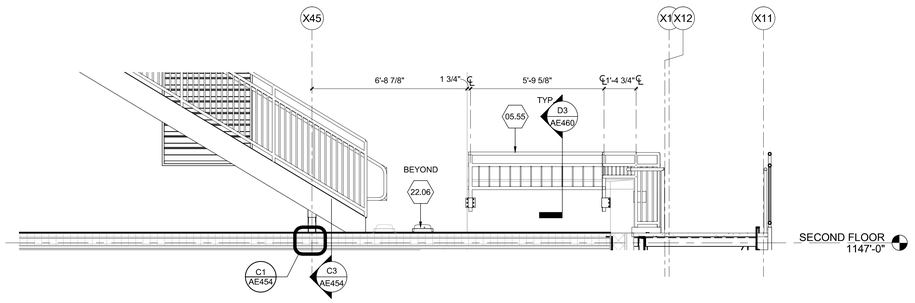

B2 EXTERIOR STAIR EAST FASCIA MOUNTED RAIL WEST

3/8" = 1'-0"

0 2' 4'

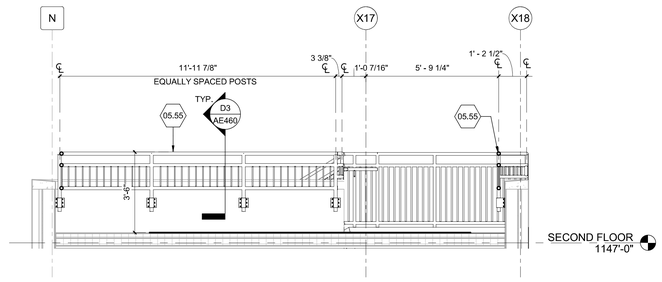

B5 EXTERIOR STAIR EAST FASCIA MOUNTED RAIL NORTH

3/8" = 1'-0"

0 2' 4'

SHEET KEYNOTES

05.55 NEW FASCIA MOUNTED PARAPET RAILING 42" ABOVE FINISHED ROOF TYP.

22.06 USE NEW ROOF DRAIN AND ROOF LEADER CONNECTING TO EXISTING PIPING, SEE PLUMBING DRAWINGS FOR INFORMATION. GC SHALL MAINTAIN ROOF SLOPE TO DRAINS.

PARTITION GRAPHICS

PARTITION PHASING

- EXISTING ELEMENT TO REMAIN
- EXISTING ELEMENT TO BE DEMOLISHED
- TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

- NO RATING
- SMOKE RESISTIVE PARTITION - NON RATED
- 1 HOUR FIRE BARRIER
- 1 HOUR FIRE/SMOKE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/ SMOKE BARRIER

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC consulting engineers

8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. CLARK REGISTERED ARCHITECT 311080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •

8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833

HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **EXTERIOR STAIR PARAPET RAILING ELEVATIONS - EAST**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: DW


Project Number: 564-17-140

Building Number: 1

Drawing Number: **AE453**


Sheet 62 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

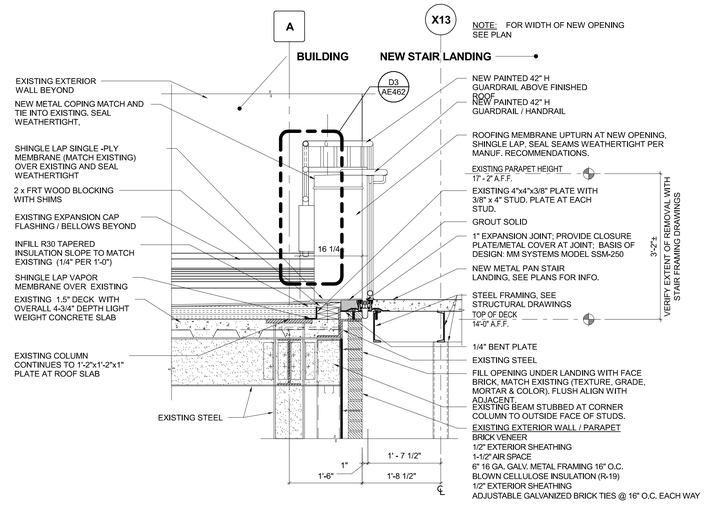


A1 SECTION AT EAST ROOF - STAIR LANDING WEST

3/4" = 1'-0"

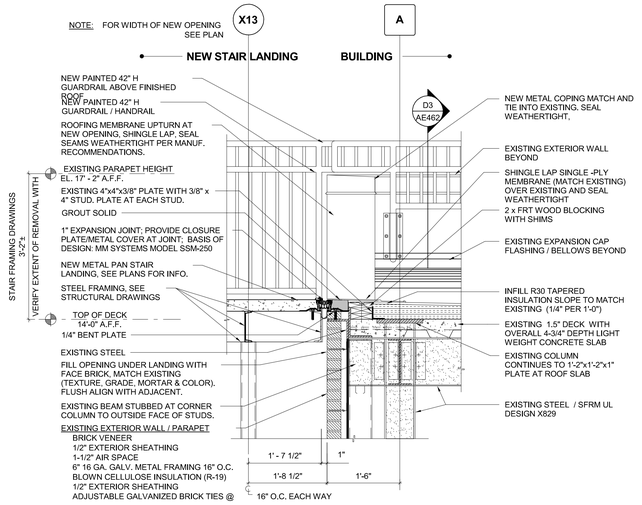

A3 SECTION AT EAST ROOF - STAIR LANDING EAST


3/4" = 1'-0"

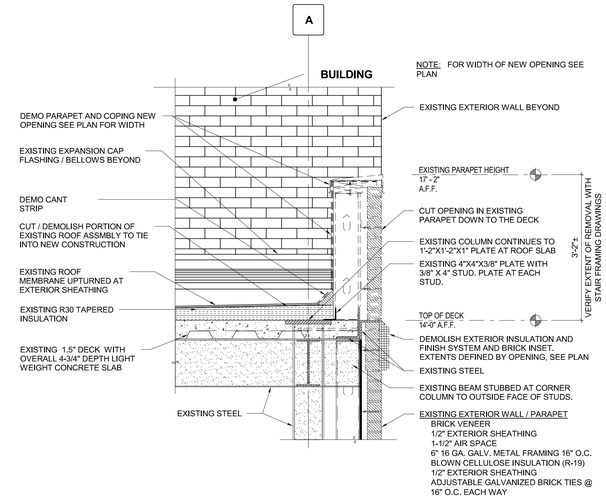

A5 SECTION AT EAST ROOF- PARAPET DEMOLITION


3/4" = 1'-0"

NOTES:
1. PRIME ALL NON POROUS SURFACES WITH FLASHING PRIMER.
2. OVERLAP NEW AND EXISTING ROOFING MIN. 8".
3. WOOD NAILERS MUST BE INSTALLED WITH SUITABLE FASTENERS TO MEET APPLICABLE BUILDING CODES (200 LBS PER LINEAR FOOT MIN IN ANY GIVEN DIRECTION).

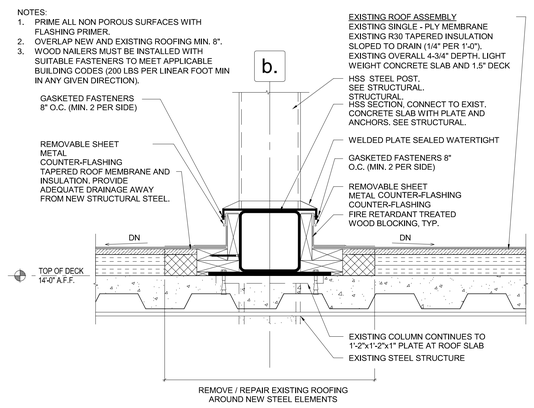


C1 ROOF & STAIR DETAIL 1

1 1/2" = 1'-0"

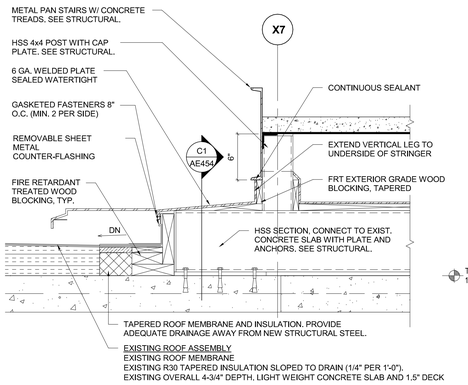


C3 ROOF & STAIR DETAIL 2

1 1/2" = 1'-0"

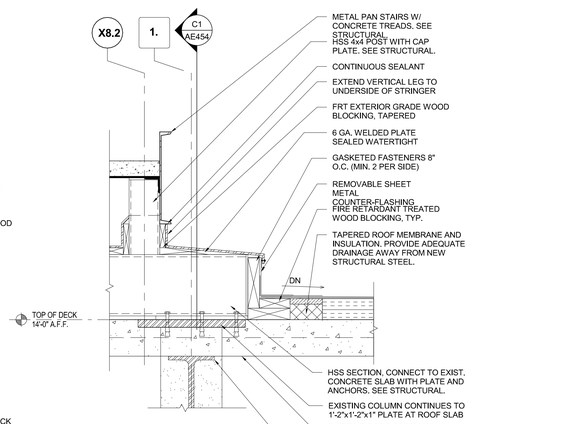

C4 ROOF & STAIR DETAIL 3

1 1/2" = 1'-0"

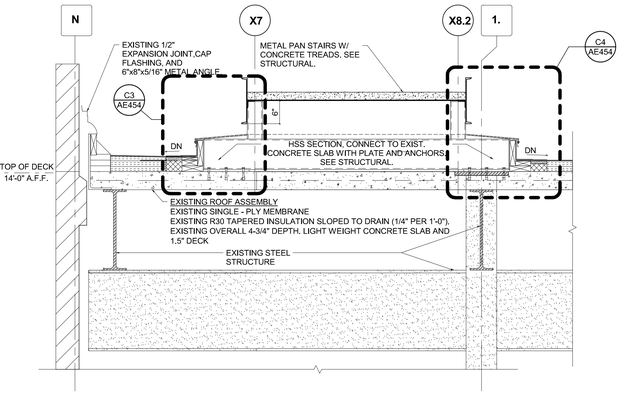


C5 BEAM TO DECK FLASHING AT SECOND ROOF

3/4" = 1'-0"


D1 JAMB DETAIL AT THIRD FLOOR - TYP.

1 1/2" = 1'-0"

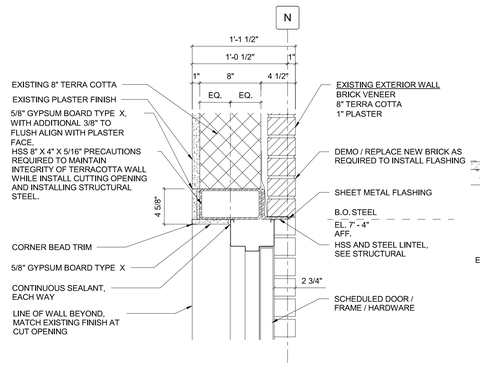


D2 HEAD AT DETAIL THIRD FLOOR - TYP.

1 1/2" = 1'-0"

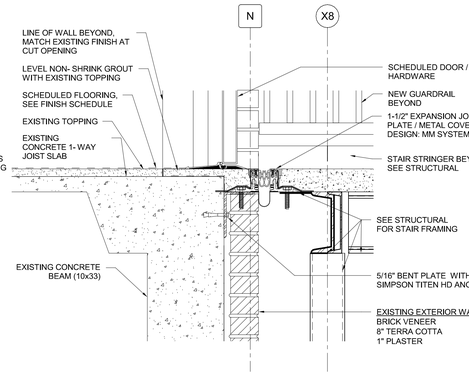


D3 SILL DETAIL AT THIRD FLOOR - TYP.

1 1/2" = 1'-0"

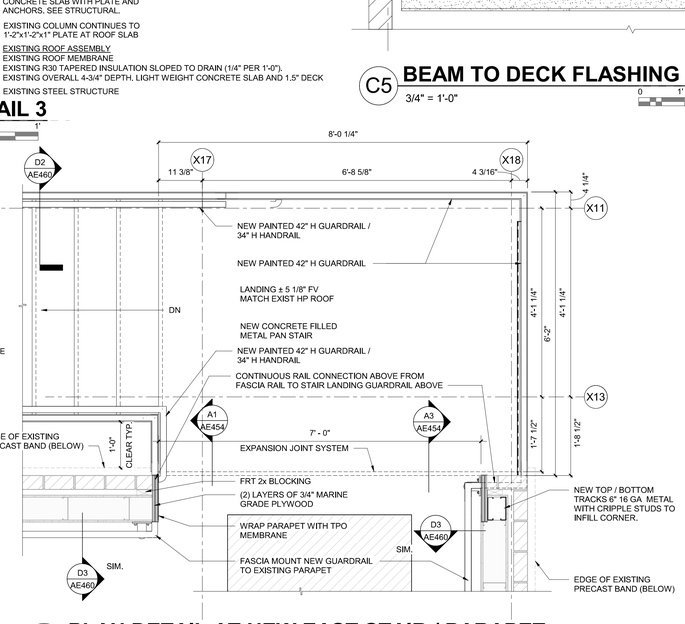

D4 PLAN DETAIL AT NEW EAST STAIR / PARAPET

3/4" = 1'-0"

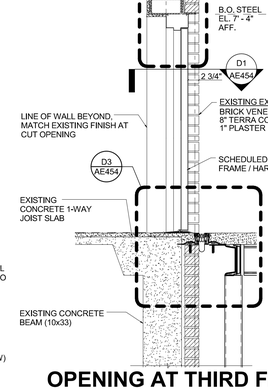

D6 OPENING AT THIRD FLOOR LANDING - TYPICAL

3/4" = 1'-0"

Revisions:		
No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES PLLC
consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.
JONATHAN M. CARR — REGISTERED PROFESSIONAL ENGINEER — 031080 — CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **SECTION DETAIL AT EAST STAIR**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: DW


Project Number: 564-17-140

Building Number: 1

Drawing Number: **AE454**

Sheet 63 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

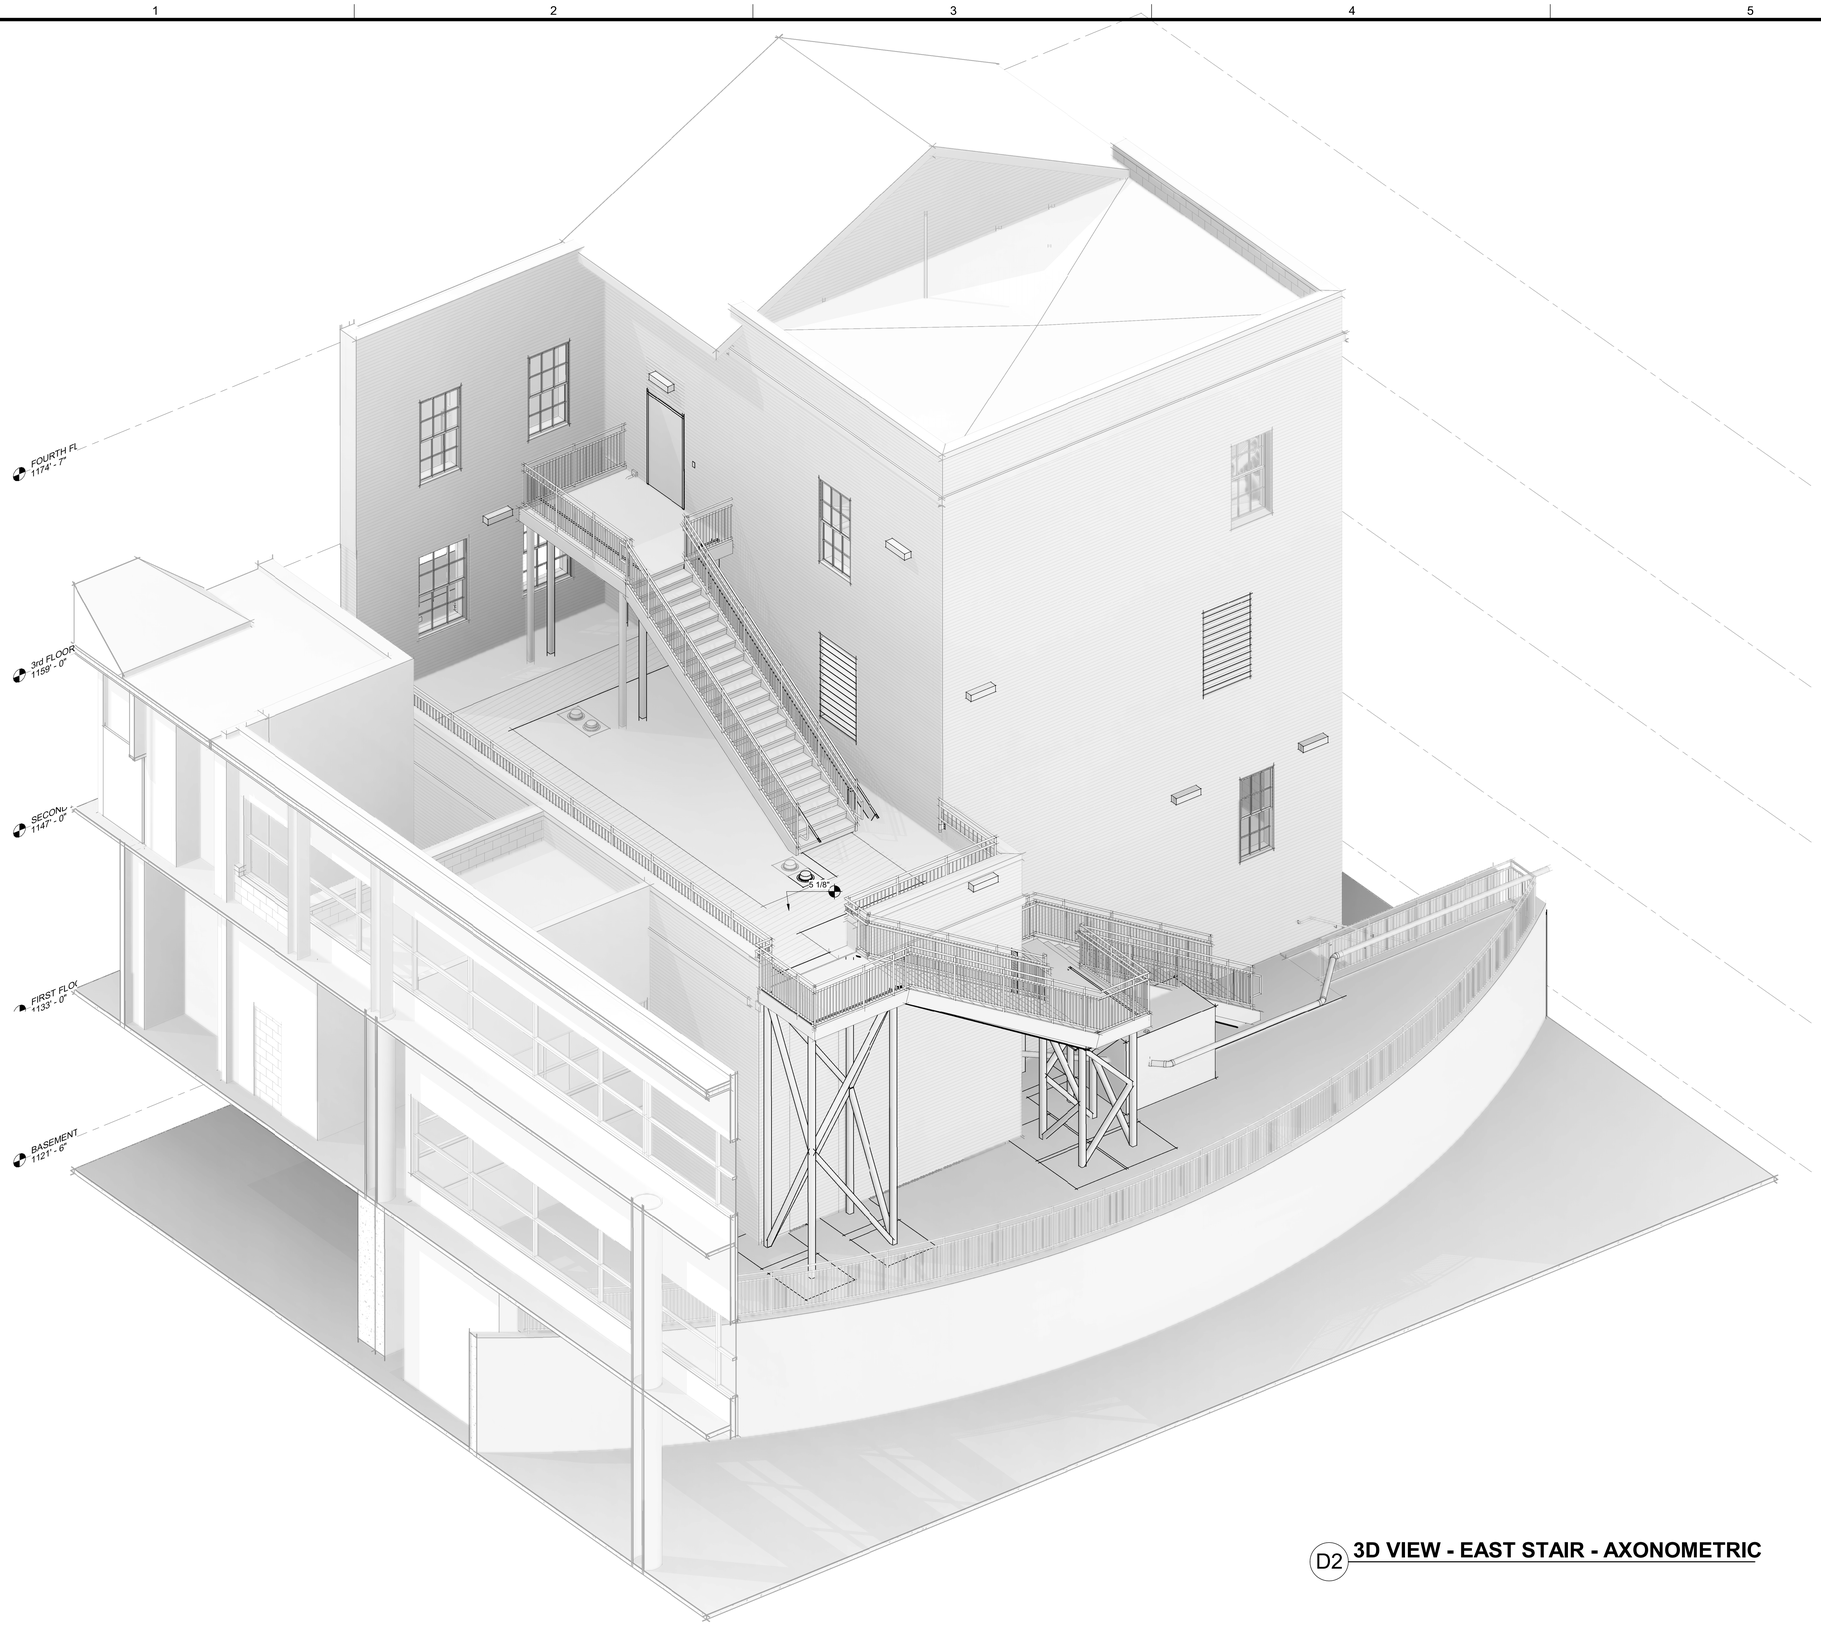

D2 **3D VIEW - EAST STAIR - AXONOMETRIC**

GENERAL SHEET NOTES

SHEET KEYNOTES

PARTITION GRAPHICS


PARTITION PHASING

- EXISTING ELEMENT TO REMAIN
- EXISTING ELEMENT TO BE DEMOLISHED
- TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

- NO RATING
- SMOKE RESISTIVE PARTITION - NON RATED
- 1 HOUR FIRE BARRIER
- 1 HOUR FIRE/SMOKE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN



THIRD FLOOR FFE: 1505.0'

SECOND FLOOR FFE: 1493.0'

FIRST FLOOR FFE: 1479.0'

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES, INC. consulting engineers

8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. CLARK — REGISTERED ARCHITECT — 11080 — CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •

8016 TOWER POINT DRIVE
CHARLOTTE, NC 28227

P 704.814.1320
F 704.321.0833

HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **3D VIEW - FIRE STAIR - EAST**

Project Phase: BIDNEW STAIR MODIFICATION

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: DW

Project Number: 564-17-140

Building Number: 1

Drawing Number: **AE455**


Sheet 64 of 162

Engineering Service

VETERANS HEALTH CARE SYSTEM OF THE OZARKS

VA U.S. Department of Veterans Affairs

BIM 360://18002 Fayetteville AR Renovate Med Surge Ward/18002 ARCH 2020.rvt

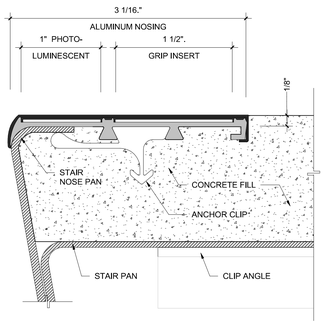


PHOTOLUMINSCENT STAIR NOSING
BOD: SAFE T NOSE STNC3, (855) 723-6673

1. BLACK POWDER COATED ALUMINUM
2. BLACK TRACTION ANTI SLIP
3. INSTALL THIS NOSING ON ALL EXTERIOR STAIR TREADS


A1 STAIR NOSING - TYPICAL

1 2" = 1'-0"

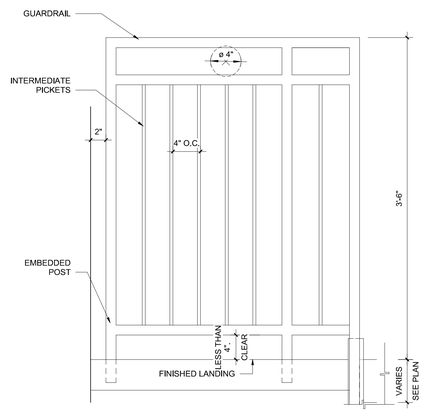


A2 GUARDRAIL DETAIL @ TOP LANDING

1 1 1/2" = 1'-0"

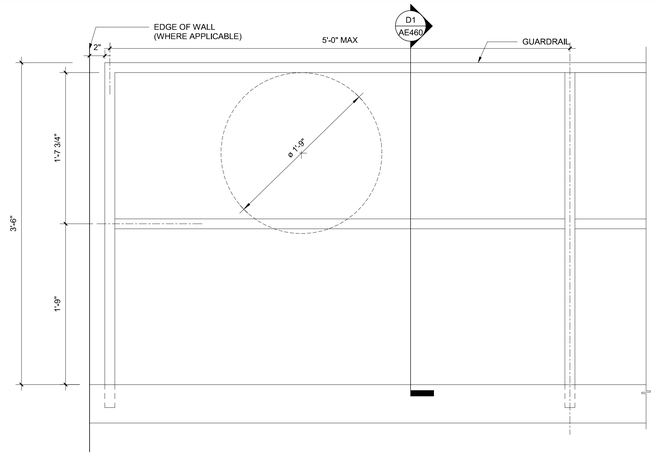


A3 GUARDRAIL ELEVATION @ MECH ROOM

1 1 1/2" = 1'-0"

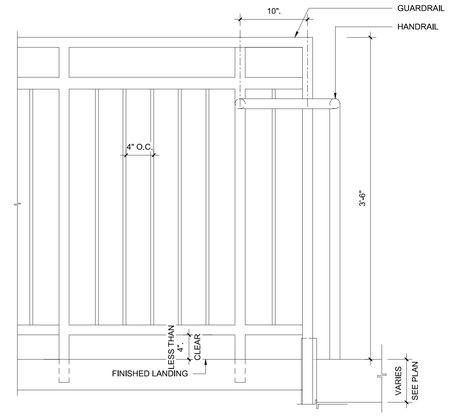

A6 GUARDRAIL DETAIL @ TOP LANDING

1 1 1/2" = 1'-0"

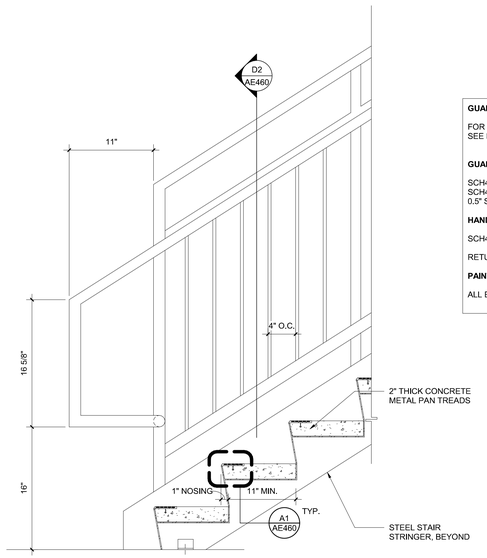

C3 LANDING BOTTOM HANDRAIL EXTENSION

1 1 1/2" = 1'-0"

GUARDRAIL/HANDRAIL DATA:

FOR RAILING (GUARDRAIL / HANDRAIL) FINISH INFORMATION, SEE EXTERIOR FINISH LEGEND ON SHEET AF601.

GUARD RAILS:

SCH40 1.5" OD PIPE TOP AND BOTTOM RAILS
SCH40 1.5" OD PIPE POSTS @ 48" O.C. MAX
0.5" SQ. PICKETS @ 4" O.C. MAX.


HANDRAILS:

SCH40 1.5" OD PIPE

RETURN ALL HANDRAILS TO WALL / RAILINGS AT END

PAINT:

ALL EXTERIOR STEEL IS POWDER-COAT PAINTED BLACK.

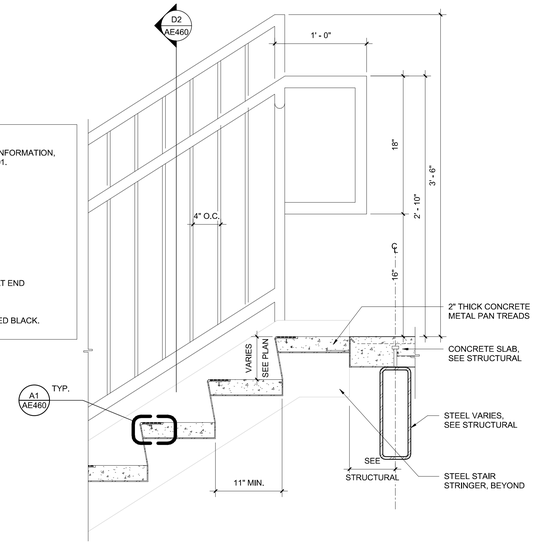

C6 LANDING TOP HANDRAIL EXTENSION


1 1 1/2" = 1'-0"

D1 GUARDRAIL DETAIL IN MECH ROOM

3" = 1'-0"


D2 HANDRAIL - GUARDRAIL DETAIL

3" = 1'-0"

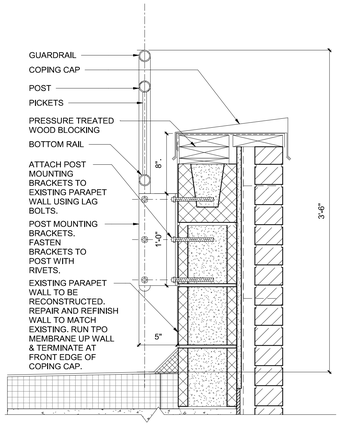

D3 RAILING MOUNTING DETAIL


1 1 1/2" = 1'-0"



PER SECTION 05 51 00, ALL STAIR SUPPORT MEMBER SIZES, CONFIGURATION AND CONNECTIONS TO SUPPORTING MEMBERS TO BE ENGINEERED BY STAIR FABRICATOR.


D4 INTERMEDIATE LANDING FRAMING

1 1 1/2" = 1'-0"

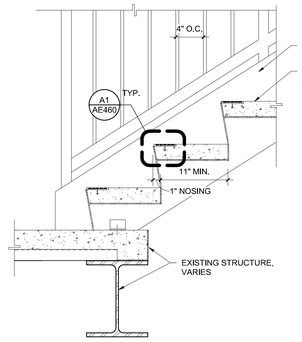

D5 STAIR BASE ANCHOR (ELEVATED SLAB)

1 1 1/2" = 1'-0"

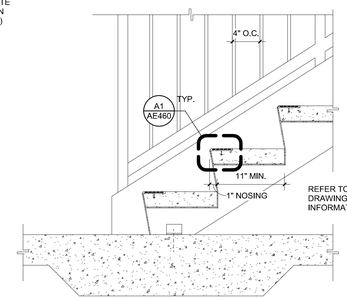

D6 STAIR BASE ANCHOR

1 1 1/2" = 1'-0"

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES, INC. consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.
JONATHAN M. LEWIS — REGISTERED ARCHITECT — 11109 — CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE
CHARLOTTE, NC 28227
P 704.814.1320
F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **STAIR TYPICAL DETAILS**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: DW

Project Number: 564-17-140


Building Number: 1

Drawing Number: **AE460**

Sheet 65 of 162


Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

BIM 360://18002 Fayetteville AR Renovate Med Surge Ward/18002 ARCH 2020.rvt

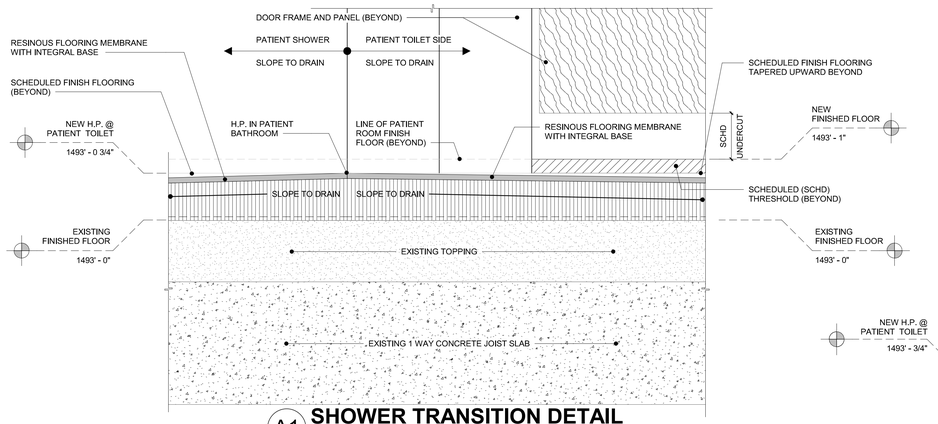


A1 SHOWER TRANSITION DETAIL

12" = 1'-0"

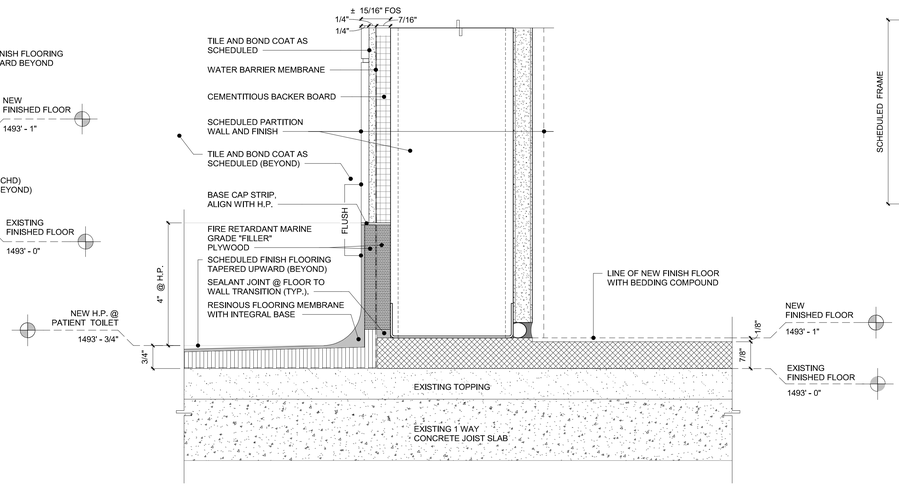


A3 COVE BASE @ NON-SHOWER TILE WALL

6" = 1'-0"

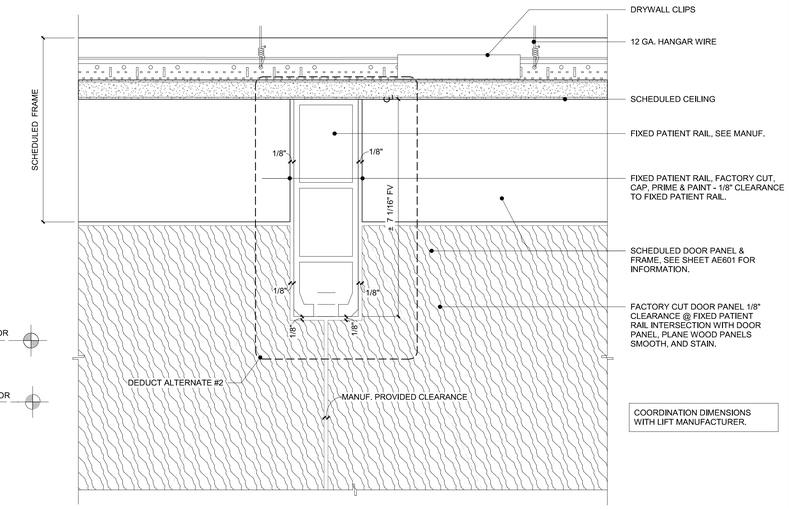


A5 HM DOOR FRAME & WOOD PANEL FACTORY CUT @ FIXED RAIL

6" = 1'-0"

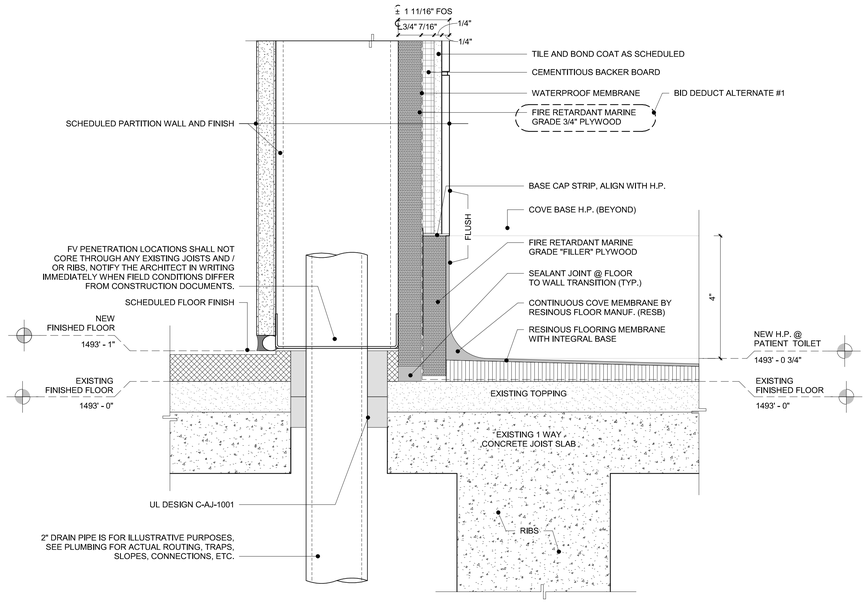


C1 COVE BASE @ SHOWER

6" = 1'-0"

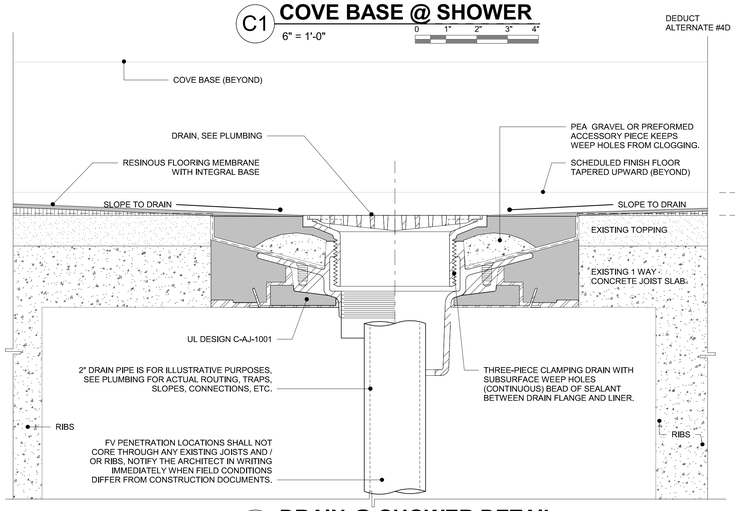

D1 DRAIN @ SHOWER DETAIL

6" = 1'-0"

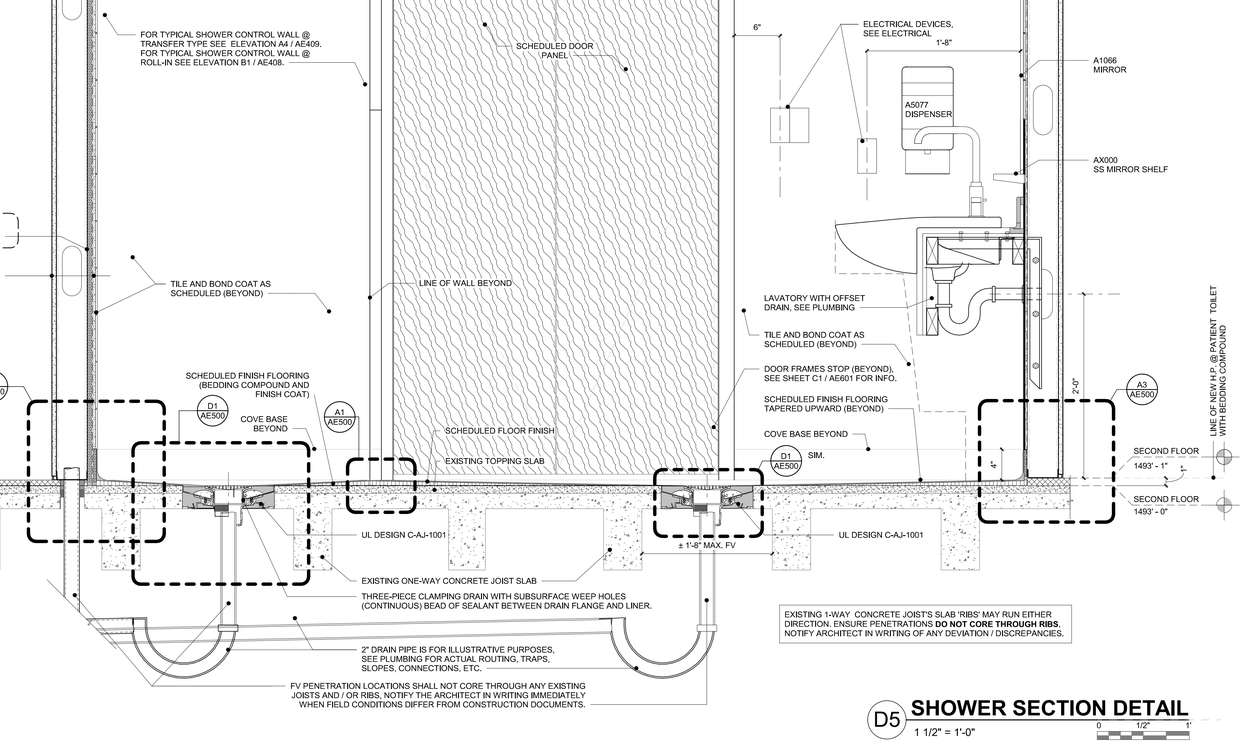

D5 SHOWER SECTION DETAIL

1 1/2" = 1'-0"

GENERAL SHEET NOTES

NOTE: REFER TO ALL PHASING SHEETS. GENERAL CONTRACTOR SHALL ENSURE THAT ALL CONTRACTORS ARE RESPONSIBLE FOR COORDINATION ACROSS ENTIRE SET OF CONSTRUCTION DOCUMENTS.

A. FOR PATIENT BATHROOM / BEDROOM THRESHOLD, SEE DETAIL D1 / AF500.

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC. consulting engineers

8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signatures not valid without Certificate below seal.

JONATHAN M. OAK, REGISTERED ARCHITECT, 31080, CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •

8016 TOWER POINT DRIVE
CHARLOTTE, NC 28227

P 704.814.1320
F 704.321.0833

HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **INTERIOR DETAILS AT PATIENT BATHROOM**

Project Title: **RENOVATE MED SURGE WARDS**

Project Number: 564-17-140

Building Number: 1

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Drawing Number: **AE500**


Sheet 66 of 162

Date: MARCH 24, 2024 | Checked: TR | Drawn: MS

Engineering Service


VETERANS HEALTH CARE SYSTEM OF THE OZARKS

VA U.S. Department of Veterans Affairs

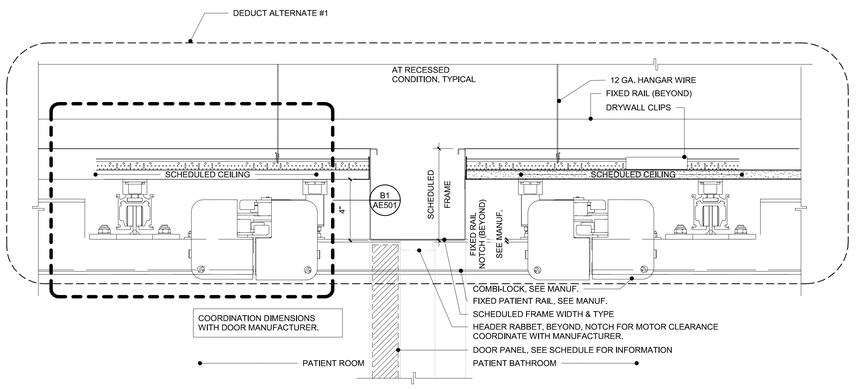


A1 HM DOOR FRAME CROSS SECTION AT PATIENT RAIL

3" = 1'-0"

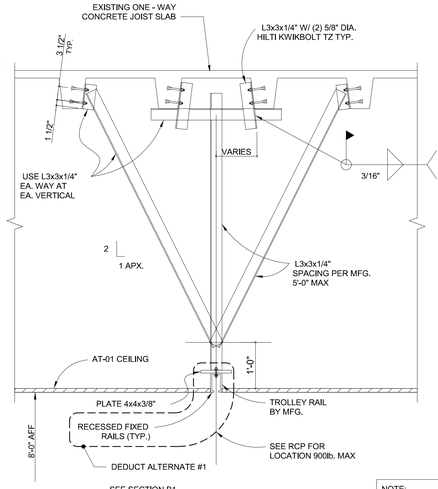

SEE SECTION B1

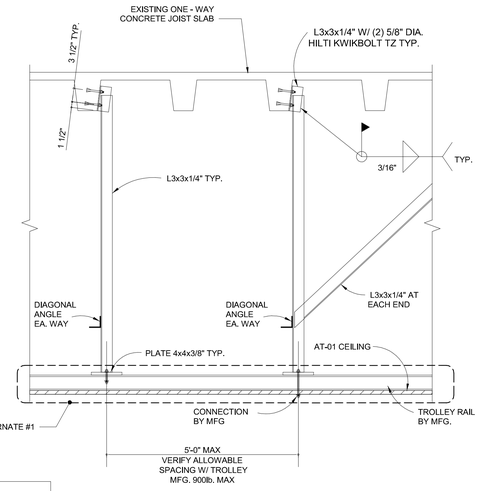

SEE SECTION B1


NOTE:
PATIENT LIFT SUPPORTS ENGINEERED BY 3RD PARTY DESIGN, SEE SPECIFICATION 11 73 00 FOR INFORMATION.

A3 SECTIONS @ PATIENT LIFT SUPPORTS

3/4" = 1'-0"


LIFT SUPPORT NOTES

1. FABRICATION AND DETAILING OF STRUCTURAL STEEL SHALL BE IN ACCORDANCE WITH AISC "CODE OF STANDARD PRACTICE". SUBMIT SHOP DRAWINGS FOR APPROVAL.
2. ALL STRUCTURAL STEEL ANGLES AND PLATES, SHALL BE ASTM A36.
3. ALL THREADED RODS SHALL BE ASTM A36.
4. BOLTS SHALL BE 3/4 INCH A325 STRUCTURAL BOLTS UNLESS NOTED.
5. USE HILTI KWIK BOLT TZ OR EQUAL FOR ANCHORS TO CONCRETE
6. ALL FIELD WELDING MUST BE BY OPERATORS CERTIFIED FOR THE POSITION OF THE WELD TO BE MADE AS REQUIRED BY AWS D1.1. WELDER CERTIFICATIONS SHALL BE SUBMITTED FOR REVIEW BEFORE STARTING ANY WORK. USE E7018 ELECTRODES UNLESS NOTED. RODS MUST BE DRY AT THE TIME OF USE. WELDING PROCEDURES SHOULD BE SUBMITTED FOR APPROVAL IF ANY OTHER TYPE PROCESS OR ROD IS USED.
7. THE ERECTOR IS RESPONSIBLE FOR MEETING THE SAFETY REQUIREMENTS OF THEIR PERSONNEL, AND COMPLYING WITH OSHA AND OWNER SAFETY REQUIREMENTS AT THIS JOBSITE, INCLUDING FIRE PREVENTION, ELECTRICAL CONTACT, FALL PREVENTION, ETC.
8. DIMENSIONS ON PLANS ARE FROM EXISTING BUILDING DRAWINGS. THE ERECTOR MUST FIELD VERIFY ACTUAL DIMENSIONS BEFORE FABRICATION.
9. COORDINATE THE TIME OF WORK WITH THE OWNER.
10. FIREPROOFING MATERIALS, REMOVED TO ALLOW FOR THE INSTALLATION OF SUPPORT FRAMES, MUST BE REPLACED.
11. COORDINATE THE LOCATION & ELEVATION OF THE SUPPORT FRAMES AND MOUNTING PLATES WITH THE EQUIPMENT SUPPLIER.



B1 TRAVERSE TO SINGLE RAIL DETAIL AT RECESS (NON-BARIATRIC)

1 1/2" = 1'-0"





B2 TRAVERSE TO SINGLE RAIL DETAIL AT RECESS (BARIATRIC)

1 1/2" = 1'-0"

C1 GAIT TRACK CROSS SECTION AT PATIENT RAIL

3" = 1'-0"

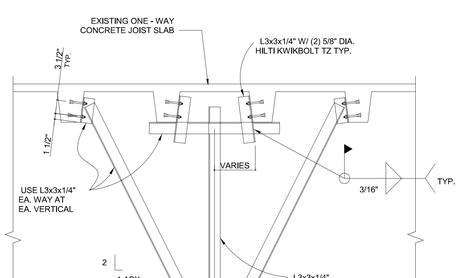


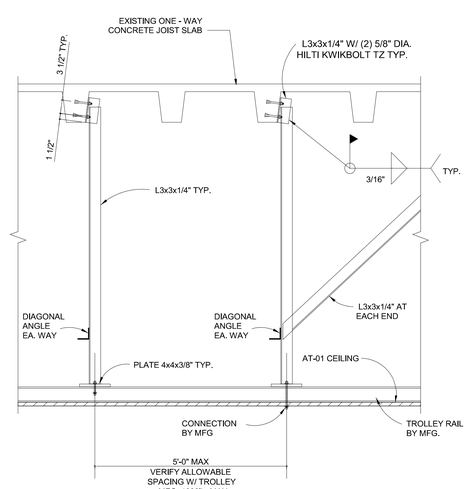

NOTE:
PATIENT LIFT SUPPORTS ENGINEERED BY 3RD PARTY DESIGN, SEE SPECIFICATION 11 73 00 FOR INFORMATION.


C3 SECTIONS @ PATIENT LIFT SUPPORTS - BARIATRIC RATED

3/4" = 1'-0"

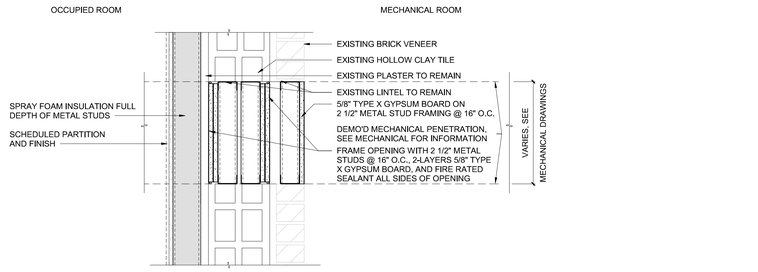


D1 TYPICAL INFILL AT DUCT PENETRATION AT MECHANICAL ROOM

1 1/2" = 1'-0"

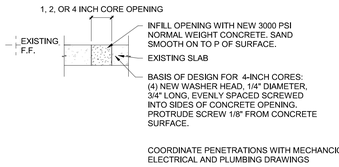


D3 TYPICAL EXISTING FLOOR SLAB PIPE PATCH

1" = 1'-0"

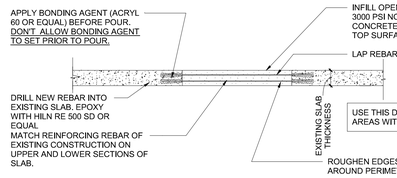

D4 TYPICAL EXISTING FLOOR SLAB PATCH DETAIL 4in. TO 8in. MAX.,

1" = 1'-0"

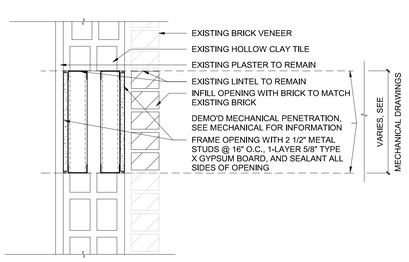


D5 INFILL AT DUCT PENETRATION AT EXISTING EXTERIOR WALL

1 1/2" = 1'-0"

B6 REVEAL DETAIL

3" = 1'-0"

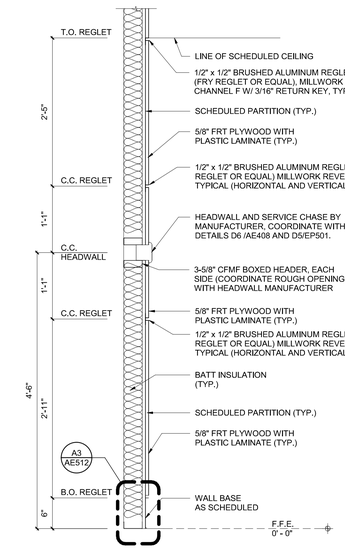

D6 VENEER WITH INTEGRAL REVEAL @ HEADWALL - TYPICAL

1" = 1'-0"

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC
consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.
JONATHAN M. OAKES REGISTERED ARCHITECT 15080 NORTH CAROLINA CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **MISCELLANEOUS DETAILS**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: TR | Drawn: MS


Project Number: 564-17-140


Building Number: 1

Drawing Number: **AE501**

Sheet 67 of 162


Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

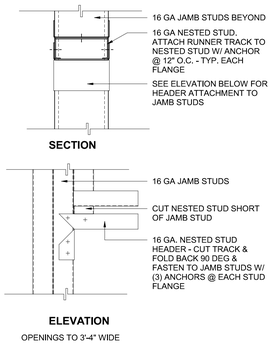


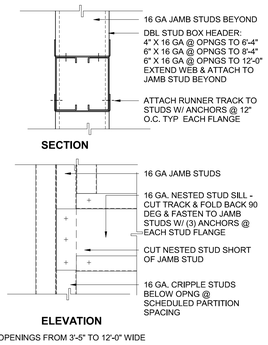

A1 HEADER FRAMING AT STUD PARTITION OPENINGS


3" = 1'-0"

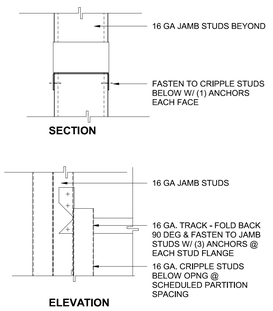

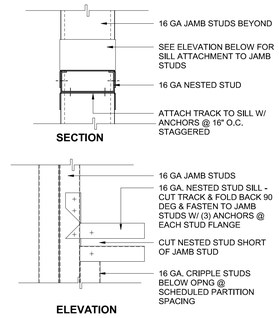


A3 SILL FRAMING AT STUD PARTITION OPENINGS

3" = 1'-0"

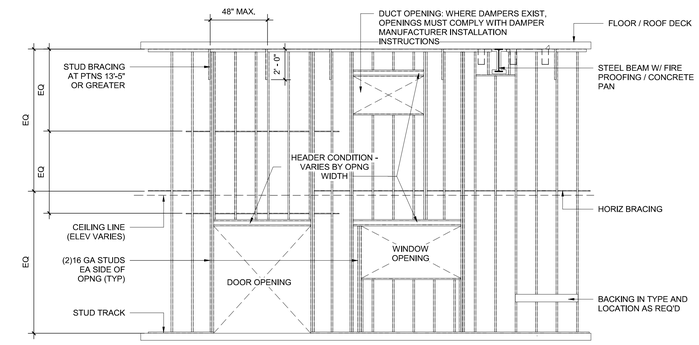


A5 TYPICAL PARTITION FRAMING

1/4" = 1'-0"

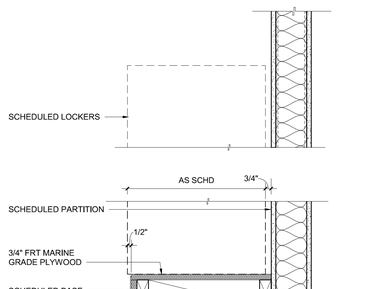


B1 LOCKER BASE - TYPICAL

1 1/2" = 1'-0"

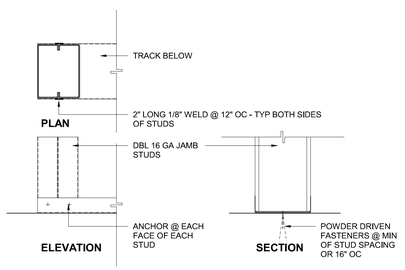


B2 JAMB AND TRACK SECTIONS

3" = 1'-0"

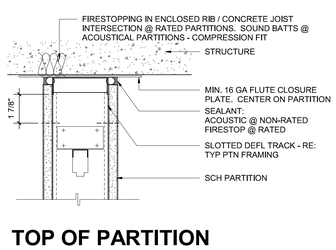


B3 TOP OF PARTITION PARALLEL TO FLUTES / PANS - DECK

3" = 1'-0"

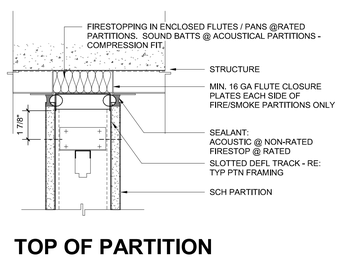


B4 TOP OF PARTITION ACROSS FLUTES / PANS - STEEL DECK

3" = 1'-0"

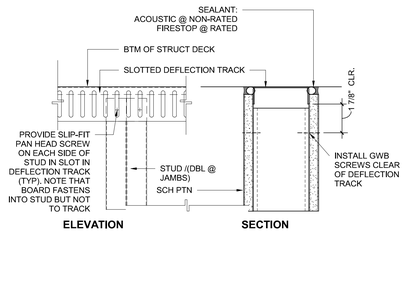


B5 DEFLECTION TRK STUD ANCHORAGE

3" = 1'-0"

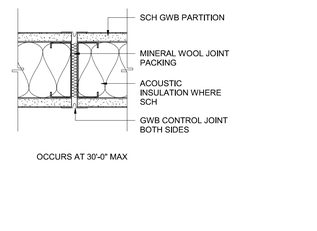


B6 GWB CONTROL JOINT

3" = 1'-0"

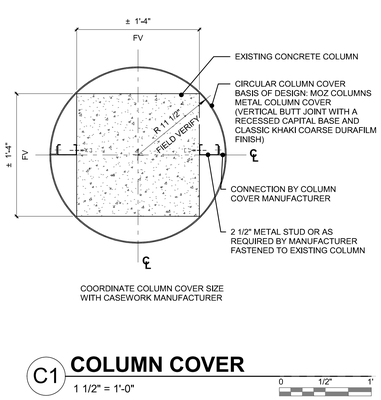


C1 COLUMN COVER


1 1/2" = 1'-0"

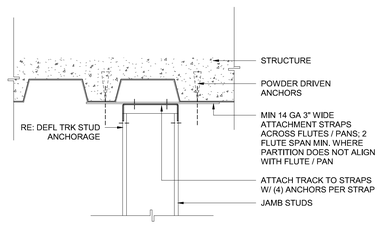

C2 JAMB STUD ANCHORAGE AT DECK


3" = 1'-0"

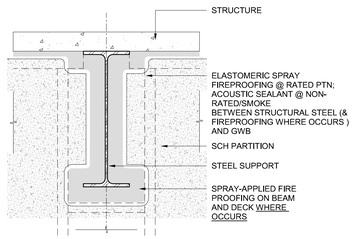


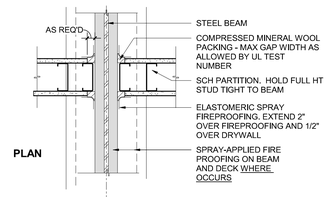


C3 RATED PTN AT INTERSECTING BEAM

1 1/2" = 1'-0"

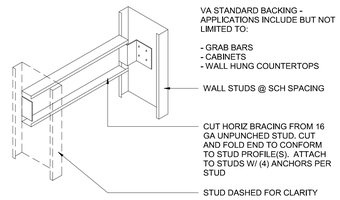

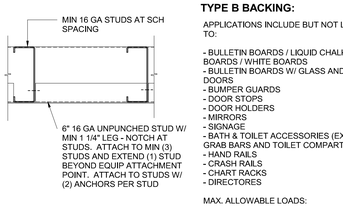

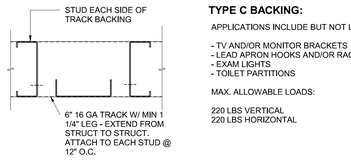


C4 WALL BACKING TYPES

3" = 1'-0"


C5 BASE OF STUD PARTITION

3" = 1'-0"




D5.2 BRACED FULL HEIGHT PARTITION


3/4" = 1'-0"

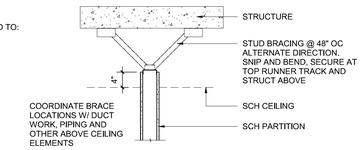


D5 BRACED PARTIAL HEIGHT PARTITION

3/4" = 1'-0"

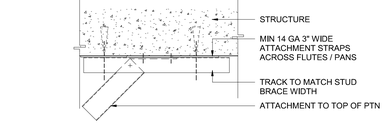


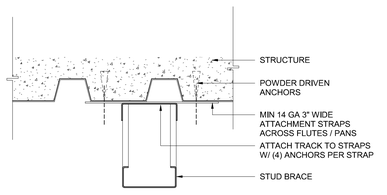

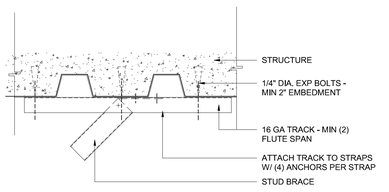


D6 STUD BRACE AT DECK

3" = 1'-0"



D1 SOLID SURFACE EDGE TERMINATION - TYPICAL

3" = 1'-0"



D2 J-BOXES IN ACOUSTIC PTNS

3" = 1'-0"

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.
JONATHAN E. CARR REGISTERED PROFESSIONAL ENGINEER 21099 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **INTERIOR DETAILS**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: TR | Drawn: MS


Project Number: 564-17-140

Building Number: 1

Drawing Number: **AE511**


Sheet 68 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

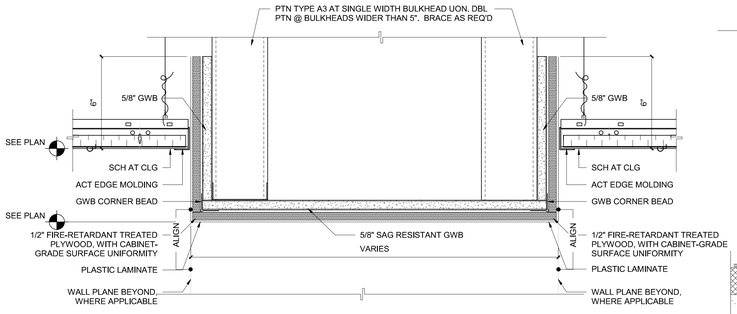


A1 ACT TO ACT WITH PLAM DROP SOFFIT

3" = 1'-0"

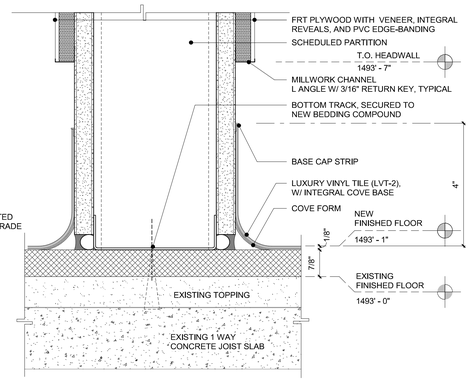


A3 WALL BASE @ HEADWALL - TYPICAL

6" = 1'-0"

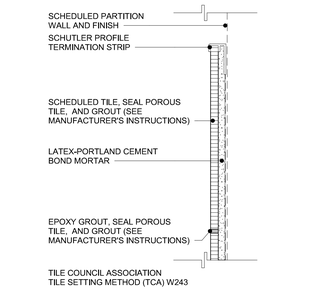


A4 TILE TERMINATION CAP / EDGE - TYPICAL

6" = 1'-0"

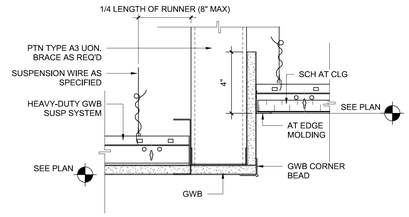


A5 GWB TO AT BULKHEAD

3" = 1'-0"

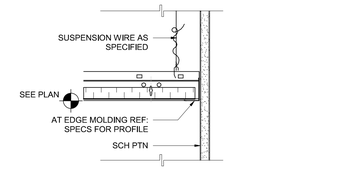


A6 ACT CLG @ WALL - TYP

3" = 1'-0"

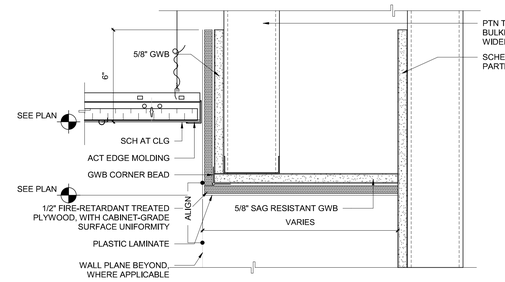


B1 ACT TO PLAM DROP SOFFIT AT WALL TERMINATION

3" = 1'-0"

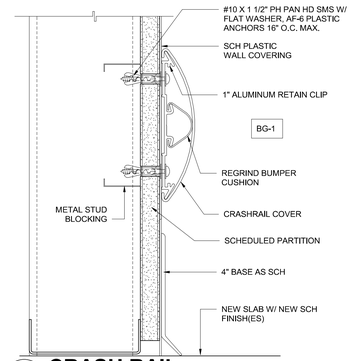


B4 CRASH RAIL

6" = 1'-0"

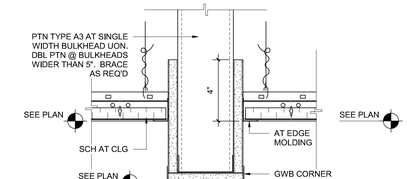


B5 ACT TO ACT BULKHEAD

3" = 1'-0"

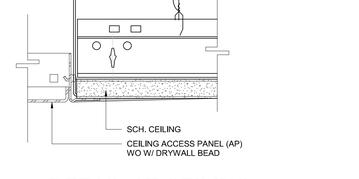


B6 DETAIL AT CEILING ACCESS PANEL (WALL SIM)

6" = 1'-0"

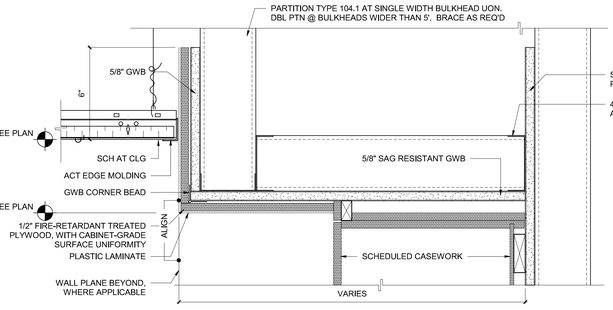


C1 ACT TO PLAM DROP SOFFIT GWB TRANSITION AT WALL TERMINATION

3" = 1'-0"

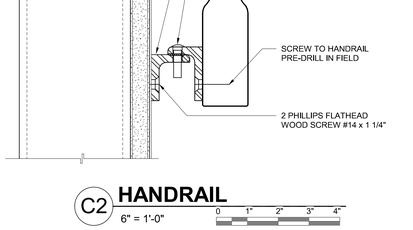


C2 HANDRAIL

6" = 1'-0"

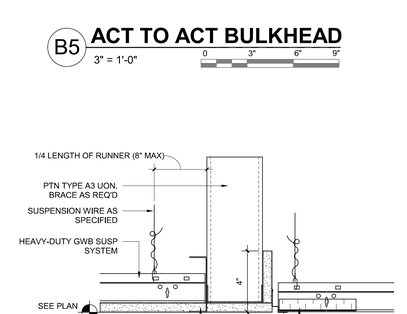


FLUSH AT TO GWB TRANSITION

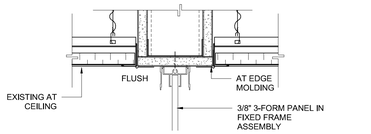


C4 ACT TO AT FLUSH - 3-FORM HEAD

3" = 1'-0"

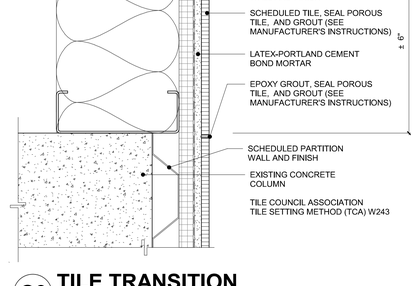


C6 TILE TRANSITION

6" = 1'-0"

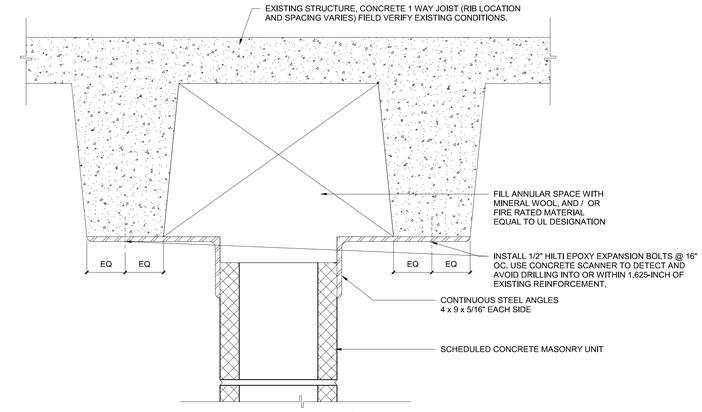


D1 CMU LATERAL BRACING DETAIL

3" = 1'-0"

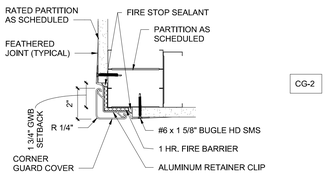


D3 CORNER GUARD

3" = 1'-0"

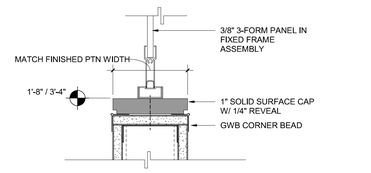


D4 3-FORM SILL DETAIL

3" = 1'-0"

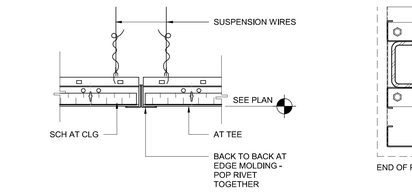

D5 CHANGE OF GRID ALIGNMENT IN AT CLG

3" = 1'-0"

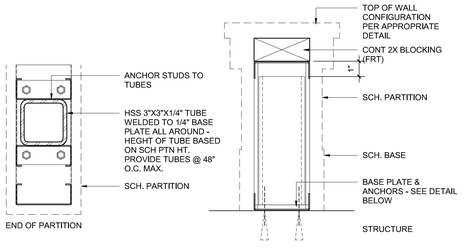

D6 STRUCTURE FOR PARTIAL HGT PARTITIONS

3" = 1'-0"

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC. consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.
JONATHAN M. COYNE REGISTERED ARCHITECT 110080 NORTH CAROLINA CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE CHARLOTTE, NC 28227
P 704.814.1320
F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **INTERIOR DETAILS**

Project Title: **RENOVATE MED SURGE WARDS**

Project Number: 564-17-140

Building Number: 1

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: TR | Drawn: MS


Drawing Number: **AE512** Sheet 69 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

GENERAL SHEET NOTES


A. CONTRACTOR TO FIELD VERIFY MEASUREMENTS, BEFORE FABRICATING ANY MILLWORK / COUNTERTOPS AND BRING ANY DISCREPANCIES TO THE ATTENTION OF THE ARCHITECT IN WRITING.
B. FOR TYPICAL NOTES, SEE SHEET AI001 FOR INFORMATION.

NOTE: STATION WILL FURNISH TEAMWORK FURNISHINGS THROUGH ACTIVATION.

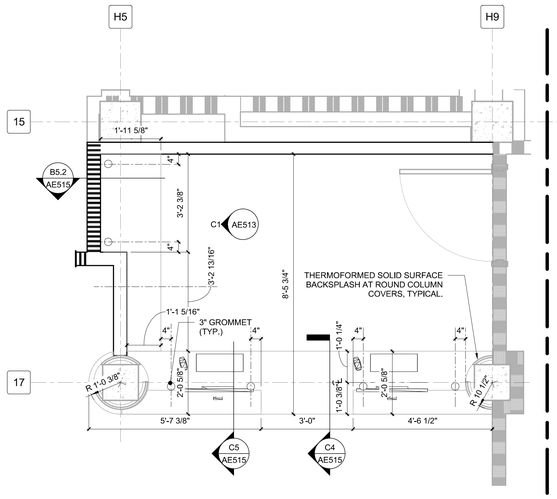


A1 MILLWORK @ CONCIERGE - PLAN

1/2" = 1'-0"

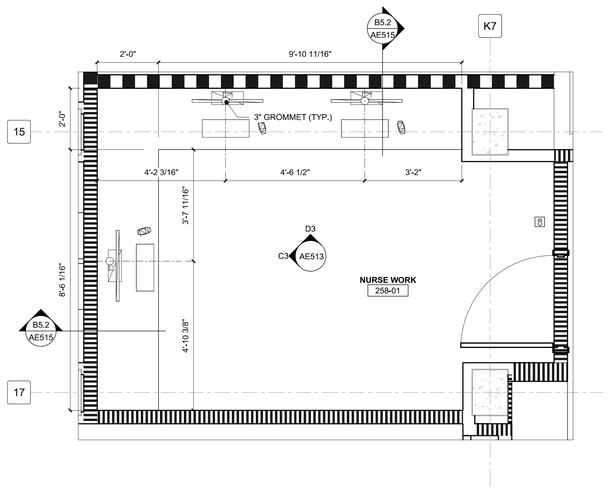


A3 MILLWORK @ NURSE WORK - PLAN

1/2" = 1'-0"

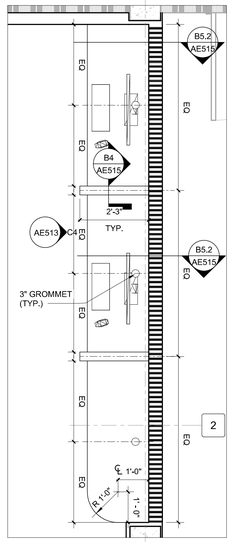


B4 MILLWORK @ TEAMWORK - PLAN

1/2" = 1'-0"

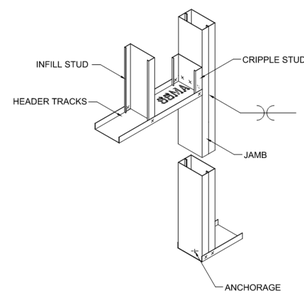


B5 DOOR FRAMING DETAIL

NOT TO SCALE

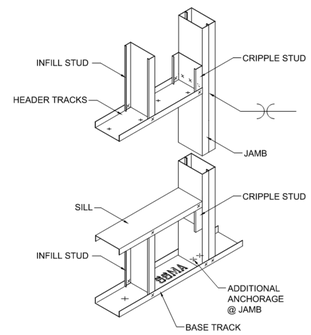


B6 WINDOW FRAMING DETAIL

NOT TO SCALE

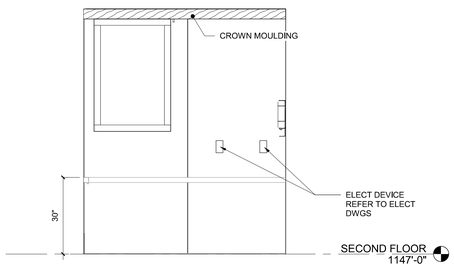


C1 MILLWORK @ CONCIERGE - ELEVATION

1/2" = 1'-0"

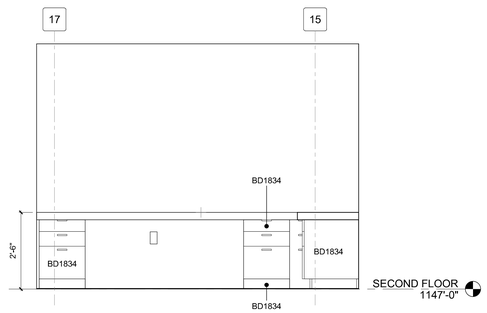


C3 MILLWORK @ NURSE WORK - ELEVATION

1/2" = 1'-0"

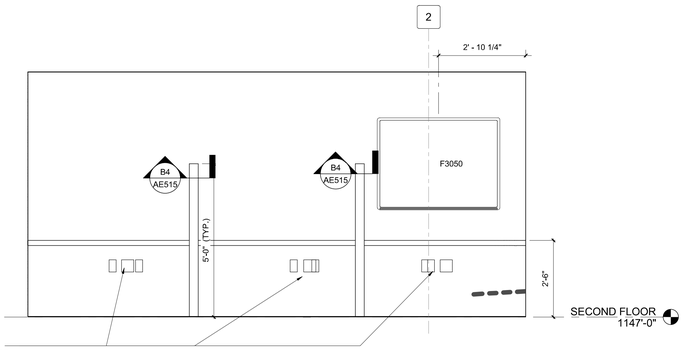


C4 MILLWORK @ TEAMWORK - ELEVATION

1/2" = 1'-0"

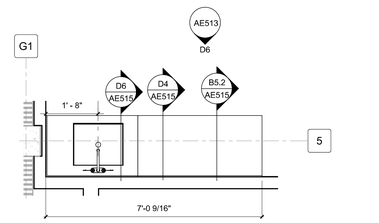


C6 MILLWORK @ LACTATION - PLAN

1/2" = 1'-0"

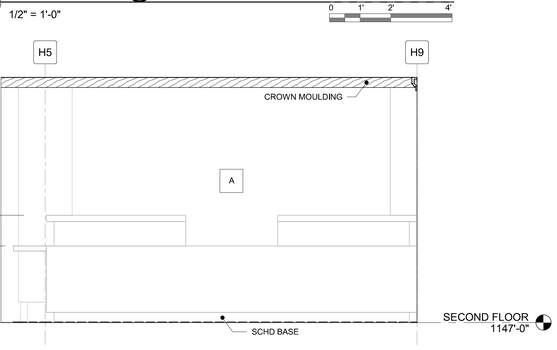


D1 MILLWORK @ CONCIERGE - ELEVATION

1/2" = 1'-0"

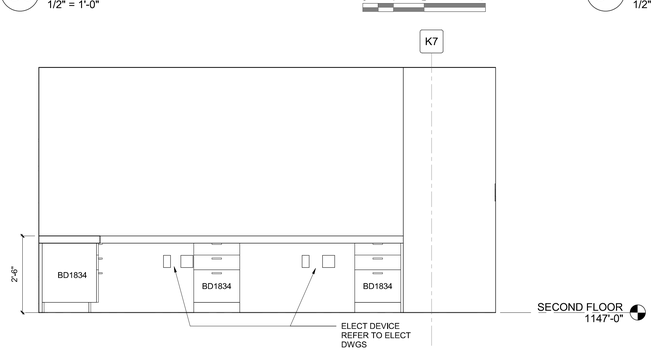

D3 MILLWORK @ NURSE WORK - ELEVATION

1/2" = 1'-0"

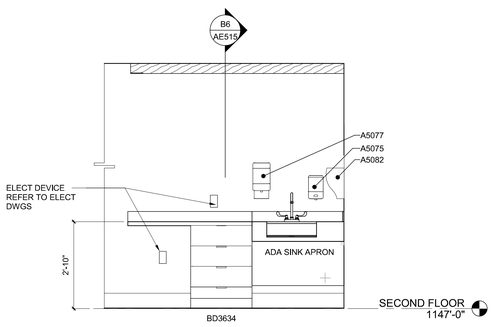

D6 MILLWORK @ LACTATION - ELEVATION

1/2" = 1'-0"

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC. consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. OAKES REGISTERED ARCHITECT 15080 NORTH CAROLINA CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **ENLARGED CASEWORK PLANS**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: TR | Drawn: MS

Project Number: 564-17-140

Building Number: 1


Drawing Number: **AE513**

Sheet 70 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs


GENERAL SHEET NOTES

A. CONTRACTOR TO FIELD VERIFY MEASUREMENTS, BEFORE FABRICATING ANY MILLWORK / COUNTERTOPS AND BRING ANY DISCREPANCIES TO THE ATTENTION OF THE ARCHITECT IN WRITING.
B. FOR TYPICAL NOTES, SEE SHEET A0001 FOR INFORMATION.
C. FOR WALL BACKING / BLOCKING REQUIREMENTS SEE DETAIL D4 AE511 FOR INFORMATION.
D. PROVIDE 3" GROMMET CENTERED ABOVE POWER AND DATA OUTLETS. COORDINATE LOCATIONS WITH OWNER.
E. SEE C1/AE511 FOR TYPICAL ROUND COLUMN COVER INFORMATION.




A1 LAVATORY STYLE 2 @ PATIENT BEDROOM

1/2" = 1'-0"




A2 ABA WALL MNTD LAVATORY STYLE 1 @ PATIENT BEDROOM

1/2" = 1'-0"

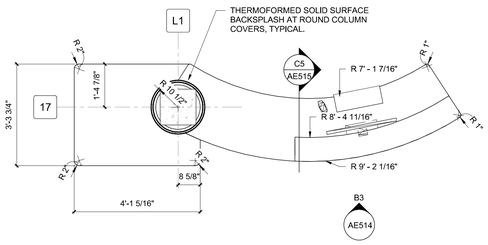


A3 MILLWORK @ NURSE'S STATION - PLAN

1/2" = 1'-0"

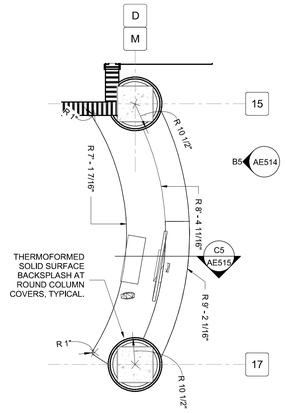


A5 MILLWORK @ NURSE STATION - PLAN

1/2" = 1'-0"

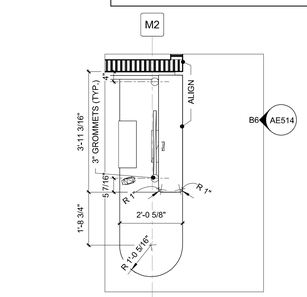


A6 MILLWORK @ NURSE STATION - PLAN

1/2" = 1'-0"




B1 LAVATORY STYLE 2 @ PATIENT BEDROOM

1/2" = 1'-0"




B2 LAVATORY (ABA APRON) STYLE 1 @ PATIENT BEDROOM

1/2" = 1'-0"

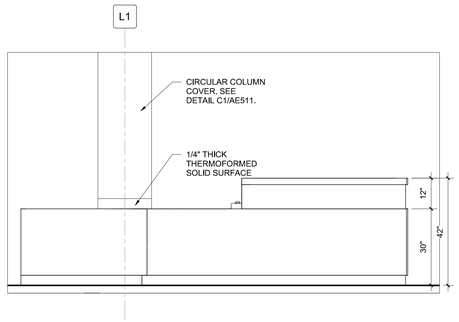


B3 MILLWORK @ NURSE STATION - ELEVATION

1/2" = 1'-0"

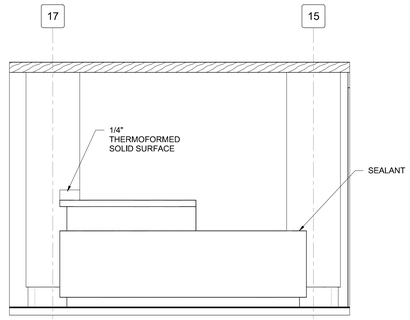


B5 MILLWORK @ NURSE STATION - ELEVATION

1/2" = 1'-0"




B6 MILLWORK @ NURSE STATION - ELEVATION

1/2" = 1'-0"

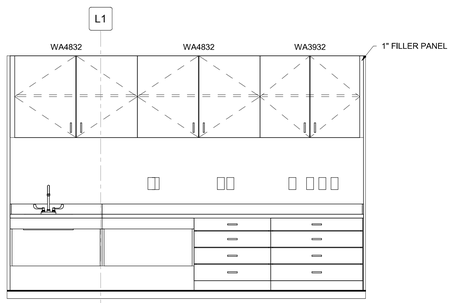

D1 MILLWORK @ NURSE STATION - ELEVATION

1/2" = 1'-0"

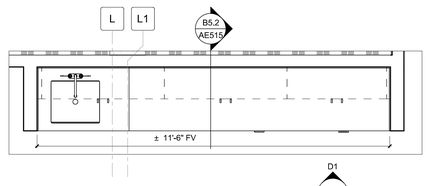

D3 MILLWORK @ NURSE STATION - PLAN

1/2" = 1'-0"

Revisions:		
No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC. consulting engineers

8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. OLIVER REGISTERED ARCHITECT 15108 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •

8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833

HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **ENLARGED CASEWORK PLANS AND ANCHORAGE DETAIL**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: TR | Drawn: MS


Project Number: 564-17-140


Building Number: 1


Drawing Number: **AE514**


Sheet 71 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

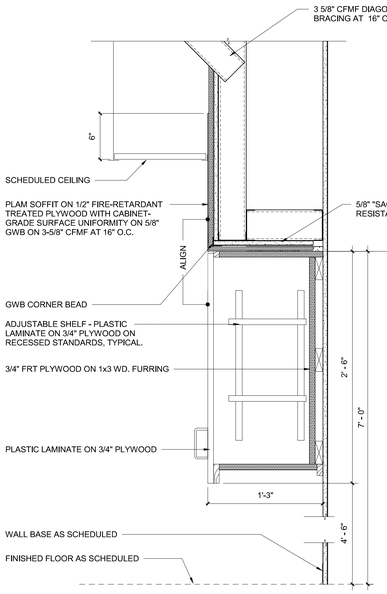

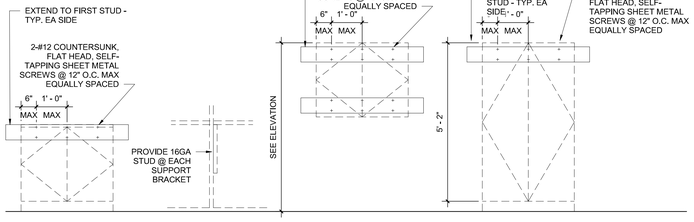



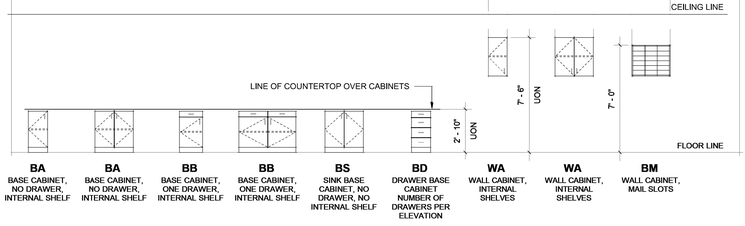

INSTRUCTIONS FOR CASEWORK TYPE DESIGNATION:

FIRST TWO LETTERS INDICATES ELEVATION TYPE. REFER TO ELEVATIONS FOR NUMBER OF DOORS / DRAWERS

FIRST PAIR OF NUMBERS INDICATES WIDTH OF UNIT IN INCHES

SECOND PAIR OF NUMBERS INDICATES HEIGHT OF COUNTERTOP OVER UNIT

EXAMPLE:

BA3034

30 INCH WIDE BASE CABINET WITH NO DRAWERS, NUMBER OF DOORS PER ELEVATION UNDER 34 INCH HIGH COUNTERTOP

NOT ALL TYPES SHOWN ARE USED ON PROJECT

GENERAL SHEET NOTES

NOTE: REFER TO ALL PHASING SHEETS. GENERAL CONTRACTOR SHALL ENSURE THAT ALL CONTRACTORS ARE RESPONSIBLE FOR COORDINATION ACROSS ENTIRE SET OF CONSTRUCTION DOCUMENTS.

A. USE MARINE-GRADE FRT PLYWOOD AND FRT SOLID WOOD BLOCKING AT ALL SINK CABINETS (TYPICAL).
B. USE PAIRS OF CONCEALED, SOFT-CLOSE FULL EXTENSION ZINC GLIDES AT ALL DRAWERS (TYPICAL).
C. TOLERANCE BETWEEN DRAWERS IS 1/8" TYPICAL.
D. USE ABS EDGE BANDING (ACRYLONITRILE BUTADIENE STYRENE) AT ALL PLYWOOD EXPOSED EDGES. COLOR TO MATCH PLASTIC LAMINATE.
E. PROVIDE 3" GROMMET CENTERED ABOVE POWER AND DATA OUTLETS. COORDINATE LOCATIONS WITH OWNER.
F. ALL CABINET HARDWARE, WITH MATCHING FASTENERS TO USE ANTIMICROBIAL COPPER IN BASE BID. FOR A DEDUCT ALTERNATE ALL ITEMS WILL USE 304 STAINLESS STEEL.

A4 CASEWORK CLARIFICATIONS

1/4" = 1'-0"


A2 CASEWORK BACKING AND ANCHORAGE REQUIREMENTS


1/2" = 1'-0"

PROVIDE WALL BACKING TYPE AS INDICATED ON WALL BACKING TYPE DETAIL

B4 SOLID SURFACE DIVIDER PARTITION

1 1/2" = 1'-0"

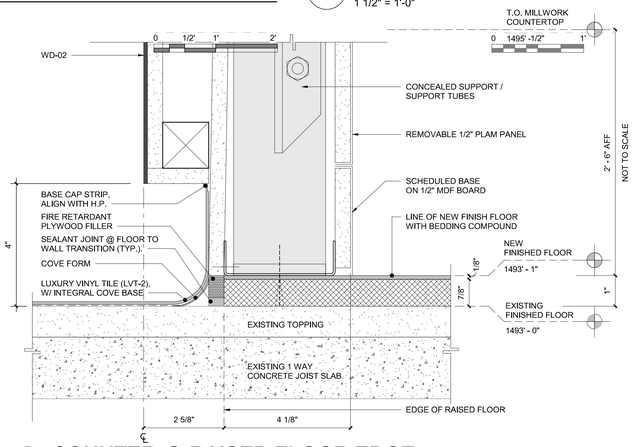

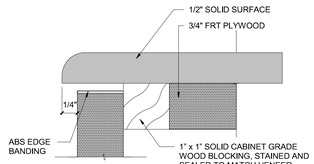

B1 CASEWORK UPPER CABINET (ONLY)

1 1/2" = 1'-0"

B2 BASE CABINET EDGE DETAIL


12" = 1'-0"


B3 COUNTER @ RAISED FLOOR EDGE

6" = 1'-0"

B5.1 SOLID SURFACE COUNTERTOP


3" = 1'-0"

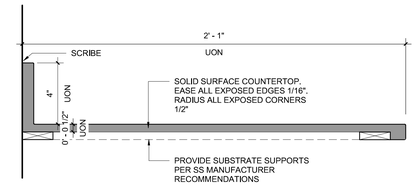


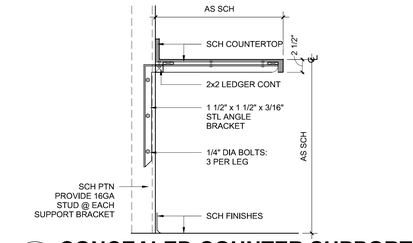

B5.2 CONCEALED COUNTER SUPPORT


1" = 1'-0"

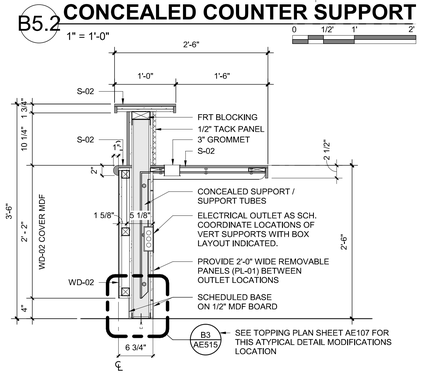


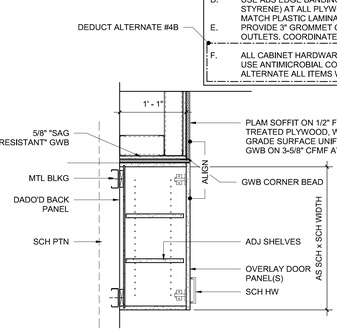


B6 CASEWORK TYPE WA

1" = 1'-0"

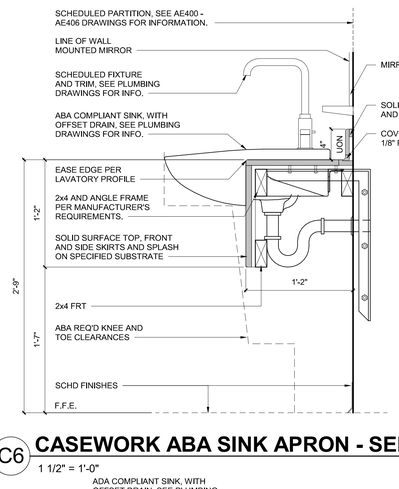


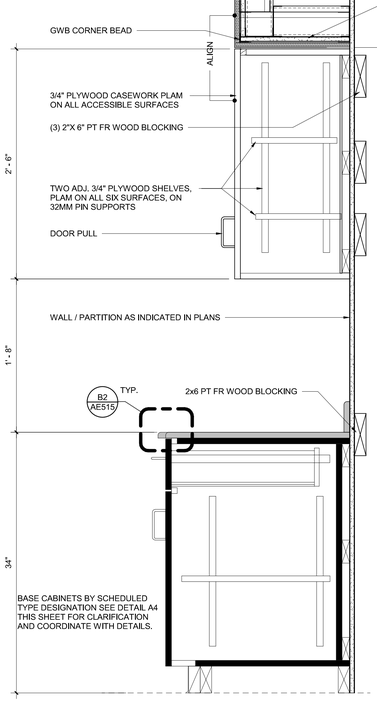

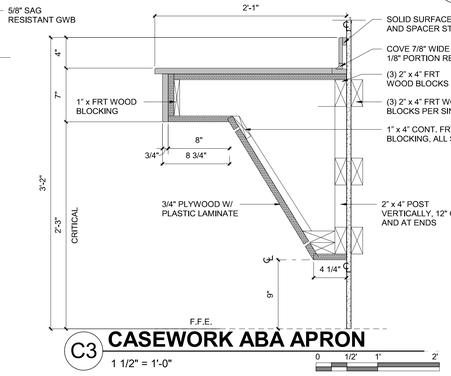

C3 CASEWORK ABA APRON

1 1/2" = 1'-0"

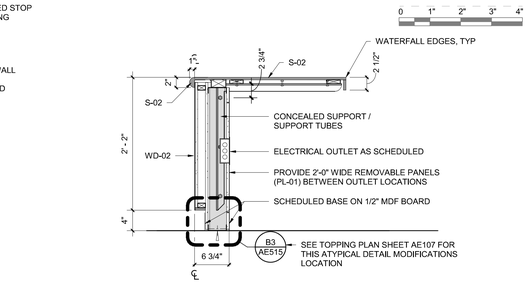

C4 LOW COUNTERTOP ABA SHELF


1" = 1'-0"

C5 TRANSACTION COUNTER DESK

1" = 1'-0"


C6 CASEWORK ABA SINK APRON - SEMI-RECESSED

1 1/2" = 1'-0"

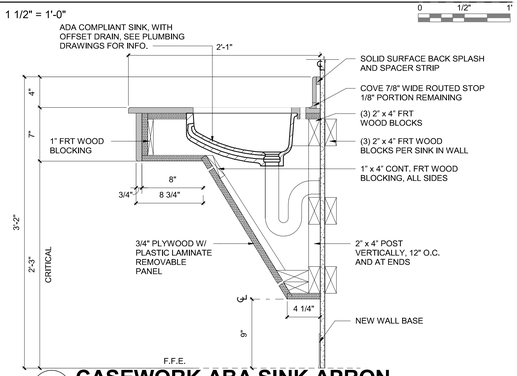


D1 CASEWORK SECTION

1 1/2" = 1'-0"

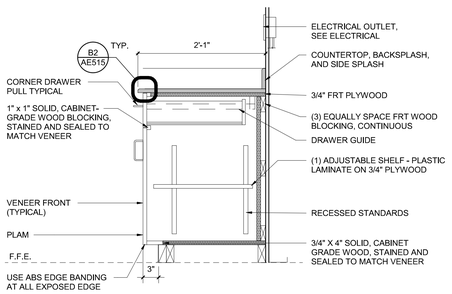


D2 CASEWORK TYPE BB

1" = 1'-0"

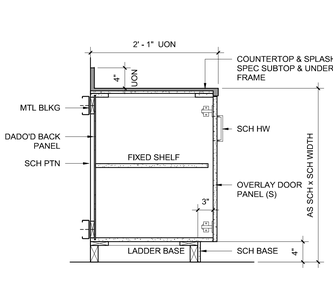


D3 CASEWORK TYPE BA

1" = 1'-0"

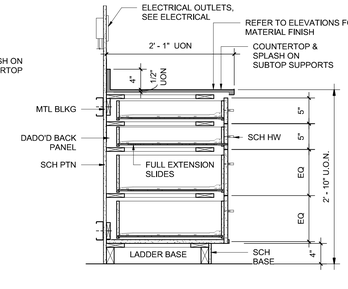

D4 CASEWORK TYPE BD

1" = 1'-0"

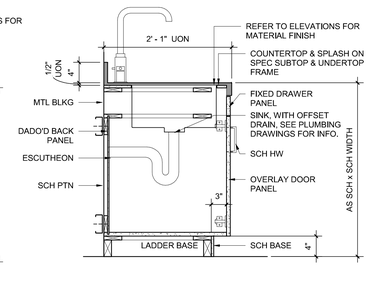

D5 CASEWORK TYPE BS

1" = 1'-0"

D6 CASEWORK ABA SINK APRON

1 1/2" = 1'-0"

Revisions:		
No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.
JONATHAN M. CLARK REGISTERED ARCHITECT 11080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE
CHARLOTTE, NC 28227
P 704.814.1320
F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **CASEWORK DETAILS**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: TR | Drawn: MS

Project Number: 564-17-140

Building Number: 1

Drawing Number: **AE515**

Sheet 72 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

DOOR SIZES

MARK	WIDTH	HEIGHT	MARK	WIDTH	HEIGHT
A	1' - 6"	6' - 8"	N	2' - 10"	7' - 0"
B	2' - 0"	6' - 8"	O	2' - 2"	7' - 0"
C	2' - 2"	6' - 8"	P	2' - 4"	7' - 0"
D	2' - 4"	6' - 8"	Q	2' - 6"	7' - 0"
E	2' - 6"	6' - 8"	R	2' - 8"	7' - 0"
F	2' - 8"	6' - 8"	S	3' - 0"	7' - 0"
G	2' - 10"	6' - 8"	T	3' - 4"	7' - 0"
H	3' - 0"	6' - 8"	U	3' - 6"	7' - 0"
I	3' - 2"	6' - 8"	V	3' - 8"	7' - 0"
J	3' - 4"	6' - 8"	W	3' - 10"	7' - 0"
K	3' - 8"	6' - 8"	X	4' - 0"	7' - 0"
L	3' - 10"	6' - 8"	Y	1' - 9"	7' - 8"
M	3' - 8 1/2"	7' 11 3/4"	Z	1' - 10"	7' - 8"

DOOR MODIFICATIONS (APPLICATION CODES)

A	LAMINATED GLAZING
ADO	AUTOMATIC DOOR OPERATOR
CR	CARD READER
D	DOUBLE GLAZED TEMPERED GLASS
DA	PIVOT HINGE AND EMERGENCY DOOR STOP
DG:	GLAZING (DOOR)
DS:	SECURITY (DOOR)
'F' GLASS	FIRE RATED GLAZING
H	ELECTRIC HOLD
L	LOUVER
LP	LIGHT PROOF LOUVER
M	MECHANICAL SEAL FOR LIGHT PROOF AND SOUND RETARDING DOOR
T	TEMPERED GLASS
U	UNDERCUT 3/4"
V	LEAD GLASS
W	WIRE GLASS
SD	SLIDING DOOR (SEE PLAN FOR CLEAR OPENING)
SL	SLOPED TOP AND 3" LATCH SIDE GAP
VP	VISION PANEL

GLASS OR LOUVER REQUIRED BY MODIFICATION

GLASS OR LOUVER REQUIRED BY ELEVATION TYPE

DOOR NOTES:

1. ALL DOORS SHALL BE FLUSH - 1 3/4" THICK UNLESS NOTED OTHERWISE
2. TOP AND SIDE RAILS SHALL BE 9" MIN. BOTTOM RAILS SHALL BE 12" MIN.
3. DOOR TYPES 7,8, & 9 SHALL NOT BE USED FOR OPPOSING DOORS.
4. EVEN NUMBERS ARE METAL; ODD NUMBER ARE SOLID CORE WOOD.
5. NOT ALL DOOR TYPES ARE USED.

GENERAL NOTES

A. CONTRACTOR IS RESPONSIBLE FOR COORDINATING DOORS, DOOR FRAMES, AND HARDWARE.
B. HARDWARE SUPPLIER IS RESPONSIBLE FOR BUILDING CODE AND FIRE RATED DOOR REQUIREMENTS.
C. ALL FIRE RATED DOORS SHALL HAVE APPLIED U.L. LABEL ON HINGE SIDE, IF DOOR IS RATED, THEN FRAME ALSO REQUIRES MATCHING UL LABEL.
D. FRAME SIZES TO BE COORDINATED WITH PARTITION WIDTHS ON THE JOB SITE BY CONTRACTOR.
E. PROVIDE TWO (2) 16 GAUGE METAL STUDS AT ALL DOOR JAMBS AND PARTITION CORNERS.
F. GLASS SHALL BE PERMANENTLY MARKED TO INDICATE THAT IT IS TEMPERED.
G. AFTER INSTALLATION OF EACH HOLLOW METAL DOOR FRAME, MARK THE ROOM NUMBER ON THE INTERIOR AND EXTERIOR OF THE FRAME WITH INK THAT WILL NOT BE VISIBLE AFTER THE SPECIFIED FINISHING IS COMPLETED.
H. WOOD VENEER AND FINISH TO MATCH FACILITY STANDARDS.
I. STANDARD DOOR UNDERCUT TO BE 1/2" (3/4" MAXIMUM) FROM FINISHED SURFACE OF HIGHEST ADJACENT FLOOR / THRESHOLD.
J. NO OVERHEAD STOP / CLOSER, INSTEAD PROVIDE 1 WALL STOP L02101 CONVEX (AVOIDS INTERFERENCE WITH PATIENT RAIL).

PAINT: PAINT EXISTING DOOR & FRAME
FRAME: PATCH HINGE DEPRESSION ON FRAME & PAINT


DOOR SYMBOLS LEGEND



DOOR RATINGS

UL LABEL	RATING (HRS)	RATING (MIN.)	MAX. GLASS AREA
A	3 HR	180 MIN.	100 SQUARE INCHES PER LEAF
B	1 1/2 HR	90 MIN.	100 SQUARE INCHES PER LEAF
C	3/4 HR	45 MIN.	1296 SQUARE INCHES PER LEAF
D	1 1/2 HR	90 MIN.	REFER TO LOCAL CODES
E	3/4 HR	45 MIN.	REFER TO LOCAL CODES
	1/3 HR	20 MIN.	1296 SQUARE INCHES PER LEAF
S	SMOKE	SMOKE	

UL LABLES D AND E ARE FOR EXTERIOR DOORS THAT ARE SUBJECT TO FIRE HAZARDS FROM THE OUTSIDE OF THE DOOR.

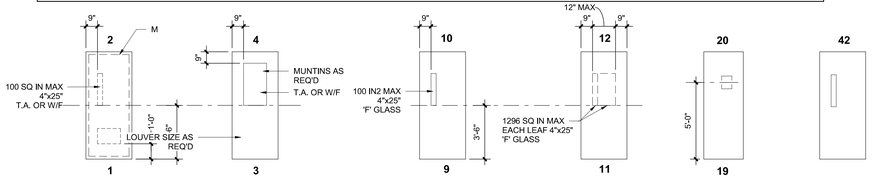


'B' LABEL 90 MINUTE

'C' LABEL 45 MINUTE

SOUND RATED

INTEGRATED DOOR ASSEMBLY

BASIS OF DESIGN: HORTON HD SWING

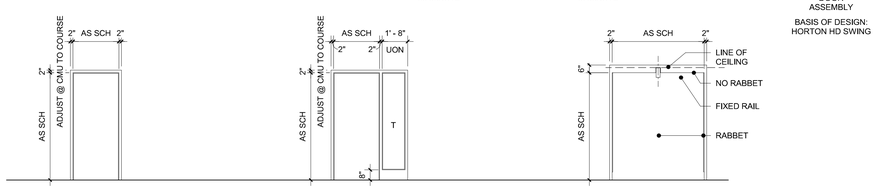

DEDUCT ALTERNATE #5


DOOR SCHEDULE

DOOR NUMBER	DOOR SIZE	DOOR PANELS PAIR / UNEQUAL PAIR	DOOR PANELS TYPE	DOOR PANELS MAT'L	DOOR FRAME TYPE	DOOR FRAME MAT'L	RATING	HW	SIGN	REMARKS	FRAME / HEAD DETAIL	SILL DETAIL	FRAME / JAMB DETAIL
Phase 1 - 2B													
235-01	S		1	WD	1	HM		SH-3		ds: CR	A / HD-1		A / JD-1
236-01	S		1	WD	1	HM		SH-3		ds: CR	A / HD-1		A / JD-1
237-01	VV	PR	42	STEEL	1	STEEL	NOT RATED	12C		dg: T (ID), ADO	B / HD-2		B / JD-2
239-01	S		1	WD	1	HM		2			A / HD-1		A / JD-1
248-01	S		1	WD	1	HM		3E		dg: T	A / HD-1		A / JD-1
250-01	VV	PR	42	STEEL	1	STEEL	C / 45 MIN.	12C	O	dg: F (ID), ADO	B / HD-2		B / JD-2
251-01	X		11	WD	1	HM	C / 45 MIN.	4F		dg: F	A / HD-1		A / JD-1
252-01	U		1	WD	1	HM		5D			A / HD-1		A / JD-1
253-01	S		1	WD	1	HM		SH-3D		ds: CR, dg: T	A / HD-1		A / JD-1
254-01	V		11	WD	1	HM	C / 45 MIN.	SH-3C		dg: F, ds :CR	A / HD-1		A / JD-1
255-01	SS	PR	11	WD	1	HM	C / 45 MIN.	SH-9B		ds: CR	A / HD-1		A / JD-1
257-01	V		11	WD	1	HM	C / 45 MIN.	SH-3D		dg: F, ds: YES, CR	A / HD-1		A / JD-1
258-01	S		1	WD	1	HM		4K		dg: T	A / HD-1		A / JD-1
259-01	S		1	WD	1	HM		4K					
262-01	S		1	WD	1	HM		SH-3		ds: CR	A / HD-1		A / JD-1
263-01	X		3	WD	3	HM		1B		dg: T	A / HD-1		A / JD-1
263A-01	YY	PR	1	WD	4	HM		10P		U, NOTE J	D / HD-1	D1 / AF500	A / JD-1
264-01	X		3	WD	3	HM		1B		dg: T	A / HD-1		A / JD-1
264A-01	YY	PR	1	WD	4	HM		10P		U, NOTE J	D / HD-1	D1 / AF500	A / JD-1
265-01	X		3	WD	3	HM		1B		dg: T	A / HD-1		A / JD-1
265A-01	YY	PR	1	WD	4	HM		10P		U, NOTE J	D / HD-1	D1 / AF500	A / JD-1
266-01	X		3	WD	3	HM		1B		dg: T	A / HD-1		A / JD-1
266A-01	YY	PR	1	WD	4	HM		10P		U, NOTE J	D / HD-1	D1 / AF500	A / JD-1
267-01	V		2	STEEL	1	HM	60 MIN.	SH-13		ds: CR			
268-01	X		3	WD	3	HM		1B		dg: T	A / HD-1		A / JD-1
268A-01	YY	PR	1	WD	4	HM		10P		U, NOTE J	D / HD-1	D1 / AF500	A / JD-1
269-01	X		3	WD	3	HM		1B		dg: T	A / HD-1		A / JD-1
269A-01	YY	PR	1	WD	4	HM		10P		U, NOTE J	D / HD-1	D1 / AF500	A / JD-1
270-01	X		3	WD	3	HM		1B		dg: T	A / HD-1		A / JD-1
270A-01	YY	PR	1	WD	4	HM		10P		U, NOTE J	D / HD-1	D1 / AF500	A / JD-1
272-01	X		3	WD	3	HM		1B		dg: T	A / HD-1		A / JD-1
272A-01	YY	PR	1	WD	4	HM		10P		U, NOTE J	D / HD-1	D1 / AF500	A / JD-1
273-01	X		3	WD	3	HM		1B		dg: T	A / HD-1		A / JD-1
273A-01	YY	PR	1	WD	4	HM		10P		U, NOTE J	D / HD-1	D1 / AF500	A / JD-1
274-01	X		3	WD	3	HM		1B		dg: T	A / HD-1		A / JD-1
274A-01	ZZ	PR	1	WD	4	HM		10P		U, NOTE J	D / HD-1	D1 / AF500	A / JD-1
346-01	V	-	2	STEEL	1	HM	60 MIN.	SH-13		ds: CR			
EG-1-01	3'-0"			GALV. STEEL		GALV. STEEL		SH-14A		ds: CR	A2/AE452		
M2-2-01	X		1	WD	1	HM	B / 90 MIN.	5B		-	C / HD-4		A / JD-1
M2-4-01	X		19	WD	1	HM	B / 90 MIN.	5B		-	A / HD-1		A / JD-1
MB05-01	SS	PR	20	HM	1	HM		SH-9B		ds: CR	A / HD-1		A / JD-1
PC259-01	F		9	WD	1	HM	B / 90 MIN.	SH-3D		dg: F	C / HD-4		A / JD-1
S203-01	X		1	WD	1	HM	B / 90 MIN.	5B		-	C / HD-4		A / JD-1
Phase 2													
229-01	S		19	WD	1	HM		2G		U	A / HD-1		A / JD-1
230-01	OPENING		-	-	-	-	-	-		-	NO CASED FRAME		NO CASED FRAME
240-01	V		19	WD	1	HM		2G			A / HD-1		A / JD-1
241-01	S		19	WD	1	HM		4K			A / HD-1		A / JD-1
242-01	VV	PR	42	STEEL	1	STEEL	NOT RATED	12C		dg: T (ID), ADO	B / HD-2		B / JD-2
243-01	S		19	WD	1	HM		4K			A / HD-1		A / JD-1
244-01	S		1	WD	1	HM		3E		dg: T	A / HD-1		A / JD-1
245-01	S		1	WD	1	HM		3E		dg: T	A / HD-1		A / JD-1
246-01	S		1	WD	1	HM		3E		dg: T	A / HD-1		A / JD-1
247-01	S		11	WD	1	HM	C / 45 MIN.	5B			A / HD-1		A / JD-1

B2 DOOR AND FRAME TYPES

1/4" = 1'-0"

0 2' 4' 8'

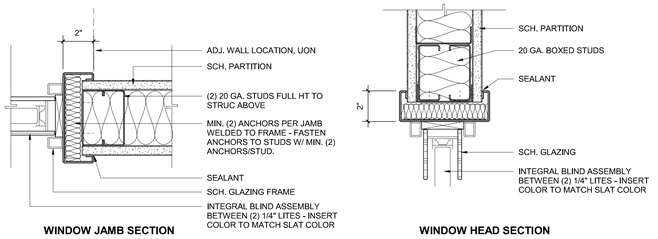


C1 HOSPITAL DOOR STOP

1/2" = 1'-0"

0 1' 2' 4'


TYPICAL FOR ALL INTERIOR DOOR FRAMES.




C2 WINDOW HEAD/JAMB DETAIL

3" = 1'-0"

0 3" 6" 9"

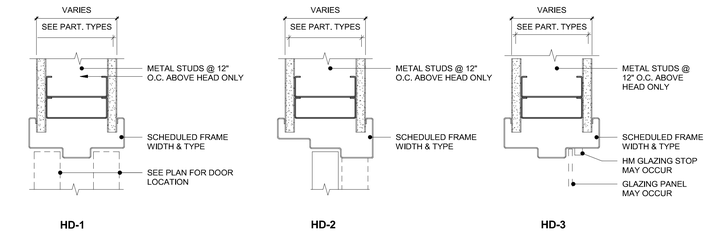


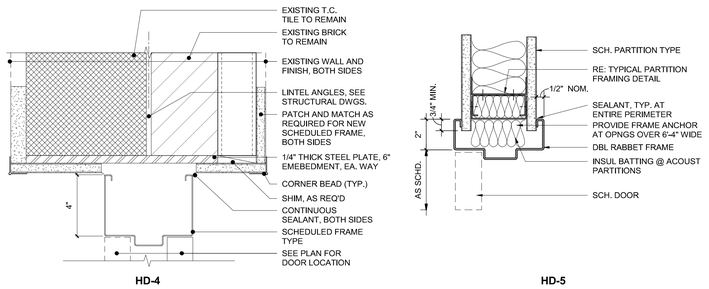

D1 HEAD DETAILS

3" = 1'-0"


0 3" 6" 9"

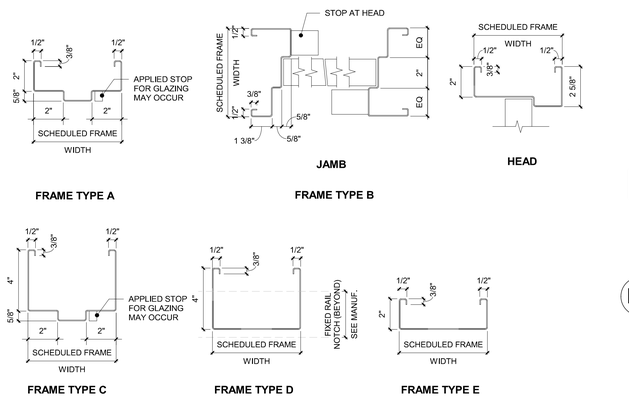

D3 FRAME TYPES

3" = 1'-0"

0 3" 6" 9"

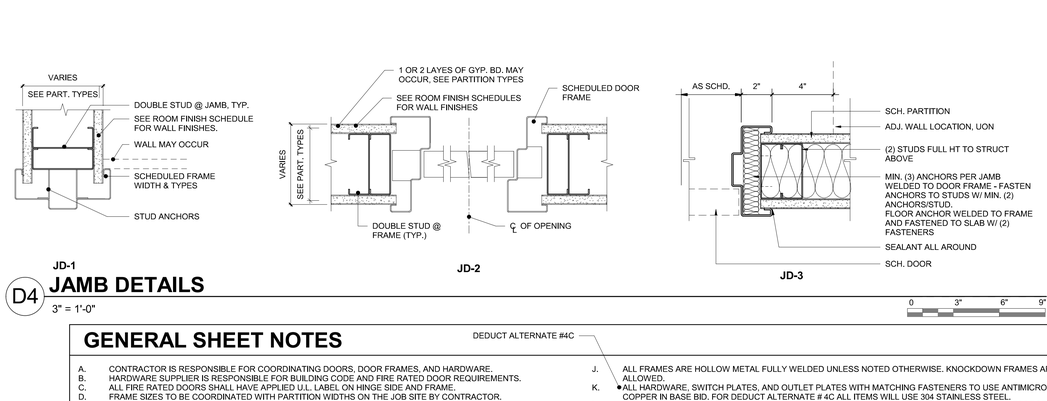

D4 JAMB DETAILS

3" = 1'-0"

0 3" 6" 9"

GENERAL SHEET NOTES

DEDUCT ALTERNATE #4C

A. CONTRACTOR IS RESPONSIBLE FOR COORDINATING DOORS, DOOR FRAMES, AND HARDWARE.
B. HARDWARE SUPPLIER IS RESPONSIBLE FOR BUILDING CODE AND FIRE RATED DOOR REQUIREMENTS.
C. ALL FIRE RATED DOORS SHALL HAVE APPLIED U.L. LABEL ON HINGE SIDE AND FRAME.
D. FRAME SIZES TO BE COORDINATED WITH PARTITION WIDTHS ON THE JOB SITE BY CONTRACTOR.
E. PROVIDE TWO (2) 16 GAUGE METAL STUDS AT ALL DOOR JAMBS AND PARTITION CORNERS.
F. GLASS SHALL BE PERMANENTLY MARKED TO INDICATE THAT IT IS TEMPERED.
G. ALL DOORS REQUIRE BEVELED EDGES. BEVEL RADIUS 1/8 INCH MIN, TYP. ALL DOORS 1-3/4" THICK AND 7'-0" HIGH UNLESS NOTED OTHERWISE. ALL DOORS ARE SOLID CORE WOOD UNLESS NOTED OTHERWISE.
H. AFTER INSTALLATION OF EACH HOLLOW METAL DOOR FRAME, MARK THE ROOM NUMBER ON THE INTERIOR AND EXTERIOR OF THE FRAME WITH INK THAT WILL NOT BE VISIBLE AFTER THE SPECIFIED FINISHING IS COMPLETED.
I. DOORS AND FRAMES INDICATED AS NRST ON THE SCHEDULE ARE NON-RATED, SMOKE TIGHT.
J. ALL FRAMES ARE HOLLOW METAL FULLY WELDED UNLESS NOTED OTHERWISE. KNOCKDOWN FRAMES ARE NOT ALLOWED.
K. ALL HARDWARE, SWITCH PLATES, AND OUTLET PLATES WITH MATCHING FASTENERS TO USE ANTIMICROBIAL COPPER IN BASE BID. FOR DEDUCT ALTERNATE # 4C ALL ITEMS WILL USE 304 STAINLESS STEEL.
L. FOR GLAZING LITES IN DOOR , SEE SCHEDULE REMARKS COLUMN AND DOOR APPLICATION CODES LEGEND; FOR DASHED LINES IN ELEVATION TYPE LOOK FOR RELEVANT DOOR APPLICATION CODE IN DOOR I.E. A, D, F, T, VP, V, W, ETC.
M. ALL EXTERIOR DOORS AND FRAMES SHALL BE GALVANIZED AND PAINTED.
N. ALL EXTERIOR DOORS SHALL BE INSULATED.
O. REFER TO SPECIFICATIONS FOR HARDWARE GROUPS.
P. DETAILS REFERENCED FOR FRAME TYPES, ARE TYP. U.N.O.
Q. FOR SIGN TYPES, SEE SHEET AF501 FOR INFORMATION.

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC. consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. OAKES REGISTERED ARCHITECT 11080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **DOOR SCHEDULE AND DETAILS**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: TR | Drawn: MS


Project Number: 564-17-140

Building Number: 1

Drawing Number: **AE601**


Sheet 73 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

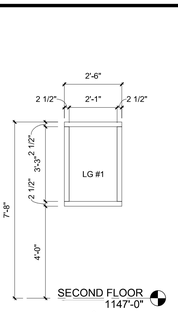


SECOND FLOOR 1147'-0"

1.0

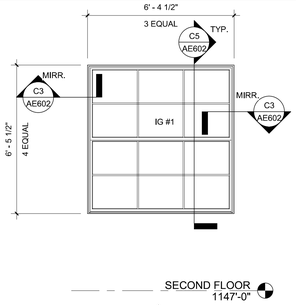


SECOND FLOOR 1147'-0"

4.0

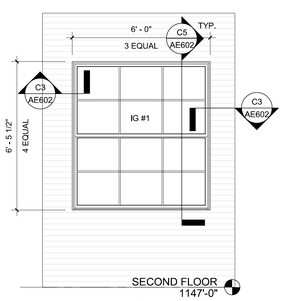


SECOND FLOOR 1147'-0"

5.0

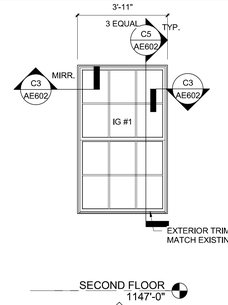


SECOND FLOOR 1147'-0"

9.0

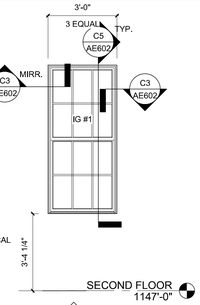


SECOND FLOOR 1147'-0"

10.0




SECOND FLOOR 1147'-0"

23




SECOND FLOOR 1147'-0"

11.0




SECOND FLOOR 1147'-0"

12.0




SECOND FLOOR 1147'-0"

13.0



SECOND FLOOR 1147'-0"


14.0

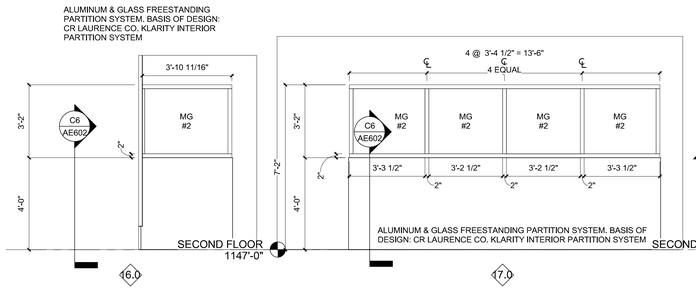

SECOND FLOOR 1147'-0"

16.0


17.0



SECOND FLOOR 1147'-0"

THIRD FLOOR 1159'-0"

18.0



THIRD FLOOR 1159'-0"

20.0


GLAZING TYPES

SEE SPECIFICATIONS FOR FULL DESCRIPTIONS.

MG #1	CLEAR FULLY TEMPERED FLOAT GLASS -1/4"	IG #1	LOW-E COATED, CLEAR DUAL INSULATING GLASS UNIT
MG #2	COMBINATION MG #1 + 3M FASARA GLASS FINISHES STRIPE SH2PTFS 1270, FINE STRING, CLASS A - FIRE CLASSIFICATION, TRANSLUCENT.	IG #2	CERAMIC COATED, INSULATING SPANDREL GLASS
LG #1	CLEAR FULLY LAMINATED GLASS WITH TWO (2) LITES OF FULLY TEMPERED FLOAT GLASS.	FR #3	FIRE - RESISTANCE RATED, CERAMIC-COATED, INSULATING SPANDREL GLASS


GENERAL SHEET NOTES

A. EXTERIOR TRIM TO MATCH EXISTING, TYPICAL.
B. FIELD VERIFY ALL OPENINGS PRIOR TO SHOP DRAWINGS.
C. ALL WINDOWS ARE TRUE-DIVIDED LIGHTS.
D. ALL LIGHTS ARE EQUALLY SPACED.
E. INSTALL SPANDREL FILM AT LOCATIONS INDICATED ON FLOOR PLANS AE102, AE103, AE104

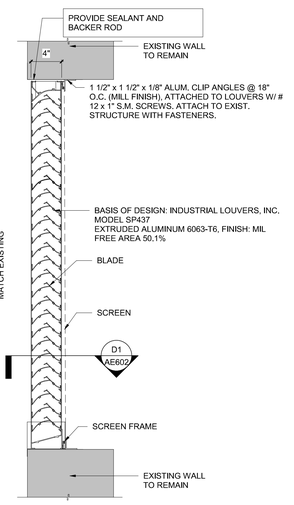


C1 LOUVER SECTION

1 1/2" = 1'-0"

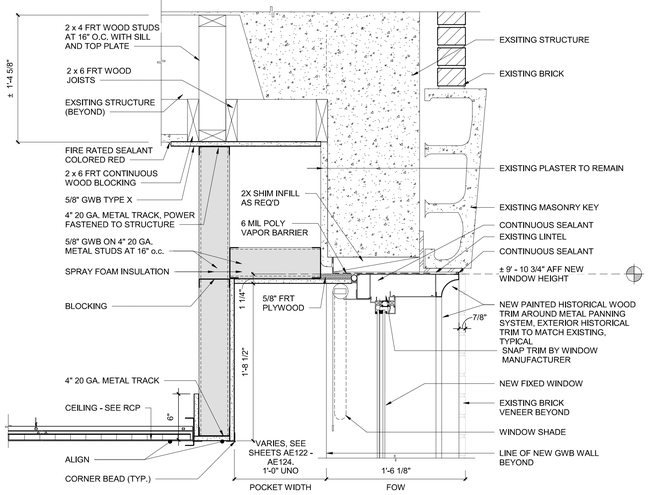


C2 EXTERIOR WINDOW HEAD DETAIL - (TYP.)

1 1/2" = 1'-0"

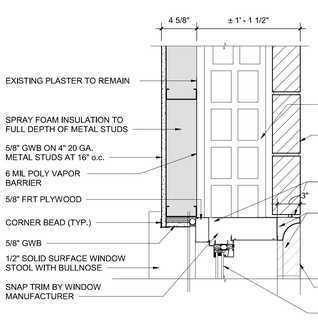


C3 EXTERIOR WINDOW JAMB DETAIL (TYP.)

1 1/2" = 1'-0"

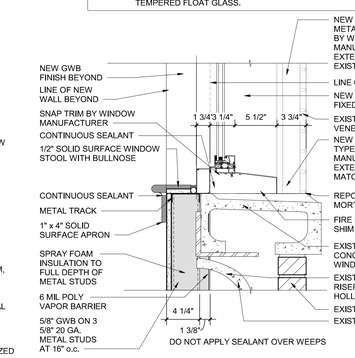


C4 EXTERIOR WINDOW SILL DETAIL (TYP.)

1 1/2" = 1'-0"

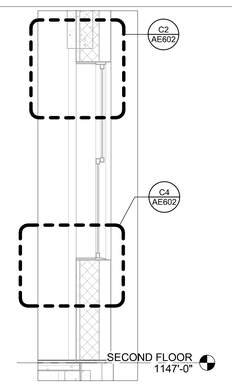


C5 WINDOW SECTION (TYP.)

1/2" = 1'-0"

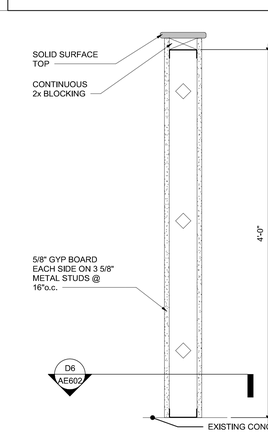


C6 KNEE WALL

1 1/2" = 1'-0"

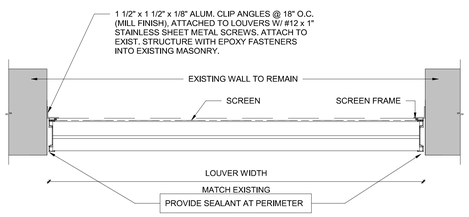

D1 LOUVER JAMB DETAILS

1 1/2" = 1'-0"

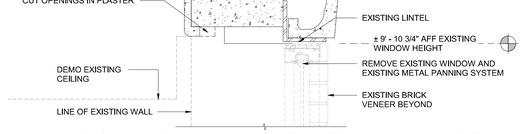


D2 EXTERIOR WINDOW HEAD DETAIL - DEMO (TYP.)

1 1/2" = 1'-0"




D3 EXTERIOR WINDOW JAMB DETAIL - DEMO (TYP.)

1 1/2" = 1'-0"

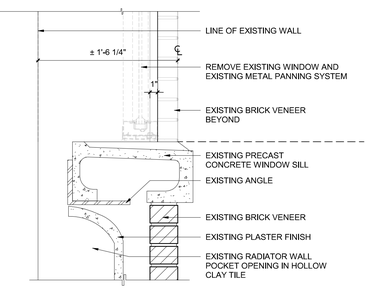

D4 EXTERIOR WINDOW SILL DETAIL - DEMO (TYP.)

1 1/2" = 1'-0"

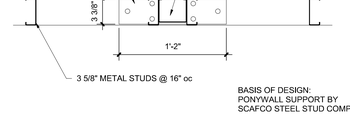

D6 KNEE WALL SUPPORT

1 1/2" = 1'-0"

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.
JONATHAN M. COHEN REGISTERED ARCHITECT 11080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **WINDOW TYPES AND DETAILS**

Project Title: **RENOVATE MED SURGE WARDS**


Project Number: 564-17-140
Building Number: 1
Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS
Drawing Number: **AE602**
Sheet 74 of 162

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Date: MARCH 24, 2024
Checked: TR
Drawn: MS

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

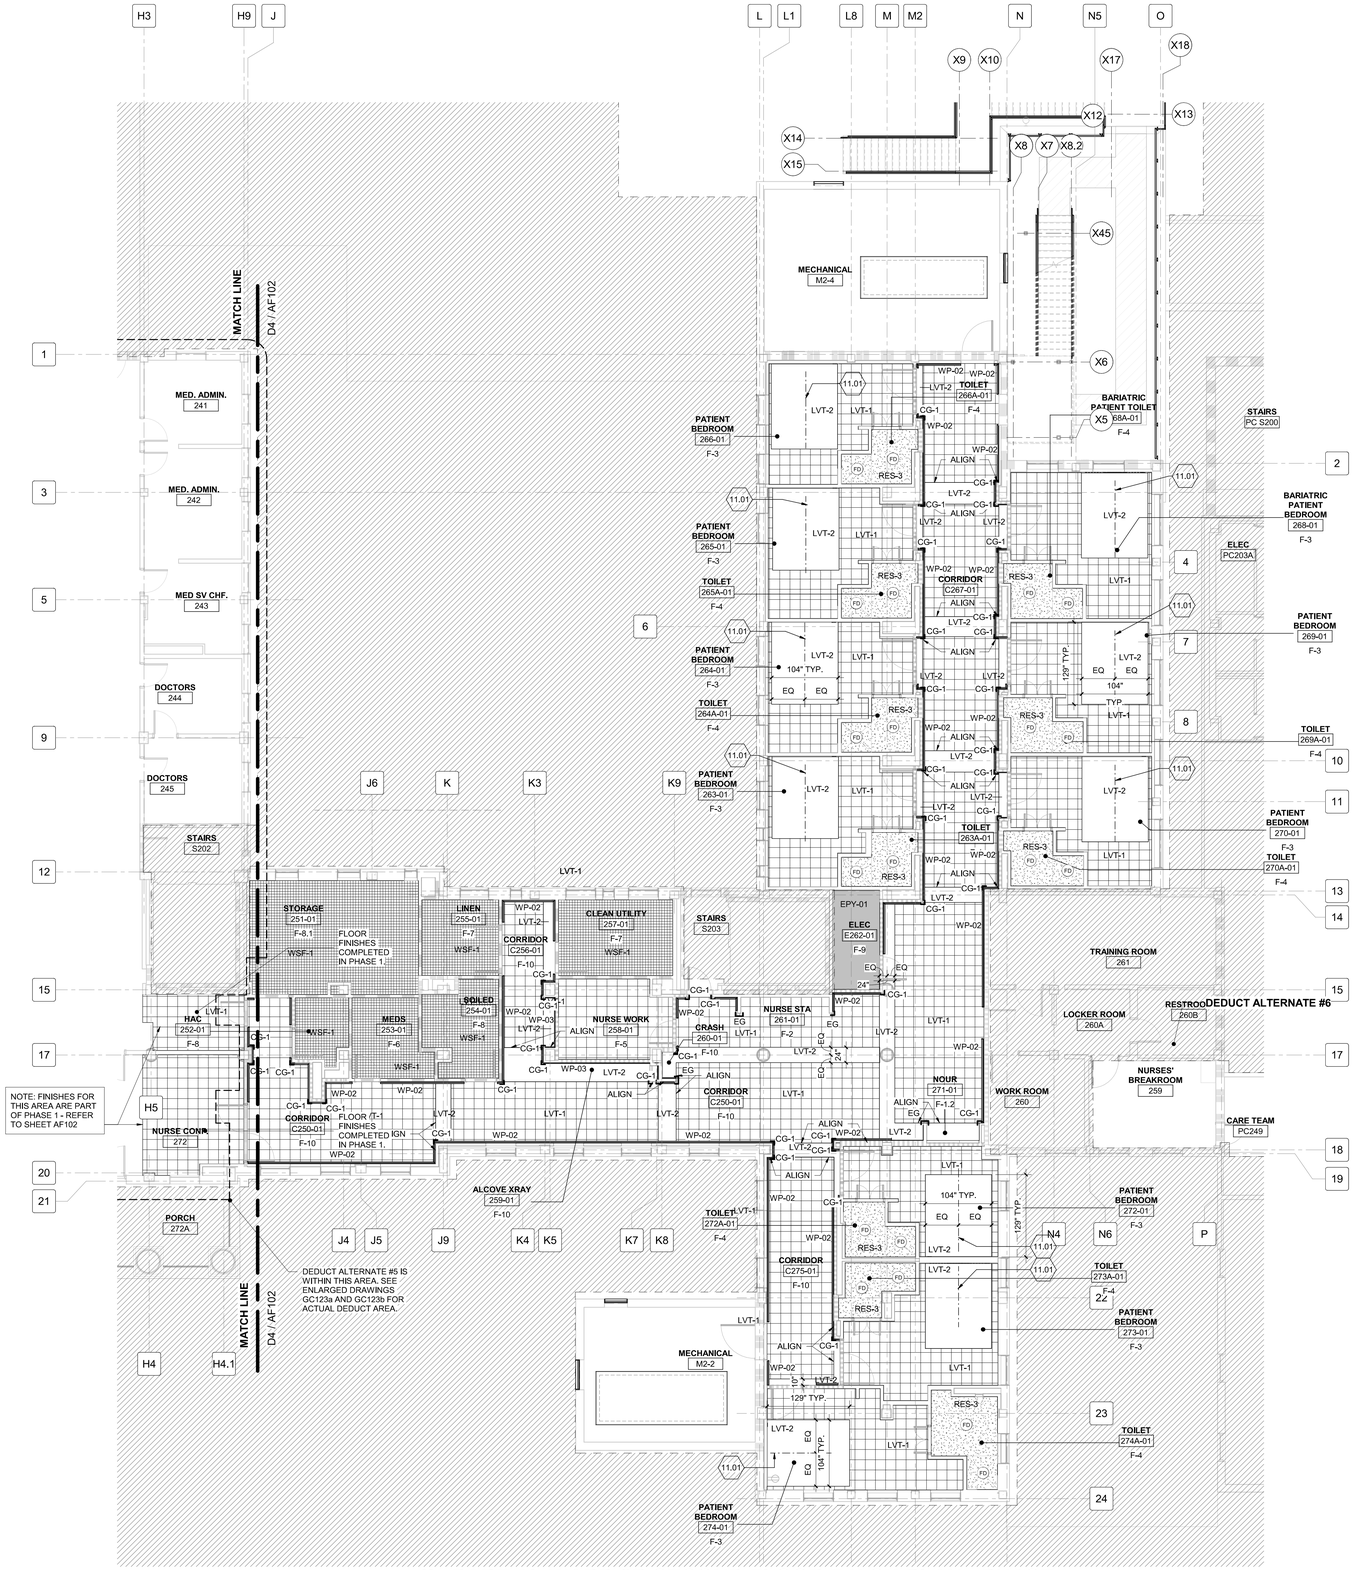

D3 **PARTIAL WARD 2B SECOND FLOOR FINISH PLAN - PHASE 1**

1/8" = 1'-0"

0 4' 8' 16'

GENERAL SHEET NOTES

A. REFER TO SHEET AI001 FOR GENERAL FINISH PLAN NOTES AND SYMBOLS.

B. ALL CORRIDORS TO RECEIVE WALL PROTECTION WP-02. INSTALL CAPS AROUND ALL PENETRATIONS.

C. ALL CORRIDOR ALCOVES TO RECEIVE WALL PROTECTION WP-03. INSTALL CAPS AROUND ALL PENETRATIONS.

D. FOR MATERIALS SEE INTERIOR MATERIALS LEGEND ON SHEET AF601 FOR INFORMATION.

E. ALL CORRIDORS CORNERS TO RECEIVE CORNER GUARDS.

SHEET KEYNOTES

11.01 CENTER-LINE OF PATIENT BED.

FINISH FLOOR LEGEND

TYPE	MARK	DESCRIPTION
	LVT-1	LUXURY VINYL TILE PATTERN 1
	LVT-2	LUXURY VINYL TILE PATTERN 2
	WSF-1	WELDED SHEET FLOORING
	WSF-2	WELDED SHEET FLOORING
	RES-3	RESINOUS FLOORING
	EPY-1	EPOXY FLOORING
CG-1, OR CG-2		CORNER GUARD (NON-RATED), OR CORNER GUARD (FIRE-RATED) SEE DETAIL D3 / AE512 FOR INFORMATION.
EG		END GUARD

SYMBOLS LEGEND

PROJECT LIMITS

NOT IN SCOPE
AREA OUTSIDE OF PROJECT LIMITS

INDICATES EGRESS WALKWAY AT EXTERIOR STAIR

PARTITION GRAPHICS

PARTITION PHASING

EXISTING ELEMENT TO REMAIN

EXISTING ELEMENT TO BE DEMOLISHED

TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

NO RATING

SMOKE RESISTIVE PARTITION - NON RATED


1 HOUR FIRE BARRIER

1 HOUR FIRE/SMOKE BARRIER

2 HOUR FIRE BARRIER

2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN



THIRD FLOOR FFE: 1505.0'

SECOND FLOOR FFE: 1493.0'

FIRST FLOOR FFE: 1479.0'

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC. consulting engineers

8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. CLARK REGISTERED ARCHITECT 11080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •

8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833

HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **PARTIAL WARD 2B SECOND FLOOR FINISH PLAN - PHASE 1**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: TR | Drawn: MS

Project Number: 564-17-140

Building Number: 1

Drawing Number: **AF101**


Sheet 75 of 162

Engineering Service

VETERANS HEALTH CARE SYSTEM OF THE OZARKS

VA U.S. Department of Veterans Affairs


BIM 360://18002 Fayetteville AR Renovate Med Surge Ward/18002 ARCH 2020.rvt

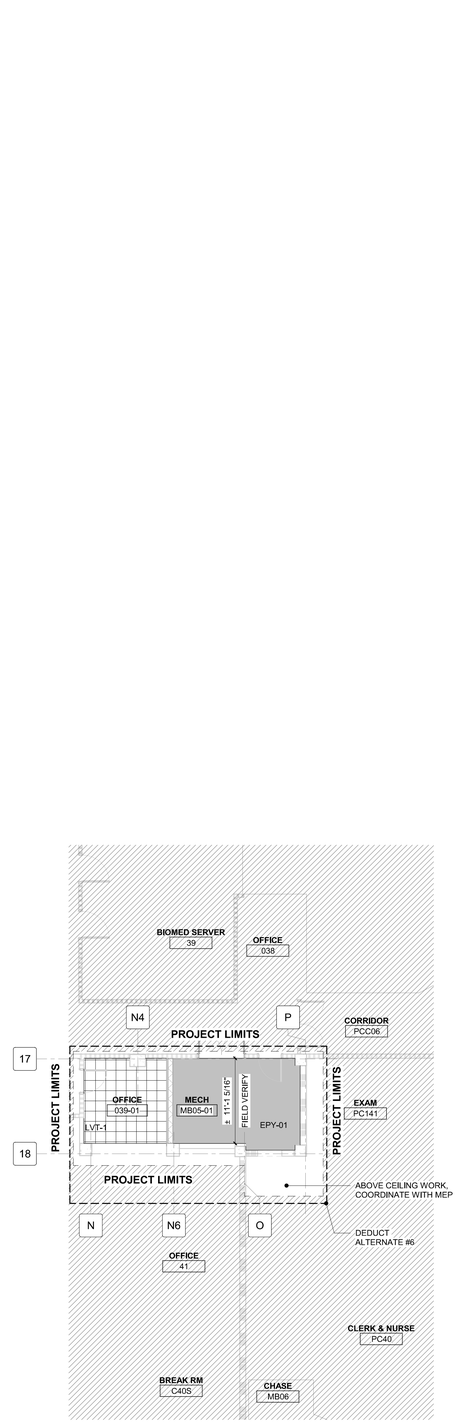

D2 PARTIAL BASEMENT FLOOR - FINISH PLAN

1/8" = 1'-0"

0 4" 8" 16"

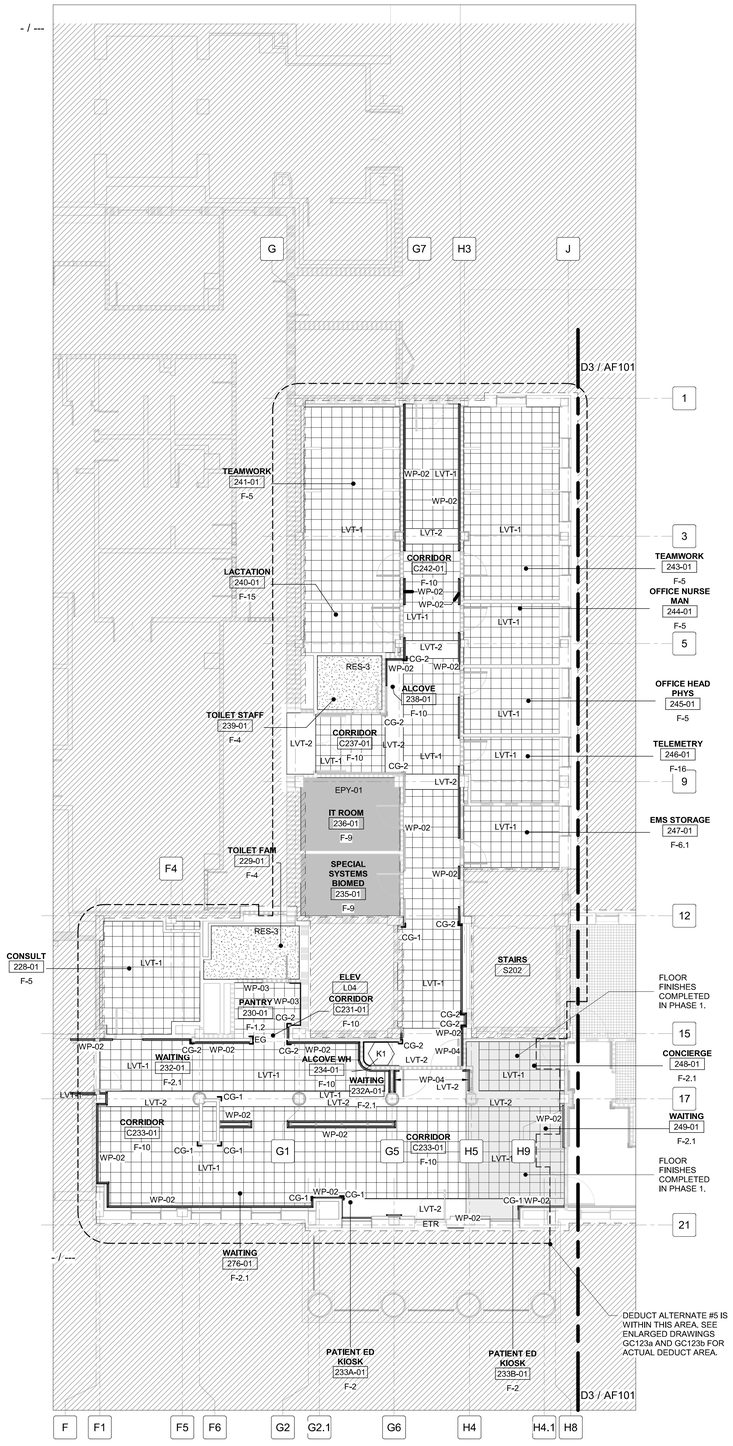

D4 PARTIAL WARD 2 SECOND FLOOR FINISH PLAN - PHASE 2

1/8" = 1'-0"

0 4" 8" 16"

GENERAL SHEET NOTES

A. REFER TO SHEET AI001 FOR GENERAL FINISH PLAN NOTES AND SYMBOLS.

B. ALL CORRIDORS TO RECEIVE WALL PROTECTION WP-02. INSTALL CAPS AROUND ALL PENETRATIONS.

C. ALL CORRIDOR ALCOVES TO RECEIVE WALL PROTECTION WP-03. INSTALL CAPS AROUND ALL PENETRATIONS.

D. FOR MATERIALS SEE INTERIOR MATERIALS LEGEND ON SHEET AF601 FOR INFORMATION.

E. ALL CORRIDORS CORNERS TO RECEIVE CORNER GUARDS.

SHEET KEYNOTES

K1 WP-04 INSIDE ROOM 234-01.

FINISH FLOOR LEGEND

TYPE	MARK	DESCRIPTION
	LVT-1	LUXURY VINYL TILE PATTERN 1
	LVT-2	LUXURY VINYL TILE PATTERN 2
	WSF-1	WELDED SHEET FLOORING
	WSF-2	WELDED SHEET FLOORING
	RES-3	RESINOUS FLOORING
	EPY-1	EPOXY FLOORING
	CG-1, OR CG-2	CORNER GUARD (NON-RATED), OR CORNER GUARD (FIRE-RATED) SEE DETAIL D3 / AE512 FOR INFORMATION.
	EG	END GUARD

SYMBOLS LEGEND

PROJECT LIMITS

NOT IN SCOPE
AREA OUTSIDE OF PROJECT LIMITS

PARTITION GRAPHICS

PARTITION PHASING

EXISTING ELEMENT TO REMAIN

EXISTING ELEMENT TO BE DEMOLISHED

TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

NO RATING

SMOKE RESISTIVE PARTITION - NON RATED


1 HOUR FIRE BARRIER

1 HOUR FIRE/SMOKE BARRIER

2 HOUR FIRE BARRIER

2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN



Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. CRAIG — REGISTERED ARCHITECT — 11080 — NORTH CAROLINA — CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE
CHARLOTTE, NC 28227
P 704.814.1320
F 704.321.0833

HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **PARTIAL WARD 2 SECOND FLOOR FINISH PLAN - PHASE 2**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Project Number: 564-17-140

Building Number: 1

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS


Date: MARCH 24, 2024 | Checked: TR | Drawn: MS

Drawing Number: **AF102**

Sheet 76 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs


BIM 360://18002 Fayetteville AR Renovate Med Surge Ward/18002 ARCH 2020.rvt

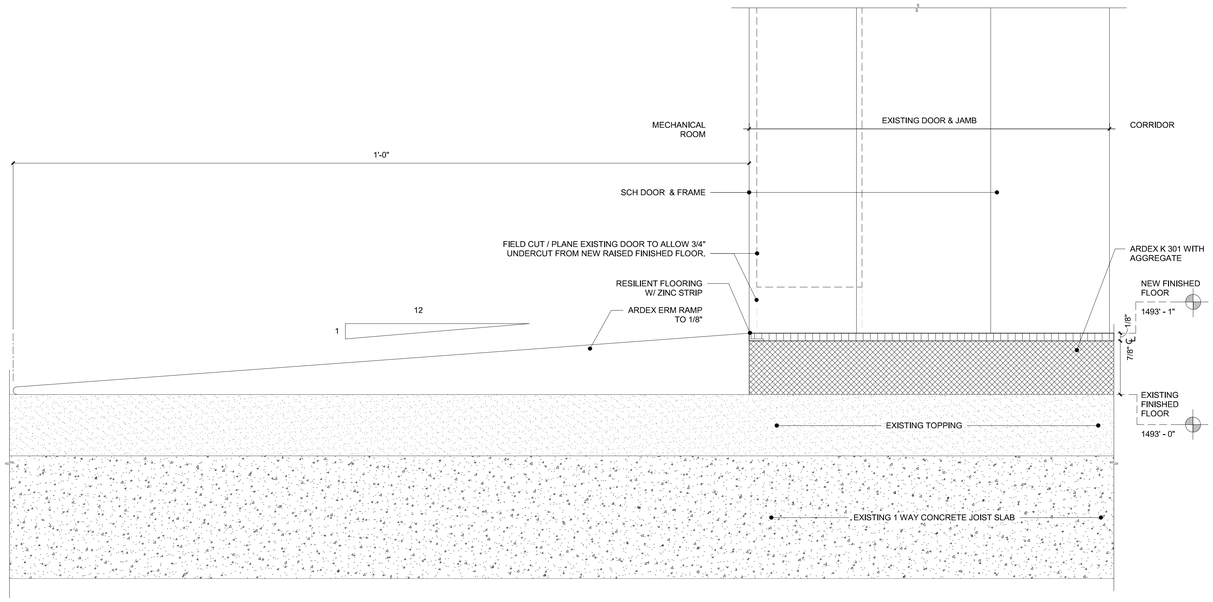

B1 MECH ROOM THRESHOLD DETAIL

12" = 1'-0"

0 1" 2"

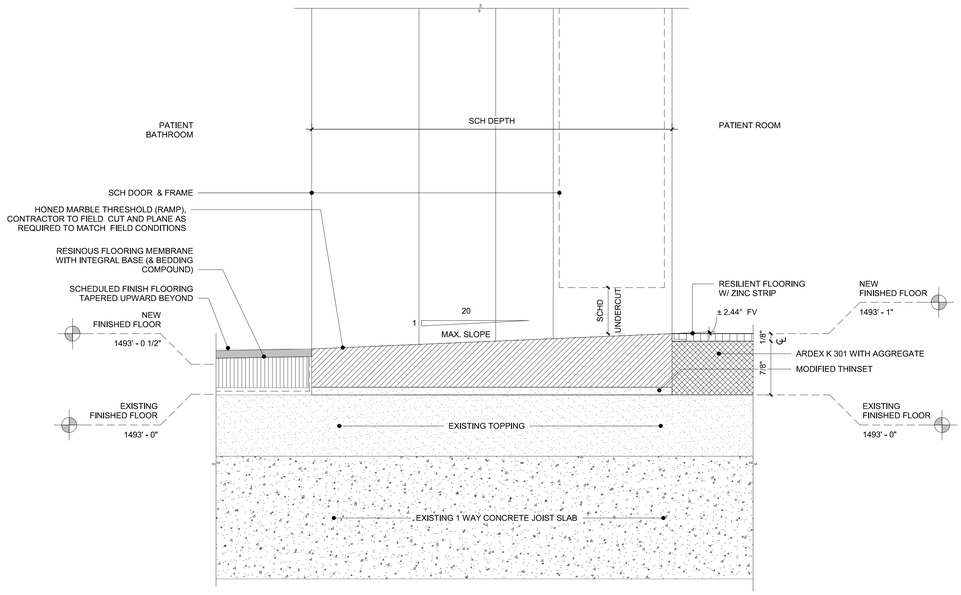


RESILIENT TO RESINOUS AT PATIENT BATHROOM DOOR


D1 BATHROOM THRESHOLD DETAIL AT RAISED FLOOR

12" = 1'-0"


0 1" 2"

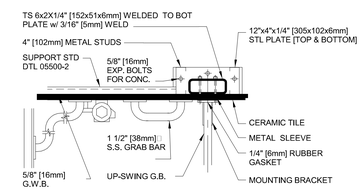


PLAN SHOWING THE STEEL TUBE & PLATE FOR ANCHORING THE UP-SWING GRAB BAR

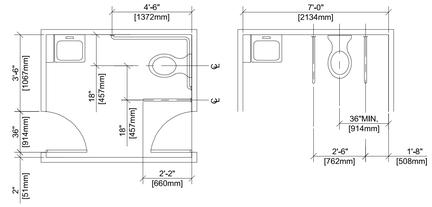

PLAN OF TOILET ROOM SHOWING RELATIONSHIP OF FIXTURES

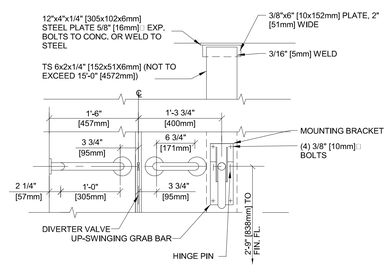

ELEVATION SHOWING POSITION OF UP-SWINGING GRAB BAR

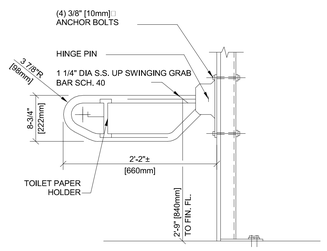


SIDE ELEVATION OF UP-SWINGING GRAB BAR


GENERAL NOTES:

1. INSTALLATION AS SHOWN IS FOR WATER CLOSET WITH DIVERTER VALVE.

B5 UP-SWING GRAB BAR

NOT TO SCALE

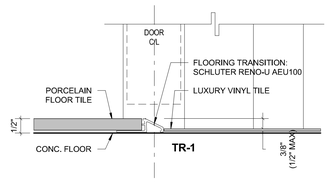

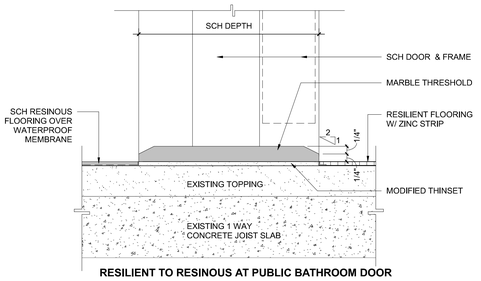

RESILIENT TO RESINOUS AT PUBLIC BATHROOM DOOR

D5 FLOORING TRANSITIONS

6" = 1'-0"

0 1" 2" 3" 4"

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC. consulting engineers

8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. OLIVER REGISTERED ARCHITECT 17080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •

8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833

HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **THRESHOLD DETAILS**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: TR | Drawn: MS

Project Number: 564-17-140

Building Number: 1


Drawing Number: **AF500**

Sheet 77 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs


INTERIOR SIGNAGE NOTES

1. SIGNAGE ELEVATION GRAPHICS ILLUSTRATE FAYETTEVILLE AR VHSO CAMPUS SIGNAGE STANDARDS AND ARE SHOWN FOR INFORMATION AND GENERAL CONFIGURATION PURPOSES. REFER TO LATEST EDITION OF FAYETTEVILLE AR VHSO CAMPUS SIGNAGE SIGNAGE DESIGN GUIDE FOR EXACT DIMENSIONS AND TYPOGRAPHY REQUIREMENTS BEFORE SUBMISSION OF SIGNAGE PACKAGE.
2. NOT ALL SIGN TYPES SHOWN ARE USED ON PROJECT.
3. A SIGN TYPE 'A' IS REQUIRED AT EACH INTERIOR DOOR OR CASED OPENING UON. REFER TO SIGN SCHEDULE FOR SIGNAGE TYPE AND WORDING REQUIRED AT SCHEDULED OPENINGS.
5. PROVIDE A TYPE FLAG AND 'I' SIGNS AT EACH FIRE EXTINGUISHER AND/OR AED CABINET LOCATION.
6. PROVIDE A TYPE FLAG AND "E" SIGN AT EACH TOILET ROOM ACCESSIBLE FROM A CORRIDOR.
7. REFER TO INTERIORS PLANS FOR SIGNAGE NOT AT OPENINGS SUCH AS DIRECTORIES.
8. CONTRACTOR MUST CONFORM SIGNAGE TO VA STATION'S INTERIOR DESIGN STANDARDS.
9. ALL TRIM IS BRUSHED ALUMINUM.

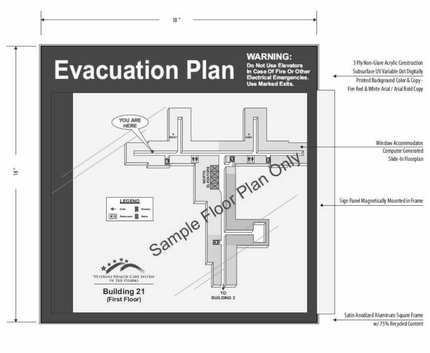


CREATIVE SIGNS MODEL NUMBER: V/W

DRAWING KEY: N




Q/W

M




O/W

L



CREATIVE SIGNS MODEL NUMBER

K



CAUTION OXIDIZING GASES STORED WITHIN NO SMOKING

NFPA 99 11.3.4.1 CMS K923


PER NFPA 80 2019 SECTION 4.1.4.1. MAX. AGGREGATE ALLOWABLE SIGNAGE (FIRE DOOR) CANNOT EXCEED 5%

TYPICAL DOOR LEAF 3' x 7' = 36" x 84" = 3,024 SQ.IN.

MAX. ALLOWED SIGN = 3,024 x .05 = 151.2 SQ. IN.

AREA OF SIGN ABOVE = 10" x 14" = 140 SQ.IN. < 151.2

O




CREATIVE SIGNS MODEL NUMBER

J



VA SIGN NUMBER IN-13
B.O. SIGN 7'-0" AFF

P




CREATIVE SIGNS MODEL NUMBER: G D/F RIGHT ANGLE

DRAWING KEY: I



CREATIVE SIGNS MODEL NUMBER

H



E/W - RACE SIGN

G




V4/W

F




G D/F RIGHT ANGLE

E




cD1A/W

D

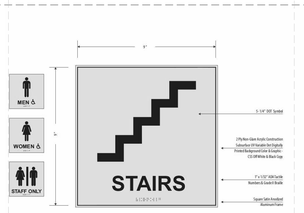


CREATIVE SIGNS MODEL NUMBER: SA/W

DRAWING KEY: C

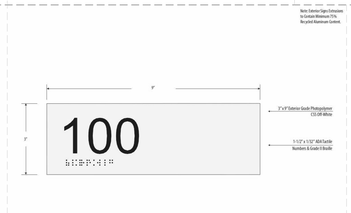

D1A-P

B

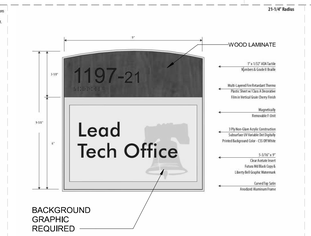


cD1A/F/W

A




CEILING DIRECTIONAL SIGN


D6

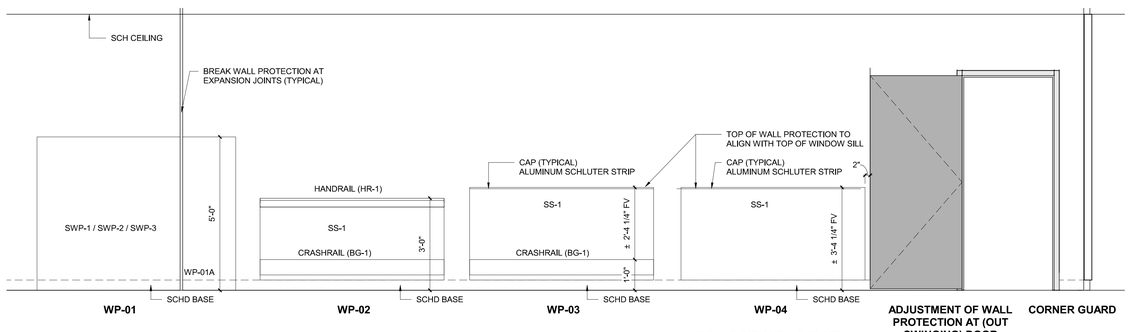

D1 WALL PROTECTION TYPES


1/2" = 1'-0"



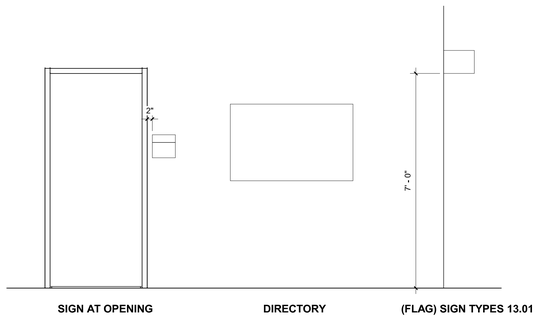


D4 SIGNAGE MOUNTING LEGEND

1/2" = 1'-0"



D5 TYPICAL INTERIOR SIGNAGE

3" = 1'-0"



GENERAL SHEET NOTES

NOTE: REFER TO ALL PHASING SHEETS. GENERAL CONTRACTOR SHALL ENSURE THAT ALL CONTRACTORS ARE RESPONSIBLE FOR COORDINATION ACROSS ENTIRE SET OF CONSTRUCTION DOCUMENTS.

A. ALL WORD SPACING SHALL BE EQUAL TO A LOWER CASE "v". COORDINATE NEW SIGN LOCATIONS WITH EXISTING SIGNS AND EQUIPMENT.

B. ALL SIGN TEXT AND SYMBOLS TO MATCH EXISTING (FAYETTEVILLE AR VHSO FACILITY CREATE SIGN VENDOR STYLE GUIDE).

C. PROVIDE A NEW ROOM NUMBER AND IDENTIFICATION SIGN AT EACH DOOR IN THE PROJECT AREA.

D. GENERAL CONTRACTOR TO SURVEY AND DOCUMENT ALL EXISTING SIGNAGE IT. PREPARE A SCHEDULE THAT DETAILS EXISTING AND NEW SIGNAGE. SUBMIT SCHEDULE TO ARCHITECT PRIOR TO REMOVING ANY SIGNAGE. GENERAL CONTRACTOR TO COORDINATE TEMPORARY IDENTIFICATION SIGNS WITH OWNER PRIOR TO REMOVING SIGNAGE OR INSTALLING TEMPORARY SIGNAGE.

E. FOR SIGNAGE LOCATIONS SEE QH100 SERIES SHEETS.

F. REUSE EXISTING SIGNAGE PREVIOUSLY STORED DURING DEMOLITION PHASE WITH NEW INSERTS (MODIFYING AS REQUIRED EXISTING SIGNAGE TO SUIT FAYETTEVILLE AR (VHSO FACILITY CREATE SIGN VENDOR STYLE GUIDE).

G. NEW SIGNAGE APPLIES ONLY TO SIGNS IN SCOPE AS SHOWN ON RELEVANT FLOOR PLANS.

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC. consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.
JONATHAN M. HARRELL REGISTERED ARCHITECT 17108 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE
CHARLOTTE, NC 28227
P 704.814.1320
F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **WALL PROTECTION / SIGNAGE TYPES**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: TR | Drawn: MS

Project Number: 564-17-140

Building Number: 1

Drawing Number: **AF501**

Sheet 78 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

BIM 360://18002 Fayetteville AR Renovate Med Surge Ward/18002 ARCH 2020.rvt

SIGNAGE SCHEDULE

SIGN TEXT	ROOM No.	SIGN TYPE	SIGN DESCRIPTION	COUNT
Phase 1 - 2B				
Patient Bedroom		A	IN-CREATIVE SIGN RM SGN (A)	1
Patient Bedroom	263-01	A	IN-CREATIVE SIGN RM SGN (A)	1
Patient Bedroom	265-01	A	IN-CREATIVE SIGN RM SGN (A)	1
Patient Bedroom	266-01	A	IN-CREATIVE SIGN RM SGN (A)	1
Patient Bedroom		A	IN-CREATIVE SIGN RM SGN (A)	5
See Detail on Sheet AF501		C	IN-CREATIVE SIGN RM SGN (C)	1
Storage - Cylinder Gas	251-01	A	IN-CREATIVE SIGN RM SGN (A)	1
Housekeeping Aides Closet	252-01	A	IN-CREATIVE SIGN RM SGN (A)	1
Medication Room	253-01	A	IN-CREATIVE SIGN RM SGN (A)	1
See Detail on Sheet AF501	253-01	G	IN-CREATIVE SIGN RM SGN (G)	1
Utility Room - Soiled	254-01	A	IN-CREATIVE SIGN RM SGN (A)	1
Linen Room - Clean	255-01	A	IN-CREATIVE SIGN RM SGN (A)	1
Utility Room - Clean	257-01	A	IN-CREATIVE SIGN RM SGN (A)	1
Nurse Workroom	258-01	A	IN-CREATIVE SIGN RM SGN (A)	1
See Detail on Sheet AF501	265A-01	G	IN-CREATIVE SIGN RM SGN (G)	1
Patient Bedroom	274-01	A	IN-CREATIVE SIGN RM SGN (A)	1
See Detail on Sheet AF501	C275-01	G	IN-CREATIVE SIGN RM SGN (G)	1
See Detail on Sheet AF501	M2-2	D	IN-CREATIVE SIGN RM SGN (D)	1
See Detail on Sheet AF501	M2-4	D	IN-CREATIVE SIGN RM SGN (D)	1
See Detail on Sheet AF501	T235-01	D	IN-CREATIVE SIGN RM SGN (D)	1
See Detail on Sheet AF501	T236-01	D	IN-CREATIVE SIGN RM SGN (D)	1
Phase 1 - 2B: 25				25
Phase 2				
See Detail on Sheet AF501	239-01	A	IN-CREATIVE SIGN RM SGN (A)	1
See Detail on Sheet AF501	229-01	C	IN-CREATIVE SIGN RM SGN (C)	1
Pantry Family	230-01	A	IN-CREATIVE SIGN RM SGN (A)	1
See Detail on Sheet AF501	232A-01	G	IN-CREATIVE SIGN RM SGN (G)	1
See Detail on Sheet AF501	239-01	A	IN-CREATIVE SIGN RM SGN (A)	1
Lactation Room	240-01	A	IN-CREATIVE SIGN RM SGN (A)	1
Patient Bedroom	241-01	A	IN-CREATIVE SIGN RM SGN (A)	1
Team Work	243-01	A	IN-CREATIVE SIGN RM SGN (A)	1
Office - Nurse Manager	244-01	A	IN-CREATIVE SIGN RM SGN (A)	1
Office - Head Physician	245-01	A	IN-CREATIVE SIGN RM SGN (A)	1
See Detail on Sheet AF501	245-01	G	IN-CREATIVE SIGN RM SGN (G)	1
Telemetry Monitoring	246-01	A	IN-CREATIVE SIGN RM SGN (A)	1
Storage - Emergency Management Service	247-01	A	IN-CREATIVE SIGN RM SGN (A)	1
Concierge Desk	248-01	A	IN-CREATIVE SIGN RM SGN (A)	1
See Detail on Sheet AF501	C233-01	J	IN-CREATIVE SIGN RM SGN (J)	1
See Detail on Sheet AF501	C242-01	G	IN-CREATIVE SIGN RM SGN (G)	1
See Detail on Sheet AF501	L04	H	IN-CREATIVE SIGN RM SGN (H)	1
See Detail on Sheet AF501	S202	F	IN-CREATIVE SIGN RM SGN (F)	1
Phase 2: 18				18
Grand total: 43				43

DEDUCT ALTERNATE #4C

GENERAL FINISH PLAN NOTES

1. BASE BID: ANTIMICROBIAL COPPER COATING HARDWARE, ELECTRICAL SWITCH PLATES, AND OUTLET PLATES WITH MATCHING FASTENERS. DEDUCT ALT.: 304 STAINLESS STEEL.
2. SLIP RESISTANT FLOORING IN SHOWER.
3. REFER TO AF501 FOR WALL PROTECTION DETAILS.
4. SEE AF602 AND FINISHES FLOOR PLANS FOR ADDITIONAL FINISHES INFORMATION.
5. WHERE NO WALL BASE HEIGHT IS STATED, INSTALL 4" HIGH BASE. TYPICAL BASE HEIGHT IS 4" HIGH, UNLESS NOTED OTHERWISE.

EXTERIOR MATERIAL TYPE LEGEND

MANUFACTURER	PATTERN / LINE	STYLE	SIZE	COLOR	FINISH	COMMENTS
NEW EXTERIOR WINDOW						
BASIS OF DESIGN: SIERRA PACIFIC	ENERGY SAVER DIRECT SET	MATCH EXISTING WINDOW STYLE AND HISTORIC METAL TRIM.	SEE WINDOW SCHEDULE SHEET AE602	MATCH EXISTING	MATCH EXISTING	
EXTERIOR DOOR HARDWARE						
				MATCH EXISTING	MATCH EXISTING	
EXTERIOR LOUVERS - SPEC SECTION 08 90 00						
	AS SPECIFIED	AS SPECIFIED	SEE PLANS	MATCH EXISTING	MATCH EXISTING	
GLAZING - SPEC SECTION 08 80 00						
				MATCH EXISTING TINT		
EXTERIOR METAL FABRICATIONS - SPEC SECTION 05 50 00						
PREMANUF. NOSING BOD: SAFE-T-NOSE		STNC3	STAIR WIDTH	ALUMINUM	CLEAR ANODIZED	
PAINT - SPEC SECTION 09 91 00						
EXTERIOR HANDRAILS/GUARDRAILS				BLACK POWDER-COATED (MATCH EXISTING)		GUARDRAIL, HANDRAIL, RAILINGS - PAINTED TO MATCH EXISTING
EXPOSED STRUC. STEEL				EXTERIOR ALKYD		COLUMNS, ANGLES, PLATES, ETC.
EXTERIOR CONCRETE - SPEC SECTION 32 05 23						
CONCRETE			SEE PLANS	---	BROOM FINISH	MATCH EXISTING

ROOM FINISHES - PHASE 1.

ROOM No.	NAME	APPROXIMATE FLOOR AREA	BASE FINISH	WALL FINISH	ACCENT WALL FINISH	CEILING FINISH	MILLWORK HORIZONTAL	MILLWORK VERTICAL	WALL PROTECTION	ELEC. & MECH. FIXTURE (MATERIAL)
PHASE 2										
259-01	ALCOVE XRAY	34 SF	RB	P-2, GWB		AT-1, GWB, PLAM-1 (SEE PLAN)			WP-02	
268-01	BARIATRIC PATIENT BEDROOM	288 SF	PRB h: 6"	P-5, GWB, HEADWALL (PLAM-1)	P-7	AT-1	SS-2		WP-04	
268A-01	BARIATRIC PATIENT TOILET	57 SF	RESB h: 4"	P-2 (SEE PLAN), PWT-1, PWT-2 (SEE ELEV.)	GT-1 / P-6	GWB (SC), P-1	SS-2		WP-04	
257-01	CLEAN UTILITY	147 SF	WSFB-2	P-2, GWB (SC)		AT(SP)			WP-01	
C237-01	CORRIDOR	71 SF	RB	P-2, GWB		AT-1, GWB, PLAM-1 (SEE PLAN)			WP-02	
C250-01	CORRIDOR	Redundant Room	RB	P-2, GWB		AT-1, GWB, PLAM-1 (SEE PLAN)			WP-02	
C256-01	CORRIDOR	141 SF	RB	P-2, GWB		AT-1, GWB, PLAM-1 (SEE PLAN)			WP-02	
C275-01	CORRIDOR	284 SF	RB	P-2, GWB		AT-1, GWB, PLAM-1 (SEE PLAN)			WP-02	
260-01	CRASH	6 SF	RB	P-2, GWB		AT-1, GWB, PLAM-1 (SEE PLAN)			WP-02	
E262-01	ELEC	79 SF	RB h: 4"	P-2						
252-01	HAC	1,098 SF	WSFB	P-2, GWB		AT(SP)			WP-01	
236-01	IT ROOM	122 SF	RB h: 4"	P-2						
255-01	LINEN	99 SF	WSFB-2	P-2, GWB (SC)		AT(SP)			WP-01	
253-01	MEDS	98 SF	RB h: 4"	P-2, GWB		AT-1	SS-3		WP-01	
271-01	NOUR	18 SF	PRB h: 6"	P-2	(@ BACKSPLASH) FT-2, FT-3, & FT-4 PATTERN. REFER TO DET. B3/AE408	AT-1 / GWB (SEE PLAN)	SS-3			
261-01	NURSE STA	286 SF	PRB h: 6"	P-2		AT-1, GWB, PLAM-1 (SEE PLAN)	SS-3		WP-04	
258-01	NURSE WORK	145 SF	RB h: 4"	P-2, GWB	P-7	AT-1	SS-3		WP-01	
263-01	PATIENT BEDROOM	252 SF	PRB h: 6"	P-5, GWB, HEADWALL (PLAM-1)	P-7	AT-1	SS-2		WP-04	
264-01	PATIENT BEDROOM	251 SF	PRB h: 6"	P-5, GWB, HEADWALL (PLAM-1)	P-7	AT-1	SS-2		WP-04	
265-01	PATIENT BEDROOM	250 SF	PRB h: 6"	P-5, GWB, HEADWALL (PLAM-1)	P-7	AT-1	SS-2		WP-04	
266-01	PATIENT BEDROOM	233 SF	PRB h: 6"	P-5, GWB, HEADWALL (PLAM-1)	P-7	AT-1	SS-2		WP-04	
269-01	PATIENT BEDROOM	249 SF	PRB h: 6"	P-5, GWB, HEADWALL (PLAM-1)	P-7	AT-1	SS-2		WP-04	
270-01	PATIENT BEDROOM	247 SF	PRB h: 6"	P-5, GWB, HEADWALL (PLAM-1)	P-7	AT-1	SS-2		WP-04	
272-01	PATIENT BEDROOM	222 SF	PRB h: 6"	P-5, GWB, HEADWALL (PLAM-1)	P-7	AT-1	SS-2		WP-04	
273-01	PATIENT BEDROOM	269 SF	PRB h: 6"	P-5, GWB, HEADWALL (PLAM-1)	P-7	AT-1	SS-2		WP-04	
274-01	PATIENT BEDROOM	278 SF	PRB h: 6"	P-5, GWB, HEADWALL (PLAM-1)	P-7	AT-1	SS-2		WP-04	
254-01	SOILED	108 SF	WSFB	P-2, GWB		AT(SP)	SS-3		WP-01 (FULL HT.)	
235-01	SPECIAL SYSTEMS BIOMED	104 SF	RB h: 4"	P-2						
251-01	STORAGE	322 SF	WSFB	P-2, GWB		AT(SP)			WP-01	
263A-01	TOILET	54 SF	RESB h: 4"	P-2 (SEE PLAN), PWT-1, PWT-2 (SEE ELEV.)	GT-1 / P-6	GWB (SC), P-1	SS-2		WP-04	
264A-01	TOILET	54 SF	RESB h: 4"	P-2 (SEE PLAN), PWT-1, PWT-2 (SEE ELEV.)	GT-1 / P-6	GWB (SC), P-1	SS-2		WP-04	
265A-01	TOILET	55 SF	RESB h: 4"	P-2 (SEE PLAN), PWT-1, PWT-2 (SEE ELEV.)	GT-1 / P-6	GWB (SC), P-1	SS-2		WP-04	
266A-01	TOILET	54 SF	RESB h: 4"	P-2 (SEE PLAN), PWT-1, PWT-2 (SEE ELEV.)	GT-1 / P-6	GWB (SC), P-1	SS-2		WP-04	
269A-01	TOILET	58 SF	RESB h: 4"	P-2 (SEE PLAN), PWT-1, PWT-2 (SEE ELEV.)	GT-1 / P-6	GWB (SC), P-1	SS-2		WP-04	
270A-01	TOILET	58 SF	RESB h: 4"	P-2 (SEE PLAN), PWT-1, PWT-2 (SEE ELEV.)	GT-1 / P-6	GWB (SC), P-1	SS-2		WP-04	
272A-01	TOILET	54 SF	RESB h: 4"	P-2 (SEE PLAN), PWT-1, PWT-2 (SEE ELEV.)	GT-1 / P-6	GWB (SC), P-1	SS-2		WP-04	
273A-01	TOILET	53 SF	RESB h: 4"	P-2 (SEE PLAN), PWT-1, PWT-2 (SEE ELEV.)	GT-1 / P-6	GWB (SC), P-1	SS-2		WP-04	
274A-01	TOILET	87 SF	RESB h: 4"	P-2 (SEE PLAN), PWT-1, PWT-2 (SEE ELEV.)	GT-1 / P-6	GWB (SC), P-1	SS-2		WP-04	

ROOM FINISHES - PHASE 2.

ROOM No.	NAME	APPROXIMATE FLOOR AREA	BASE FINISH	WALL FINISH	ACCENT WALL FINISH	CEILING FINISH	MILLWORK HORIZONTAL	MILLWORK VERTICAL	WALL PROTECTION	ELEC. & MECH. FIXTURE (MATERIAL)
PHASE 2										
238-01	ALCOVE	17 SF	RB	P-2, GWB		AT-1, GWB, PLAM-1 (SEE PLAN)			WP-02	
234-01	ALCOVE WH	15 SF	RB	P-2, GWB		AT-1, GWB, PLAM-1 (SEE PLAN)			WP-02	
228-01	CONSULT	177 SF	RB h: 4"	P-2, GWB	P-7	AT-1	SS-3		WP-01	
C233-01	CORRIDOR	Redundant Room	RB	P-2, GWB		AT-1, GWB, PLAM-1 (SEE PLAN)			WP-02	
C242-01	CORRIDOR	678 SF	RB	P-2, GWB		AT-1, GWB, PLAM-1 (SEE PLAN)			WP-02	
247-01	EMS STORAGE	100 SF	RB h: 4"	P-2, GWB		AT-1			WP-01	
240-01	LACTATION	79 SF	PRB h: 6"	P-2, GWB		AT-1				
245-01	OFFICE HEAD PHYS	107 SF	RB h: 4"	P-2, GWB	P-7	AT-1	SS-3		WP-01	
244-01	OFFICE NURSE MAN	98 SF	RB h: 4"	P-2, GWB	P-7	AT-1	SS-3		WP-01	
230-01	PANTRY	21 SF	PRB h: 6"	P-2	(@ BACKSPLASH) FT-2, FT-3, & FT-4 PATTERN. REFER TO DET. B3/AE408	AT-1 / GWB (SEE PLAN)	SS-3			
233A-01	PATIENT ED KIOSK	33 SF	PRB h: 6"	P-2		AT-1, GWB, PLAM-1 (SEE PLAN)	SS-3		WP-04	
233B-01	PATIENT ED KIOSK	27 SF	PRB h: 6"	P-2		AT-1, GWB, PLAM-1 (SEE PLAN)	SS-3		WP-04	
241-01	TEAMWORK	312 SF	RB h: 4"	P-2, GWB	P-7	AT-1	SS-3		WP-01	
243-01	TEAMWORK	310 SF	RB h: 4"	P-2, GWB	P-7	AT-1	SS-3		WP-01	
246-01	TELEMETRY	103 SF	RB h: 4"	P-2, GWB		AT-1			WP-01	
229-01	TOILET FAM	82 SF	RESB h: 4"	P-2 (SEE PLAN), PWT-1, PWT-2 (SEE ELEV.)	GT-1 / P-6	GWB (SC), P-1	SS-2		WP-04	
239-01	TOILET STAFF	59 SF	RESB h: 4"	P-2 (SEE PLAN), PWT-1, PWT-2 (SEE ELEV.)	GT-1 / P-6	GWB (SC), P-1	SS-2		WP-04	
232-01	WAITING	804 SF	PRB h: 6"	P-2	W-1	AT-1, PLAM-1 (SEE PLAN)			WP-04 / WP-02	
232A-01	WAITING	122 SF	PRB h: 6"	P-2	W-1	AT-1, PLAM-1 (SEE PLAN)			WP-04 / WP-02	
276-01	WAITING	76 SF	PRB h: 6"	P-2	W-1	AT-1, PLAM-1 (SEE PLAN)			WP-04 / WP-02	

ROOM FINISHES - OTHER FLOORS

ROOM No.	NAME	Area	ROOM FINISH KEY	BASE FINISH	WALL FINISH	ACCENT WALL FINISH	CEILING FINISH	MILLWORK HORIZONTAL	MILLWORK VERTICAL	WALL PROTECTION	ELEC. & MECH. FIXTURE (MATERIAL)
305A	CORRIDOR	54 SF	F-10	RB	P-2, GWB		AT-1, GWB, PLAM-1 (SEE PLAN)			WP-02	
039-01	OFFICE	133 SF	F-5	RB h: 4"	P-2, GWB	P-7	AT-1	SS-3		WP-01	
MB05-01	MECH	212 SF	EPY-01	RB h: 4"	MATCH EXISTING		FOG PAINT				

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC. consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. OAKS REGISTERED ARCHITECT 11080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: INTERIOR FINISH SCHEDULE AND SIGNAGE SCHEDULE

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: RENOVATE MED SURGE WARDS

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: TR | Drawn: MS

Project Number: 564-17-140

Building Number: 1

Drawing Number: AF601

Sheet 79 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

INTERIOR MATERIAL TYPE LEGEND

MARK	MANUFACTURER	PATTERN / LINE	STYLE	SIZE	COLOR	FINISH	COMMENTS
EXTERIOR 2							
PAINT - SPEC SECTION 09 91 00							
P-3	SHERWIN-WILLIAMS				BLACK POWDER-COATED (MATCH EXISTING)		GUARDRAIL, HANDRAIL, RAILINGS - PAINTED TO MATCH EXISTING
FLOORING							
PAINT - SPEC SECTION 09 91 00							
EPY-01	SHERWIN-WILLIAMS	SEALED CONCRETE				GLOSS 6	PRO INDUSTRIAL HIGH-PERFORMANCE EPOXY
P-3	SHERWIN-WILLIAMS				BLACK POWDER-COATED (MATCH EXISTING)		GUARDRAIL, HANDRAIL, RAILINGS - PAINTED TO MATCH EXISTING
RESILIENT SHEET FLOORING - SPEC SECTION 09 65 16							
WSF-1	MANNINGTON	REALITIES BOARDWALK		ROLL SIZE: 6' - 30 - 50 SQ YDS PER ROLL THICKNESS: 0.080" (2mm)	HONEYTONE / 5664		ISOLATION PATIENT ROOMS
WSF-2	MANNINGTON	BIOSPEC MD		ROLL SIZE: 6'6" - 30 - 73 SQ YDS PER ROL THICKNESS: 0.080" (2mm)	BUTTERMILK 15360		STORAGE, MEDS, CLEAN UTILITY
RESILIENT TILE FLOORING - SPEC SECTION 09 65 19							
LVT-1	TARKETT	CONTOUR - MODERN WOOD		6" x 48" x 3mm	NEWBORN 0361		
LVT-2	TARKETT	LEGACY STONE		18" x 18" x 3mm	ARCADIAN PILAR 0541		
RESINOUS FLOORING / INTEGRAL BASE - SPEC SECTION 09 67 23.50							
RES-3	STONHARD	STONSHIELD HRI			MALT	STONSET TG5 (TROWEL-ABLE EPOXY MORTAR), STONPROOF ME7 - WATERPROOF MEMBRANE	SLOPE TO DRAIN, SEE DRAWINGS FOR INFORMATION. INCLUDES RESB-1 INETGRAL COVE BASE, SEE DRAWINGS.
BASE							
PAINT - SPEC SECTION 09 91 00							
P-3	SHERWIN-WILLIAMS				BLACK POWDER-COATED (MATCH EXISTING)		GUARDRAIL, HANDRAIL, RAILINGS - PAINTED TO MATCH EXISTING
PROFILE RUBBER BASE - SPEC SECTION 09 65 13							
PRB	TARKETT	MW-45-F6		REVEAL 6" HIGH	45 SANDALWOOD		PUBLIC PATIENT LOCATIONS
RRESINOUS FLOORING / INTEGRAL BASE - SPEC SECTION 09 67 23.50							
RESB-2	STONHARD	STONSHIELD HRI			MALT	STONSET TG5 (TROWEL-ABLE EPOXY MORTAR), STONPROOF ME7 - WATERPROOF MEMBRANE	INTEGRAL BASE HEIGHT VARIES 4" @ H.P.
RUBBER BASE - SPEC SECTION 09 65 13							
RB-1	TARKETT	TDCR-31		4.5" HIGH	ZEPHYR / 31		UTILITY LOCATIONS
WALLS							
CERAMIC TILE / PORCELAIN TILE - SPEC SECTION 09 30 13							
FT-2	AMERICAN OLEAN	UNGLAZED MOSAICS		1" x 2" x 1/4"	OCEAN TIDE / 0A60		BACKSPLASH AT NOURISHMENT.
FT-3	AMERICAN OLEAN	UNGLAZED MOSAICS		1" x 2" x 1/4"	GLACIER / 0A62		BACKSPLASH AT NOURISHMENT.
FT-4	AMERICAN OLEAN	UNGLAZED MOSAICS		1" x 2" x 1/4"	ICE WHITE / 0A25		BACKSPLASH AT NOURISHMENT.
GT-1	AMERICAN GLASS	SURF		1" x 1"			ACCENT TILE AT BATHROOM RECESS / ALCOVE BEHIND SINK & MIRROR.
PT-1	CROSSVILLE	MAIN STREET / AV211		12" x 12" x 3/8"	CINEMA CHAMPAGNE	UPS FINISH	DECORATIVE WALLS
PT-2	CROSSVILLE	MAIN STREET / AV211		2" x 2" x 3/8" MOSAIC	CINEMA CHAMPAGNE	UPS FINISH	DECORATIVE WALLS
PWT-1	TRINITY TILE	DUNES		12" x 24"	BEIGE FIELD TILE	MATTE FINISH	WALL FIELD TILE BOTTOM
PWT-2	TRINITY TILE	DUNES		6" x 24"	BEIGE FIELD TILE	MATTE FINISH	WALL FIELD TILE BOTTOM
PWT-3	TRINITY TILE	DUNES		3" x 24"	BEIGE FIELD TILE	MATTE FINISH	WALL BULLNOSE TRIM / PUBLIC TOILET
PAINT - SPEC SECTION 09 91 00							
P-2	SHERWIN-WILLIAMS				ARCADE WHITE / SW7100	5 SEMI-GLOSS, CLEANABLE	
P-3	SHERWIN-WILLIAMS				BLACK POWDER-COATED (MATCH EXISTING)		GUARDRAIL, HANDRAIL, RAILINGS - PAINTED TO MATCH EXISTING
ACCENT WALLS							
PAINT - SPEC SECTION 09 91 00							
P-3	SHERWIN-WILLIAMS				BLACK POWDER-COATED (MATCH EXISTING)		GUARDRAIL, HANDRAIL, RAILINGS - PAINTED TO MATCH EXISTING
P-5	SHERWIN-WILLIAMS				CRISP LINEN SW6378	5 SEMI-GLOSS, CLEANABLE	ACCENT WALL
P-6	SHERWIN-WILLIAMS				SOAR SW6799	5 SEMI-GLOSS, CLEANABLE	ACCENT WALL
P-7	SHERWIN-WILLIAMS				MOODY BLUE / SW6221	5 SEMI-GLOSS, CLEANABLE	ACCENT WALL
CEILINGS							
ACOUSTICAL CEILING TILE AND GRID - SPEC SECTION 09 51 00							
AT(SP)	USG	MARS™ HEALTHCARE CLEAN ROOM PANELS 75/35 (NRC/CAC)	86169CR	24" x 24" x 3/4"	WHITE	15/16" DONN CE GASKETED GRID IN WHITE	GRID PROFILE OPTION "O"
AT-1	USG	MARS™ HEATHCARE HIGH-CAC ACOUSTICAL PANELS 60/40 (NRC/CAC)	86272	24" x 24" x 3/4"	WHITE	15/16" DONN DX GRID IN WHITE	BASE BID: PROFILE: SHADOWLINE TAPERED
AT-2	USG	MARS™ HEATHCARE HIGH-CAC ACOUSTICAL PANELS 60/40 (NRC/CAC)	86270	24" x 24" x 3/4"	WHITE	15/16" DONN DX GRID IN WHITE	ALTERNATE: PROFILE: SQUARE EDGE
PAINT - SPEC SECTION 09 91 00							
P-1	SHERWIN-WILLIAMS				ARCADE WHITE / SW7100	1 MATTE	CEILINGS
P-3	SHERWIN-WILLIAMS				BLACK POWDER-COATED (MATCH EXISTING)		GUARDRAIL, HANDRAIL, RAILINGS - PAINTED TO MATCH EXISTING
HORIZONTAL MILLWORK							
FINISHED CARPENTRY- SPEC SECTION 06 20 00							
CHR-1	SPECTRIM BP	TCR-351		5"		ANIGRE #02	CONFERENCE ROOM
PAINT - SPEC SECTION 09 91 00							
P-3	SHERWIN-WILLIAMS				BLACK POWDER-COATED (MATCH EXISTING)		GUARDRAIL, HANDRAIL, RAILINGS - PAINTED TO MATCH EXISTING
SOLID SURFACE - SPEC SECTION 12 36 00							
SS-2	CORIAN				GRANOLA		COUNTERTOPS IN PATIENT ROOM MILLWORK & WINDOW SILLS
SS-3	LG HI MACS	HI MACS MARMO			HAZE M308		COUNTERTOPS UON
VERTICAL MILLWORK							
GLAZING - SPEC SECTION 08 80 00							
SPF-1	VARIA ECO RESIN			1/2" GAUGE	GINGKO THATCH	SANDSTONE	WAITING AREA - VERTICAL PANELS (SCREEN)
PLASTIC LAMINATE - SPEC SECTION 06 20 00							
PLAM-1	WILSONART	AEON			ASIAN SAND / 7952K-18	07 TEXTURED GLOSS	MILLWORK (NURSE'S STA., & ABA APRON, ETC.)
PLAM-2	WILSONART	AEON			FUSION MAPLE 7909	07 TEXTURED GLOSS	CEILINGS, BULKHEADS, & CORRIDOR PILASTERS.
PLASTIC LAMINATE - SPEC SECTION 12 32 00							
PLAM-1	WILSONART	AEON			ASIAN SAND / 7952K-18	07 TEXTURED GLOSS	MANUF. CABINETRY
WALL PROTECTION							
PAINT - SPEC SECTION 09 91 00							
P-3	SHERWIN-WILLIAMS				BLACK POWDER-COATED (MATCH EXISTING)		GUARDRAIL, HANDRAIL, RAILINGS - PAINTED TO MATCH EXISTING
VERTICAL WALL PROTECTION - SPEC SECTION 12 36 00							
SS-1	DUPONT	CORIAN	1/4" FOR VERTICAL APPLICATION		CANVAS		
VINYL-COATED FABRIC WALL COVERING - SPEC SECTION 09 72 16							
W-1	COLOUR AND DESIGN	BOKA / CD2-BKA-07		54" / 30 LINEAL YARD ROLLS	PONGEE		WAITING AREA ACCENT
W-2	COLOUR AND DESIGN	SILK ROAD / BBSR10		54" WIDTH	PORCELAIN / 4798		WALL COVERING CONFERENCE ROOM
W-3	COLOUR AND DESIGN	SILK ROAD / BBSR01		54" WIDTH	CLEAR SKIES / 4798		ACCENT WALL COVERING CONFERENCE ROOM
WALL PROTECTION CORNER GUARDS - SPEC SECTION 10 26 00							
CG-1	CS ACROVYN	SFS-20		FULL HEIGHT 2" (WIDTH)	CHAMPAGNE #186		FLUSH MOUNTED
CG-2	CS ACROVYN	FSC-25N		FULL HEIGHT (VARIES)	CHAMPAGNE #186		FLUSH MOUNTED END GUARD
WALL PROTECTION CRASH RAILS - SPEC SECTION 10 26 00							
BG-1	C-S GROUP	ACROVYN WALL PROTECTION CRASH RAIL WITH CONTINUOUS ALUMINUM RETAINER	SCR-50N	5" TALL	CHAMPAGNE #186		CRASH RAIL END CAP & OURSIDE CORNER (AS NEEDED)
WALL PROTECTION HANDRAILS - SPEC SECTION 10 26 00							
HR-1	SPECTRIM BP		HR-810	51/2" TALL	ANIGRE #02		HANDRAIL END CAP & OURSIDE CORNER (AS NEEDED)
WALL PROTECTION WALLCOVERING - SPEC SECTION 10 26 00							
SWP-1	C-S GROUP	ACROVYN HIGH IMPACT WALLCOVERING		.040" THICK	933 MISSION WHITE	SUEDE TEXTURE	
SWP-2	C-S GROUP	ACROVYN HIGH IMPACT WALLCOVERING		.040" THICK	933 MISSION WHITE	SUEDE TEXTURE	
SWP-3	C-S GROUP	ACROVYN HIGH IMPACT WALLCOVERING		.040" THICK	933 MISSION WHITE		
WINDOW SHADES							
WINDOW SHADES - SPEC SECTION 12 24 00							
RS-1	MECO SHADE	EUROVEIL			5314 TRAVERTINE		BASKET WEAVE 5300 SERIES (5% OPEN)
RS-2	MECO SHADE	EQUINOX BLACKOUT			0104 SANDSTONE		SHADE CLOTH - BLACKOUT 0100 SERIES (OPAQUE)
MISCELLANEOUS FINISHES							
STRUCT	EXPOSED STRUCTURE				FOG		EXPOSED STRUCTURE
DOOR FINISHES - SPEC SECTION 08 14 00							
DWD-01			QUARTER SAWN WHITE OAK		FACTORY POLYURETHANE CLEAR FINISH		TYPICAL WOOD DOOR VENEER SPECIED UON. ORIENT GRAIN VERTICALLY.
GROUT FOR CERAMIC TILE / PORCELAIN TILE - SPEC SECTION 09 30 13							
G-1	TEC	ACCUCOLOR EFX EPOXY			STANDARD WHITE 931		
HOLLOW METAL DOOR AND FRAME FINISHES - SPEC SECTION 08 11 13							
DHM-01	SHERWIN-WILLIAMS				SW 6385 DOVER WHITE GLOSS		HOLLOW METAL DOORS & FRAMES
PAINT - SPEC SECTION 09 91 00							
P-3	SHERWIN-WILLIAMS				ARCADE WHITE / SW7100	5 SEMI-GLOSS	DOORS TYP. UON
P-4	SHERWIN-WILLIAMS				ARCADE WHITE / SW7100	5 SEMI-GLOSS	DOORS / WINDOW FRAMES TYP. UON

DEDUCT ALTERNATE #4B

DEDUCT ALTERNATE #4B

GENERAL SHEET NOTES

A. REFER TO A#001, INTERIOR ELEVATION SHEETS AE405 & AE409 AND FINISH PLAN AF100 SERIES FOR ADDITIONAL NOTES.

B. PROVIDE MANUFACTURER'S TYPICAL TRIM, TRANSITION AND FINISHING ACCESSORIES UNO ON DRAWINGS. EDGES AND JOINTS SHALL BE FINISHED SMOOTH AND TO MANUFACTURER'S INSTRUCTIONS.

C. CONTRACTOR TO FURNISH ALL MATERIALS AS PER BRAND NAME OR EQUAL.

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC. consulting engineers

8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. CLARK 151080 REGISTERED ARCHITECT CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •

8016 TOWER POINT DRIVE
CHARLOTTE, NC 28227

P 704.814.1320
F 704.321.0833

HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **INTERIOR MATERIALS LEGEND**

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: **RENOVATE MED SURGE WARDS**

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: TR | Drawn: MS

Project Number: 564-17-140

Building Number: 1


Drawing Number: **AF602**


Sheet 80 of 162


Engineering Service

VETERANS HEALTH CARE SYSTEM OF THE OZARKS

VA U.S. Department of Veterans Affairs

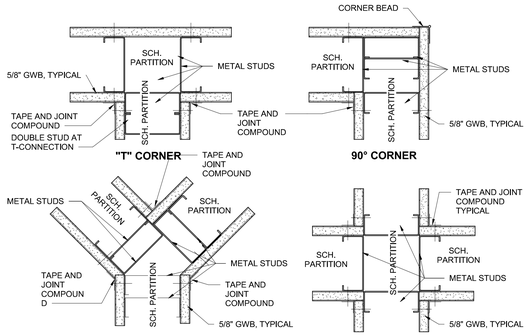

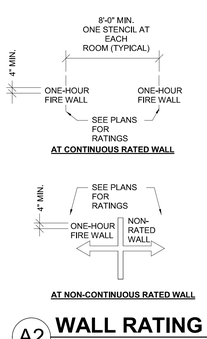



A2 WALL RATING LABELING


NOT TO SCALE

B1 PARTITION FRAMING DETAILS

3" = 1'-0"


PARTITION PRIORITIES (HIGHEST TO LOWEST):

1. 4-HOUR
2. 2-HOUR FIRE/SMOKE
3. 2-HOUR FIRE
4. 1-HOUR FIRE/SMOKE
5. 1-HOUR FIRE
6. NON-RATED SMOKE
7. NON-RATED

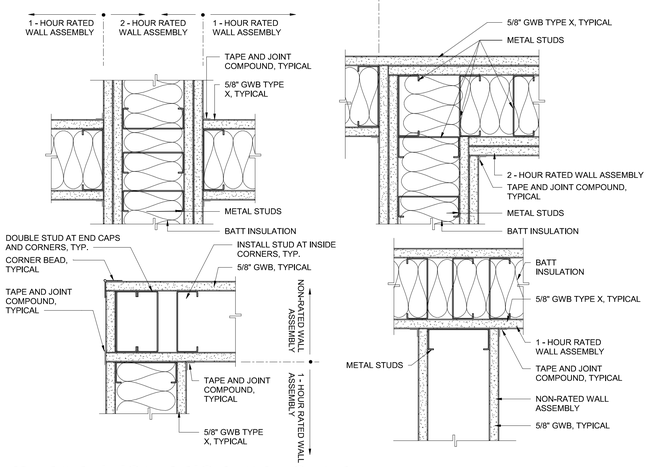



C1 PARTITION PRIORTY LEGEND

3" = 1'-0"

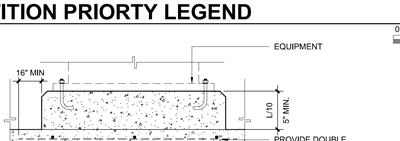


SECTION A-A (PAD POURED WITH SLAB)



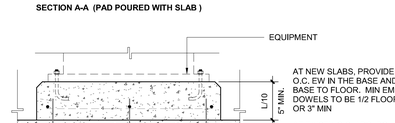

SECTION A-A (PAD NOT POURED WITH SLAB)




NOTES:

1. L & W TO BE 6" GREATER THAN THE EQUIPMENT MOUNTING PLATE / FOOTPRINT
2. PROVIDE 3/4" CHAMFER AROUND ENTIRE UPPER EDGE
3. PAINT ENTIRE PAD SAFETY YELLOW

VA STANDARD DETAIL SD230541-03

D1 EQUIPMENT PAD

1 1/2" = 1'-0"

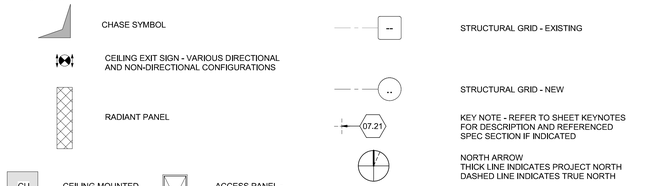

PARTITION GRAPHICS - PHASING

- EXISTING PARTITION / BARRIER / WALL TO REMAIN
- EXISTING PARTITION / BARRIER / WALL TO BE REMOVED
- NEW PARTITION / BARRIER / WALL
- TEMPORARY PARTITION

PARTITION GRAPHICS - RATINGS

- NO RATING
- NON-RATED CMU
- SMOKE-RESISTIVE PARTITION - NON RATED
- 1 HOUR FIRE BARRIER
- 1 HOUR FIRE/SMOKE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE BARRIER

D2 STANDARD SYMBOLS

1/4" = 1'-0"

GENERAL FLOOR PLAN NOTES

1. REFER TO SHEET GI001 FOR REQUIRED COORDINATION NOTES.
2. REFER TO SHEET GI501 FOR PARTITION TYPES, LEGENDS AND NOTES.
3. REFER TO SHEETS GI100 SERIES FOR PROJECT-WIDE LIFE SAFETY SCOPE OF RATED WALLS, BARRIERS, SMOKE RESISTENT PARTITIONS, SUITE DESIGNATIONS, EGRESS AND EXIT DISCHARGE INFORMATION.
4. REFER TO QH102 - QH106 FOR ENLARGED FLOOR PLANS AND AE410 & AE411 FOR 3D VIEWS INCLUDING MEDICAL EQUIPMENT NOT SHOWN IN AE100 SERIES PLANS.
5. DIMENSIONS ARE TO FINISH FACE OF WALL OR SOFFIT AND TO COLUMN CENTERLINE UON.
6. PROVIDE 3" GROMMETS 48" O.C. IN ALL COUNTERTOPS ABOVE OPEN KNEE SPACE. CENTER ON OUTLETS BELOW.
7. PARTITION TYPES AS NOTED BY THE SYMBOL CONTINUE BETWEEN ROOM/SPACE CORNERS OR ANY INTERSECTING PARTITION.
8. DIFFERING PARTITION TYPES SHALL ALIGN SO THAT WALL PLANES CONTINUE UNBROKEN WITHIN/ACROSS ROOMS AND/OR SPACES.
9. REFER TO SHEETS AE601 - AE602 FOR DOOR SCHEDULE & WINDOW TYPES.
10. DISTANCE FROM HINGE SIDE OF DOOR TO INTERSECTING STUD WALL SHALL BE 4" UNLESS NOTED OR DETAILED OTHERWISE (MEASURED FROM OUTSIDE OF FRAME)
11. CONTRACTOR SHALL VERIFY ALL DIMENSIONS NOTED AS "CLR", "CLEAR" OR "MIN". DIMENSIONS NOTED AS "HOLD" ARE CRITICAL TO COORDINATE OTHER WORK (E.G. CEILING GRIDS, LIGHTING, FINISHES).
12. CONTRACTOR SHALL VERIFY ALL DIMENSIONS PRIOR TO INITIATING CONSTRUCTION AND REPORT DISCREPANCIES TO COR PRIOR TO COMMENCING WORK.
13. CONTRACTOR SHALL PROVIDE ALL BLOCKING REQUIRED TO ANCHOR ALL WALL AND CLG MOUNTED ITEMS, INCLUDING BUT NOT LIMITED TO EQUIPMENT BLOCKING REQUIREMENT SCHEDULE ON SHEET QH601.
14. FIRE STOPPING SYSTEMS – REFER TO SPEC SECTION 07 84 00 FOR INFO REGARDING PENETRATIONS OF ALL RATED ASSEMBLIES (BOTH SINGLE AND DOUBLE MEMBRANE PENETRATIONS) INCLUDING BUT NOT LIMITED TO PENETRATIONS FOR DUCTWORK, CONDUIT, PIPING AND SUPPORT FOR WALL MOUNTED EQUIPMENT, CABINETS AND COUNTERTOPS.
15. IN SPACES WITH FLOOR DRAINS, SLOPE FLOORS TO DRAINS UON.

REFLECTED CEILING NOTES

1. CEILING HEIGHTS TO BE 8'-0" UON.
2. DIMENSIONS ARE TO FINISH FACE OF WALL OR SOFFIT UON.
3. RATED WALLS: ARE INDICATED IN PLAN AND RCP WITH GRAPHIC DENOTING HOURLY RATING AND/OR RESISTANT TO PASSAGE OF SMOKE. REFER TO PARTITION TAGS ON FLOOR PLAN SHEETS AE050 - AE109 AND PARTITION SCHEDULE ON SHEET GI501 FOR MORE INFORMATION.
4. GYPSUM BOARD SOFFITS: HEIGHT AFF TO MATCH ADJACENT CEILING OR TOP OF CASEWORK UON ON RCP.
5. CEILING MATERIAL TRANSITIONS, FLUSH AND NON-FLUSH CONDITIONS: REFER TO STANDARD DETAILS.
6. CEILING FINISHES/MATERIALS ARE NOTED ON FINISH SCHEDULE.
7. ACOUSTIC TILE CEILINGS TO BE CENTERED IN BOTH DIRECTIONS IN ROOM TYP. UON OR DIMENSIONED OTHERWISE. IF DIMENSION IS PROVIDED IN ONE DIRECTION ONLY, ASSUME GRID IS CENTERED IN OTHER DIRECTION.
8. CUT TILES SHALL BE NO SMALLER THAN 6 INCHES IN ANY DIRECTION. CLG FINISHES/MATLS NOTED ON TYPICALS FINISH SCHEDULE.
9. PLASTIC LAMINATE (PLAM) CLOSURE PANELS (IN LIEU OF GYP SOFFITS) OVER CASEWORK - SEE INT ELEV SERIES DWGS., REFLECTED CEILING PLAN SHEETS AE120-AE123, AND AE512 DETAILS.
10. CENTER LIGHT FIXTURE AND OTHER CEILING DEVICES WITHIN ACOUSTIC TILE UON. IF ONLY DIMENSIONED IN ONE DIRECTION, ASSUME DEVICE IS CENTERED IN THE OTHER DIRECTION.
11. EXIT SIGNAGE/LIGHTING SHOWN ON ELECTRICAL LIGHTING DRAWINGS.
12. SPRINKLER HEADS, SMOKE DETECTORS, NURSE CALL DEVICES, OTHER MISC ELECTRICAL DEVICES ARE SHOWN & DIMENSIONED ON ARCHITECTURAL RCPS FOR PUBLIC AREAS TYPICALLY, FOR ABOVE NAMED ITEMS NOT SHOWN, ORGANIZE DEVICES IN CENTER OF TILE OF SUSPENDED CLGS & ALIGN MULTIPLE DEVICES DOWN CORRIDORS AND THROUGHOUT LARGE ROOMS. COORD W/ OTHER TRADE'S DEVICES.
13. COORDINATE TOILET COMPARTMENT STEEL SUPPORTS WITH CEILING HEIGHTS.

GENERAL INTERIORS NOTES

1. REFER SHEET GI002 FOR GRAPHIC LEGEND OF WALL DEVICES AND TYPICAL MOUNTING HEIGHT UON.
2. REFER TO SHEETS AF501, AF601, AF602, & AE512 FOR WALL PROTECTION, & CORNER GUARDS (ELEVATIONS, TYPES, DETAILS, LOCATION, AND DEFINITIONS).
3. FOR TOILET ACCESSORIES, REFER TO SHEET GI002 FOR TYPICAL MOUNTING HEIGHT, UON.
4. REFER SHEETS AE514 AND AE515 FOR TYPICAL CASEWORK SECTIONS AND DETAILS.
5. REFER TO SHEETS AE601 AND AE602 FOR DOOR AND WINDOWS SCHEDULES, LEGEND AND DETAILS
6. REFER TO SHEETS AE120-AE123 FOR CEILING HEIGHTS.
7. REFER TO EQUIPMENT DRAWINGS FOR DISPLAY EQUIPMENT TYPES, SCHEDULE, ELEVATIONS AND DETAILS.
8. REFER NURSE EQUIPMENT SHEETS EY101 - EY104 FOR LOCATION AND NURSE CALL EQUIPMENT TYPES.
9. PROVIDE MINIMUM 1" FILLER PANELS AGAINST FINISH WALL PARTITIONS AND WHERE CASEWORK TURNS CORNER @ WALL AND BASE CABINETS, UON.
10. ALL COUNTERS TO BE 25" DEEP UON.
11. ALL WALL CABINETS TO HAVE PLAM SOFFIT, UON.
12. PROVIDE FINISH PANELS ON ALL EXPOSED SIDES AND BACKS OF BASE AND WALL CABINETS.
13. FOR COUNTERTOPS PROVIDE INTEGRAL SIDE SPLASHES AND BACK SPLASHES ON ALL ADJACENT WALLS.

GENERAL FINISH PLAN NOTES

1. NO T-SEAMS OR PARTIAL PIECES ACCEPTED FOR SEAMLESS FLOORING.
2. SEE SPECIFICATIONS IN CONJUNCTION WITH FINISH LEGENDS FOR FINISH INFORMATION.
3. ALL WALLS TO BE PAINTED P-2 UON.
4. ALL METAL DOOR FRAMES AND DOORS TO BE PAINTED DHM-01, SEE SHEET AF602 FOR MATERIALS LEGEND.
5. SEAMS FOR CARPET AND SEAMLESS FLOORING TO NOT BE LOCATED AT DOORWAYS.
6. REFER TO WALL PROTECTION TYPES FOR HEIGHTS, EXTENTS AND CLEARANCES AT OBSTRUCTIONS AND END CONDITIONS, SEE AF501 AND AE512.
7. TYPICAL FLOORING TRANSITIONS TO OCCUR UNDER OR AT CENTERLINE OF DOOR OPENINGS UON. SEE AF500 FOR INFORMATION.
8. LAY FLOORING WITH GRAIN RUNNING PERPENDICULAR TO CORRIDORS, UON.
9. PAINT TO BE SEMI-GLOSS IN TOILET ROOMS; FLAT ELSEWHERE, UON.
10. GROUT JOINTS TO ALIGN WITH FINISHED BASE OF WALL.
11. REFER TO FINISH PLANS FOR EXTENTS OF ACCENT WALL AND FLOORING MATERIALS.
12. ALL CORNER GUARDS TO BE FULL-HEIGHT FROM TOP OF BASE TO CEILING ABOVE (STOP 1/8" BELOW CEILING). REFER TO ELEVATIONS AND REFLECTED CEILING PLANS FOR HEIGHTS.
13. ALL TOILET PARTITIONS TO MATCH P-2 UON.

GENERAL PROJECT NOTES

1. REFER TO GENERAL REQUIREMENTS OF THE PROJECT SPECIFICATIONS FOR REQUIREMENTS RELATED TO WORK RESTRICTIONS, NOISE CONTROL, SECURITY, LIFE SAFETY, INFECTION CONTROL RISK ASSESSMENT.
2. REFER TO COVER SHEET FOR COORDINATION DRAWING REQUIREMENTS.
3. THE EXISTING CONDITIONS AND DEMOLITION WORK INDICATED IS INTENDED TO SHOW THE GENERAL SCOPE OF THE WORK. THE CONTRACTOR IS TO STUDY THE COMPLETE SET OF DOCUMENTS AND PERFORM ANY AND ALL DEMOLITION AND NEW CONSTRUCTION REQUIRED TO COMPLETE THE WORK SHOWN. VERIFY ALL EXISTING DIMENSIONS AND CONDITIONS AND REPORT ANY DISCREPANCIES IN CONDITIONS TO THE COR BEFORE BEGINNING OR CONTINUING WORK.
4. AT PROJECT COMPLETION, THE GENERAL CONTRACTOR SHALL PROVIDE TO THE COR AN "AS BUILT DRAWING" FOR THE WORK, REFER TO GENERAL REQUIREMENTS SECTION OF THE SPECIFICATIONS.
5. VERIFY AND ASCERTAIN THE LOCATION, DEPTH, DIRECTION, SIZE OF ANY AND ALL EXISTING UTILITIES IN THE GENERAL VICINITY OF THE WORK AREA. IT SHALL BE THE GENERAL CONTRACTOR'S RESPONSIBILITY TO REPAIR ANY UTILITY DISRUPTED, BROKEN, OR OTHERWISE RENDERED NON FUNCTIONAL DUE TO THE WORK PERFORMED AT NO ADDITIONAL COST TO THE VETERANS AFFAIRS DURING THIS COURSE OF WORK. THE GENERAL CONTRACTOR SHALL IDENTIFY ANY NON-FUNCTIONING UTILITY/SYSTEM PRIOR TO THE START OF WORK TO THE COR. IDENTIFICATION OF UTILITIES THE START OF WORK SHALL BE DEEMED AS DISTURBED/DAMAGED BY THE GENERAL CONTRACTOR AND SHALL BE REPAIRED AT THE EXPENSE OF THE GENERAL CONTRACTOR.
6. THE GENERAL CONTRACTOR SHALL PROPERLY SUPPORT ANY UTILITY ENCOUNTERED IN THE COURSE OF THIS WORK.
7. THE GENERAL CONTRACTOR SHALL PROVIDE STORAGE FOR MATERIALS. MATERIALS SHALL NOT BE STORED IN DEPARTMENT OF VETERANS AFFAIRS BUILDINGS, UNLESS AGREED TO BY VA.
8. COORDINATE MATERIAL STAGING AREAS WITH THE COR.
9. THE CONTRACTOR SHALL NOT LEAVE THE WORK AREA UNATTENDED FOR ANY REASON, UNLESS SAFETY PARTITIONS, SAFETY FENCING ARE INSTALLED AND SECURED.
10. THE GENERAL CONTRACTOR IS ADVISED THAT ANY RIGGING SHALL BE PERFORMED BY PROFESSIONAL RIGGERS AT THE EXPENSE OF THE GENERAL CONTRACTOR.
11. CONTRACTOR SHALL HAVE A REPRESENTATIVE ON SITE AT ALL TIMES DURING CONSTRUCTION ACTIVITIES.
12. REFER TO SPECIFICATIONS FOR GENERAL REQUIREMENTS OF THE CONTRACT.
13. INFECTION CONTROL, SAFETY AND PHASING: VERIFY REQUIREMENTS RELATED TO INFECTION CONTROL, DUST MITIGATION, SAFETY AND RISK ASSESSMENT. CONTRACTOR TO DEVELOP AND PUBLISH WORK PLAN ADDRESSING INFECTION CONTROL, SAFETY, AND PHASING FOR APPROVAL BY COR PRIOR TO BEGINNING THEIR WORK. PLAN TO INCLUDE MEANS AND METHODS OF DEBRIS STAGING AND REMOVAL, BOTH INTERNALLY AND EXTERNALLY. INFECTON CONTROL PLAN TO INCLUDE TEMPORARY DUST AND DEBRIS BARRIERS AND VESTIBULES AROUND PROJECT WORK AREAS. TEMPORARY BARRIERS ARE NOT TO RESTRICT REQUIRED MEANS OF EGRESS PATHS AND WIDTHS.
14. CONTRACTOR SHALL PROVIDE EGRESS SIGNAGE AS REQUIRED BY THE VA COR.
15. ALL PENETRATIONS THROUGH RATED FLOOR/CEILING ASSEMBLIES AND THROUGH FIRE RATED WALL AND SMOKE BARRIER ASSEMBLIES - THOSE CREATED BY REMOVAL OF DEMOLISHED ITEMS UNDER THIS CONTRACT AND THOSE DISCOVERED DURING CONSTRUCTION UNDER THIS CONTRACT AS A RESULT OF PREVIOUS WORK AND THOSE CREATED BY NEW WORK UNDER THIS CONTRACT - MUST BE SEALED AS PART OF THIS CONTRACT. ALL RATED SEPARATIONS MUST MEET CURRENT CODE REQUIREMENTS.
16. PROTECT EXISTING HORIZONTAL AND VERTICAL FIREPROOFING AND FIRE STOPPING DURING PROJECT. ONCE DEMOLITION IS COMPLETE, CONTRACTOR SHALL REPAIR ALL DAMAGED FIREPROOFING AND RESTORE MISSING FIREPROOFING, WHETHER A RESULT OF DEMOLITION OPERATIONS OR NOT, TO MEET REQUIRED RATING(S).
17. CONTRACTOR IS TO COORDINATE AND ADJUST DIMENSIONS OF HOUSEKEEPING AND EQUIPMENT PADS TO ACCOMMODATE FINAL EQUIPMENT SELECTIONS AT TIME OF SHOP DRAWING REVIEW.
18. INSTALL 24X24 ACCESS PANELS WHERE SHOWN ON DRAWINGS AND ONE (1) PER FLOOR DAMPER IN ADJACENT WALL, FOR RESETTING AND SERVICING DAMPER.

GENERAL DEMOLITION NOTES

1. THE EXISTING CONDITIONS AND DEMOLITION WORK INDICATED IS INTENDED TO SHOW THE GENERAL SCOPE OF THE WORK. THE CONTRACTOR IS TO STUDY THE COMPLETE SET OF DOCUMENTS AND PERFORM ANY AND ALL DEMOLITION AND NEW CONSTRUCTION REQUIRED TO COMPLETE THE WORK SHOWN. VERIFY ALL EXISTING DIMENSIONS AND CONDITIONS AND REPORT ANY DISCREPANCIES IN CONDITIONS TO THE COR BEFORE BEGINNING OR CONTINUING WORK.
2. ALL DEMOLITION WORK SHALL BE PERFORMED WITH "DUE CARE AND DILIGENCE" SO AS TO PREVENT THE ARBITRARY DESTRUCTION OR INTERRUPTION OF CONCEALED UTILITIES WHICH COULD NOT BE PREDETERMINED UNTIL DEMOLITION WAS STARTED. ALL SUCH DISCOVERIES OF UTILITIES DURING THE DEMOLITION PROCESS WHICH ARE IN A LOCATION DIFFERENT FROM FLOOR TO FLOOR, ETC., OR ARE UNIDENTIFIED SHALL BE REPORTED TO THE COR BEFORE REMOVAL FOR FINAL DISPOSITION.
3. REMOVE ALL CONSTRUCTION DESIGNATED TO BE REMOVED AND CLEAR TO RECEIVE NEW WORK AS HEREIN INDICATED.
4. REMOVE PORTIONS OF EXISTING CONSTRUCTION AS DRAWN AND PATCH TO MATCH ADJACENT CONSTRUCTION.
5. WHEREVER EXISTING EQUIPMENT, PIPING, DUCTS, ETC., ARE REQUIRED TO BE REMOVED, SUCH REMOVAL SHALL INCLUDE ALL ANCHORS, HANGERS, BRACING, FOUNDATION, ETC. AFTER REMOVAL, AFFECTED CONSTRUCTION AND SURFACES, SUCH AS FLOORS, WALLS, BASES, AND CEILINGS, SHALL BE FINISHED TO MATCH ADJACENT SURFACES UNLESS OTHERWISE NOTED.
6. NEW WORK AS A RESULT OF PATCHING SHALL ALIGN WITH AND MATCH EXISTING WORK EXCEPT WHERE OTHERWISE DIMENSIONED OR DETAILED.
7. ANY EXISTING CONDITIONS WHICH ARE INCONSISTENT WITH CONTRACT DRAWINGS RELEVANT TO THIS CONTRACT SHALL BE REPORTED TO THE COR.
8. WHERE DEMOLITION OR RELATED WORK LEAVES FLOOR SURFACES WITH IMPERFECTIONS OR NOT LEVEL TO TOLERANCES SPECIFIED FOR NEW WORK, PROVIDE SELF-LEVELING UNDERLAYMENT.
9. WHERE DEMOLITION WORK UNCOVERS OR LEAVES OPENINGS IN PARTITIONS OR INCOMPLETE PARTITIONS, EXTEND, RESTORE, AND/OR CLOSE OPENING IN PARTITION AS INDICATED AND/OR AS REQUIRED TO MAINTAIN FIRE RATINGS, MATCH EXISTING CONSTRUCTION, U.N.O., WITHIN THE LIMITS AND TOLERANCES FOR MATERIALS AS SPECIFIED OR RECOMMENDED BY THE MANUFACTURER. REFINISH SURFACES TO ALIGN FLUSH WITH EXISTING.
10. WHERE DEMOLITION WORK OR RELOCATION OF EXISTING ITEMS LEAVES UNFINISHED SURFACES AND/OR SUBSTRATES, CUT AND PATCH AS REQUIRED TO RESTORE SUBSTRATE AND/OR FINISH MATERIAL EVEN AND FLUSH WITH ADJOINING SURFACES. TEXTURE AND REFINISH TO MATCH EXISTING U.N.O.
11. CONTRACTOR SHALL DISPOSE OF ALL ITEMS PER SPECIFICATIONS. OWNER RESERVES THE RIGHT TO SELECT SPECIFIC ITEMS FOR SALVAGE. THESE ITEMS SHALL BE IDENTIFIED DURING A PRECONSTRUCTION WALKTHROUGH.
12. WALK-OFF MATS, THE CONSTUCTION BARRIER, AND NEGATIVE PRESSURE BY HEPA FILTRATION SHALL BE IN PLACE PRIOR TO START DEMOLITION AT THE MINIMUM AND PER THE ICRA.
13. HAZARDOUS MATERIAL ABATEMENT IS REQUIRED IN PROJECT SCOPE. REF. HA050 - HA102 FOR ADDITIONAL INFORMATION.
14. ALL OPENINGS AND SURFACES MADE BARE BY DEMOLITION AND/OR REMOVAL OF MATERIALS SHALL BE REPAIRED AND/OR PATCHED TO MATCH ADJACENT FINISH. PREPARE SURFACES TO RECEIVE NEW FINISH(S).
15. DISTURBANCE OF EXISTING MATERIALS ARE THE RESPONSIBILITY OF THE CONTRACTOR WITH REFERENCE TO PROPER LEGAL DISPOSAL, LEGAL ABATEMENT, PATCHING AND FINISHING. ALL DISTURBED AREAS AND MATERIALS SHALL MATCH EXISTING CONDITIONS.
16. COORDINATE WITH M/E/P DRAWINGS FOR ADDITIONAL DEMOLITION IN FLOORS, WALLS AND ROOFS & RELATED ITEMS AS REQUIRED TO ACCOMODATE NEW CONSTRUCTION OR UTILITIES ON THESE FLOORS OR RELATED ADJACENT FLOORS. PATCH/REPAIR BY EACH RESPECTIVE DISCIPLINE. COORDINATE DEMOLITION WITH OTHER DISCIPLINES. HOLES/PENETRATIONS IN RATED WALLS CREATED WHEN DEMOLITION OCCURS ARE TO BE FILLED TO MATCH THE EXISTING RATED CONDITION OR BETTER.
17. WHERE TILE FLOORING OR TERRAZO FLOOR AND BASE ARE REMOVED, PROVIDE FLOOR LEVELING AS REQUIRED TO CREATE A LEVEL FLOOR SURFACE WITH THE FLOORS THAT ARE TO REMAIN. PREPARE NEW SURFACE TO RECEIVE NEW FINISHES.
18. WHERE EXISTING WALL IS REMOVED, PROVIDE FLOOR LEVELING AS REQUIRED TO CREATE A LEVEL FLOOR SURFACE WITH THE FLOOR LEVELS AT EACH SIDE OF THE DEMO-ED WALL LOCATION. PREPARE NEW SURFACE TO RECEIVE NEW FINISHES.
19. DURING DEMOLITION AND CONSTRUCTION PHASES, MAINTAIN ALL REQUIRED EXISTING WALL RATINGS AT WALLS TO REMAIN, AS ARE INDICATED ON DRAWINGS. REMOVE ALL MISC, FASTENING ANCHORS, CLIPS, CONDUIT, PIPING AND RELATED ITEMS THAT ARE NOT IN USE.
20. COORDINATE THE EXACT PHASING OF THE DEMOLITION FOR SPECIFIC STRUCTURAL MEMBERS WITH STRUCTURAL DRAWINGS.
21. DO NOT CORE THROUGH STRUCTURAL MEMBERS, INCLUDING CONCRETE BEAMS, JOISTS, AND STEMS. ONLY CORE THROUGH THE DECK BETWEEN SUPPORTING MEMBERS.
22. 1-HOUR TEMPORARY WALLS EXTENDING FROM FLOOR TO STRUCTURAL DECK ARE REQUIRED TO SEPARATE CONSTRUCTION AREAS FROM OCCUPIED AREAS, UNLESS NOTED OTHERWISE. SPRINKLERED SYSTEM TO REMAIN ACTIVE IN CONSTRUCTION AREAS, IN THE CONSTRUCTION AREA, IF THE SPRINKLERED SYSTEM REMAINS ACTIVE AND HEADS ARE TURNED UPRIGHT, THE 1-HOUR RATED WALLS DO NOT NEED TO EXTEND ABOVE THE EXISTING CEILING. IF SPRINKLERED HEADS REMAIN POINTED DOWNWARD IN THE CONSTRUCTION AREAS, THEN THE 1-HOUR RATED TEMPORARY WALLS MUST PENETRATE THROUGH CEILINGS AND EXTEND UP TO STRUCTURE.

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC
consulting engineers
8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. CLARK REGISTERED ARCHITECT 15080 NORTH CAROLINA CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •
8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833
HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: **NOTES AND LEGENDS**

Project Title: **RENOVATE MED SURGE WARDS**

Project Number: 564-17-140

Building Number: 1

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: MS

Drawing Number: **AI001**

Sheet 29 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

BIM 360://18002 Fayetteville AR Renovate Med Surge Ward/18002 ARCH 2020.rvt

A	
A LABEL	CLASS A DOOR
A/C	AIR CONDITIONING
A/C UNIT	AIR CONDITIONING UNIT
A/E	ARCHITECT/ENGINEER
AAMA	AMERICAN ARCHITECTURAL MANUFACTURERS ASSOCIATION
AB	ANCHOR BOLT
ABA	ARCHITECTURAL BARRIERS ACT
ABC	AGGREGATE BASE COURSE
AC	ASBESTOS CEMENT OR ASPHALTIC CONCRETE
ACI	AMERICAN CONCRETE INSTITUTE
ACS DR	ACCESS DOOR
ACS FLR	ACCESS FLOOR
ACS PNL	ACCESS PANEL
ACST	ACOUSTIC
ACT	ACOUSTICAL CEILING TILE
AD	AREA DRAIN
ADA	AMERICANS WITH DISABILITIES ACT
ADB	AUTOMATIC DOOR BOTTOM
ADC	AUTOMATIC DOOR CLOSER
ADDL	ADDITIONAL
ADDN	ADDITION
ADH	ADHESIVE
ADJ	ADJACENT, ADJOINING, OR ADJUSTABLE
ADMIN	ADMINISTRATION
AED	AUTOMATED EXTERNAL DIFIBRILATOR CABINET
AFC	ABOVE FINISHED COUNTER
AFF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
AFS	ABOVE FINISHED SLAB
AGA	AMERICAN GAS ASSOCIATION, ASSOCIATED GENERAL CONTRACTORS
AGGR	AGGREGATE
AHJ	AUTHORITY HAVING JURISDICION
AHR	ANCHOR
AHU	AIR HANDLING UNIT
AIA	AMERICAN INSTITUTE OF ARCHITECTS
AISC	AMERICAN INSTITUTE OF STEEL CONSTRUCTION
ALT	ALTERNATE, ALTERNATIVE
ALT NO	ALTERNATE NUMBER
ALUM	ALUMINUM
AMP	AMPERE
AMT	AMOUNT
ANOD	ANODIZE
ANSI	AMERICAN NATIONAL STANDARDS INSTITUTE
ANT	ANTENNA
APA	AMERICAN PLAYWOOD ASSOCIATION
APPD	APPROVED
APPROX	APPROXIMATE, APPROXIMATELY
APT	APARTMENT
AR	AS REQUIRED
ARCH	ARCHITECT, ARCHITECTURAL
ASB	ASBESTOS
ASI	ARCHITECT'S SUPPLEMENTAL INSTRUCTION
ASKLR	AUOMATIC SPRINKLER
ASPH	ASPHALT
ASSN	ASSOCIATION
ASTM	AMERICAN SOCIETY FOR TESTING AND MATERIALS
AT (SP)	ACOUSTICAL CEILING TILE (SPECIAL FACED)
ATCH	ATTACHMENT
ATM	AUTOMATIC TELLER MACHINE
ATS	AUTOMATIC TRANSFER SWITCH
AUTO	AUTOMATIC
AUX	AUXILIARY
AV	AUDIO-VISUAL
AVE	AVENUE
AVG	AVERAGE
AW	ACID WASTE
AWI	ARCHITECTURAL WOODWORKING INSTITUTE
AWPA	AMERICAN WOOD PRESERVERS'S ASSOCIATION
AWS	AMERICAN WELDING SOCIETY
AWT	ACOUSTICAL WALL TREATMENT
B	
B LABEL	CLASS B DOOR
B PL	BASE PLATE
BALC	BALCONY
BAT	BATTEN
BB	BULLETIN BOARD
BD	BOARD
BD FT	BOARD FEET (FOOT)
BEV	BEVEL
BHMA	BUILDER'S HARDWARE MANUFACTURER'S ASSOCIATION
BI FLD DR	BIFOLDING DOORS
BITUM	BITUMINOUS
BKG	BACKING
BLD	BUILD
BLDG	BUILDING
BLKG	BLOCKING
BLKT	BLANKET
BLVD	BOULEVARD
BM	BEAM OR BENCHMARK
BOT	BOTTOM
BR	BEDROOM
BRCG	BRACING
BRDG	BRIDGING
BRDG JST	BRIDGING JOIST
BRG	BEARING
BRG PL	BEARING PLATE
BRKT	BRACKET
BRZ	BRONZE
BSMT	BASEMENT
BTWN	BETWEEN
BU	BUSHEL
BUR	BUILT-UP ROOFING
C	
C	CELSIUS CHANNEL OR CHANNEL CELSIUS
C CONC	CAST CONCRETE
C LABEL	CLASS C DOOR
C TO C	CENTER TO CENTER
CAB	CABINET
CAC	CEILING ATENUATION CLASS
CB	CATCH BASIN OR CORNER BEAD
CBB	CEMENTITIOUS (BACKER) BOARD
CC	CUBIC CENTIMETER; CONTRACTOR FURNISHED/ CONTRACTOR INSTALLED
CCTV	CLOSED CIRCUIT TELEVISION
CCW	COUNTERCLOCKWISE
CD	CONSTRUCTION DOCUMENTS OR CONTRACT DOCUMENTS
CEM	CEMENT, CEMENTITIOUS
CEM PLAS	CEMENT PLASTER
CER	CERAMIC
CF	CONTRACTOR FURNISHED
CFLG	COUNTERFLASHING
CFM	CUBIC FEET PER MINUTE
CFMF	COLD-FORMED METAL FRAMING
CFS	CUBIC FEET PER SECOND
CG	CENTER OF GRAVITY OR CORNER GUARD
CGSFU	CERAMIC GLAZED STRUCTURAL FACING UNITS
CH BD	CHALKBOARD
CHEM	CHEMICAL
CHFR	CHAMFER
CHK	CHECK
CI	CAST IRON
CIP	CAST-IN-PLACE
CIR	CIRCLE
CIRC	CIRCULATING, CIRCULAR
CIRC	CIRCULAR
CJ	CONSTRUCTION JOINT OR CONTROL JOINT
CL	CENTER LIINE
CLDG	CLADDING
CLG	CEILING
CLG HT	CEILING HEIGHT
CLR	CLEAR

CM	CONSTRUCTION MANAGER
cm2	SQUARE CENTIMETER
cm3	CUBIC CENTIMETER
CMU	CONCRETE MASONRY UNIT
CNR	CORNER
CNTR	COUNTER
CO	CARBON MONOXIDE, CERTIFICATE OF OCCUPANCY, CLEAN OUT, OR COMPANY
co2	CARBON DIOXIDE
COL	COLUMN
COM	COMMON
COMB	COMBINAION, COMBINED
COMM	COMMUNICATION
COMP	COMPONENT
CONC	CONCRETE
CONC FLR	CONCRETE FLOOR
COND	CONDENSER OR CONDITION
CONF	CONFERENCE
CONN	CONNECTION
CONSTR	CONSTRUCTION
CONT	CONTINUOUS, CONTINUE
CONTR	CONTRACTOR
COORD	COORDINATE
COR	COORDINATION OFFICER
CORR	CORRIDOR
CPM	CRITICAL PATH METHOD
CPOT	COMMON PATH OF TRAVEL
CPRS	COMPRESSIBLE
CPT	CARPET
CR	CARD READER
CRS	COLD ROLLED STEEL
CRSI	CONCRETE REINFORCING STEEL
CSB	CONCRETE SPLASH BLOCK
CSG	CASING
CSI	CONSTRUCTION SPECIFICATIONS INSTITUTE
CSK	COUNTER SUNK
CSMT	CASEMENT
CSWK	CASEWORK
CT	CERAMIC TILE
CTB	CERAMIC TILE BASE
CTF	CERAMIC TILE FLOOR
CTG	COATING
CTR	CENTER CONTOUR
CTRL	CONTROL
CTV	CABLE TELEVISION
CU	COPPER C
CU FT	CUBIC FEET
CU IN	CUBIC INCH
CU YD	CUBIC YARD
CURT	CURTAIN
CYL	CYLINDER
CYL L	CTLINDER LOCK
D	
D	DEPTH OR PENNY (NAIL)
D LABEL	CLASS D DOOR
DAT	DATUM
DB	DECIBEL
DBL	DOUBLE
DBL GLZ	DOUBLE GLAZE
DC	DIRECT CURRENT
DEG	DEGREE
DEL	DELETE
DEMO	DEMOLITION
DEPT	DEPARTMENT
DET	DETAIL
DF	DRINKING FOUNTAIN
DIA	DIAMETER
DIAG	DIAGONAL DIAGRAM OR DIAGRAM DIAGONAL
DIFF	DIFFERENCE OR DIFFUSER
DIM	DIMENSION
DIR	DIRECTION
DISP	DISPENSER
DIST	DISTANCE
DIV	DIVIDE OR DIVISION
DL	DEAD LOAD
DOC	DOCUMENT
DOUG FIR	DOUGLAS FIR
DOZ	DOZEN
DR	DOOR, DRAIN, DRESSING ROOM, OR DRIVE
DR CL	DOOR CLOSER
DR FR	DOOR FRAME
DR OPNG	DOOR OPENING
DS	DOWNSPOUT
DSGN	DESIGN
DW	DISHWASHER
DWG	DRAWING
DWTR	DUMBWAITER
E	
E	EAST
E LABEL	CLASS E DOOR
EA	EACH
EFF	EFFICIENCY
EFS	EXTERIOR FINISH SYSTEM
EIFS	EXTERIOR INSULATION AND FINISH SYSTEM
EJ	EXPANSION JOINT
EL	ELEVATION
ELAST	ELASTOMERIC
ELEC	ELECTRIC, ELECTRICAL
ELEC DR OP	ELECTRIC DOOR OPENER
ELEV	ELEVATOR
ELEVS	ELEVATIONS
EMER	EMERGENCY
EMER SHR	EMERGENCY SHOWER
ENCL	ENCLOSURE
ENGR	ENGINEER
ENVIR	ENVIRONMENT
EPA	ENVIRONMENTAL PROTECTION AGENCY
EPDM	ETHYLENE PROPYLENE DIENE
EPO	EMERGENCY POWER OFF
EPS	EXPANDED POLYSTYRENE BOARD (INSULATION)
EQ	EQUAL
EQL SP	EQUALLY SPACED
EQUIP	EQUIPMENT
EQUIV	EQUIVALENT
ERD	EXISTING ROOF DRAIN
ESC	ESCAPE OR ESCUTCHEON
ESCAL	ESCALATOR
ESMT	EASEMENT
ESP	ESPECIALLY
EST	ESTIMATE
ETC	AND SO FORTH OR ET CETERA
ETR	EXISTING TO REMAIN
EW	EACH WAY
EWC	ELECTRIC WATER COOLER
EWS	EYE WASH STATION
EXC.	EXCEPTION
EXH	EXHAUST
EXIST	EXISTING
EXP	EXPANSION OR EXPOSED
EXP BT	EXPANSION BOLT
EXST GR	EXISTING GRADE
EXT	EXTERIOR, EXTERNAL, OR EXTINGUISHER
EXT GR	EXTERIOR GRADE
F	
F	FAHRENHEIT OR FEMALE
FA	FIRE ALARM
FAB	FABRIC
FAC	FACTOR
FACIL	FACILITY
FAS	FASCIA
FAS BD	FASCIA BOARD

FCO	FLOOR CLEANOUT
FCTY	FACTORY
FD	FLOOR DRAIN
FDC	FIRE DEPARTMENT CONNECTION
FDTN	FOUNDATION
FE	FIRE EXTINGUISHER
FEC	FIRE EXTINGUISHER CABINET
FF	FINISH FACE
FF EL	FINISH FLOOR ELEVATION
FF&E	FURNITURE, FIXTURE, AND EQUIPMENT
FH	FLAT HEAD OR FLAT HEAD SCREWS
FHC	FIRE HOSE CABINET
FHMS	FLAT HEAD MACHINE SCREW
FHP	FULL HEIGHT PARTITION
FHWS	FLAT HEAD WOOD SCREW
FIG	FIGURE
FIL	FILLET
FIN	FINISH
FIN FLR	FINISH FLOOR
FIN GR	FINISH GRADE
FIN WD	FINISH WOOD
FIXT	FIXTURE
FL	FLOORLINE
FLASH	FLASHING
FLDG	FOLDING
FLEX	FLEXIBLE
FLG	FLOORING
FLR	FLOOR
FLR FIN	FLOOR FINISH
FLR SK	FLOOR SINK
FLUOR	FLUORESCENT
FLUOR FIX	FLUORESCEN FIXTURE
FM	FACTORY MUTUAL
FM-G	FACTORY MUTUAL GLOBAL
FO	FINISHED OPENING
FOC	FACE OF CONCRETE OR FACE OF CURB
FOF	FACE OF FINISH
FOM	FACE OF MASONRY
FOS	FACE OF SLAB OR FACE OF CURB
FOUNT	FOUNTAIN
FOW	FACE OF WALL
FP	FIRE PROTECTION OR FIREPROOF
FPM	FEET PER MINUTE
FPS	FEET PER SECOND
FR	FIRE RATING, FIRE RESISTANT, OR FRAME
FR SNK	FLUSHING RIM SINK
FREQ	FREQUENCY
FRMG	FRAMING
FRP	FIBER REINFORCED POLYESTER OR FIBERGLASS REINFORCED PLASTIC
FRT	FIRE-RETARDANT TREATED
FRZ	FREEZER
FS	FEDERAL SPECIFICATION
FSTNR	FASTENER
FT	FEET OR FOOT
FTG	FOOTING
FURG	FURRING
FURN	FURNISH OR FURNITURE
FUT	FUT
FV	FIELD VERIFY
FWC	FABRIC WALL COVERING
G	
GA	GAGE OR GYPSUM ASSOCIATION
GAL	GALLON, GALLONS
GALV	GALVANIC OR GALVANIZED
GALV STL	GALVANIZED STEEL
GB	GRAB BAR
GC	GENERAL CONTRACTOR
GCJ	GWB CONTROL JOINT
GD	GUARD
GDR	GUARD RAIL
GEN	GENERAL OR GENERATOR
GFRC	GLASS-FIBER-REINFORCED
GFRG	GLASS-FIBER-REINFORCED
GFRP	GLASS-FIBER-REINFORCED PLASTIC
GI	GALVANIZED IRON
GL	GLASS
GL BLK	GLASS BLOCK
GLU LAM	GLUED LAMINATED WOOD
GPR	GROUND PENETRATING RADAR
GR FL	GROUND FLOOR
GRAN	GRANITE
GRTG	GRATING
GSB	GYPSUM SHEATHING BOARD
GSM	GALVANIZED SHEET METAL
GSU	GLAZED STRUCTURAL UNIT
GT	GROUT
GUAR	GUARANTEE
GUT	GUTTER
GWB (SC)	GYPSUM BOARD - HIGH BUILD GLAZED COATING (SPECIAL COATING)
GYP	GYPSUM
GYP BD	GYPSUM BOARD
GYP PLAS	GYPSUM PLASTER
H	
H	HIGH
H PLAM	HIGH PRESSURE PLASTIC LAMINATE
HAZ MAT	HAZARDOUS MATERIALS
HB	HOSE BIBB
HC	HOLLOW CORE
HCWD	HOLLOW CORE WOOD DOOR
HDBD	HARDBOARD
HDNR	HARDENER
HDO	HIGH DENSITY OVERLAY
HDR	HEADER
HDW	HARDWARE
HDWD	HARDWOOD
HEPA	HIGH EFFICIENCY PARTICULATE AIR (FILTER)
HEX	HEXAGON
HF	HIGH FREQUENCY
HGR	HANGAR
HM	HOLLOW METAL OR HECTOMETER
HMD	HOLLOW METAL DOOR
HMDF	HOLLOW METAL DOOR AND FRAME
HMF	HOLLOW METAL FRAME
HNDRL	HANDRAIL
HO	HOLD OPEN
HORIZ	HORIZONTAL
HOSP	HOSPITAL
HP	HIGH PRESSURE OR HORSEPOWER
HQ	HEADQUARTERS
HR	HOUR
HRS	HOURS
HS	HEAT-STRENGTHENED (GLASS) OR HIGH STRENGTH
HSE	HOUSE
HSKPG	HOUSEKEEPING
HST	HOIST
HT	HEIGHT
HVAC	HEATING, VENTILATION, AND AIR CONDITIONING
HVY	HEAVY
HW	HOT WATER
HYD	HYDRANT
HYDR	HYDRAULIC
I	
I	INTERSTATE (HIGHWAY) OR MOMENT OF INERTIA
IAQ	INDOOR AIR QUALITY
IBC	INTERNATIONAL BUILDING CODE
ID	IDENTIFICATION, INSIDE DIAMETER, OR INTERIOR DESIGN
ID NO	IDENTIFICATION NUMBER
ILLUM	ILLUMINATION
INCL	INCLUDED
IND	INDEPENDENT OR INDUSTRIAL

INFO	INFORMATION
INSUL	INSULATED, INSULATION
INT	INTERIOR
INTERCOM	INTERCOMMUNICATION
INTL	INTERNATIONAL
IRMA	INVERTED ROOF MEMBRANE ASSEMBLY
IWH	INSTANANEOUS WATER HEATER
K	
KD	KILN DRIED OR KNOCKED DOWN
KIT	KITCHEN
KO	KNOCKOUT
KPL	KICKPLATE
L	
L	ANGLE
LAB	LABORATORY
LAD	LADDER
LAM	LAMINATE
LAM GL	LAMINATED GLASS
LAU	LAUNDRY
LAV	LAVATORY
LBR	LUMBER
LBS	POUND
LD BRG	LOAD-BEARING
LDR	LEADER
LED	LIGHT EMITTING DIODE
LF	LINEAR FEET (FOOT)
LH	LEFT HAND
LHR	LEFT HAND REVERSE OR LATENT HEAT RATIO
LIB	LIBRARY
LIN	LINEAR
LINO	LINOLEUM
LIQ	LIQUID
LKR	LOCKER
LKR RM	LOCKER ROOM
LKWASH	LOCKWASHER
LL	LEAD LINED
LLH	LONG LEG HORIZONTAL
LLV	LONG LEG VERTICAL
LMST	LIMESTONE
LNDSCP	LANDSCAPE
LR	LIVING ROOM
LRG	LARGE
LRV	LOUVERED ROOF VENT
LS	LUMP SUM
LT	LIGHT
LT GA	LIGHT GAGE
LT WT	LIGHTWEIGHT
LTG	LIGHTING
LTNG	LIGHTNING
LVD	LOUVERED
LVR	LOUVER
LWC	LIGHTWEIGHT CONCRETE
LWIC	LIGHTWEIGHT INSULATING CONCRETE
LYR	LAYER
M	
MACH	MACHINE
MACH RM	MACHINE ROOM
MAINT	MAINTAIN, MAINTENANCE
MAN	MANUAL
MATL	MATERIAL
MATV	MASTER ANTENNA TELEVISION SYSTEM
MAX	MAXIMUM
MB	MACHINE BOLT
MCB	METAL CORNER BEAD
MCJ	MASONRY CONTROL JOINT
MD	DECK
ME	MECHANICAL ENGINEER
MEAS	MEASURE
MECH	MECHANICAL
MECH RM	MECHANICAL ROOM
MED	MEDICAL MEDIUM O MEDIUM MEDICAL
MEK	METHYL ETHYL KETONE
MEL	MELAMINE
MEMBO	MEMORANDUM
MEZZ	MEZZANINE
MF	MILL FINISH
MFD	MANUFACTURED
MFG	MANUFACTURING
MFR	MANUFACTURER
MFR REC	MANUFACTURER'S RECOMMENDATION
MGT	MANAGEMENT
MH	MANHOLE
MIC	MICROPHONE
MID	MIDDLE
MIL STD	MILITARY STANDARD
MIN	MINIMUM
MIN	MINIMUM MINUTE OR MINUTE MINIMUM
MIRR	MIRROR
MISC	MISCELLANEOUS
MISC	MISCELLANEOUS
MIT	MITER
MKR	MARKER
ML	METAL LATH
MLDG	MOLDING (MOULDING)
MLWK	MILLWORK
mm	MILLIMETER
MO	MASONRY OPENING OR MOTOR OPERATED
MO	MASONRY OPENING OR MOTOR OPERATED
MOD	MODEL, MODIFY OR MODULE
MOD BIT	MODIFIED BITUMEN
MON	MONITOR
MOPR	MOP RACK
MR	MOISTURE RESISTANT
MS	MACHINE SCREW OR MOP SINK
MTD	MOUNTED
MTG	MOUNTING
MTL	METAL
MULL	MULLION
MW	MICROWAVE
MWP	MEMBRANE WATERPROOFING
N	
N	NORTH
NA	NOT APPLICABLE
NAAMM	NATIONAL ASSOCIATION OF ARCHITECTURAL METAL MANUFACTURERS
NAT	NATURAL
NATL	NATIONAL
NC	NOISE CRITERIA
NCOMBL	NONCOMBUSTIBLE
NEC	NATIONAL ELECTRICAL CODE
NEG	NEGATIVE
NEMA	NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION
NEUT	NEUTRAL
NFC	NATIONAL FIRE CODE
NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
NIC	NOT IN CONTRACT
NO	NUMBER
NOM	NOMINAL
NR	NOISE REDUCTION
NRC	NOICE REDUCTION COEFFICIENT
NRCA	NATIONAL ROOFING CONTRACTORS ASSOCIATION
NRP	NONREMOVABLE
NRST	NON-RATED, SMOKE TIGHT
NS	NARROW STILE
NUM	NUMERAL

O	
O	OXYGEN
O/H	OVER HEAD
O/O	OUT TO OUT
OA	OUTSIDE AIR OR OVERALL
OC	ON CENTER
OCC	OCCUPY
OCT	OCTAGON
OD	OUTSIDE DIAMETER OR OUTSIDE DIMENSION
OFD	OVERFLOW DRAIN
OFF	OFFICE
OH	OVERHANG
OH DR	OVERHEAD (COILING) DOOR
OPH	OPPOSIE HAND
OPNG	OPENING
OPP	OPPOSITE
OPR	OPERABLE
OPT	OPTIONAL
OR	OPERATING ROOM OR OUTSIDE RADIUS
ORD	ORDNANCE OR OVERFLOW ROOF DRAIN
ORG	ORGANIC
ORIG	ORIGINAL
ORN	ORNAMENTAL
OSHA	OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION
OUT	OUTLET
OZ	OUNCE
P	
PACS	PHYSICAL ACCESS SECURITY SYSTEM
PAR	PARALLEL OR PARAPET
PARA	PARAGRAPH
PART	PARTIAL
PAT	PATTERN
PB	PUSHBUTTON
PBD	PARTICLEBOARD
PC	PIECE, POLYCARBONATE OR PORTLAND CEMENT
PCA	PORTLAND CEMENT ASSOCIATION
PCC	PRECAST CONCRETE
PCCP	CONCRETE PAVEMENT
PCD	PAPER CUP DISPENSER
PCF	POUNDS PER CUBIC FOOT
PCP	PORTLAND CEMENT PLASTER
PED	PEDESTAL
PEN	PENETRATE
PEND	PENDANT
PERF	PERFORATED
PERIM	PERIMETER
PERP	PERPENDICULAR
PGBD	PEGBOARD
PHAR	PHARMACY
PHOTO	PHOTOGRAPH
PHS	PHILLIPS HEAD SCREW
PKG	PACKAGE
PL	PROPERTYLINE
PL GL	PLATE GLASS
PLAM	PLASTIC LAMINATE
PLAM	PLASTIC LAMINATE
PLAS	PLASTER OR PLASTIC
PLBG	PLUMBING
PLYWD	PLYWOOD
PMTL	PAINTED METAL
PNEU	PNEUMATIC
PNL	PANEL
PO	POST OFFICE PURCHASE ORDER OR PURCHASE ORDER POST OFFICE
POLY	POLYETHYLENE (PLASTIC)
PR	PAIR
PRCST	PRECAST
PREFAB	PREFABRICATE
PREFIN	PREFINISH
PRELIM	PRELIMINARY
PREP	PREPARATION
PRESS	PRESSURE
PREV	PREVIOUS
PRKG	PARKING
PRMLD	PREMOLDED
PROJ	PROJECT
PROP	PROPERTY
PSF	POUNDS PER SQUARE FOOT
PSI	POUNDS PER SQUARE INCH
PT	PAINT, PNEUMATIC TUBE, OR PRESSURE TREATED
PTD	PAPER TOWEL DISPENSER
PTN	PARTITION
PVC	POLYVINYL CHLORIDE (PLASTIC)
PVG	PAVING
PWR	POWER
Q	
QA	QUALITY ASSURANCE
QC	QUALITY CONTROL
QRY	QUARRY
QT	QUARRY TILE OR QUART
QTB	QUARRY TILE BASE
QTF	QUARRY TILE FLOOR
QTR	QUARTER
QTY	QUANTITY
QUAD	QUADRANT
QUAL	QUALITY
R	
R	RADIUS OR RISER
RA	RETURN AIR
RA	RETURN AIR
RAD	RADIATOR
RB	RESILIENT BASE OR RUBBER BASE
RB HK	ROBE HOOK
RBM	REINFORCED BRICK MASONRY
RBR	RUBBER
RC	REMOTE CONTROL
RCP	REFLECTED CEILING PLAN
RCVR	RECEIVER
RD	ROAD OR ROOF DRAIN
REC	RECESSED
RECD	RECEIVED
RECPT	RECEPTACLE
RECT	RECTANGLE
REF	REFERENCE OR REFRIGERATOR
REFR	REFRACTORY REFRIGERATION OR REFRIGERATION REFRACTORY
REG	REGISTER
REINF	REINFORCE, REINFORCED, OR REINFORCING
REP	REPAIR
REPL	REPLACE
REQ	REQUIRE
REQD	REQUIRED
RESIL	RESILIENT
RET	RETURN
REV	REVISION
RF	RADIO FREQUENCY
RFG	ROOFING
RFI	REQUEST FOR INFORMATION
RFP	REQUEST FOR PROPOSAL
RH	RIGHT HAND
RHMS	ROUND HEAD MACHINE SCREW
RHR	RIGHT HAND REVERSE
RHWS	ROUND HEAD WOOD SCREW
RL	ROOF LEADER
RLG	RAILING
RM	ROOM
RND	ROUND
RO	ROUGH OPENING
ROW	RIGHT OF WAY
RPM	REVOLUTIONS PER MINUTE
RS	ROUGH SAWN
RT	RIGHT

RV	ROOF VENT
RVS	REVERSE
RWD	REDWOOD
RWL	RAIN WATER LEADER
S	
SA	SUPPLY AIR
SALV	SALVAGE
SAMP	SAMPLE
SAN	SANITARY
SAT	SUSPENDED ACOUSTICAL TILE
SATC	SUSPENDED ACOUSTICAL TILE CEILING
SB	SPLASH BLOCK
SBS	STYRENE BUTADIEN STYRENE
SBSTR	SUBSTRATE
SC	SHADING COEFFICIENT OR SOLID CORE
SCH	SCHOOL
SCHED	SCHEDULE, SCHEDULED
SCHEM	SCHEMATIC
SCP	SCUPPER
SCRN	SCREEN
SCT	STRUCTURAL CLAY TILE
SCWD	SOLID CORE WOOD DOOR
SD	SHOP DRAWINGS, SMOKE DETECTOR, OR SOAP DISPENSER
SDG	SIDING
SECT	SECTION
SEG	SEGMENT
SEL	SELECT
SEP	SEPARATE
SF	SQUARE FOOT (FEET)
SFTWD	SOFTWOOD
SGD	SLIDING GLASS DOOR
SGL	SINGLE
SHR	SHOWER
SHR HD	SHOWER HEAD
SHRD	SHOWER DRAIN
SHT	SHEET
SHT MTL	SHEET METAL (FLASHING)
FLASH	
SHTHG	SHEATHING
SIM	SIMILAR
SJ	SCORED JOINT
SJ	SCORED JOINT
SJI	STEEL JOIST SLIDING WINDOW
SK	SKETCH
SKLT	SKYLIGHT
SLD WDW	HORIZONTAL SLIDING WINDOW
SLDG	SLIDING
SLNT	SEALANT
SM	SHEET METAL
SMK	SMOKE
SMS	SHEET METAL SCREW
SND	SANITARY NAPKIN DISPENSER
SND INS	SOUND INSULATION
SNDU	SANITARY NAPKIN DISPOSAL UNIT
SPEC	SPECIFICATION
SPKLR	SPRINKLER
SPKR	SPEAKER
SPLY	SUPPLY
SQ	SQUARE
SQ IN	SQUARE INCH
SQ YD	SQUARE YARD
SS	SANITARY SEWER, SERVICE SINK OR SOLID SURFACING
SST	STAINLESS STEEL
ST	STAIRS OR STREET
STC	SOUND TRANSMISSION CLASSIFICATION
STIF	STIFFENER
STL	STEEL
STL JST	STEEL JOIST
STL LNTL	STEEL LINTEL
STL PL	STEEL PLATE
STL RF DK	STEEL ROOF DECK
STL TB	STEEL TUB
STL TR	STEEL TRUSS
STNLS	STAINLESS
STOR	STORAGE
STR	STRINGERS
STRUCT	STRUCTURAL
STRUCT STL	STRUCTURAL STEEL
SUB	SUBSTITUTE
SURF	SURFACE
SUSP	SUSPENDED
SUSP CLG	SUSPENDED CEILING
SV	SHEET VINYL
SW	SWITCH
SWDR	SWING DOOR
SYM	SYMBOL
SYNTH	SNTHETIC
SYS	SYSTEM
T	
T	TREAD
T&G	TONGUE AND GROOVE
T&M	TIME AND MATERIALS
TB	THROUGH BOLT OR TOWEL BAR
TCA	TILE COUNCIL OF AMERICA
TCP	TELEPHONE CONTROL PANEL, TEMPERATURE CONTROL PANEL, OR TRAFFIC CONTROL PLAN
TD	TRAVEL DISTANCE
TECH	TECHNICAL
TEL	TELEPHONE
TEMP	TEMPERATURE OR TEMPORARY
TER	TERRAZZO
THD	THREAD
THERM	THERMAL
THK	THICKNESS
THRES	THRESHOLD
THRU	THROUGH
THRUOUT	THROUGHOUT
TK BD	TACKBOARD
TLT	TOILET
TMPD	TEMPERED
TMPD GL	TEMPERED GLASS
TN	TRUE NORTH
TO	TOP OF __
TO FDN	TOP OF FOUNDATION
TOB	TOP OF BEAM
TOM	TOP OF MASONRY
TOP	TOP OF PARAPET
TOS	TOP OF STEEL
TYP	TYPICAL
U	
U.N.O.	UNLESS NOTED OTHERWISE
U.O.N.	UNLESS OTHERWISE NOTED
V	
VC	VA FURNISHED / CONTRACTOR INSTALLED
VCT	VINYL COMPOSITION TILE OR VITRIFIED CLAY TILE
VENT	VENTILATION
VERT	VERTICAL
VIF	VERIFY IN FIELD
VV	VA FURNISHED / VA INSTALLED
W	
W/	WITH
WD	WOOD
WP	WALL PROTECTION / WEATHERPROOF

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC
consulting engineers

8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signature not valid without Certificate below seal.

JONATHAN M. OAKS REGISTERED ARCHITECT 31080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL
• DESIGN GROUP, PC •

8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833

HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title:
ARCHITECTURAL ABBREVIATIONS

Project Title:
RENOVATE MED SURGE WARDS

Project Number: 564-17-140

Building Number: 1

Project Phase:
BID DOCUMENTS

FULLY SPRINKLERED


Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: MS

Drawing Number: **AI002**

Sheet 30 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs

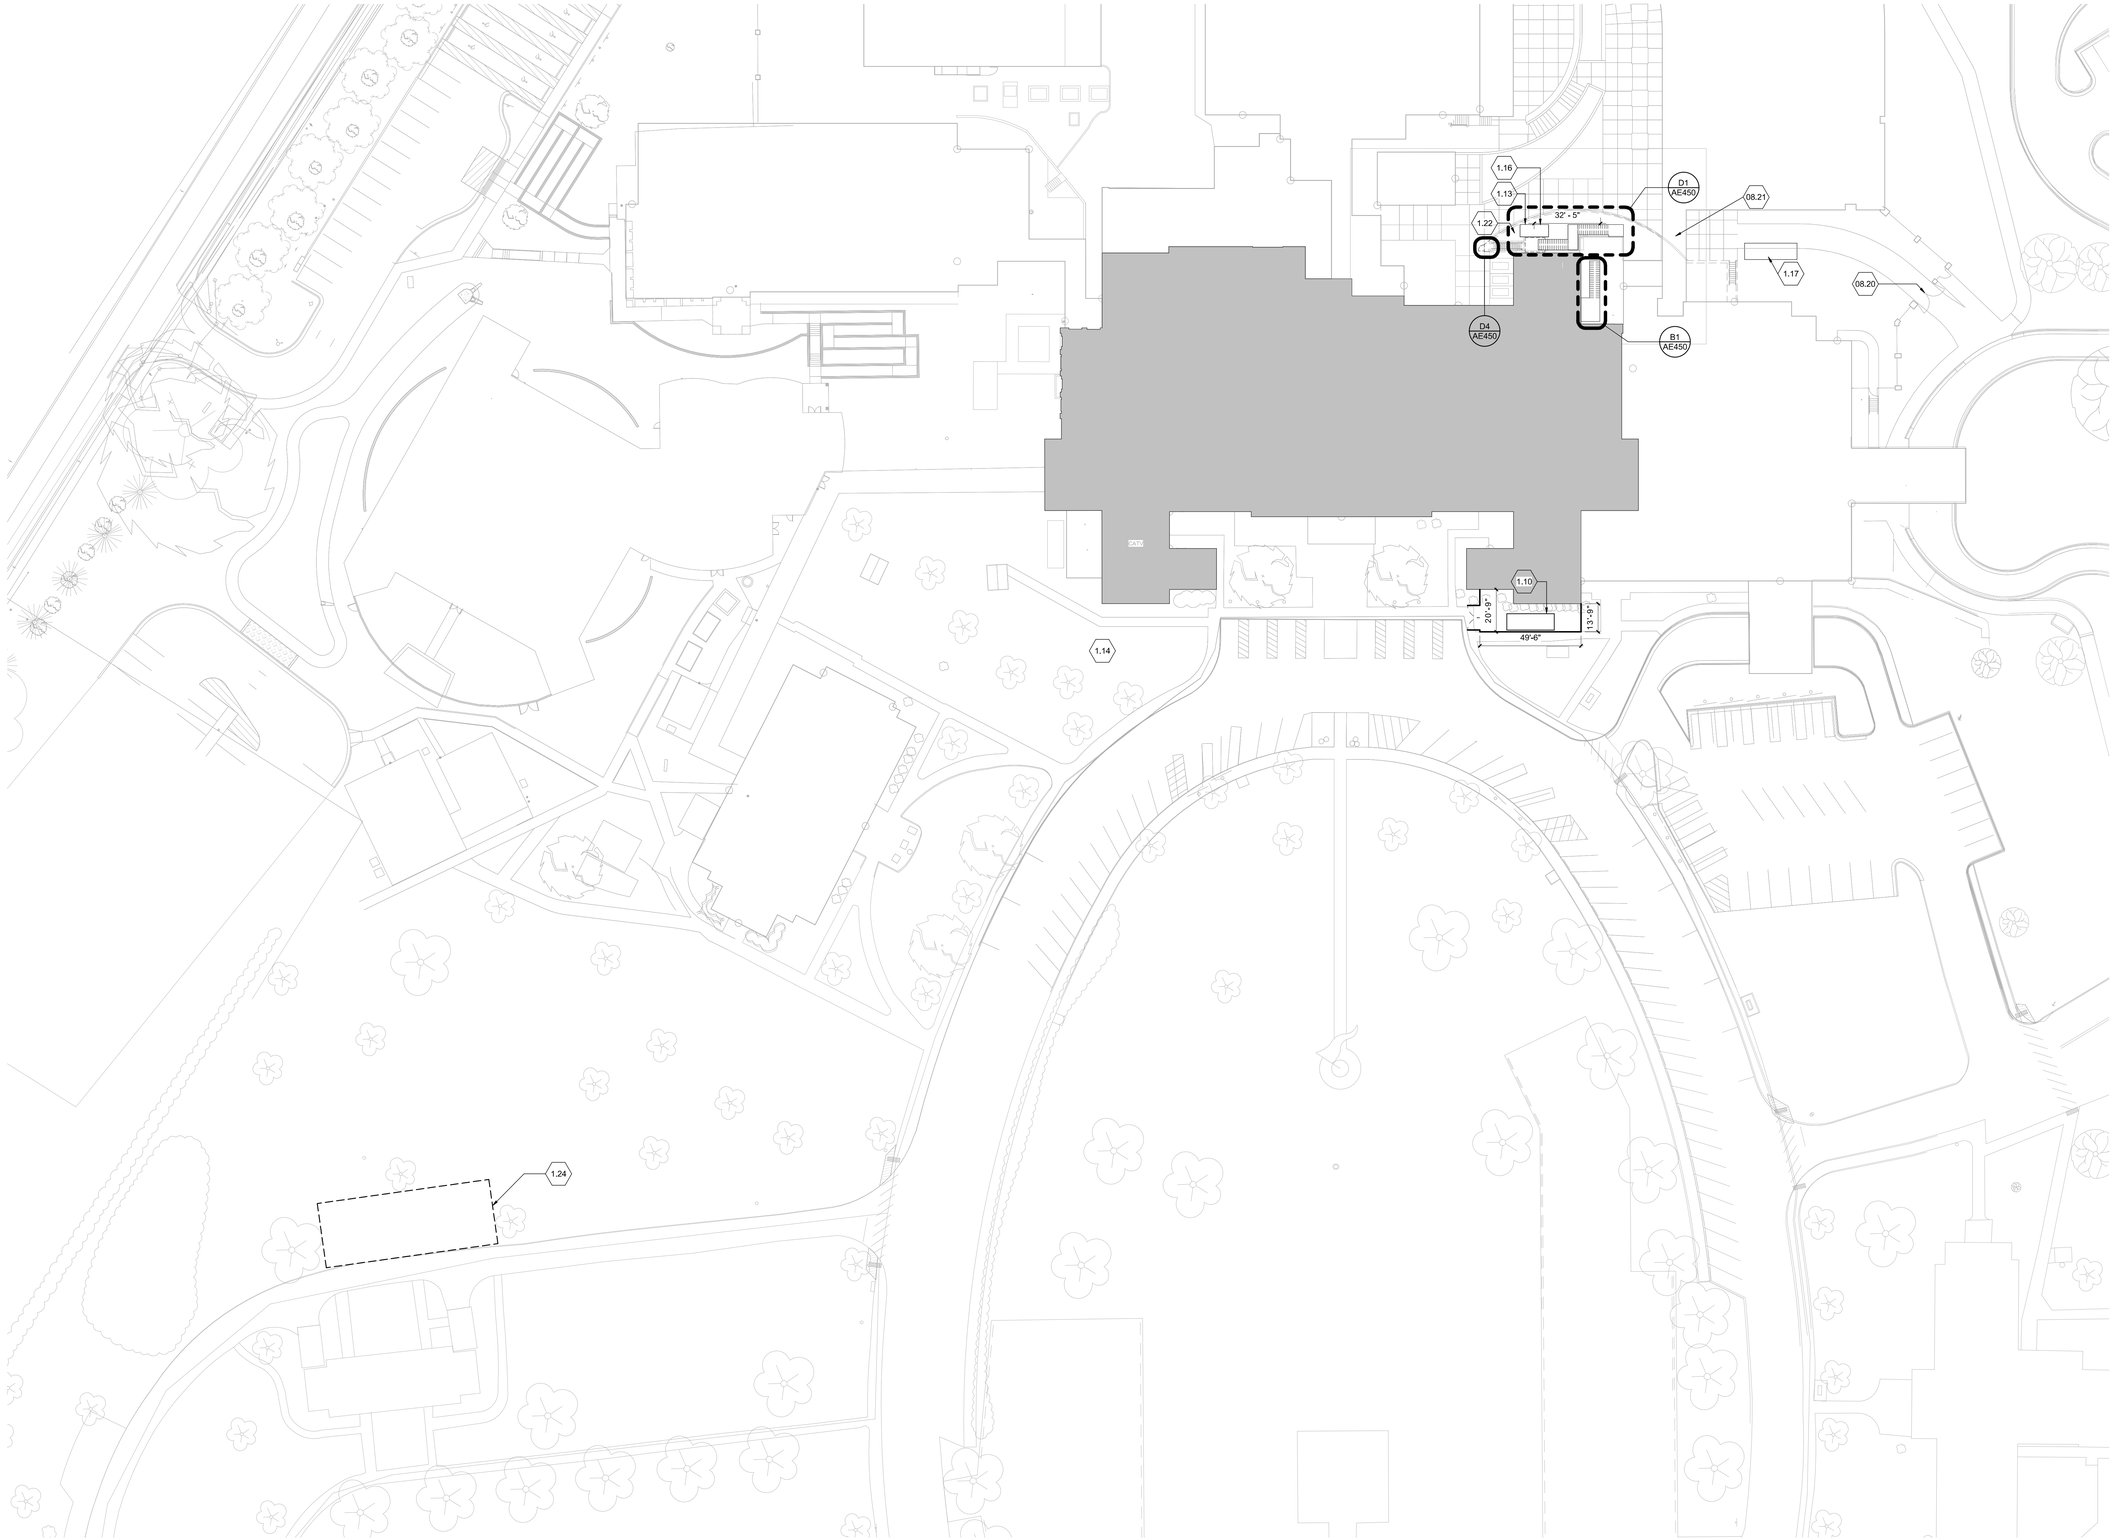

GENERAL SHEET NOTES

A. RESEED FENCED AREAS UPON COMPLETION OF PHASED WORK AND REMOVAL OF FENCES. SEE SPEC SECTION 32 90 00 FOR SEEDING REQUIREMENTS.

B. PERFORM CIVIL SITE SURVEYS PRIOR TO COMMENCING EXTERIOR WORK. SEE SPEC SECTION 01 00 00.

C. PERFORM UTILITY LOCATING SERVICES PRIOR TO STARTING CONSTRUCTION TO DETERMINE AND FIELD VERIFY UTILITY LOCATIONS. COORDINATE ALL WORK WITH THE RESPECTIVE UTILITY COMPANY AND THE COR.

D. ANY DISCREPANCIES OR CONFLICTS WHICH BECOME APPARENT BEFORE OR DURING CONSTRUCTION, SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER OF RECORD OR COR. PRIOR TO CONSTRUCTION SO THAT RESIGN OR CLARIFICATION MAY OCCUR.

E. CONDUCT SITE ACTIVITIES TO PROVIDE MINIMUM TRAFFIC DISRUPTIONS AND FOLLOW VA FACILITY GUIDELINES.

F. CONTRACTOR TO MAINTAIN EXISTING SITE DRAINAGE IN WORK AREAS.

G. PERFORM EXISTING CONDITIONS SURVEYS INSIDE AND OUTSIDE PRIOR TO WORK. SEE SPEC SECTION 01 00 00.

H. UPON COMPLETION OF CONTRACT, RESTORE, REPLACE, AND/OR REINSTALL DAMAGED EXISTING WORK (LAWN, UTILITIES, ROADS, WALKS, ETC). LEAVE WORK IN SAME CONDITION AS EXISTED BEFORE COMMENCING WORK.

I. PRIOR TO CONSTRUCTING FENCE LOCATIONS, COORDINATE WITH COR. SEE SPEC SECTION 01 00 00 FOR TEMPORARY FENCE AND STAGING REQUIREMENTS. PROVIDE COR DUPLICATE KEY OR CODE TO ALL FENCE GATE LOCKS.

J. PROTECT EXISTING TREES, SHRUBS, AND OTHER FORMS OF VEGETATION DURING CONSTRUCTION. FOR TREES LOCATED IN FENCED WORK AREAS, INSTALL TREE PROTECTION ZONES (TPZ) PRIOR TO CONSTRUCTION WORK ACTIVITIES. TPZ IS AN EXCLUSION ZONE INCLUDING CONTINUOUS 4'-0" TALL TREE PROTECTION AND ONE (1) TEMPORARY CONSTRUCTION SAFETY SIGN PER TREE MOUNTED TO TPZ FENCE POST. 12"x24" SIGN STATES IN ENGLISH AND SPANISH "TREE PROTECTION – DO NOT ENTER". 4'-0" ROLL FENCE TO BE USED. FABRIC COLOR IS BRIGHT ORANGE. CONSTRUCTION MATERIALS AND WORK ACTIVITIES ARE PROHIBITED INSIDE TPZ. TREE PROTECTION RADIUS IS CALCULATED AS FOLLOWS:

TPZ RADIUS AROUND THE TRUNK = TRUNK DIAMETER IN INCHES x 1.5 MULTIPLIER = TPZ RADIUS IN FEET.

EXAMPLE:
TRUNK DIAMETER = 8 INCHES
8" TRUNK x 1.5 MULTIPLIER = 12'-0" RADIUS TPZ MEASURED FROM TRUNK.


SHEET KEYNOTES

1.10 FENCED DUMPSTER LOCATION DURING CONSTRUCTION OF 2B.
1.13 CONTRACTOR SHALL REMOVE EXISTING GRASS AND LEVEL THE PAD FOR TEMPORARY AHU. PROVIDE GEOFABRIC ON GRADE W/ 4" GRAVEL BASE FOR TEMPORARY AHU.
1.16 LOCATION OF TEMPORARY AHU TO SERVE 1B DURING 2B CONSTRUCTION. LOCATE ON BERM.
1.17 GENERATOR TO SERVICE TEMPORARY AHU. LOCATE MINIMUM 25'-0" AWAY FROM TEMPORARY AHU UNIT.
1.22 SEE DETAIL D4 ON SHEET AE450 FOR EXISTING SITEWORK INFORMATION RELATING TO EAST STAIR LOCATION.
1.24 UNFENCED CONNEX MATERIAL STORAGE AREA. COORDINATE PRECISE CONNEX LOCATIONS WITH COR. PROVIDE COR DUPLICATE KEY TO ALL CONNEXES STORED ON SITE.
08.20 RETROFIT EXISTING SECURED GATE WITH AN ELECTRIFIED RIM PANIC DEVICE-WEATHERIZED AT EACH LEAF (FREE EGRESS AT HOSPITAL SIDE) WEATHERPROOF CARD READER AT PUBLIC SECURE SIDE.
08.21 MAX. OPENING, 11'-6"H x 15'-6"W.

SYMBOLS LEGEND

CONSTRUCTION FENCE AND GATES. COORDINATE PRECISE LOCATION WITH VA-COR. SEE SPEC SECTION 01 00 00.

KEY PLAN

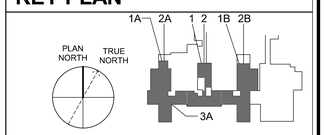

THIRD FLOOR FFE: 1505.0'
SECOND FLOOR FFE: 1493.0'
FIRST FLOOR FFE: 1479.0'

F1 ARCHITECTURAL SITE PLAN

1" = 30'-0"

0 30' 60'

Revisions:

No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES INC
consulting engineers

8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0495
WWW.BRITTPETERS.COM

Seal:

Digital Signatures not valid without Certificate below seal.

JONATHAN M. OAKS REGISTERED ARCHITECT 31080 CHARLOTTE, NC

ARCHITECT / ENGINEERS:

HARRELL • DESIGN GROUP, PC •

8016 TOWER POINT DRIVE P 704.814.1320
CHARLOTTE, NC 28227 F 704.321.0833

HDG PROJECT: 18002
COPYRIGHT © 2023

Drawing Title: ARCHITECTURAL SITE PLAN

Project Phase: BID DOCUMENTS

FULLY SPRINKLERED

Project Title: RENOVATE MED SURGE WARDS

Location: VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date: MARCH 24, 2024 | Checked: JC/LK | Drawn: DW

Project Number: 564-17-140

Building Number: 1

Drawing Number: AS001

Sheet 31 of 162

Engineering Service
VETERANS HEALTH CARE SYSTEM OF THE OZARKS
VA U.S. Department of Veterans Affairs