KEY NOTES:

- (A) LABELED (STAMP TYPE) DOOR FRAME.
- (B) FIRE SPRINKLERS INSTALLED PER FLOOR MOUNTED OBSTRUCTION SPACING REQUIREMENTS OF TABLE 8.6.5.2.2 IN NFPA 13–2013 EDITION.
- (C) SEE EQUIVALENCY FOR OVERSIZED PROTECTIVE PLATE ON FIRE DOOR.
- (D) DOOR RATING AND FRAME LABEL UNDER PIANO HINGE.
- (E) NOT AN EXIT. CIRCULATION STAIR ONLY.
- (F) FIRE SEPARATION AT FIRST FLOOR LEVEL.
- (G) THREE STORY COMMUNICATING SPACE OPEN AREA SMOKE DETECTION PROVIDED PER SECTION 8.6.6(3) OF NFPA 101–2012 EDITION.
- (H) UL LISTED WINDOW SPRINKLER PROTECTION EQUIVALENT TO SMOKE BARRIER. 1 HOUR FIRE RATED AND 2 HOUR FIRE RATED CONSTRUCTION REQUIREMENTS.
- (I) 1 HOUR FIRE RATED ENCLOSURES NOT REQUIRED FOR ELECTRICAL ROOMS WITH TRANSFORMERS GREATER THAN 112.5 KVA AND WITH CLASS 155 OR HIGHER INSULATION SYSTEM PER ARTICLE 450.21, EXCEPTION NO. 2 OF NFPA 70–2011 EDITION.

GENERAL DRAWING NOTES (BUILDING 1)

1. BUILDING CONSTRUCTED IN 1932.
2. PRIMARY CARE ADDITION BUILT TO 1994 EDITION OF NFPA 101.
3. 2N URGENT CARE EXPANSION BUILT TO 2000 EDITION OF NFPA 101.
4. 2S URGENT CARE EXPANSION BUILT TO 2006 EDITION OF NFPA 101.
5. PHARMACY EXPANSION BUILT TO 2006 EDITION OF NFPA 101.
6. LOADING DOCK BUILT TO 2006 EDITION OF NFPA 101.

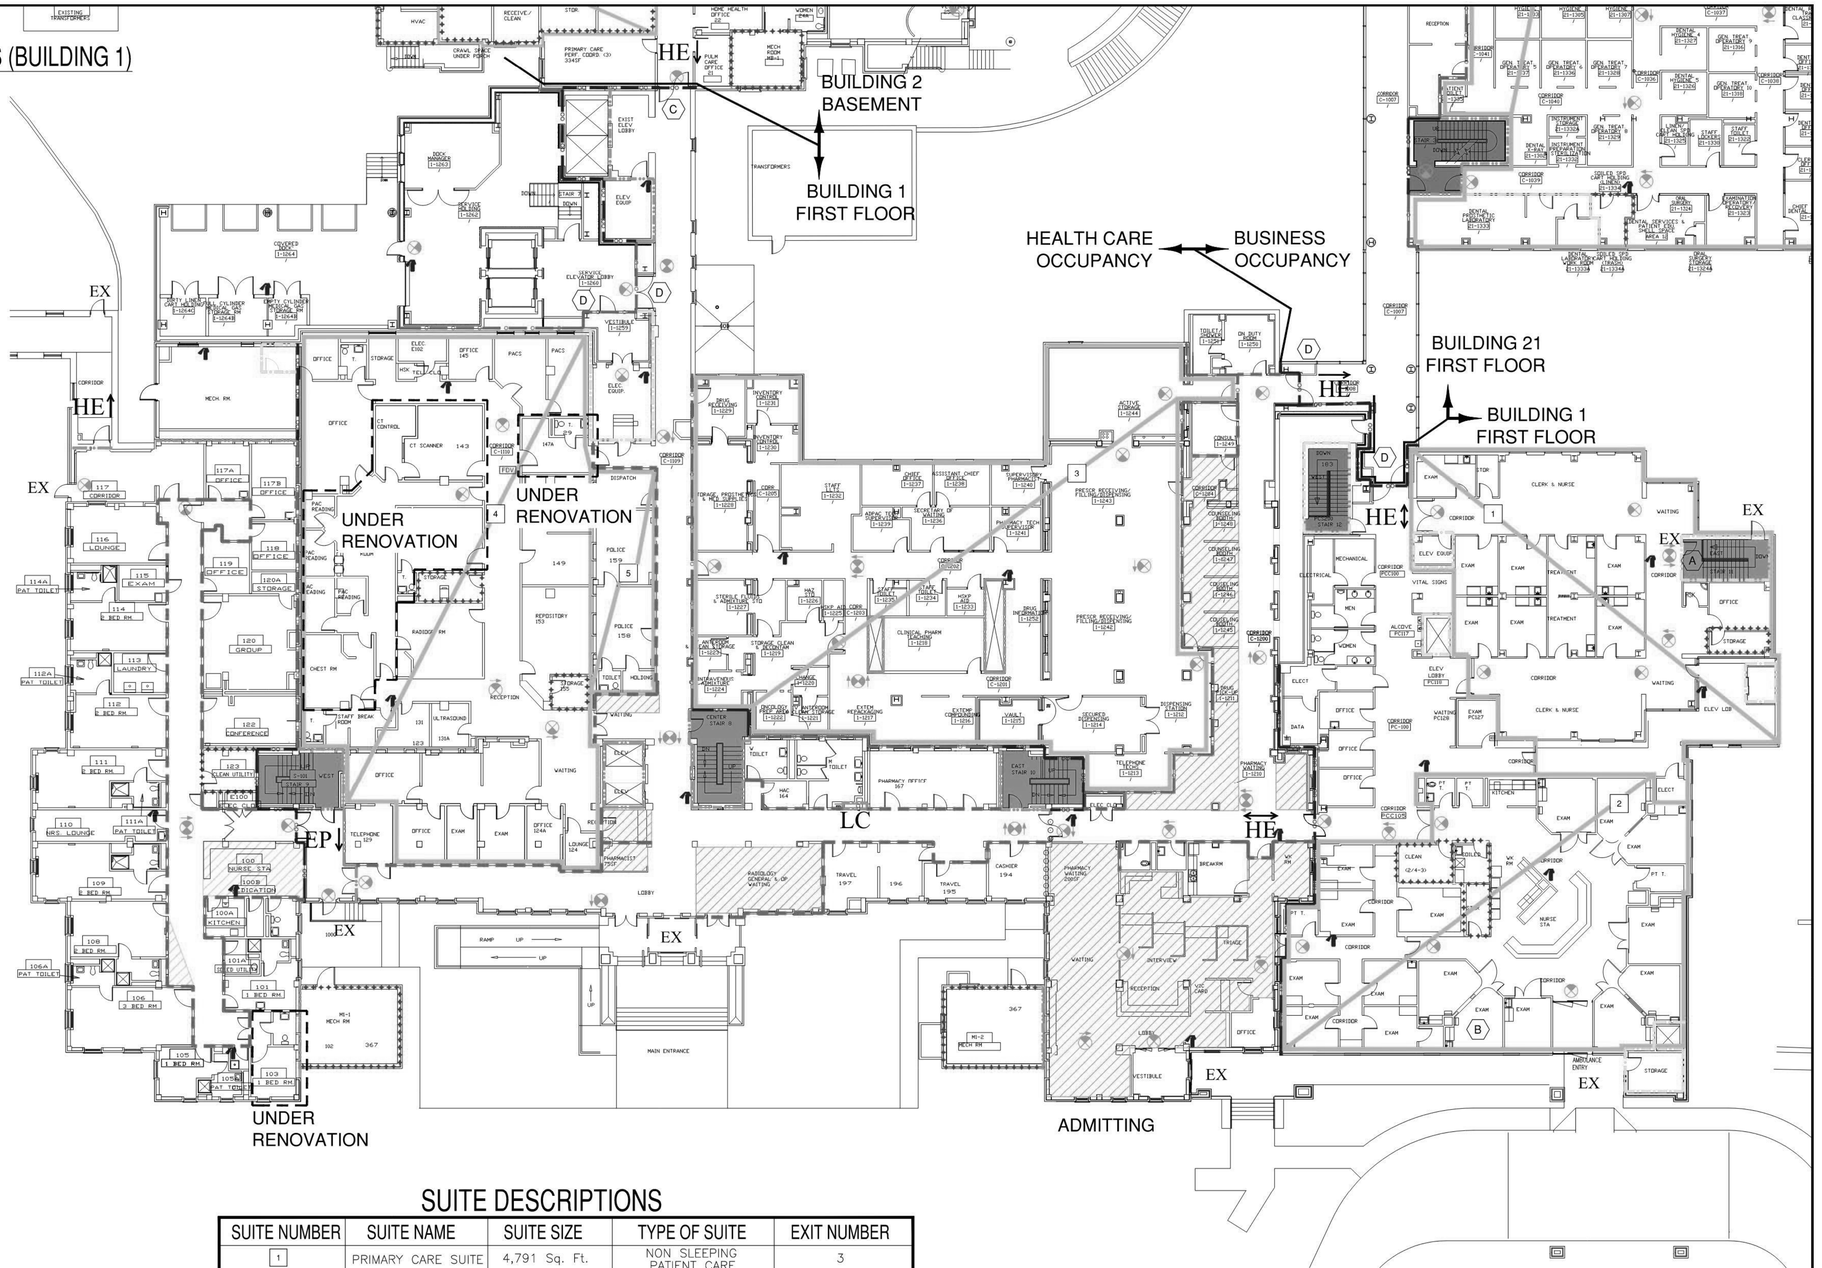

SYMBOLS LIST

- 2 HOUR FIRE/SMOKE BARRIER
- 1 HOUR FIRE/SMOKE BARRIER
- 2 HOUR FIRE BARRIER
- 1 HOUR FIRE BARRIER
- SMOKE RESISTIVE HAZARDOUS AREA
- NON RATED SMOKE PARTITION
- NON–RATED SMOKE BARRIER (COMMUNICATING SPACE)
- NON–FIRE–RATED PARTITION
- HE HORIZONTAL EXIT PASSAGEWAY
- EX EXIT
- EP EXIT PASSAGEWAY
- LC LINEN CHUTE
- TC TRASH CHUTE
- SUITE DESIGNATIONS
- AREA OPEN TO CORRIDOR – WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR – NO SMOKE DETECTION REQUIRED
- EXIT STAIR OR PASSAGEWAY
- FIRE EXTINGUISHER
- DIRECTION OF EXIT SIGN CHEVRON
- DIRECTION OF EXIT SIGN ILLUMINATION
- BATTERY PACK LIGHT
- EWS EYE WASH STATION

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	PRIMARY CARE SUITE	4,791 Sq. Ft.	NON SLEEPING PATIENT CARE	3
2	URGENT CARE SUITE	4,869 Sq. Ft.	NON SLEEPING PATIENT CARE	2
3	PHARMACY SUITE	8,500 Sq. Ft.	NON PATIENT CARE	3
4	RADIOLOGY/EKG SUITE	7,397 Sq. Ft.	NON SLEEPING PATIENT CARE	2
5	POLICE SUITE	733 Sq. Ft.	NON PATIENT CARE	2

BUILDING 1 FIRST FLOOR

FULLY SPRINKLERED MIXED OCCUPANCY

FOR REFERENCE ONLY

Revisions	Date
FP&C Proj.#:	1552.27
GFS Proj.#:	

Dept. of Veterans Affairs
VA Medical Center
1100 North College
Fayetteville, AR 72703

Goodwin Facilities Solutions
19375 Highway 74
Elkins, AR 72727

FIRE PROTECTION & CODE CONSULTANTS, L.L.C.
1520 MAIN STREET
INDIANAPOLIS, IN 46224
(317)486-5188

Drawing Title	BUILDING 1 FIRST FLOOR
Contract No.	
AutoCAD File Name	SOC02 1-1
Project Title	STATEMENT OF CONDITIONS
Designed By	FVO
Checked By	FVO
Drawn By	KW/DN
Date	1/26/17
Location	VA MEDICAL CENTER FAYETTEVILLE, ARKANSAS
Scale:	N.T.S.
Drawing No.	SOC-3
Sht.	20 of 162