
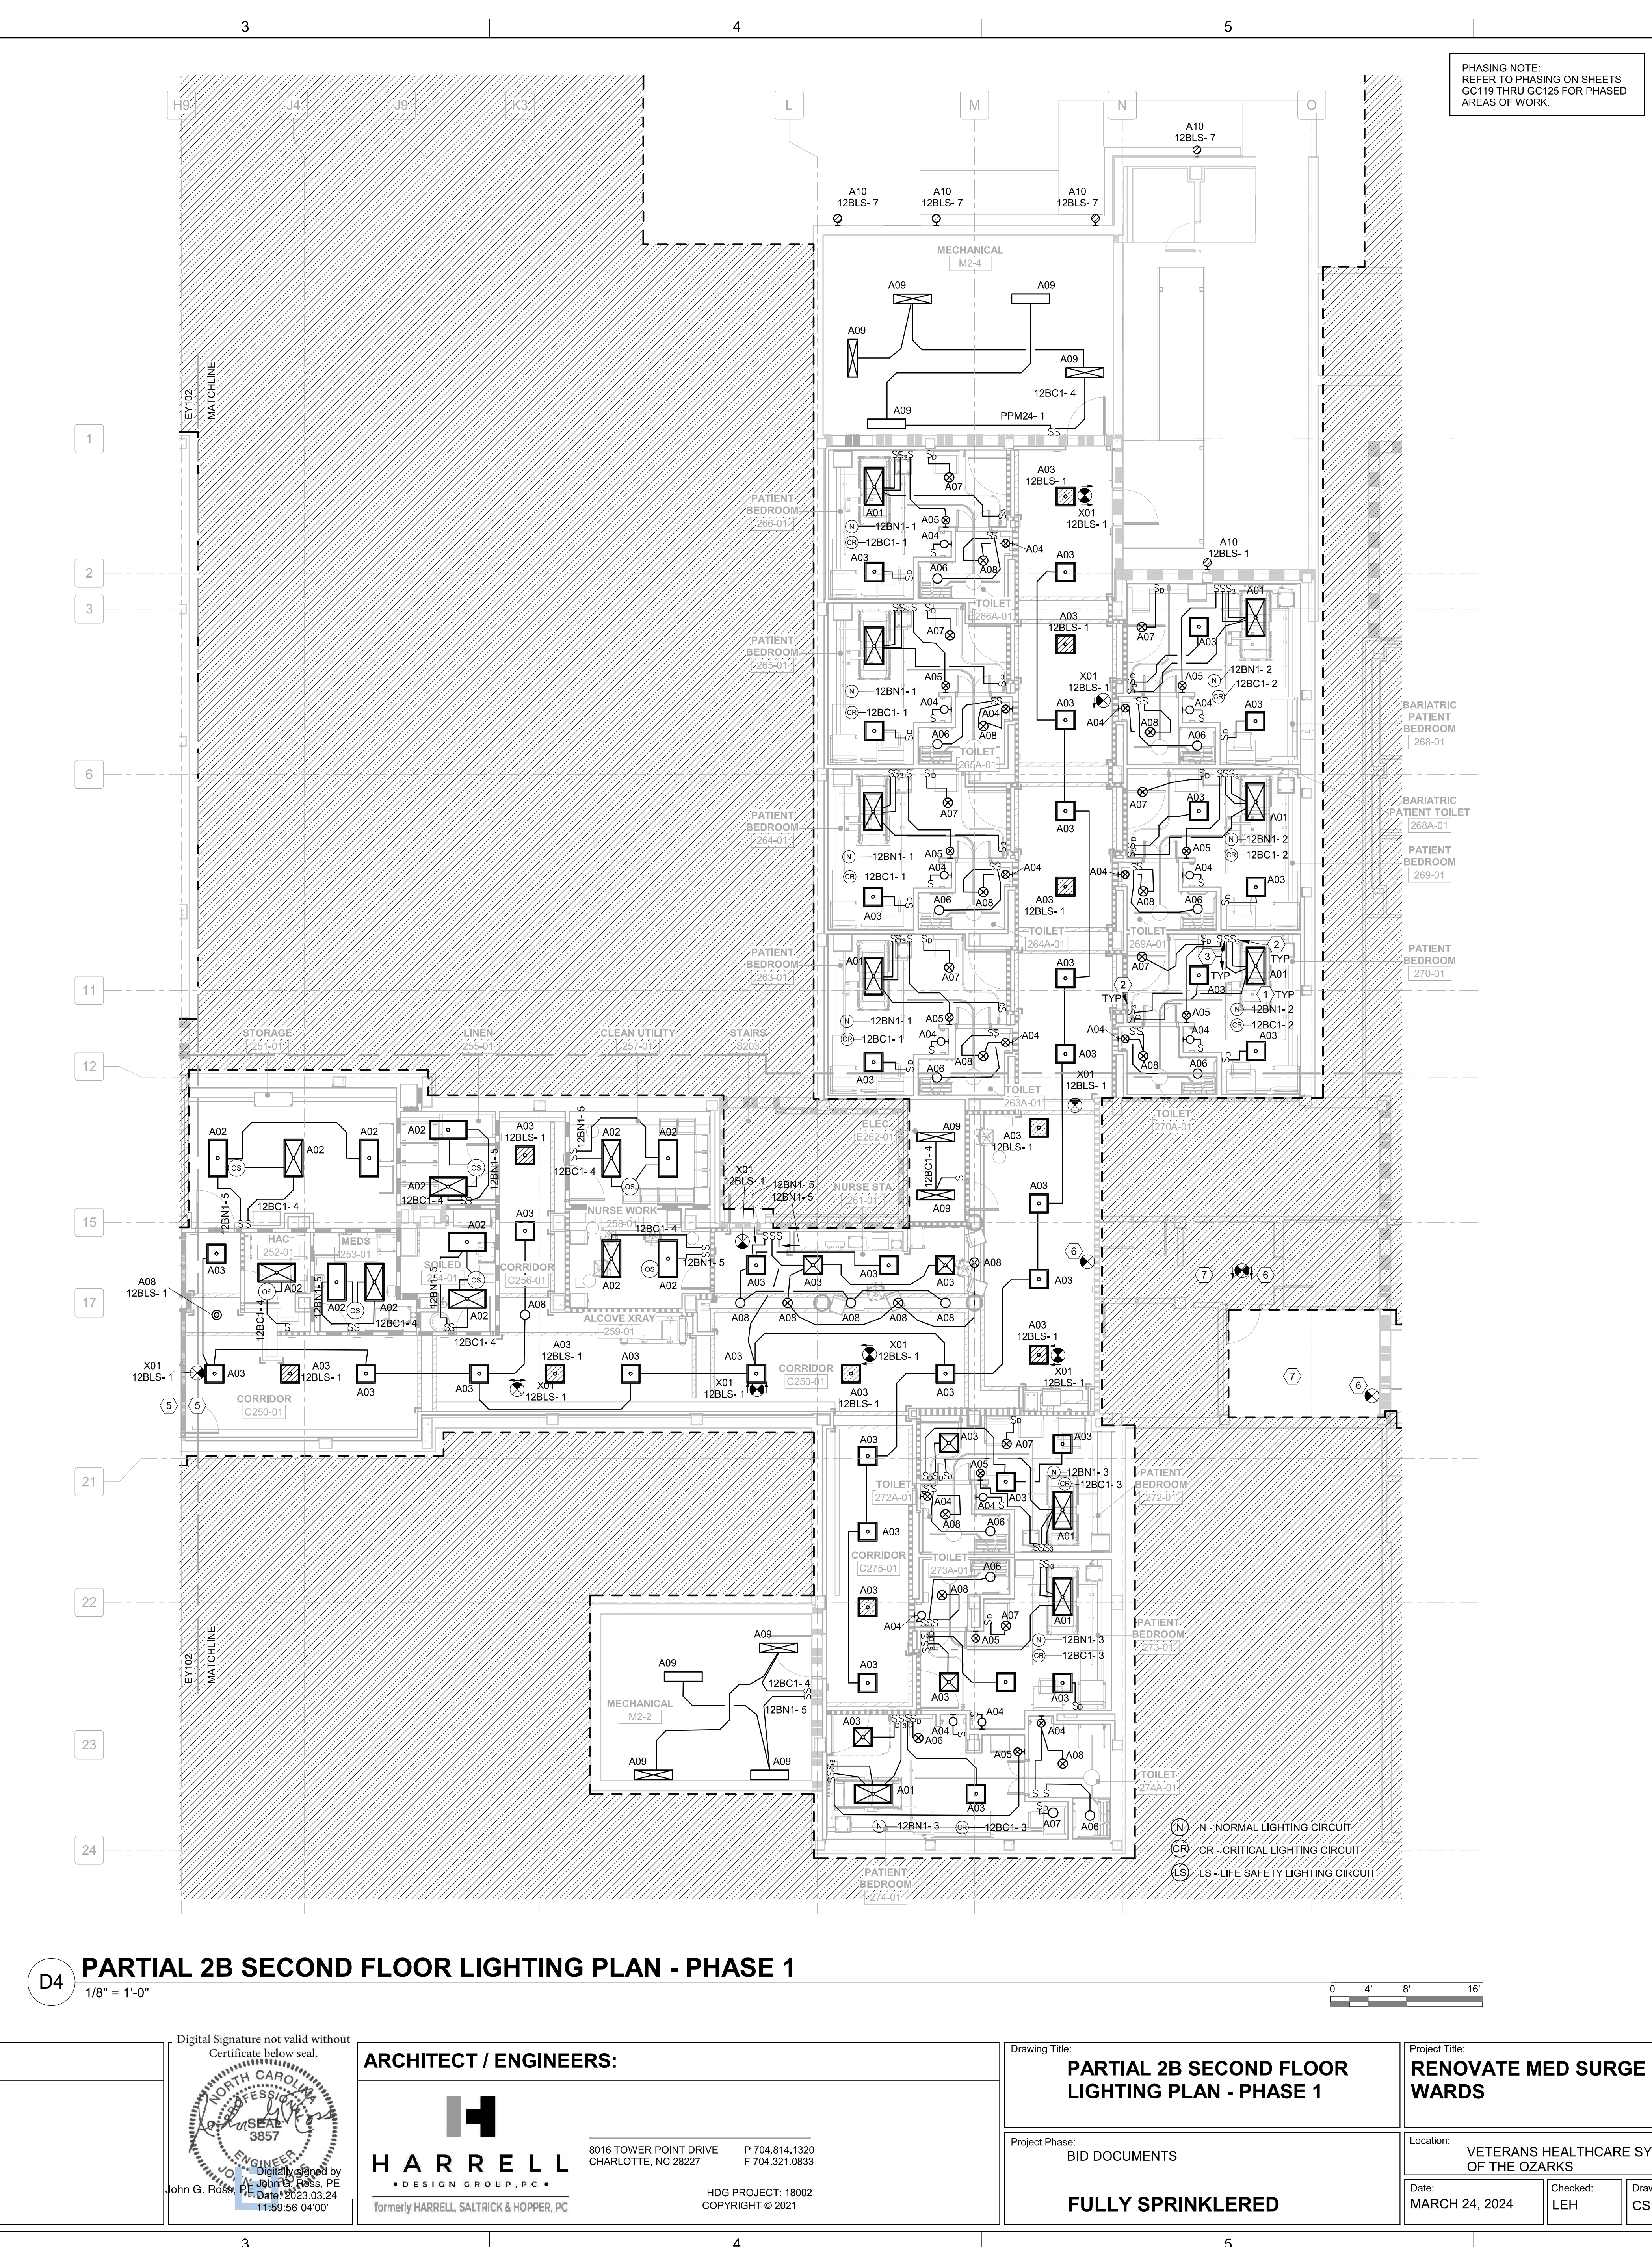


three inches = one foot
one inch = one foot
one half inch = one foot
three quarters inch = one foot
one eighth inch = one foot
one quarter inch = one foot
one eighth inch = one foot

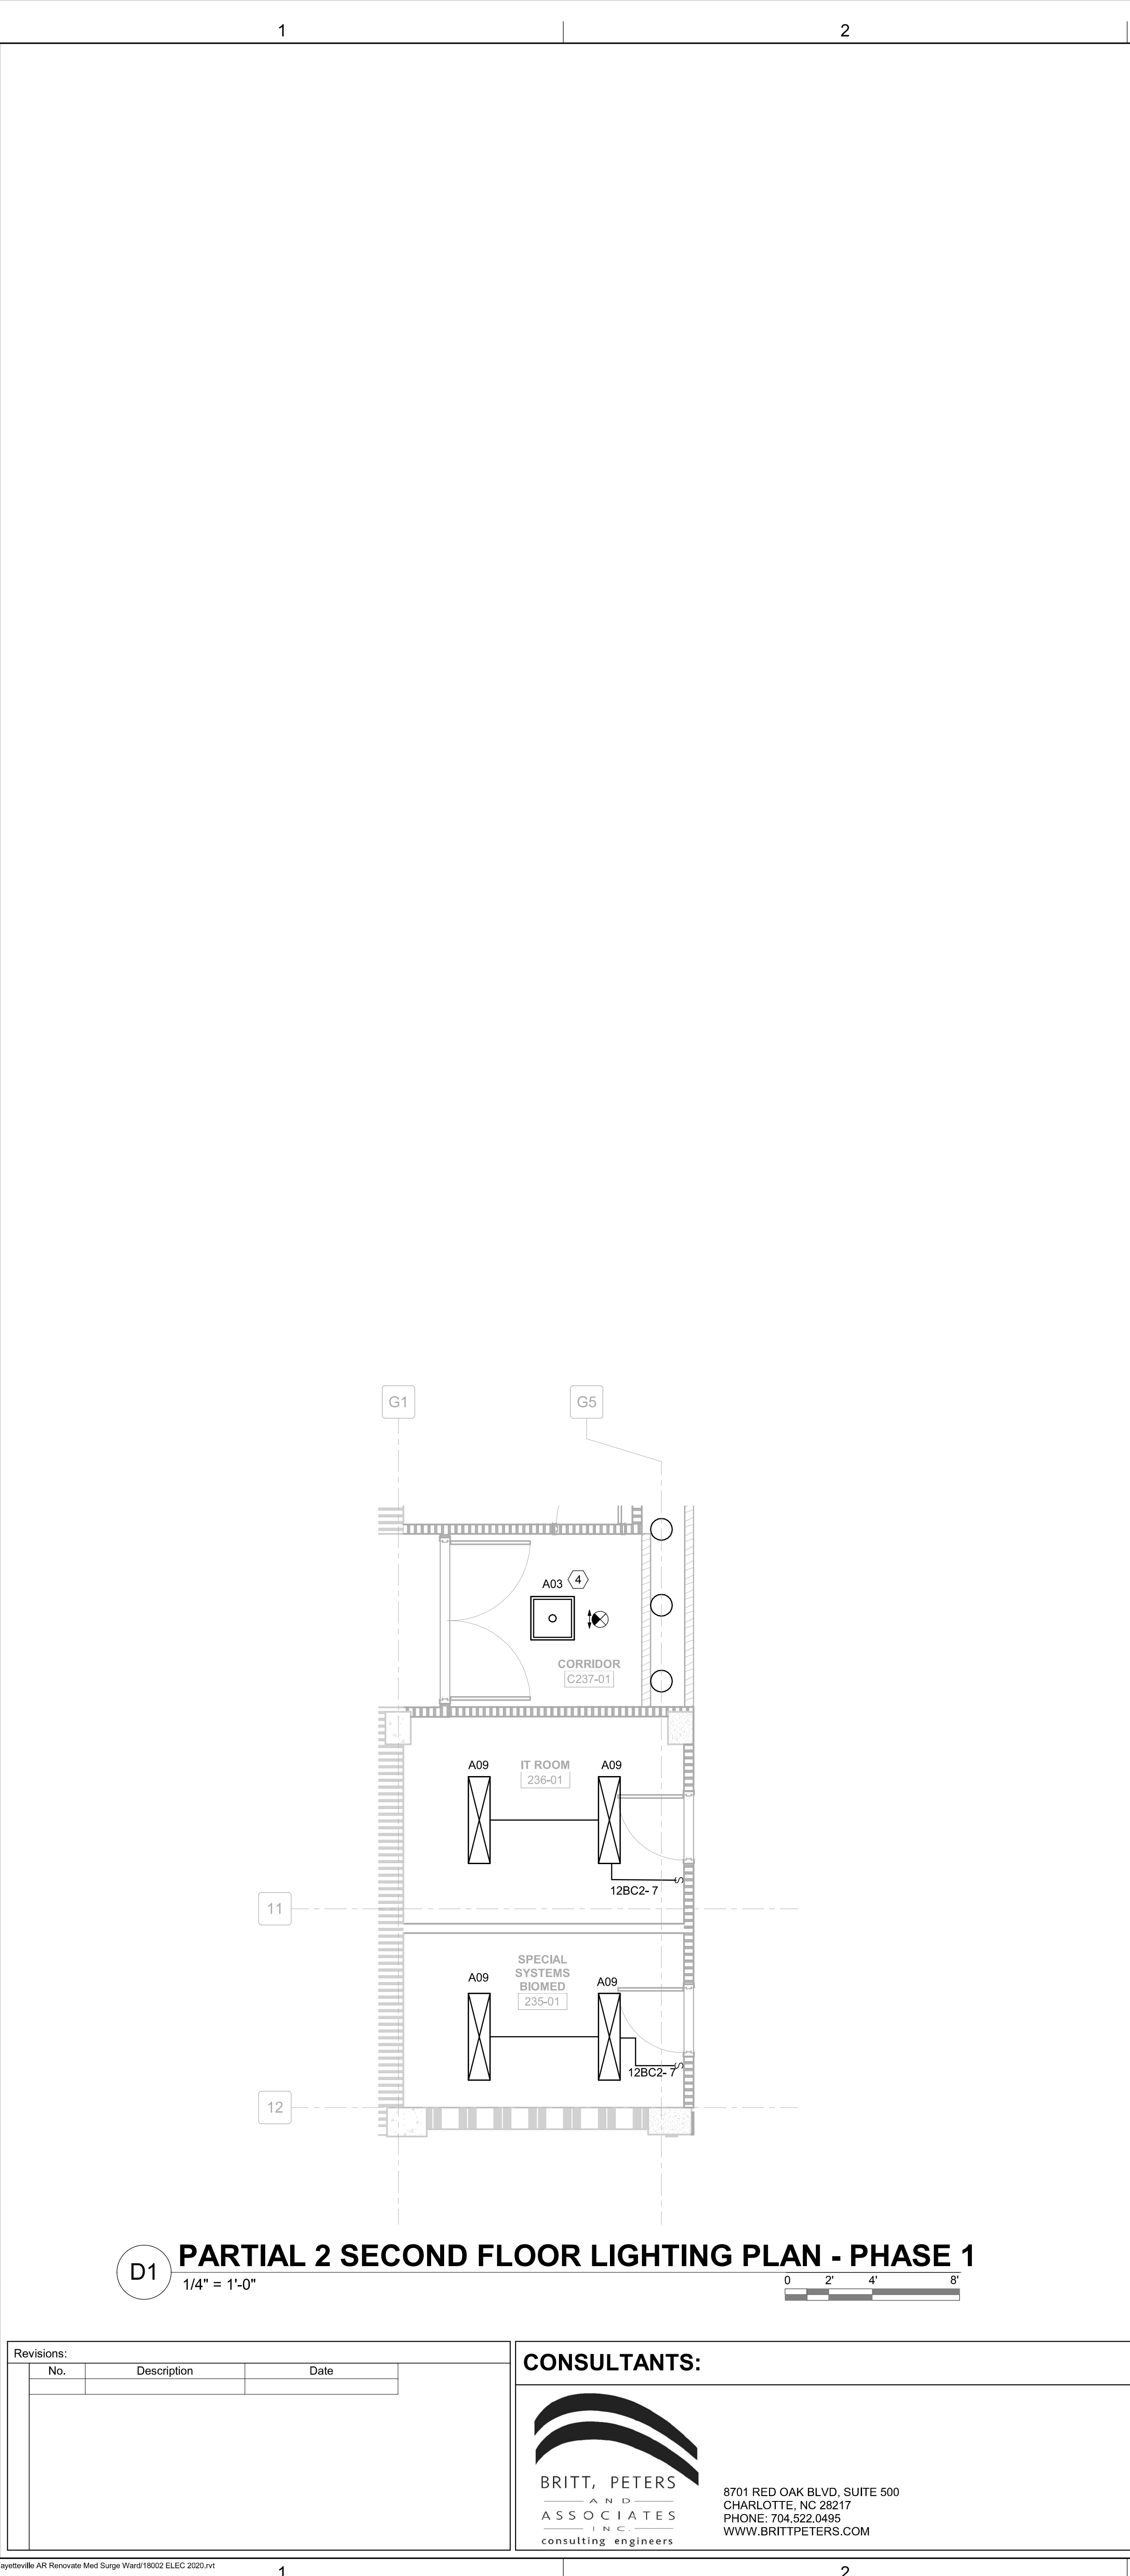

GENERAL NOTES

A. REFER TO DRAWING EG001 FOR TYPICAL SYMBOLS AND ABBREVIATIONS USED IN THIS DRAWING.

B. REFER TO ARCHITECTURAL REFLECTED CEILING PLAN FOR EXACT LOCATIONS OF ALL CEILING MOUNTED FIXTURES AND DEVICES.

C. CONNECT ALL EMERGENCY EGRESS LIGHTING AND EXIT SIGNS AHEAD OF ANY LOCAL SWITCHING.

D. REVIEW THE CONSTRUCTION DOCUMENTS OF ALL TRADES FOR ADDITIONAL PHASING REQUIREMENTS.

SHEET KEYNOTES

1. MULTIFUNCTION LIGHT FIXTURE READING LIGHT SHALL BE POWERED FROM THE NORMAL POWER BRANCH. THE EXAM, NIGHT LIGHT, AND AMBIENT LIGHT FUNCTIONS SHALL BE POWERED FROM THE CRITICAL BRANCH. READING AND AMBIENT LIGHTING FUNCTIONS SHALL BE CONTROLLED FROM THE PATIENT PILLLOW SPEAKER.

2. 3-WAY SWITCH CONTROLS NIGHT LIGHT FUNCTION OF THE MULTIFUNCTION LIGHT FIXTURE. SEE ARCHITECTURAL DETAIL D6A6405 FOR HEAD WALL SWITCH DETAILS.

3. SWITCH FOR CONTROL OF EXAM LIGHT FUNCTION OF MULTIFUNCTION LIGHT FIXTURE. SEE ARCHITECTURAL DETAIL D6A6406 FOR HEAD WALL DETAILS.

4. DURING PHASE 1 CONNECT NEW LIGHT TO EXISTING AREA LIGHTING CIRCUIT AND RECONNECT TO CIRCUIT SHOWN IN PHASE 2. (SEE SHEET EL102)

5. PHASE 2 RACEWAYS AND CONDUITS FOR POWER, LIGHTING, AND SPECIAL SYSTEMS SERVING PHASE 2 DEVICES SHALL BE INSTALLED IN PHASE 1.

6. PROVIDE TEMPORARY EXIT SIGNS DURING CONSTRUCTION OF PHASE 1. EXIT SIGNS TO BE REMOVED AFTER PHASE ONE. WHEN TEMPORARY DOOR IS REMOVED AND EXISTING PATH OF EGRESS IS RE-ESTABLISHED. CONNECT TO LOCAL EMERGENCY CIRCUIT CLOSEST TO FUTURE.

7. DURING CONSTRUCTION OF PHASE ONE. CONNECT FIXTURES IN THIS AREA TO NEAREST LOCAL EMERGENCY CIRCUIT TO MAINTAIN PATH OF EGRESS. RECONNECT TO CURRENT CIRCUIT AFTER TEMPORARY DOOR IS REMOVED.

PARTITION GRAPHICS

PARTITION PHASING

EXISTING ELEMENT TO REMAIN

EXISTING ELEMENT TO BE DEMOLISHED

TEMPORARY 1-HOUR RATED ELEMENT TO BE CONSTRUCTED AND DEMOLISHED IN SAME PHASE

PARTITION RATING

NO RATING

SMOKE RESISTIVE PARTITION - NON RATED

1 HOUR FIRE BARRIER

1 HOUR FIRE/SMOKE BARRIER

2 HOUR FIRE BARRIER

2 HOUR FIRE/ SMOKE BARRIER

KEY PLAN

PLAN NORTH

TRUE NORTH

THIRD FLOOR FFE: 1505.0'

SECOND FLOOR FFE: 1493.0'

FIRST FLOOR FFE: 1479.0'

Revisions:		
No.	Description	Date

CONSULTANTS:

BRITT, PETERS AND ASSOCIATES

CONSULTING ENGINEERS

8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0405
WWW.BRITTPETERS.COM

Digital Signature not valid without Certificate below seal.

JOHN G. ROSS, PE

11-59-56-04007

ARCHITECT / ENGINEERS:

HARRELL

DESIGN GROUP, P.C.

8016 TOWER POINT DRIVE
CHARLOTTE, NC 28227

P 704.814.1320
F 704.321.0833

HDG PROJECT: 18002
COPYRIGHT © 2021

Drawing Title:

PARTIAL 2B SECOND FLOOR LIGHTING PLAN - PHASE 1

Project Phase:

BID DOCUMENTS

FULLY SPRINKLERED

Project Title:

RENOVATE MED SURGE WARDS

Location:

VETERANS HEALTHCARE SYSTEM OF THE OZARKS

Date:

MARCH 24, 2024

Checked:

LEH

Drawn:

CSR

Project Number:

564-17-140

Building Number:

1

Drawing Number:

EL101

Sheet

146 of 162

Engineering Service

VETERANS HEALTH CARE SYSTEM OF THE OZARKS

VA

U.S. Department of Veterans Affairs