

D2 ELECTRICAL SITE PLAN
1" = 30'-0"

SHEET KEYNOTES

- TEMPORARY GENERATOR SHALL BE RATED MINIMUM 60KW, 208V, 3-PHASE EQUIPMENT WITH A MINIMUM 48-HOUR FUEL TANK.
- CONTRACTOR SHALL PROVIDE TEMPORARY WIREWAY FROM TEMPORARY GENERATOR LOCATION ALONG EXISTING RETENTION WALL ROUTED BELOW WALKWAY UP HIGH NEAR CEILING STRUCTURE IN CORNER AND CONTINUE ROUTING ALONG RETENTION WALL TO TEMPORARY AHU NEAR STAIR AND CONNECT POWER CABLES TO EQUIPMENT DISCONNECT.


Revisions:		
No.	Description	Date

CONSULTANTS:



8701 RED OAK BLVD, SUITE 500
CHARLOTTE, NC 28217
PHONE: 704.522.0405
WWW.BRITTPETERS.COM

Digital Signature not valid without
Certificate below seal.

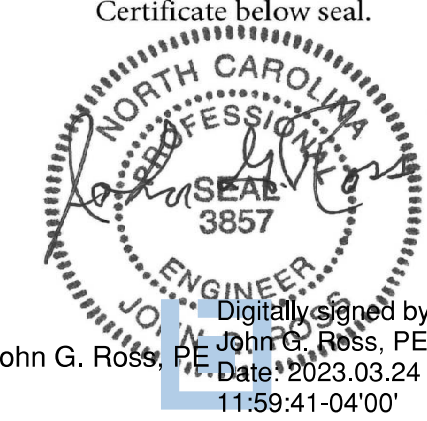

ARCHITECT / ENGINEERS:



8016 TOWER POINT DRIVE
CHARLOTTE, NC 28227
P 704.814.1320
F 704.321.0833

HDG PROJECT: 18002
COPYRIGHT © 2021

Drawing Title:

ELECTRICAL SITE PLAN

Project Phase:

BID DOCUMENTS

FULLY SPRINKLERED

Project Title:

RENOVATE MED SURGE
WARDS

Location:

VETERANS HEALTHCARE SYSTEM
OF THE OZARKS

Date:

MARCH 24, 2024

Checked:

LEH

Drawn:

CSR

Project Number:

564-17-140

Building Number:

Drawing Number:

ES101

Sheet 142 of 162

Engineering
Service



VA U.S. Department
of Veterans Affairs