SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	EXIT NUMBER	TYPE OF SUITE
1	SURGERY SUITE	6,707 Sq. Ft.	2	NON PATIENT CARE
2	ICU SUITE	4,178 Sq. Ft.	2	NON PATIENT CARE
3	OUTPATIENT SURGERY SUITE	1,835 Sq. Ft.	1	NON SLEEPING PATIENT CARE

KEY NOTES:

- (A) SPRINKLER LAYOUT MEETS FLOOR OBSTRUCTION REQUIREMENTS OF SECTION 8.6.5.2.2 OF NFPA 13–2013 EDITION.
- (B) SEE EQUIVALENCY FOR OVER SIZED PROTECTIVE PLATES ON FIRE DOORS.
- (C) FIRE SPRINKLERS INSTALLED PER THE 3:1 MAXIMUM DIMENSION OBSTRUCTION REQUIRMENTS OF SECTION 8.6.5.2.1.3 OF NFPA 13–2013 EDITION.
- (D) EXISTING HEALTH CARE OCCUPANCY DEAD END CORRIDORS EXCEEDING 30 FEET PERMITTED PER SECTION 19.2.5.2 OF NFPA 101–2015 EDITION. SEE ADDITIONAL DOCUMENTS IN SOC BINDER.

SYMBOLS LIST

- 2 HOUR FIRE/SMOKE BARRIER
- 1 HOUR FIRE/SMOKE BARRIER
- 2 HOUR FIRE BARRIER
- 1 HOUR FIRE BARRIER
- SMOKE RESISTIVE HAZARDOUS AREA
- NON RATED SMOKE PARTITION
- NON–RATED SMOKE BARRIER (COMMUNICATING SPACE)
- NON–FIRE–RATED PARTITION
- HE HORIZONTAL EXIT PASSAGEWAY
- EX EXIT
- EP EXIT PASSAGEWAY
- LC LINEN CHUTE
- TC TRASH CHUTE
- SUITE DESIGNATIONS
- AREA OPEN TO CORRIDOR – WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR – NO SMOKE DETECTION REQUIRED
- EXIT STAIR OR PASSAGEWAY
- FIRE EXTINGUISHER
- DIRECTION OF EXIT SIGN CHEVRON
- DIRECTION OF EXIT SIGN ILLUMINATION
- BATTERY PACK LIGHT
- EWS EYE WASH STATION

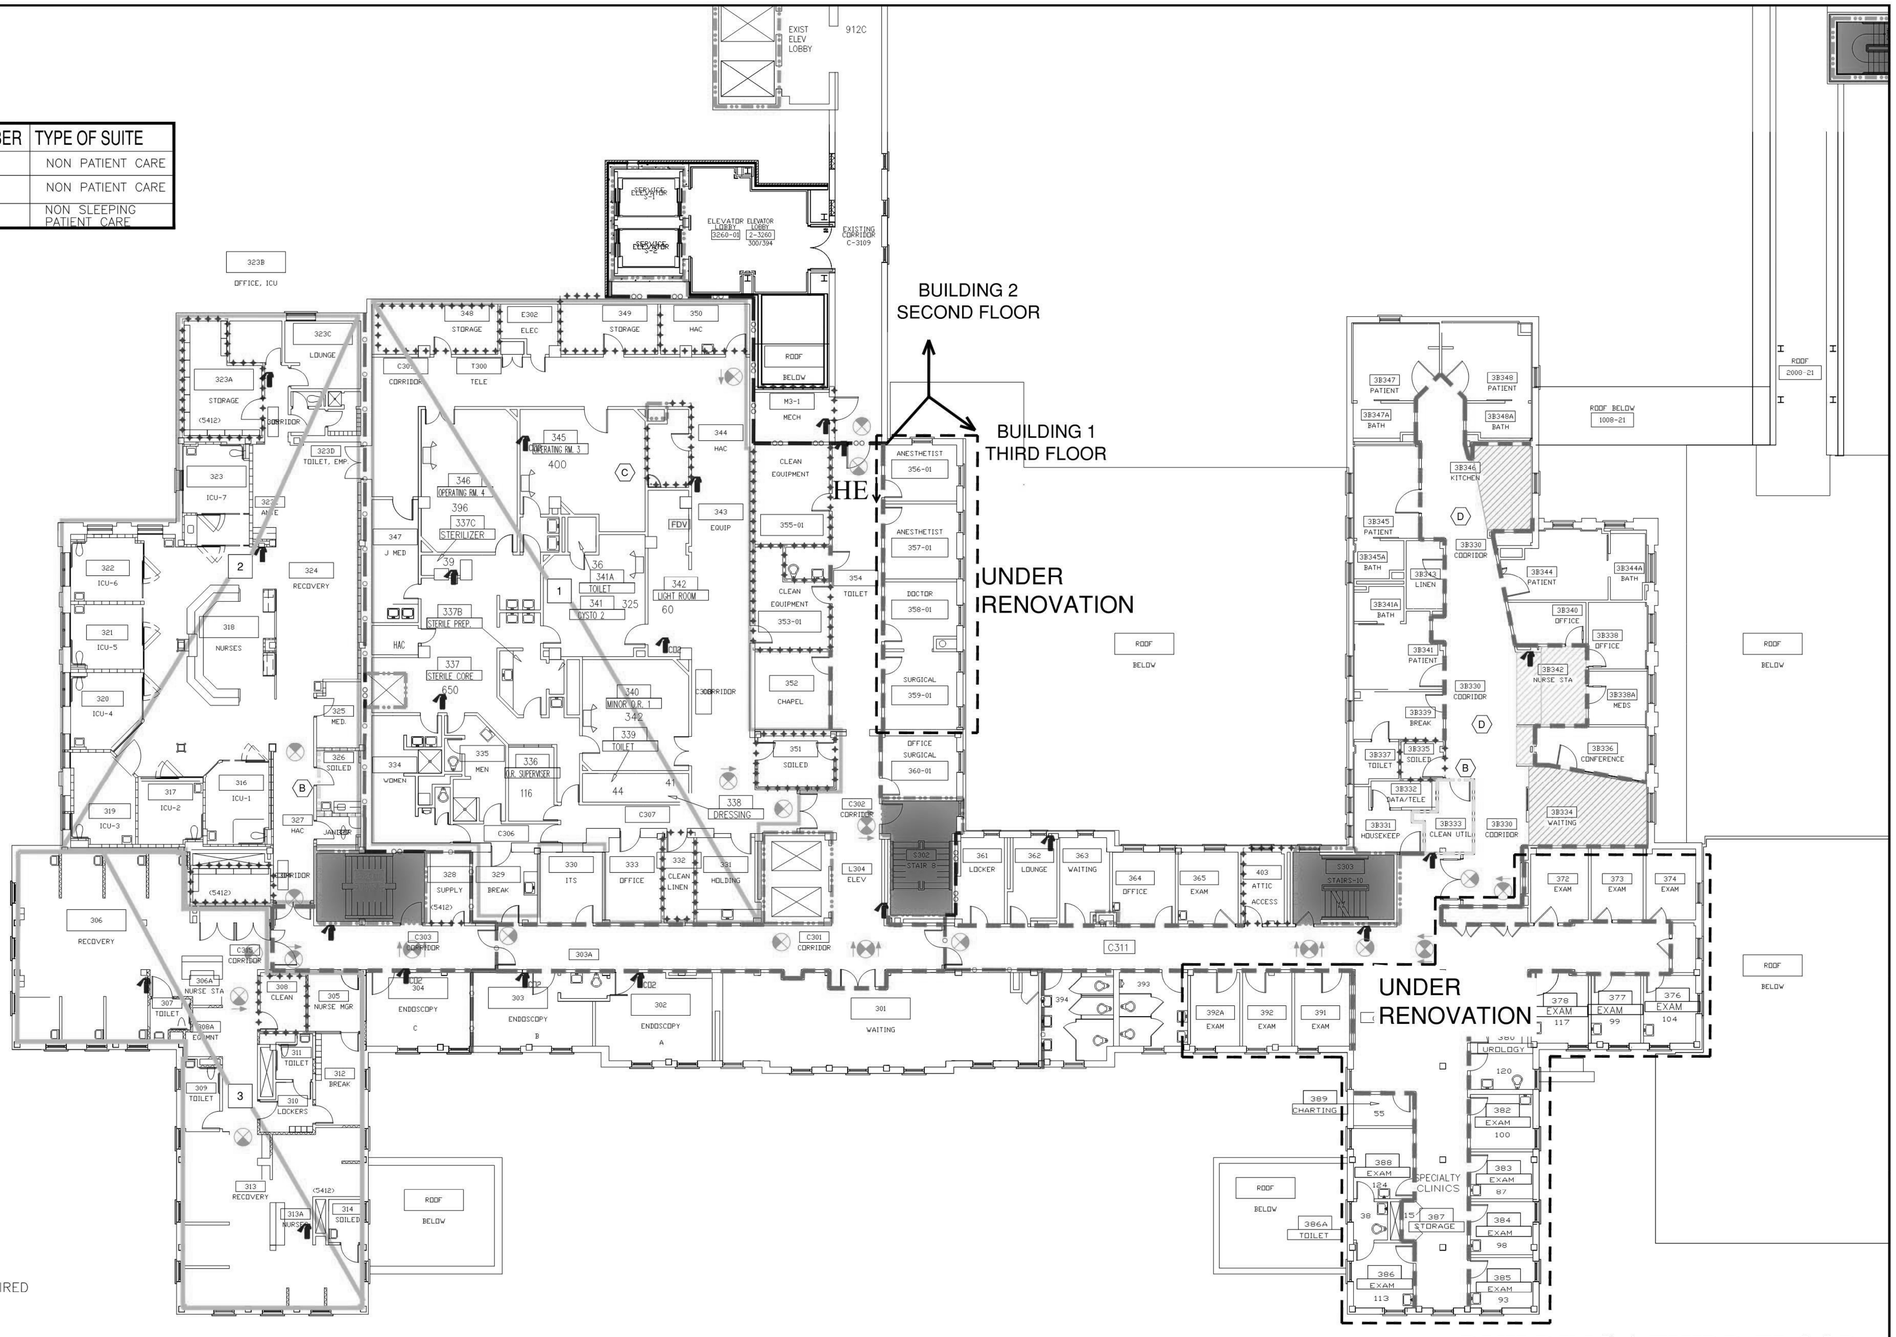

BUILDING 1 THIRD FLOOR

FULLY SPRINKLERED
HEALTH CARE OCCUPANCY

FOR REFERENCE ONLY

Revisions	Date
FP&C Proj.#:	1552.27
GFS Proj.#:	

Dept. of Veterans Affairs
VA Medical Center
1100 North College
Fayetteville, AR 72703

Goodwin Facilities Solutions
19375 Highway 74
Elkins, AR 72727

FIRE PROTECTION & CODE CONSULTANTS, L.L.C.
1520 MAIN STREET
INDIANAPOLIS, IN 46224
(317)486-5188

Drawing Title	Contract No.	Project Title	Designed By	Checked By	Drawn By	Date
BUILDING 1 THIRD FLOOR	AutoCAD File Name SOC04 1–3	STATEMENT OF CONDITIONS	FVO	FVO	KW/DN	1/26/17
			Location: VA MEDICAL CENTER FAYETTEVILLE, ARKANSAS			Scale: N.T.S.

Drawing No. SOC-9
Sht. 22 of 162