


**FLAG NOTES**

- 1 EXISTING CONTACTOR FOR EXISTING YARD LIGHTING. EXISTING WIRING TO YARD LIGHTS TO REMAIN. PROVIDE NEW SUPPLY WIRING TO CONTACTOR FROM PANEL 'B'.
- 2 PROVIDE #10 CONDUCTORS IN 3/4" ENTIRE LENGTH OF CIRCUIT.
- 3 EXISTING SWITCH BOX LOCATION, REUSE EXISTING BOX.
- 4 NEW SWITCH BOX LOCATION, PROVIDE NEW BOX.

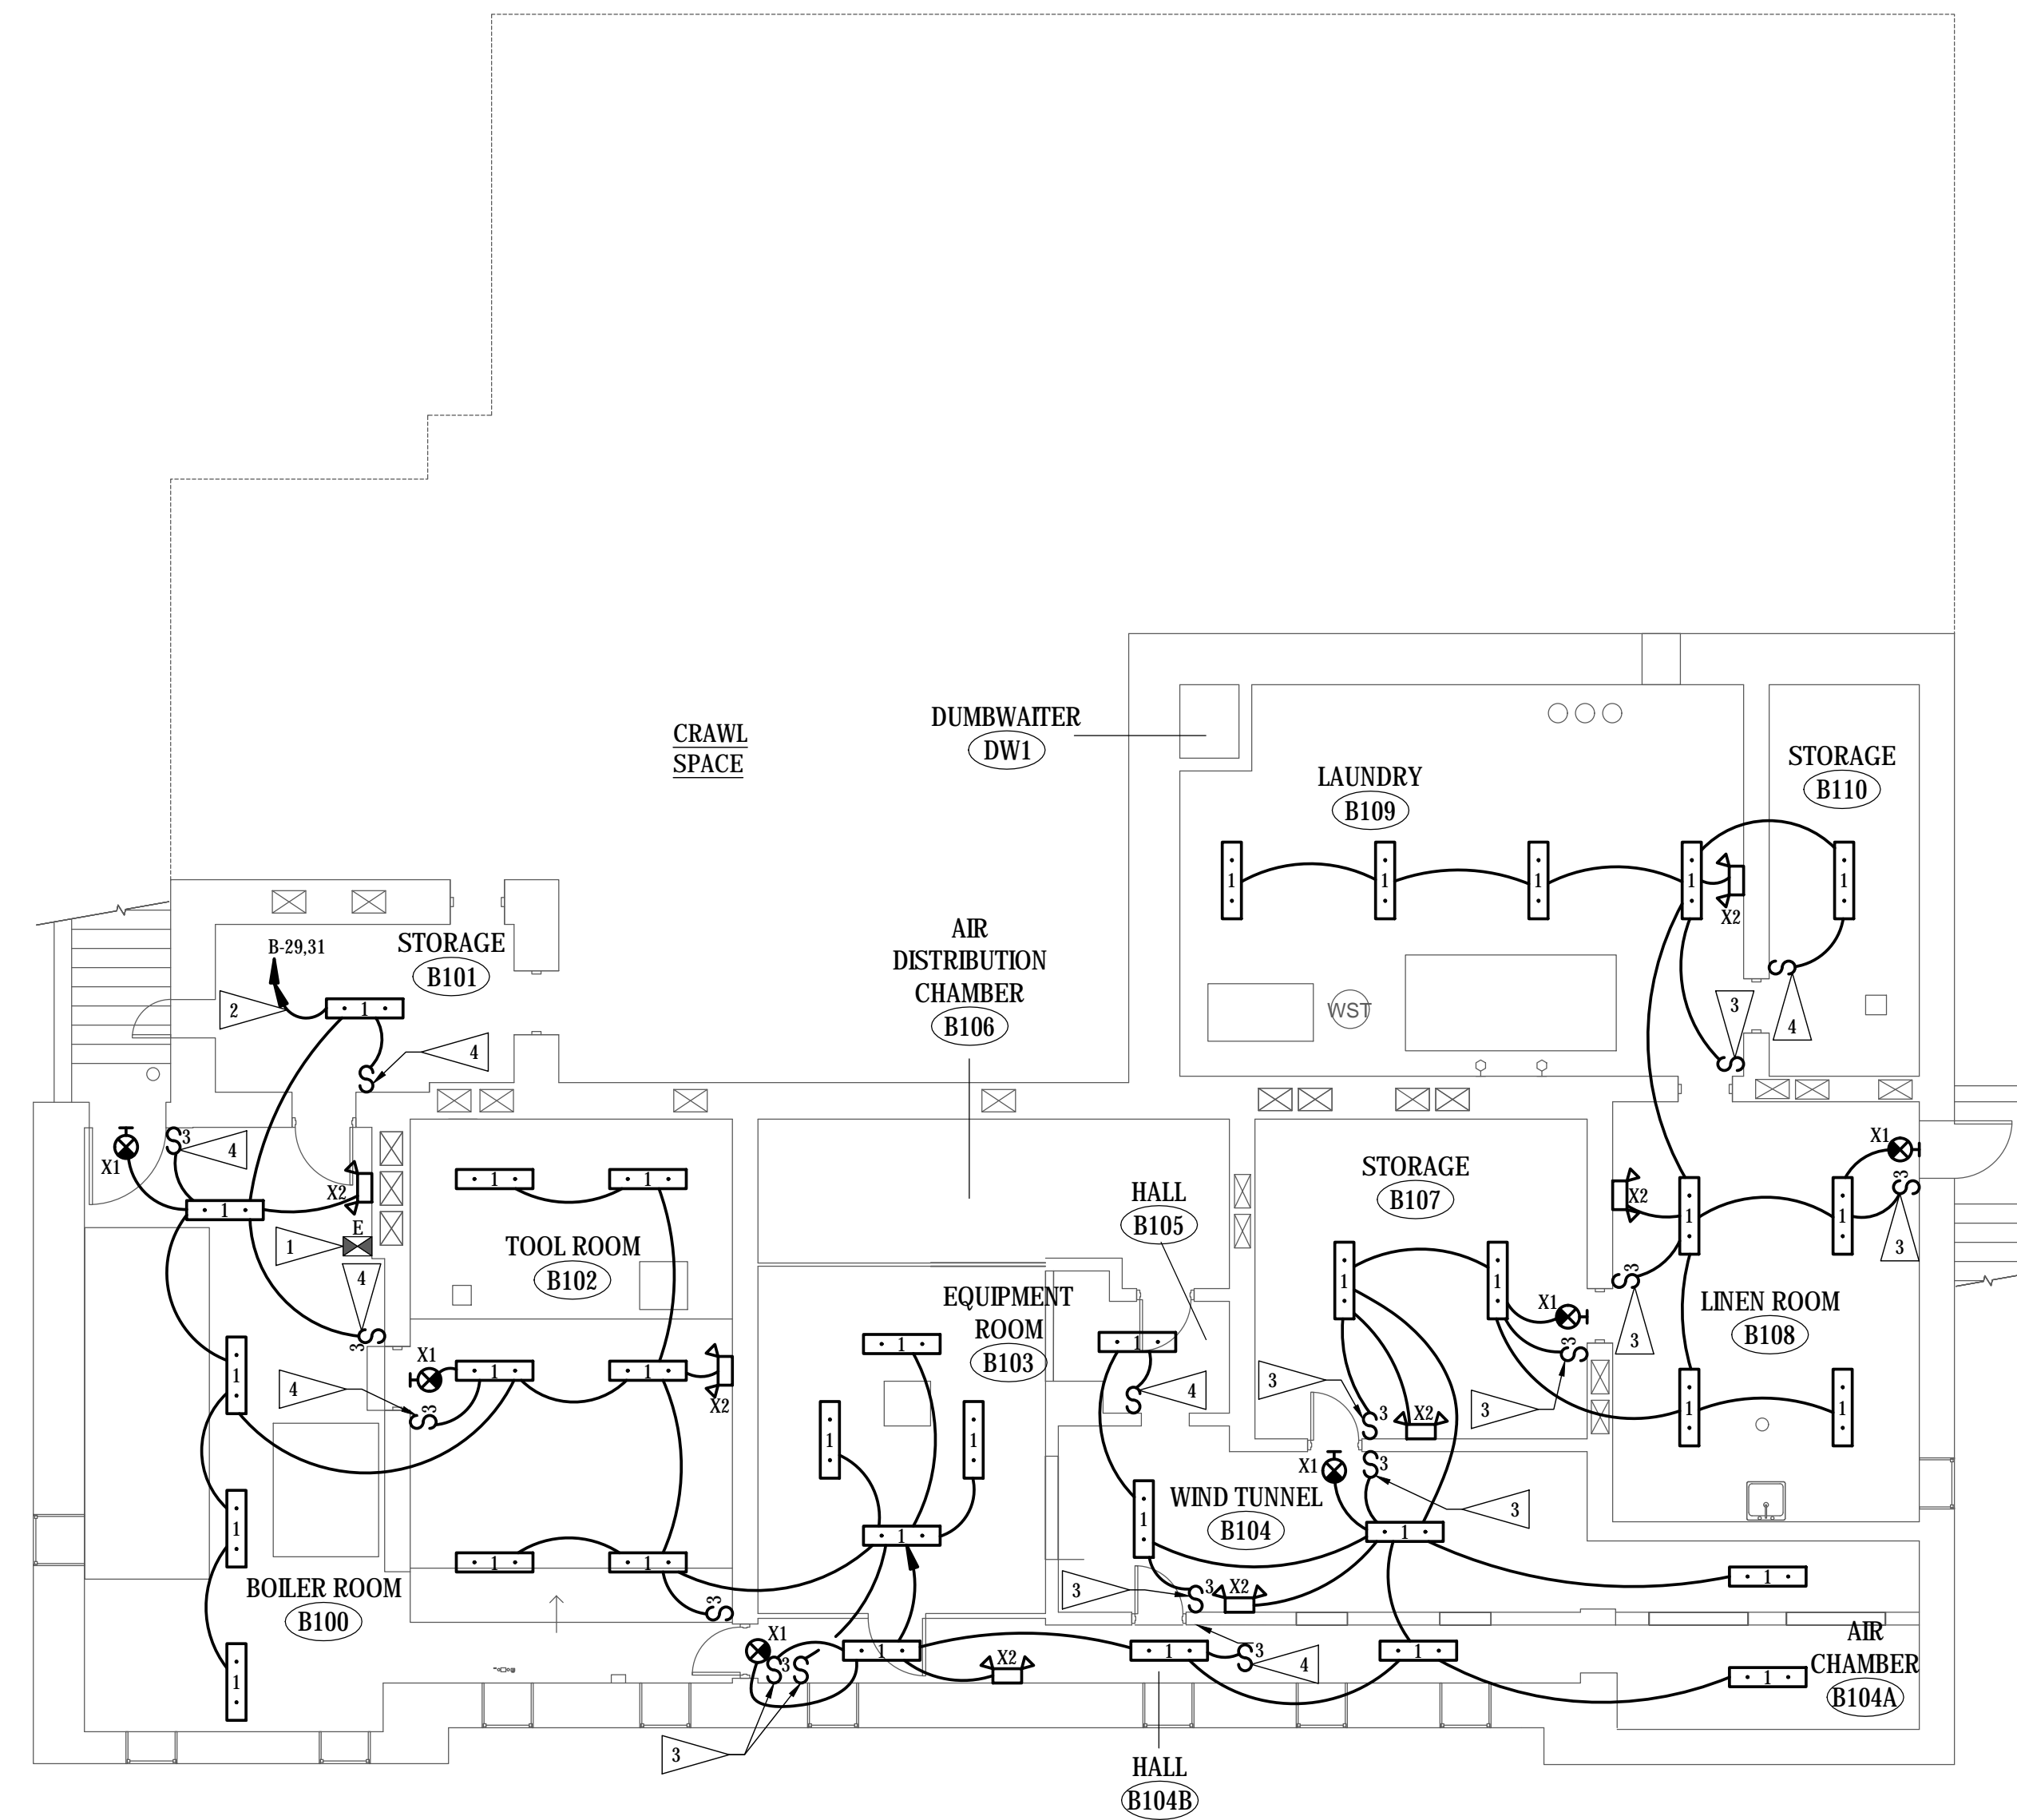

© COPYRIGHT 2024 AEF 20239955  
 Permission to reproduce all or part of this drawing is hereby granted solely for the limited purpose of construction of this project or archiving. Unauthorized copying, disclosure or construction use without written permission of Alvine Engineering is prohibited by copyright law.  
**NOTE:**  
 DO NOT SCALE DRAWINGS. VERIFY ALL DIMENSIONS and clearances from ARCHITECTURAL, STRUCTURAL, shop and other appropriate drawing or at site. lay out and coordinate all work prior to installation to provide clearances required for operation, maintenance, and codes and verify non-interference with other work. DO NOT FABRICATE PRIOR TO VERIFICATION OF CLEARANCE FOR ALL TRADES. READ SPECIFICATIONS.

**BASEMENT FLOOR PLAN - LIGHTING**  
 SCALE: 1/8" = 1'-0"

FINAL CONSTRUCTION DOCUMENTS

A/E FIRM PRIME: KENNETH HAHN ARCHITECTS, INC. OMAHA, NE. SUBCONTRACTOR: ALVINE ENGINEERING OMAHA, NE.	DESIGNED: RCF	SUB SHEET NO.  <b>E2-1</b>	TITLE OF SHEET  <b>BASEMENT FLOOR PLAN - LIGHTING</b>  BUCKSTAFF BATHHOUSE HVAC HOT SPRINGS NATIONAL PARK HOT SPRINGS, AK	DRAWING NO. XXX/XXXX
	DRAWN BY: JAS			PMIS NO. 177425
	TECH. REVIEW: GAN			SHEET
	DATE: 2/15/2024			41 OF 60

February 16, 2024, 10:58am 20239955\_E2\_1.rvt gpcvmm