

HISTORIC ELEVATOR STABILIZATION WORK:

EXISTING HISTORIC WIRE CAGE ELEVATORS IN MEN'S AND WOMEN'S STAIR HALLS TO BE STABILIZED BY CONTRACTOR. CABS TO BE MOVED AND STABILIZED AT THE FIRST FLOOR LEVEL AND FULLY SUPPORTED WITH STEEL BEAM TO NOT MOVE. WEIGHTS TO BE DISENGAGED AND FIXED IN PLACE. CABLES TO BE DISCONNECTED AND INSTALLED TO BE NON-WORKING AND FIXED IN PLACE. CONTRACTOR TO CLEAN UP ALL DEBRIS AND LOOSE EQUIPMENT OR PARTS FROM ELEVATOR PITS. ALL PARTS TO BE BOXED, LABELED, AND DELIVERED TO PARK STORAGE. CONTRACTOR TO EMPTY ALL OIL FROM MOTORS, IF EXISTING. SLIDING DOORS TO BE WELDED INTO PLACE AT ALL FLOOR LEVELS TO PREVENT ACCESS INTO SHAFT. ALL SECTIONS OF THE SHAFT WIRE CAGE TO BE REPAIRED WITH SECTIONS OF NEW METAL MESH PANELING WHERE WIRE MESH IS MISSING OR DAMAGED.


GENERAL NOTES - TREATMENT:

- A. DO NOT SCALE FROM THE DRAWINGS. ALL DIMENSIONS ARE APPROXIMATE. ACTUAL FIELD VERIFIED DIMENSIONS SHALL BE OBTAINED BY THE GENERAL CONTRACTOR OR THE APPLICABLE SUB-CONTRACTORS BEFORE SUBMITTING SHOP DRAWINGS, ORDERING MATERIALS, OR THE COMMENCEMENT OF CONSTRUCTION.
- B. THE GENERAL CONTRACTOR IS RESPONSIBLE FOR VERIFYING EXISTING CONDITIONS, IDENTIFYING ADDITIONAL TREATMENT WORK THAT MAY BE REQUIRED FOR THE INSTALLATION OF NEW WORK.
- C. THE CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS PRIOR TO COMMENCING ANY WORK. EXISTING CONDITIONS INCLUDE UTILITY LOCATIONS, EXISTING STRUCTURE LOCATIONS, AND EXISTING FIELD DIMENSIONS. THE ARCHITECT SHALL BE NOTIFIED OF ANY DISCREPANCIES DETRIMENTAL TO THE PROPER EXECUTION OF NEW WORK.


KEYNOTES

05.00	055213, 099123 - NORTH/SOUTH STAIRS: STRIP AND REPAINT EXISTING HISTORIC ELEVATOR CAGE TO REMAIN (ALL LEVELS - BASEMENT THROUGH 3RD FLOOR). PAINT WITH COLOR FROM HISTORIC PAINT ANALYSIS. MAKE REPAIRS TO ELEVATOR CAGE FOR SAFETY. REFERENCE VERTICAL CIRCULATION INTERIOR ELEVATION. REFER TO MATERIALS TEST REPORT FOR LEAD PAINT TESTING.
05.01	055213, 099123 - NORTH/SOUTH STAIRS: INSTALL METAL SUPPORT AT EXISTING ELEVATOR CAGE TO SUPPORT ANCHORING ON NEW HANDRAIL BRACKETS. PREP, PRIME, AND PAINT.
05.11	055213, 099123 - NORTH/SOUTH STAIR: INSTALL NEW ABAAS COMPLIANT STEEL HANDRAIL AT ALL LEVELS - BASEMENT THROUGH 3RD FLOOR. PREP, PRIME AND PAINT IN THE FIELD. ALL ANCHORS TO BE STAINLESS STEEL.
05.13	EXISTING ELEVATOR DOOR AT ALL FLOORS IS TO BE SECURED AND WELDED SHUT.
05.100	BASEMENT: INSTALL NEW METAL GATE AT ELEVATOR PIT OPENINGS (2 EA).
09.51	NORTH STAIRS: REPLACE MISSING MARBLE TREADS. START THE REPLACEMENT WITH THE 17 NON-HISTORIC MARBLE TREADS STORED IN MEN'S DRESSING ROOM 205. USE THE 10 HISTORIC MARBLE TREADS STORED IN WOMEN'S PACK ROOM 101 AND 12 HISTORIC MARBLE TREADS STORED IN HALL 211 TO FILL IN. ALL MARBLE TREADS TO BE CLEANED WITH BASIS OF DESIGN PROSOCO LIQUID MARBLE CLEANER, OR EQUAL, PER THE MANUFACTURER'S INSTRUCTIONS. REMOVE STAINING AND SOILING FROM MARBLE.
09.53	NORTH STAIRS: REPLACE LANDINGS WITH MARBLE LANDINGS STORED IN WOMEN'S PACK ROOM 101, MEN'S DRESSING ROOM 205, AND HALL 211. INSTALL 3 NEW MARBLE LANDINGS TO MATCH EXISTING. MISSING MARBLE LANDINGS ARE ROUGHLY 42-INCHES BY 42-INCHES. FIELD MEASURE LANDINGS FOR FINAL DIMENSIONS FOR NEW REPLACEMENT LANDINGS. ALL MARBLE LANDINGS TO BE CLEANED WITH BASIS OF DESIGN PROSOCO LIQUID MARBLE CLEANER, OR EQUAL, PER THE MANUFACTURER'S INSTRUCTIONS. REMOVE STAINING AND SOILING FROM MARBLE.
10.13	ADD ABA TEXTURED LOW VISION ANTI-SLIP TAPE ALONG TREAD EDGE. TYPICAL FOR ALL INTERIOR STAIRS.

1 Enlarged Plan - North Stair Basement Plan
A5.0 1/2" = 1'-0" SCALE (A)

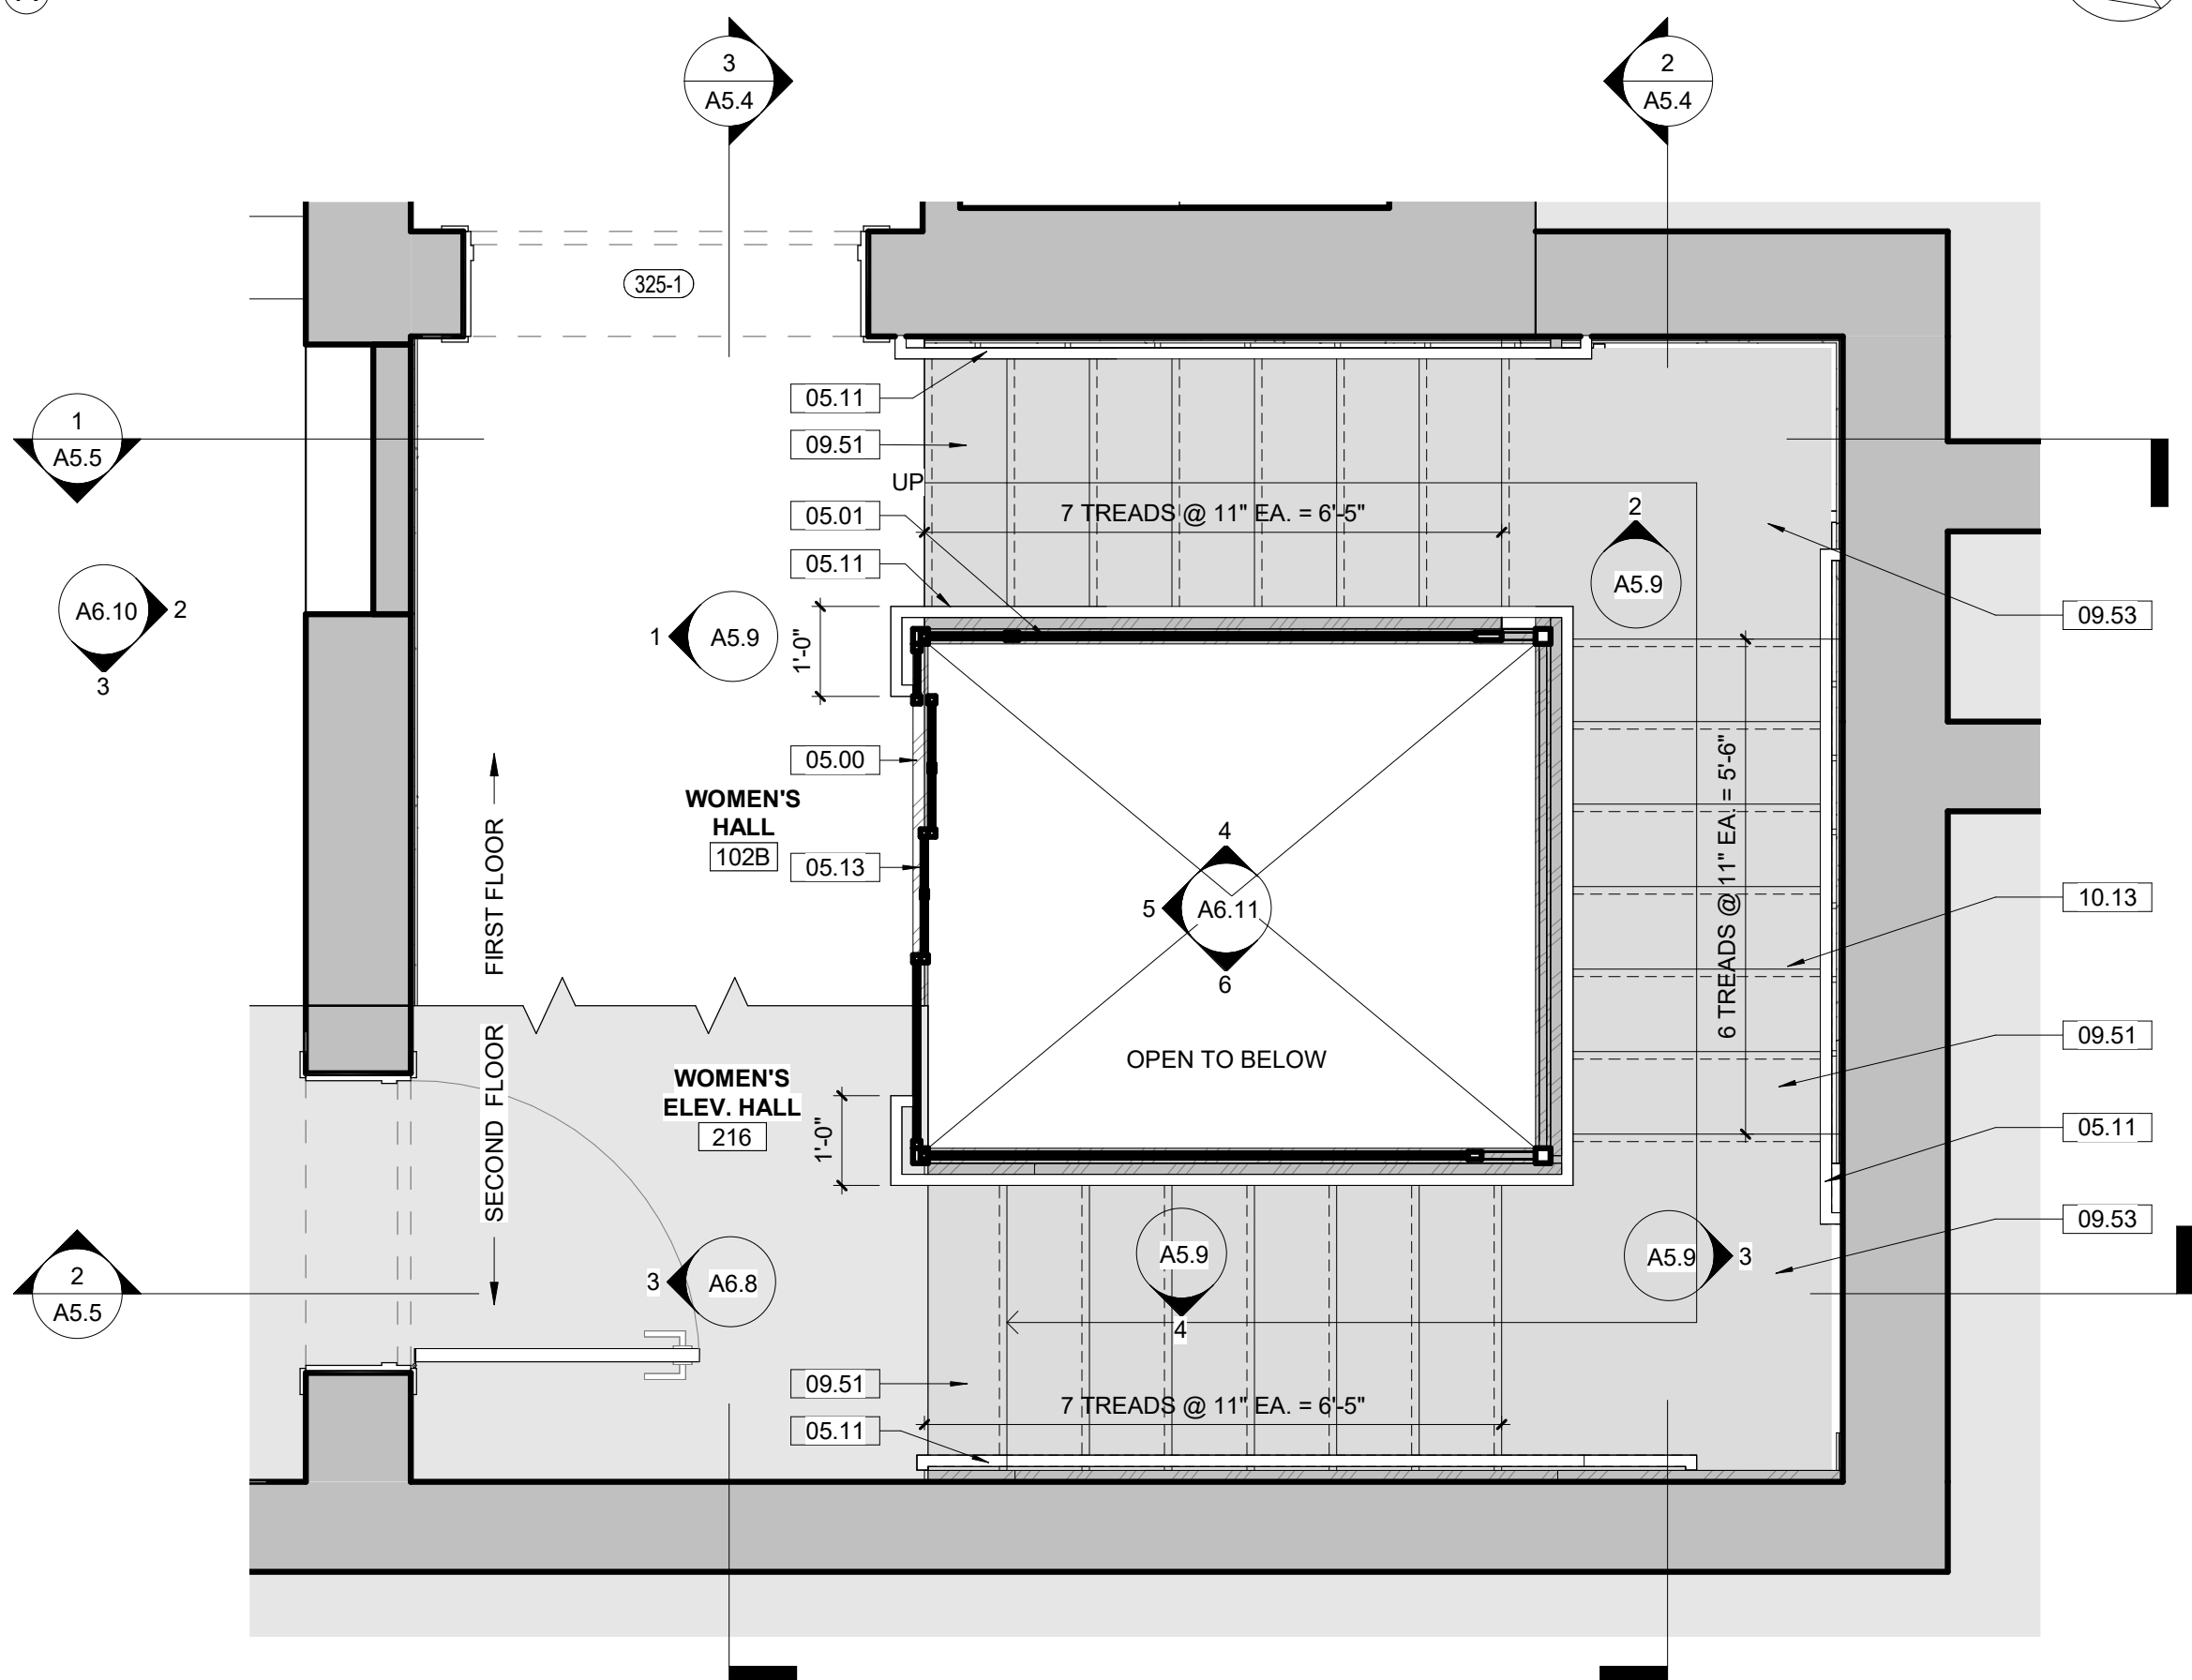

2 Enlarged Plan - North Stair First Floor Plan
A5.0 1/2" = 1'-0" SCALE (A)

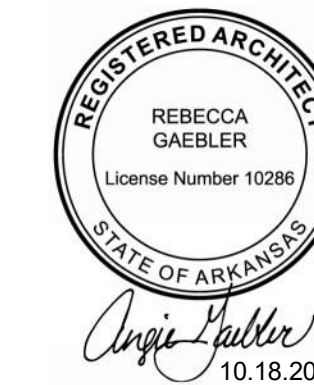

A/E FIRMS
PRIME/ARCH:
STRATA ARCHITECTURE
1701 OAK STREET,
SUITE 100
KANSAS CITY, MO
64114-4740/9900

DESIGNED: CA/AG
CADD: CA/ZA/EM
TECH. REVIEW: AG
DATE: 10.27.2023

SUB SHEET NO.
01
A5.0

TITLE OF SHEET
MAURICE BATHHOUSE
VERTICAL CIRCULATION

REHABILITATE BATHHOUSES
HOT SPRINGS NATIONAL PARK

DRAWING NO.
128
182951
PMIS/PKG NO.
318915
SHEET
64 OF 286

