




- SHEET NOTES:**
1. REFER TO SHEET E0.0 AND E0.1 FOR GENERAL NOTES AND SYMBOLS.
 2. REFER TO MECHANICAL PLANS FOR ALL MECHANICAL EQUIPMENT LOCATIONS.
 3. ALL POWER CIRCUITS ON THIS SHEET SHALL BE CONNECTED TO PANEL ML3, UNLESS NOTED OTHERWISE.
 4. ALL POWER, SECURITY AND LOW-VOLTAGE WIRING SHALL BE INSTALLED IN CONDUIT.

- KEYNOTES:** (#)
1. REFER TO M1.4 FOR EXACT LOCATION OF CONDENSING UNIT ON ROOF.
 2. FURNISH AND INSTALL 100AMP, 3P NON-FUSED DISCONNECT SWITCH IN NEMA-3R ENCLOSURE.
 3. E.C. SHALL FURNISH AND INSTALL WIRE AND CONDUIT FROM HP-1M TO INDOOR UNIT.

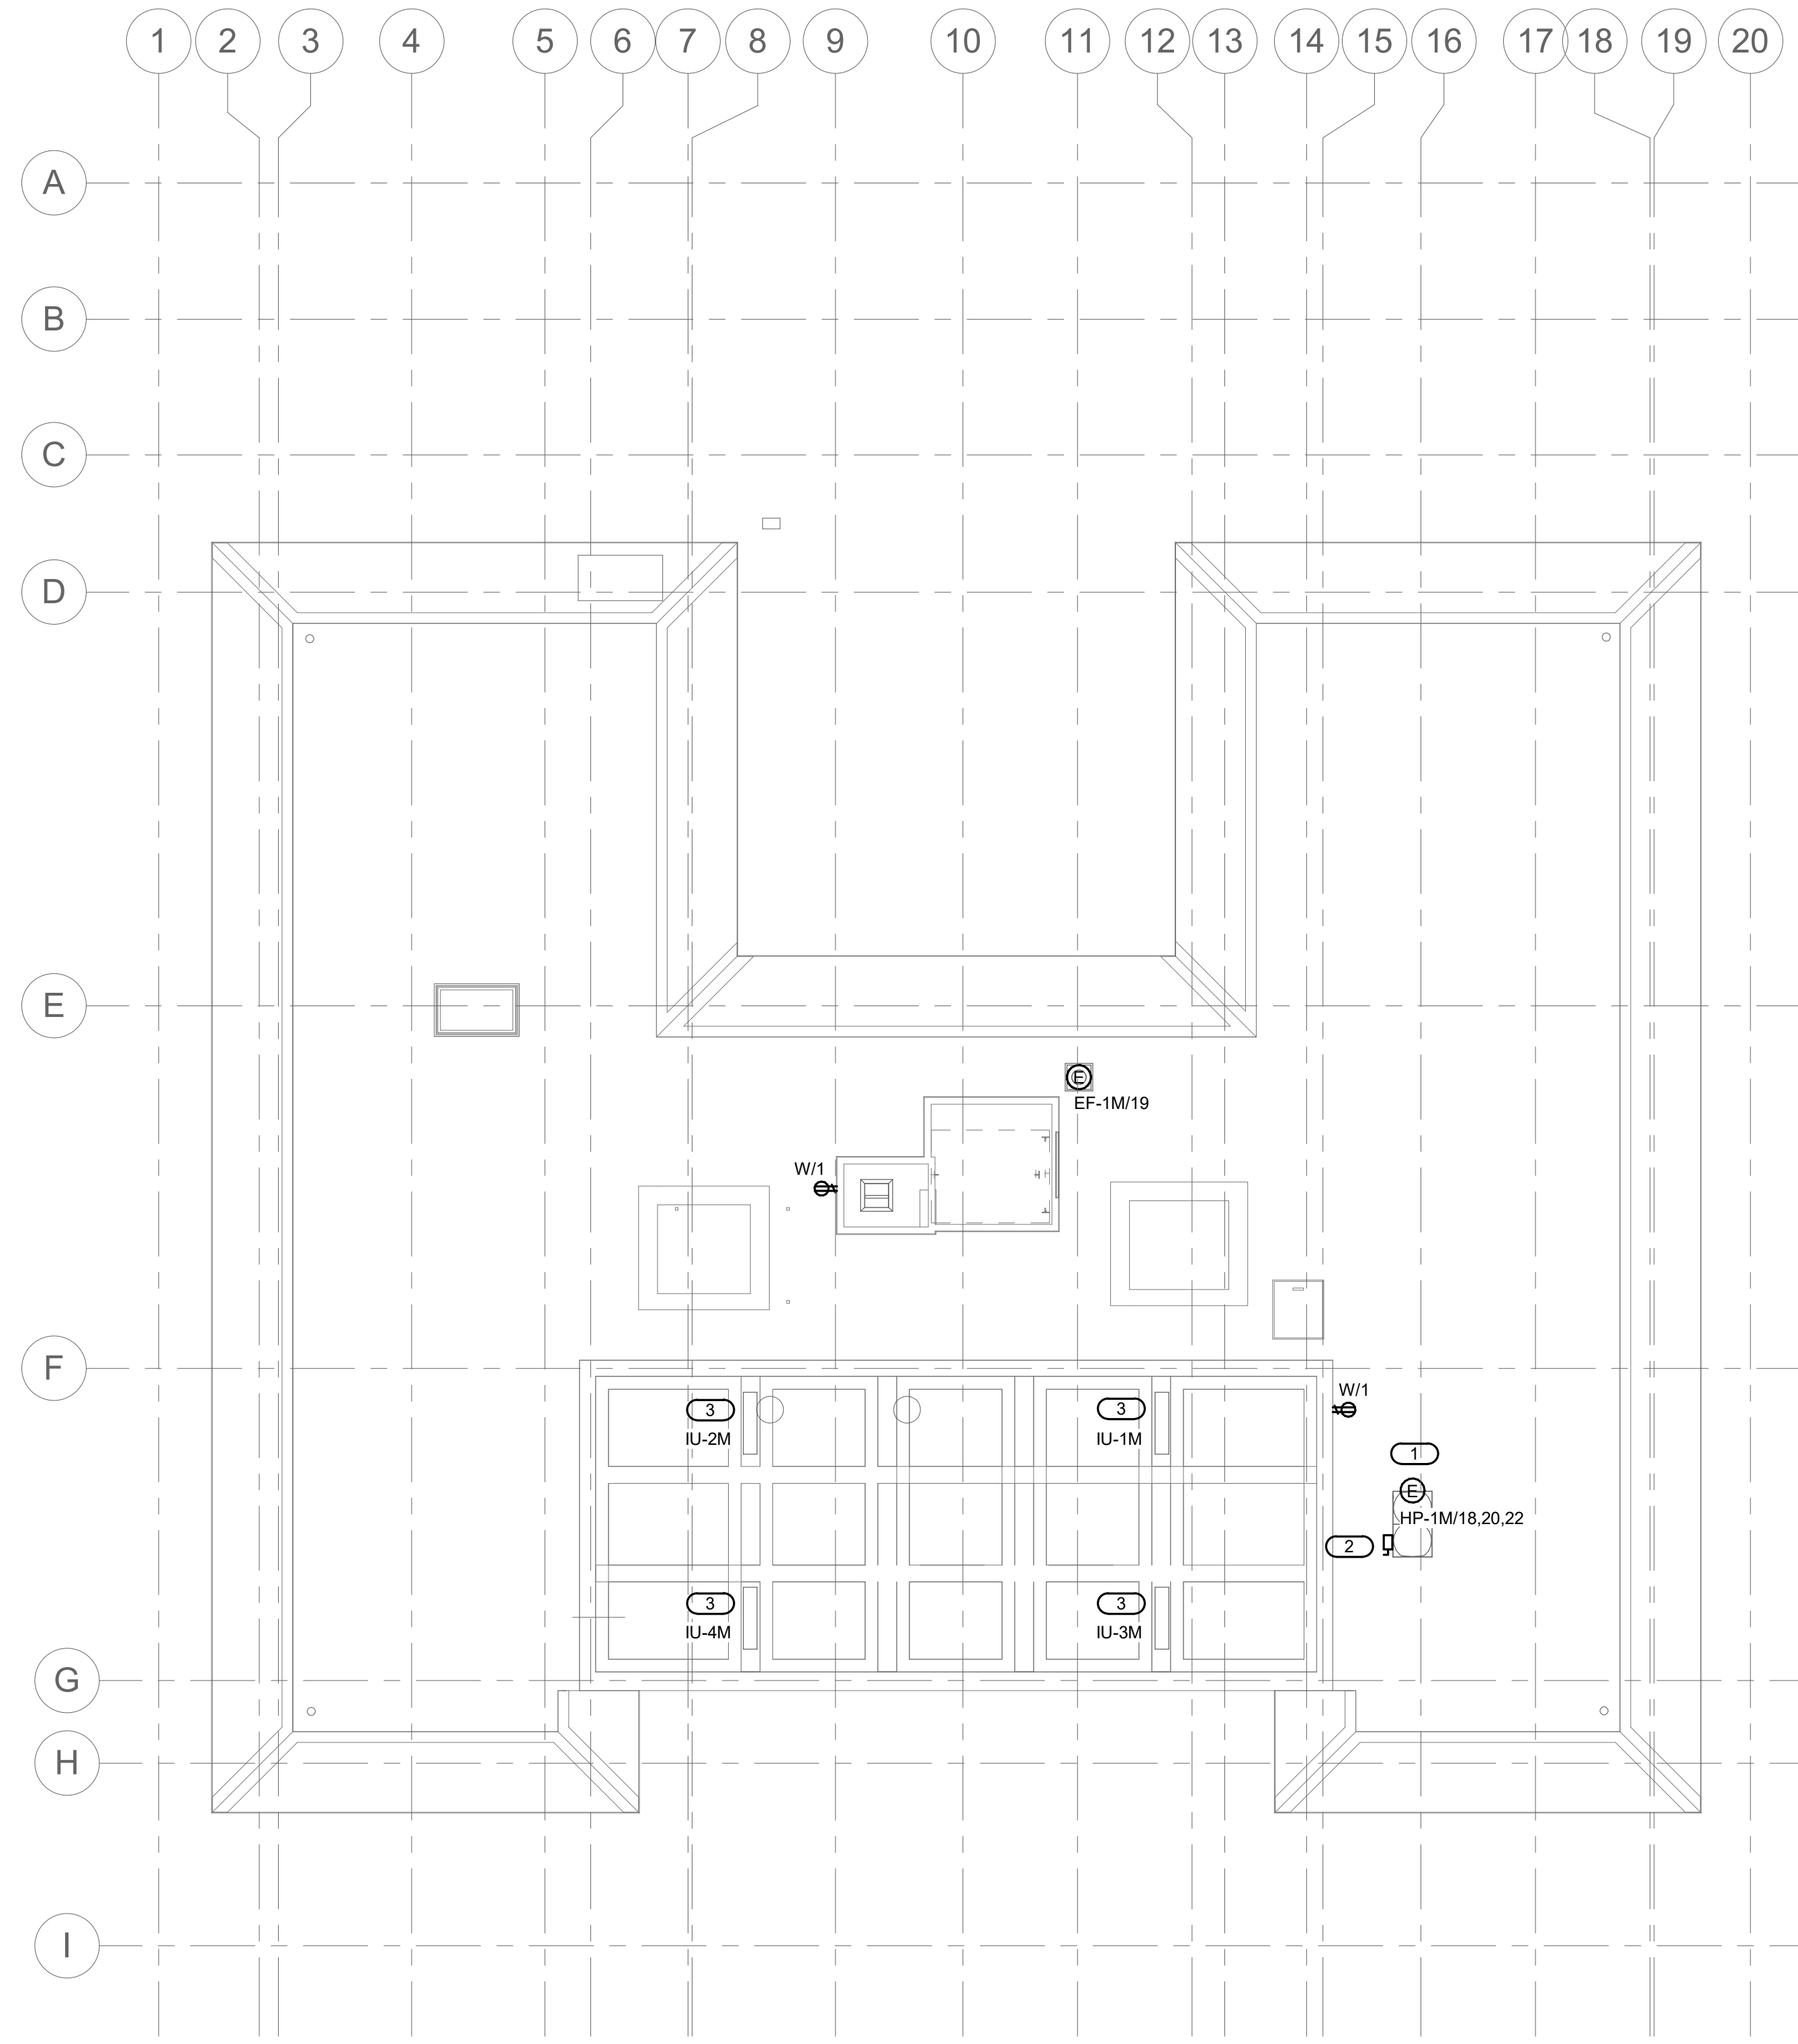

1
EP1.4 ROOF POWER PLAN

1/8" = 1'-0"

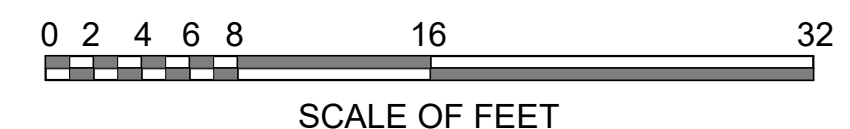

10.27.2023

A/E FIRMS PRIME/ARCH: STRATA ARCHITECTURE 1703 OAK STREET, SUITE 100 KANSAS CITY, MO T: 816.474.0900 MEP/ENG: IMEG CORP. 1400 BALTIMORE STREET, SUITE 300 KANSAS CITY, MO T: 816.842.8437	DESIGNED: PIP	SUB SHEET NO. 01 EP1.4	TITLE OF SHEET MAURICE BATHHOUSE ROOF POWER PLAN REHABILITATE BATHHOUSES HOT SPRINGS NATIONAL PARK	DRAWING NO. 626 180065
	CADD: WMM			PMIS/PKG NO. 318674
	TECH. REVIEW: PIP			SHEET 180 OF 286
	DATE: 10.27.2023			

10/27/2023 1:13:56 PM