



- SHEET NOTES:**
- REFER TO SHEET E0.0 AND E0.1 FOR GENERAL NOTES AND SYMBOLS.
 - ALL FIRE ALARM WIRING SHALL BE INSTALLED IN CONDUIT.
 - REFER TO FIRE PROTECTION RISER FOR COORDINATION OF INSTALLATION OF TAMPER SWITCH MONITOR AND FLOW SWITCH MONITOR.

- KEYNOTES:** (#)
- CONTROL MODULE FOR ELEVATOR RECALL.
 - CONTROL MODULE SHALL SHUNT-TRIP ELEVATOR POWER IF HEAT DETECTOR SIGNAL TRIPS.

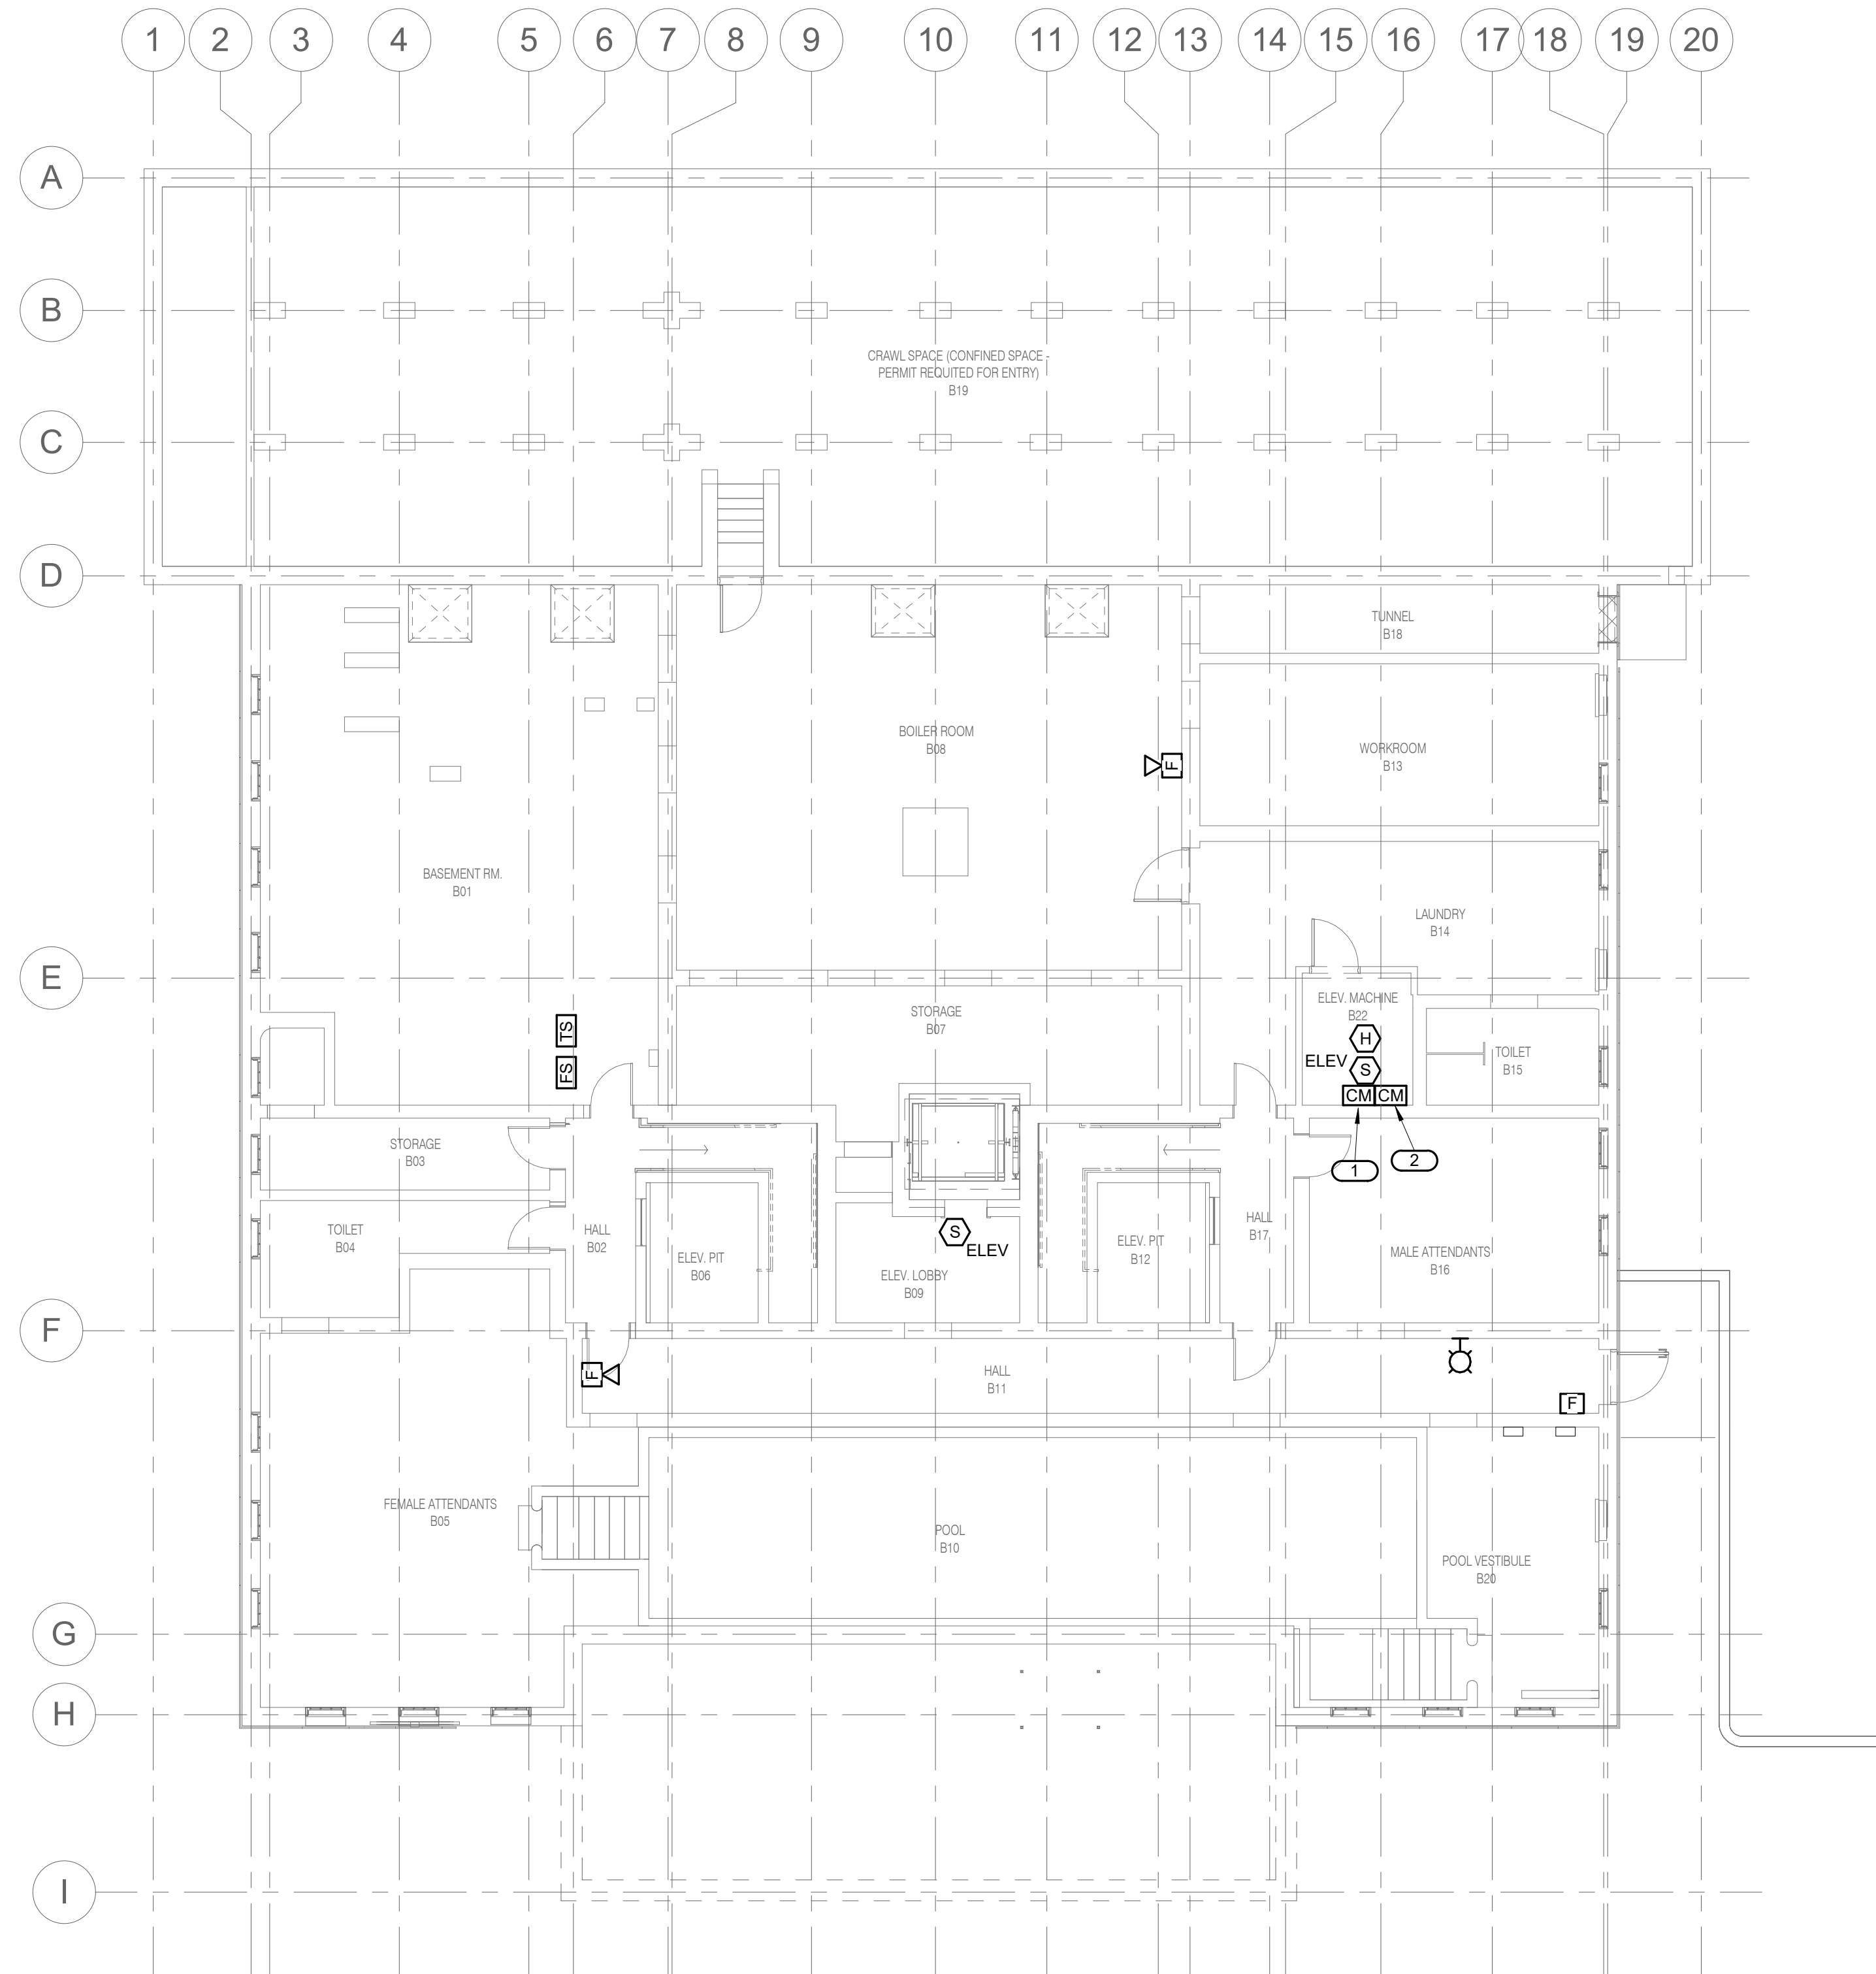

1 BASEMENT FIRE ALARM PLAN
 EF1.0 1/8" = 1'-0"
 0 2 4 6 8 16 32
 SCALE OF FEET



10.27.2023

A/E FIRMS PRIME/ARCH: STRATA ARCHITECTURE 1703 OAK STREET, SUITE 100 KANSAS CITY, MO T: 816.474.0900 MEP/ENG: IMEG CORP. 1400 BALTIMORE STREET, SUITE 300 KANSAS CITY, MO T: 816.842.8437	DESIGNED: PIP	SUB SHEET NO. 01 EF1.0	TITLE OF SHEET MAURICE BATHHOUSE BASEMENT FIRE ALARM PLAN REHABILITATE BATHHOUSES HOT SPRINGS NATIONAL PARK	DRAWING NO. 626 180065
	CADD: WMM			PMIS/PKG NO. 318674
	TECH. REVIEW: PIP			SHEET 181 OF 286
	DATE: 10.27.2023			

10/27/2023 1:13:38 PM