
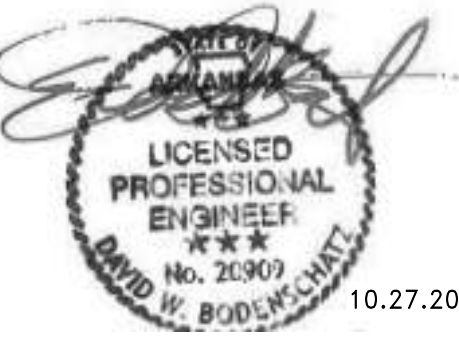



- SHEET NOTES:**
- ROUTING OF TERMINAL EQUIPMENT, DUCTWORK AND PIPING SHALL BE VERY CAREFULLY COORDINATED WITH EXISTING CONDITIONS, PRESERVATION ZONES AND HISTORIC NATURE OF BUILDING TO CONFORM WITH THE SECRETARY OF THE INTERIOR'S REHABILITATION REQUIREMENTS AND PRESERVATION BRIEFS RELATED TO MEP DESIGN AND INSTALLATION.

- KEYNOTES: #**
- DEHUMIDIFIER MOUNTED AS HIGH AS POSSIBLE FROM STRUCTURE W/ ISOLATORS. SUPPLY & RETURN DUCTWORK SHALL BE STAINLESS STEEL.
 - 30"x18" RA OPENING W/ SS INSECT SCREEN MOUNTED IN FRAME INSTALLED ON INLET.
 - STAINLESS STEEL DUCTWORK.
 - SEAL PENETRATIONS AIRTIGHT.
 - NEW STAINLESS STEEL MANUAL DAMPER.
 - HUMIDISTAT W/ REMOTE BULB SENSOR TO CONTROL EF-1.
 - 12"x12" STAINLESS STEEL SLEEVE W/ SS BACKDRAFT DAMPER.

1 BASEMENT MECHANICAL PLAN
M1.0 1/8" = 1'-0"

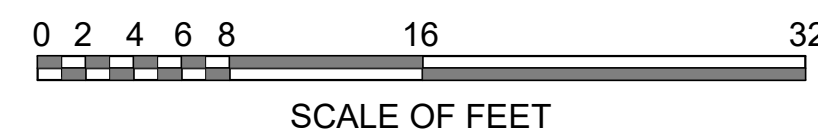

10.27.2023

A/E FIRMS PRIME/ARCH: STRATA ARCHITECTURE 1703 OAK STREET, SUITE 100 KANSAS CITY, MO T: 816.474.0900 MEP/ENG: IMEG CORP. 1400 BALTIMORE STREET, SUITE 300 KANSAS CITY, MO T: 816.842.8437	DESIGNED: SGB	SUB SHEET NO. 01 M1.0	TITLE OF SHEET MAURICE BATHHOUSE BASEMENT VENTILATION PLAN REHABILITATE BATHHOUSES HOT SPRINGS NATIONAL PARK	DRAWING NO. 626 180065
	CADD: WMM	180065		PMIS/PKG NO. 318674
	TECH. REVIEW: SGB			SHEET 141 OF 286
	DATE: 10.27.2023			

10/27/2023 1:14:56 PM