



**SHEET NOTES:**

- ROUTING OF TERMINAL EQUIPMENT, DUCTWORK AND PIPING SHALL BE VERY CAREFULLY COORDINATED WITH EXISTING CONDITIONS, PRESERVATION ZONES AND HISTORIC NATURE OF BUILDING TO CONFORM WITH THE SECRETARY OF THE INTERIOR'S REHABILITATION REQUIREMENTS AND PRESERVATION BRIEFS RELATED TO MEP DESIGN AND INSTALLATION.

**KEYNOTES:** #

- 3/4" HWS, HWR, DPP AND 1" CWS, CWR UP TO FCU ABOVE.
- 3/4" HWS, HWR, CWS, CWR, DPP UP TO FCU ABOVE.
- FUTURE VAV BOX.
- HORIZONTAL HOT WATER UNIT HEATER.
- NO PIPING OR DUCTWORK SHALL PENETRATE THE SECOND FLOOR IN THIS AREA.
- VALVE & CAP FOR FUTURE CONNECTION.
- RADIATOR CONTROL VALVE. SEE PLAN FOR GPM.
- ROUTE DPP DN WALL TO FLOOR BELOW.
- ROUTE DPP DN IN CHASE TO BASEMENT.
- INSTALL RECESSED THERMOSTAT ON CHASE WALL AND ROUTE WIRING IN CHASE. IF NEW CHASE WITHOUT SHEATHING, ALLOW FOR FUTURE PLASTER/GYP. BD. COORDINATE LOCATION AND CONDUIT/WIRING ROUTING WITH CO BEFORE INSTALLATION.
- RECESSED THERMOSTAT, CHANNEL EXISTING PLASTER TO ROUTE WIRING TO TAB. COORDINATE LOCATION AND CONDUIT/WIRING ROUTING WITH CO BEFORE INSTALLATION. PATCH WALL TO MATCH EXISTING.

1 SECOND FLOOR MECHANICAL PIPING PLAN  
MP1.2 1/8" = 1'-0"

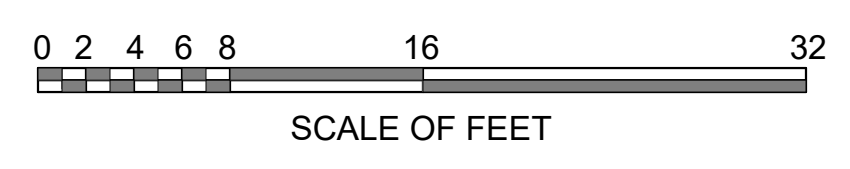

A/E FIRMS STRATA ARCHITECTURE 1703 OAK STREET, SUITE 100 KANSAS CITY, MO T: 816.474.0900 MEP/ENG: IMEG CORP. 1400 BALTIMORE STREET, SUITE 300 KANSAS CITY, MO T: 816.842.8437	DESIGNED:	SUB SHEET NO.	TITLE OF SHEET	DRAWING NO.
	CADD:	01 MP1.2	MAURICE BATHHOUSE SECOND FLOOR MECHANICAL PIPING PLAN	626 180065
	TECH. REVIEW:		REHABILITATE BATHHOUSES HOT SPRINGS NATIONAL PARK	PMIS/PKG NO. 318674
	DATE: 10.27.2023			

10/27/2023 1:14:16 PM