


SHEET NOTES:

- BRANCH PIPING TO TERMINAL UNITS SHALL BE 3/4" MIN. UNLESS NOTED OTHERWISE.

KEYNOTES: #

- VALVE AND CAP DRAIN WITH THREADED HOSE CONNECTION.
- MINIMUM FLOW AUTO BYPASS VALVE.
- VALVE AND CAP FOR FUTURE EXTENSION.

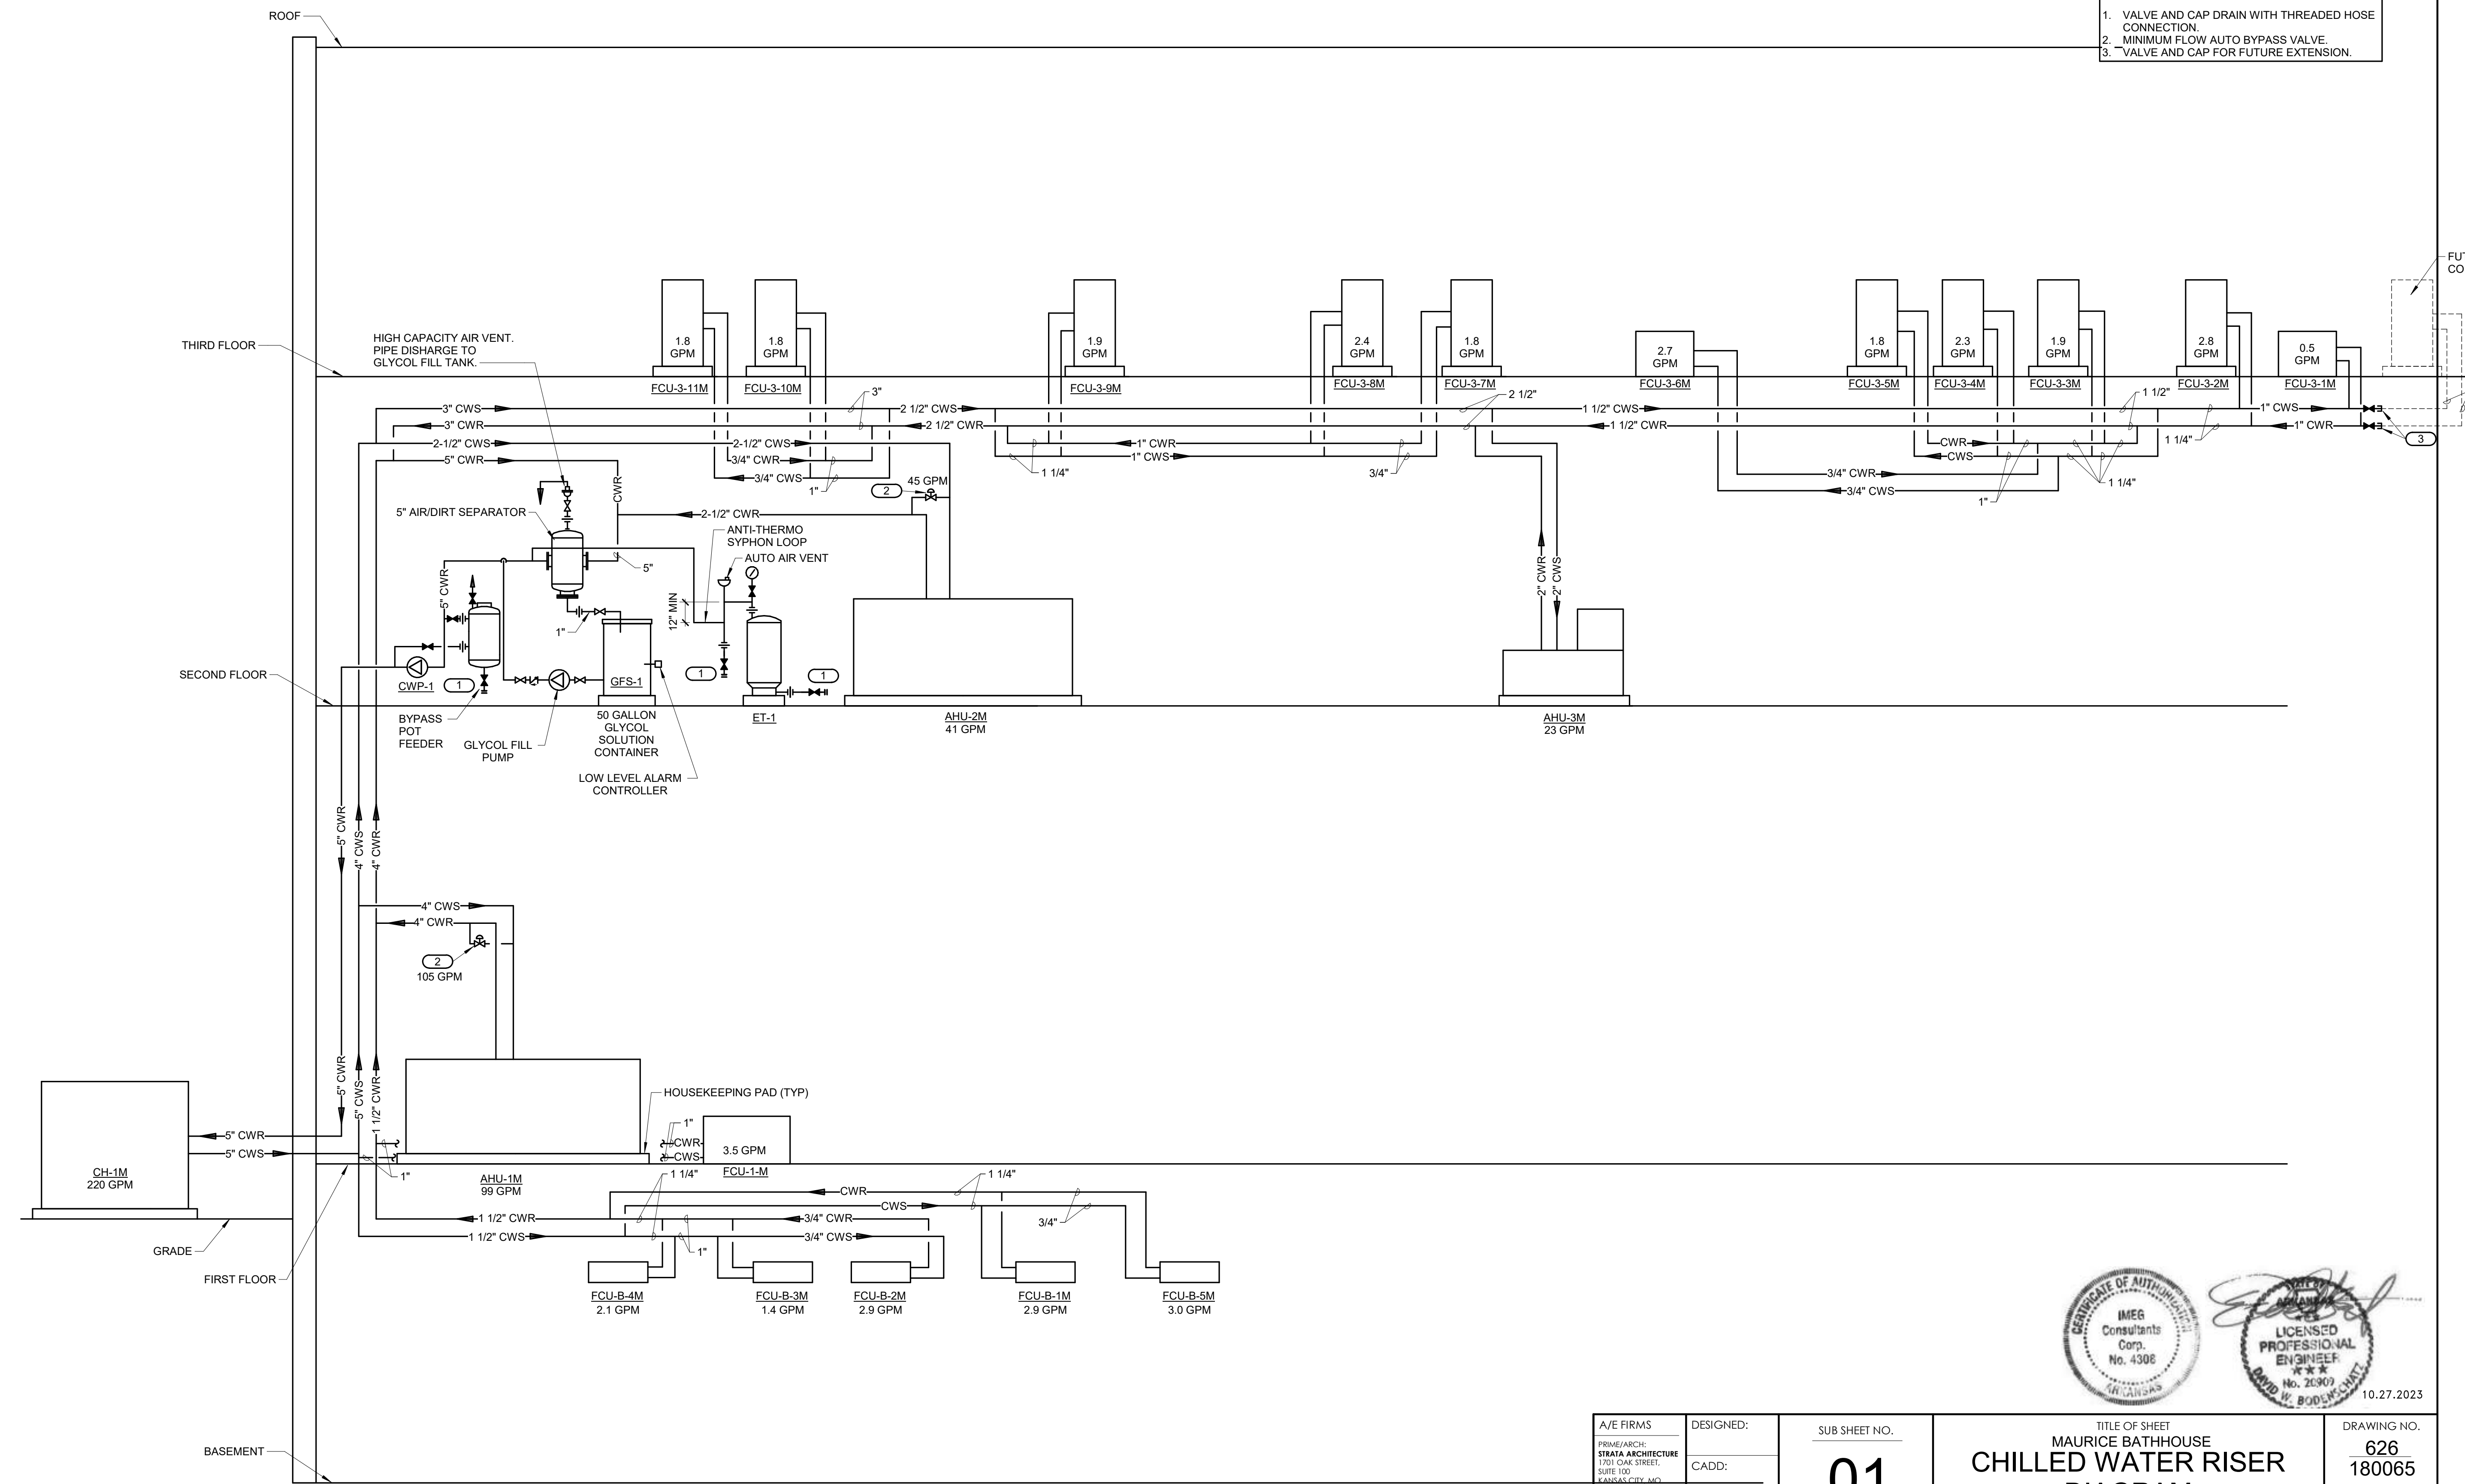

1 CHILLED WATER RISER DIAGRAM
 M6.0 12" = 1'-0"



A/E FIRMS STRATA ARCHITECTURE 1703 OAK STREET, SUITE 100 KANSAS CITY, MO T: 816.474.0900	DESIGNED:	SUB SHEET NO. 01 M6.0	TITLE OF SHEET CHILLED WATER RISER DIAGRAM	DRAWING NO. 626 180065
	CADD:			
MEP/ENG: IMEG CORP. 1400 BALTIMORE STREET, SUITE 300 KANSAS CITY, MO T: 816.842.8437	TECH. REVIEW:	DATE: 10.27.2023	REHABILITATE BATHHOUSES HOT SPRINGS NATIONAL PARK	SHEET 154 OF 286
	DATE:			10.27.2023

10/27/2023 1:14:18 PM