



Issue	Date
100% Construction Documents	09/27/02
90% Progress Printing	08/30/02
100% Design Development	03/01/02




Job No. POLSHEK & PARTNERS ARCH. 9908
CROMWELL AE 99-114
Scale: 1/8" = 1'-0"
Date: SEPTEMBER 27, 2002

**BASEMENT LEVEL
AREA C
LIGHTING PLAN**

Sheet No. **E200c**



FOR OFFICIAL USE ONLY

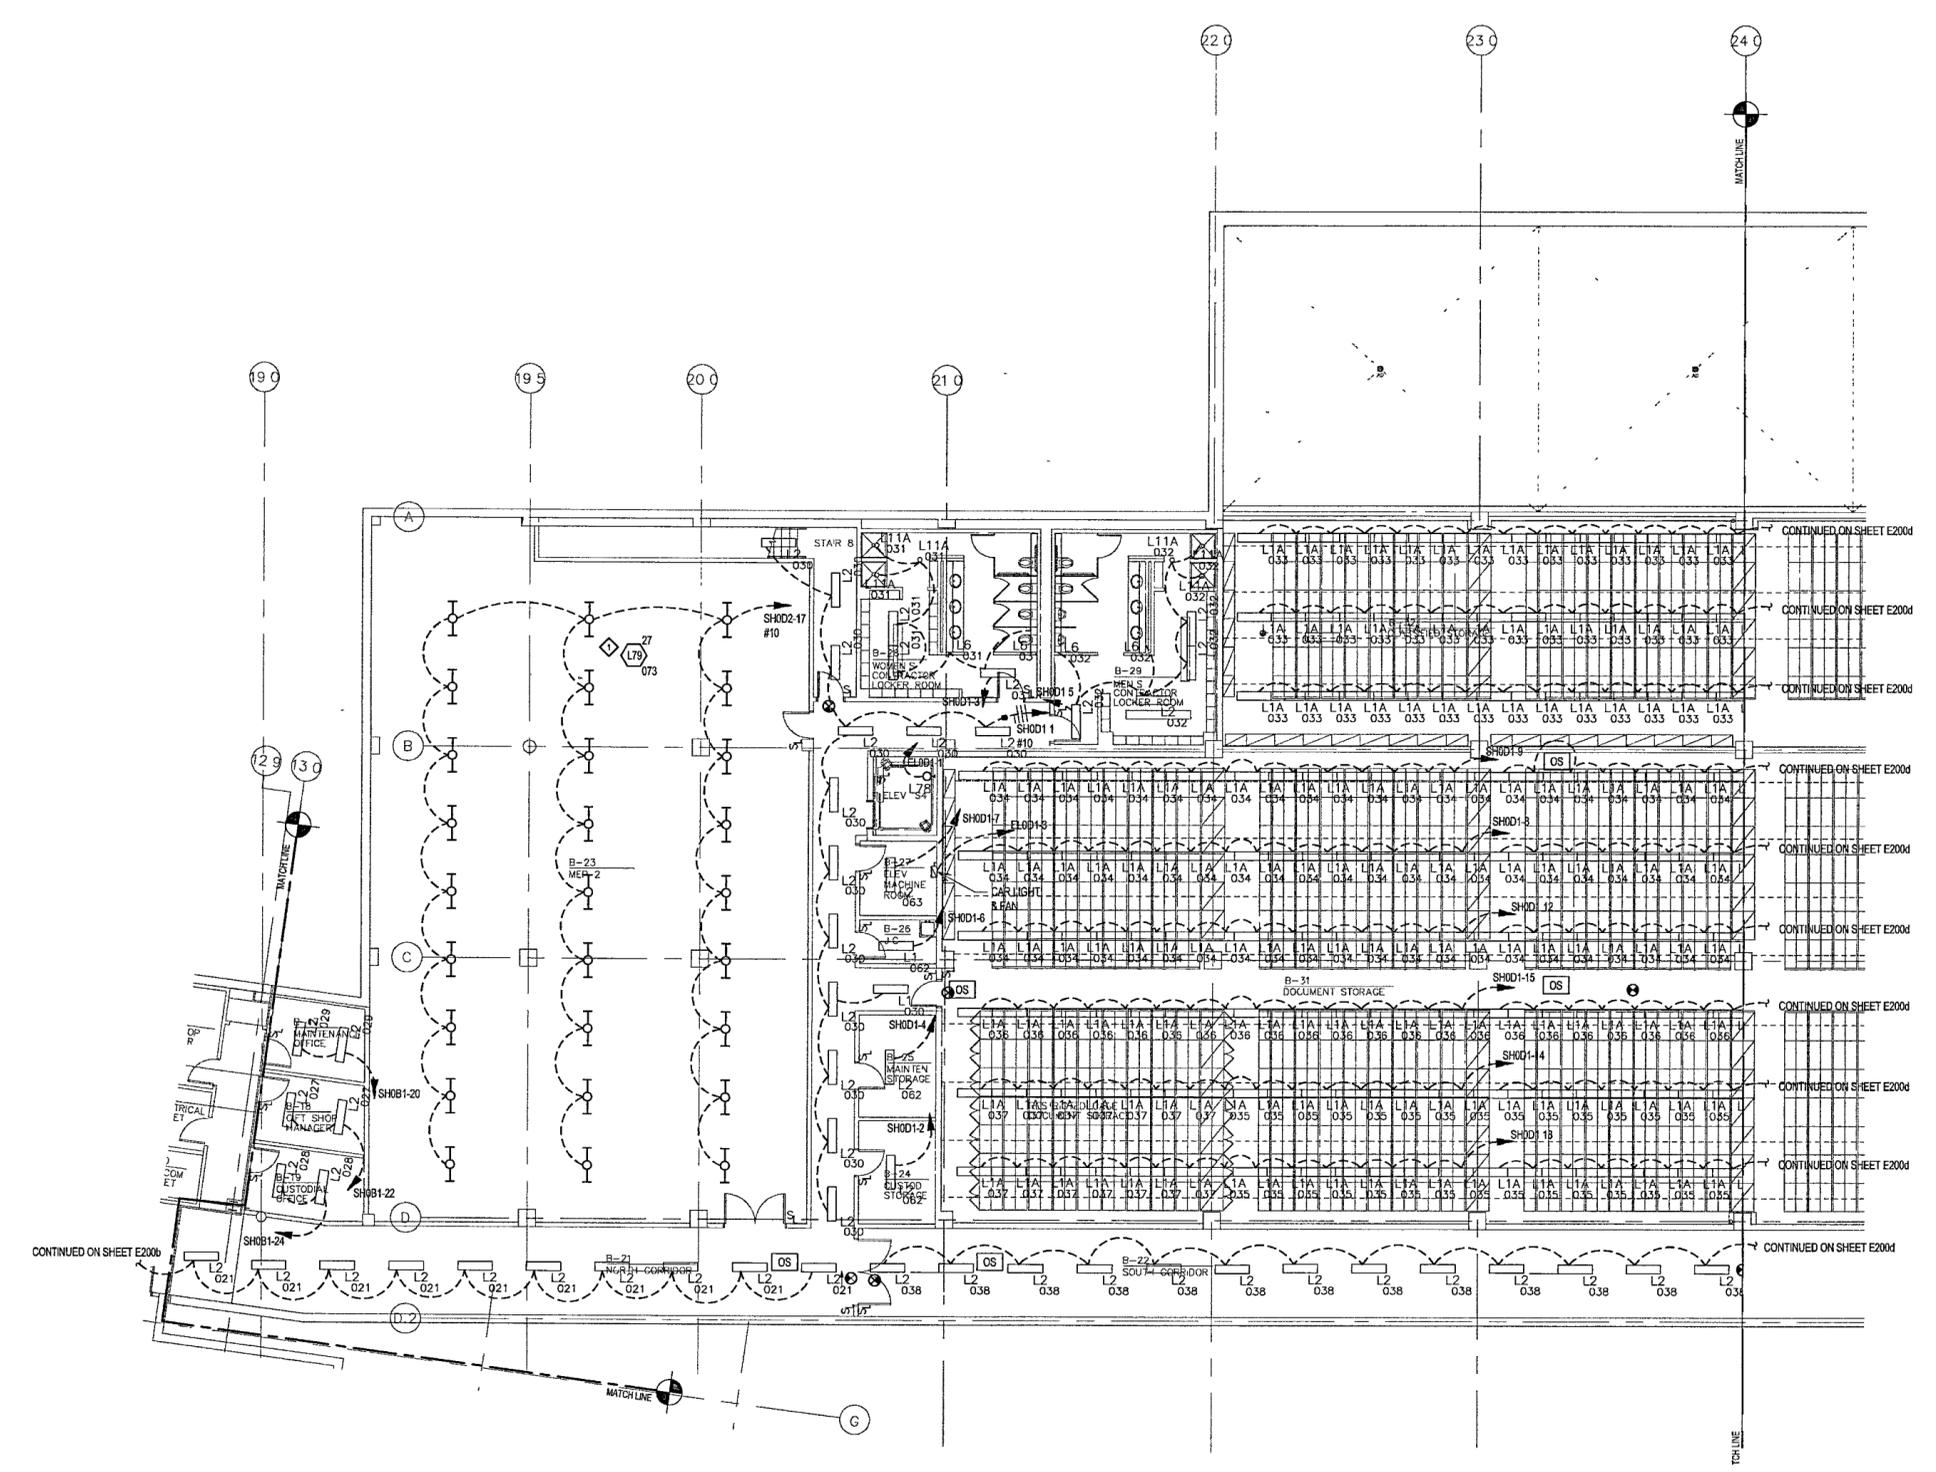

- GENERAL NOTES**
- COORDINATE EXACT LOCATION, QUANTITY AND STYLE OF S, AND OS DEVICES WITH ARCHITECT FOR CONTROL INTENT
 - PROVIDE CLASS 2 WIRING AND CONDUIT FROM EVERY OS AND SL DEVICE, HOMERUNS BACK TO BMS SERVER CLOSETS
 - CIRCUIT EXIT SIGNS TO NEAREST SPARE CIRCUIT BREAKER IN A LOW VOLTAGE EMERGENCY PANEL, UNSWITCHED
 - TWO TRACK SYSTEMS ARE USED FOR NORMAL AND EMERGENCY LIGHTING, ONE-TRACK FOR EACH ON TRACKS RUNNING NORTH-SOUTH, WIRE EMERGENCY CIRCUITS TO WEST-SIDE TRACK. ON TRACKS RUNNING EAST-WEST, WIRE EMERGENCY CIRCUITS TO NORTH-SIDE TRACK. EMERGENCY CIRCUITS HOME RUNS ARE DXXXX, DXXXX, SHXXX, SLXXX. MOUNT L2A FIXTURES PERMANENTLY TO EMERGENCY TRACK SIDE.
 - ON DXXXX AND SXXXX (DIMMERS AND SWITCHES) NEVER USE A NEUTRAL IN COMMON TO TWO OR MORE MODULES IN THE PANELS. ALL DXXXX AND SXXXX MUST HAVE DEDICATED NEUTRALS FROM THE LOAD(S) ALL THE WAY BACK TO THE MODULE
- KEYED NOTES**
- COORDINATE EXACT LOCATION OF FIXTURES WITH MECHANICAL EQUIPMENT

1 BASEMENT LEVEL AREA C LIGHTING PLAN
E200c | E200c 1/8" = 1'-0"
0 4' 8' 16' 24'