

**WILLIAM J. CLINTON  
PRESIDENTIAL  
CENTER**

LITTLE ROCK, ARKANSAS

Architect  
POLSHEK PARTNERSHIP LLP  
320 West 13th Street  
New York, New York 10014  
212.607.7171

Coordinating Architects  
POLK STANLEY YEARY ARCHITECTS Ltd.  
700 South Schiller Street  
Little Rock, Arkansas 72201  
501.378.0878

HITSSELL EVANS RASCO  
801 West Third Street  
Little Rock, Arkansas 72201  
501.374.5300

WOODS CARADINE ARCHITECTS  
2200 South Main Street  
Little Rock, Arkansas 72206  
501.374.4060

Landscape Architects  
HARGREAVES ASSOCIATES  
118 Magazine Street  
Cambridge, Massachusetts 02139  
617.851.0070


LANDSCAPE ARCHITECTURE, Inc.  
2300 Cottondale Lane Suite 202  
Little Rock, Arkansas 72202  
501.374.5610

Structural Engineer  
LESLIE E. ROBERTSON ASSOC. R.L.P.  
30 Broad Street, 4th Floor  
New York, New York 10004  
212.750.9000


MEP Engineers  
FLACK + KURTZ Inc.  
475 Fifth Avenue  
New York, New York 10017  
212.532.9600

CROMWELL ARCHITECTS ENGINEERS  
101 South Spring Street  
Little Rock, Arkansas 72201  
501.372.2900

Curtilage Consultant  
R. A. HEINTGES ARCHITECTS  
126 Fifth Avenue, 9th Floor  
New York, New York 10011  
212.652-2965



Issue	Date
100% Construction Documents	09/27/02
90% Progress Printing	09/30/02
100% Design Development	03/01/02



Job No. POLSHEK & PARTNERS ARCH 0908  
CROMWELL AE 99-114

Scale 1/8" = 1'-0"

Date SEPTEMBER 27, 2002


Title

**BASEMENT LEVEL  
AREA D  
LIGHTING PLAN**

Sheet No  
**E200d**



FOR OFFICIAL USE ONLY

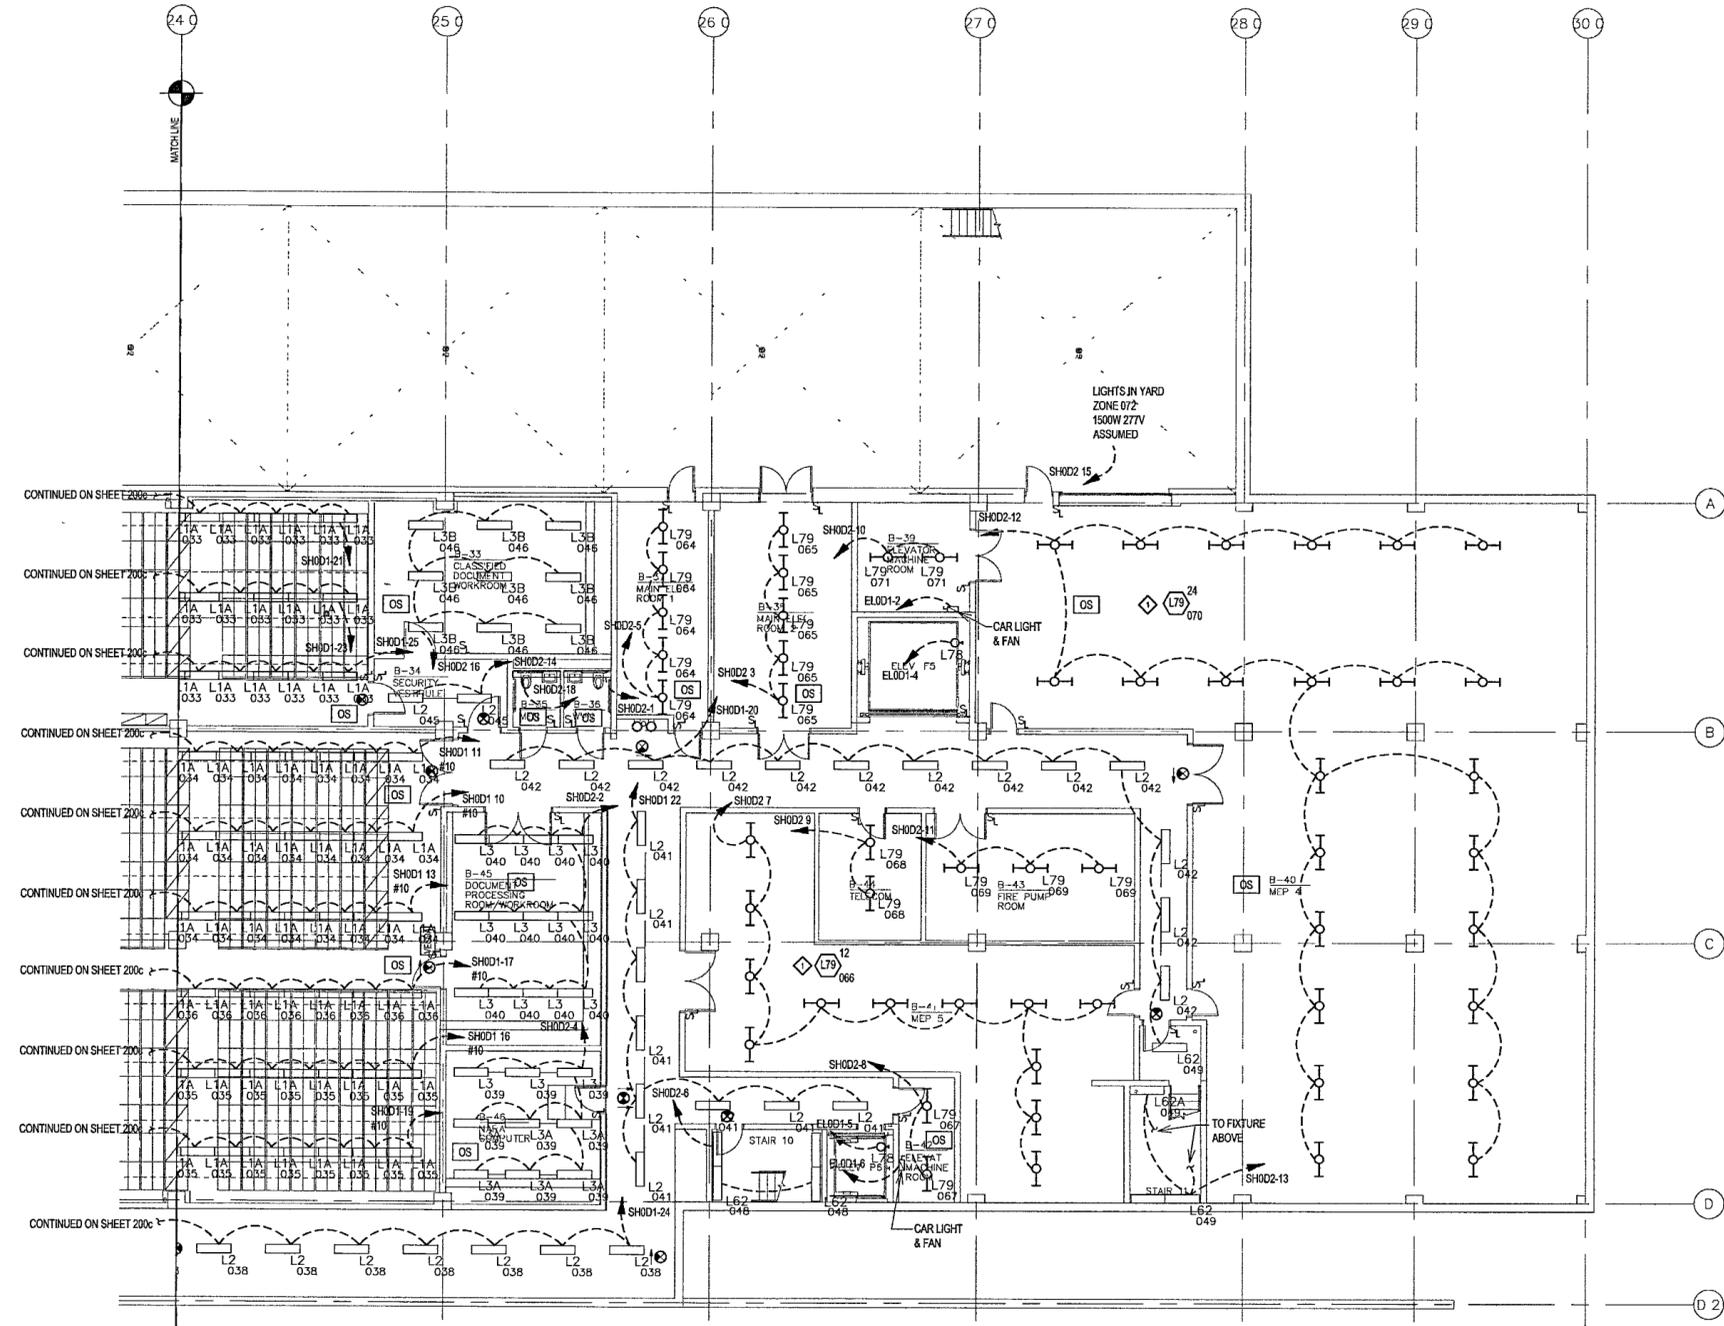

**GENERAL NOTES**

- COORDINATE EXACT LOCATION, QUANTITY AND STYLE OF S<sub>1</sub> AND OS DEVICES WITH ARCHITECT FOR CONTROL INTENT
- PROVIDE CLASS 2 WIRING AND CONDUIT FROM EVERY OS AND SL DEVICE, HOMERUNS BACK TO BMS SERVER CLOSETS.
- CIRCUIT EXIT SIGNS TO NEAREST SPARE CIRCUIT BREAKER IN A LOW VOLTAGE EMERGENCY PANEL, UNSWITCHED
- TWO-TRACK SYSTEMS ARE USED FOR NORMAL AND EMERGENCY LIGHTING, ONE-TRACK FOR EACH ON TRACKS RUNNING NORTH-SOUTH, WIRE EMERGENCY CIRCUITS TO WEST-SIDE TRACK ON TRACKS RUNNING EAST WEST, WIRE EMERGENCY CIRCUITS TO NORTH-SIDE TRACK. EMERGENCY CIRCUITS HOME-RUNS ARE DXXXX, DLXXX, SHXXX, SLXXX. MOUNT L2A FIXTURES PERMANENTLY TO EMERGENCY TRACK SIDE
- ON DXXXX AND SXXXX (DIMMERS AND SWITCHES) NEVER USE A NEUTRAL IN COMMON TO TWO OR MORE MODULES IN THE PANELS. ALL DXXXX AND SXXXX MUST HAVE DEDICATED NEUTRALS FROM THE LOAD(S) ALL THE WAY BACK TO THE MODULE

**KEYED NOTES**

◆ COORDINATE EXACT LOCATION OF FIXTURES WITH MECHANICAL EQUIPMENT

**1 BASEMENT LEVEL AREA D LIGHTING PLAN**  
E200d | E200d 1/8" = 1'-0"  
0 4' 8' 16' 24'

