


100% Construction Documents	09/27/02
50% Progress Printing	08/30/02
100% Design Development	03/01/02
Issue	Date




Job No. POLSHEK & PARTNERS ARCH. 0008
CROMWELL AE 99-114
Scale 1/8" = 1'-0"
Date SEPTEMBER 27, 2002
Title

GROUND LEVEL
AREA C
LIGHTING PLAN

Sheet No. **E201c**



- GENERAL NOTES
- COORDINATE EXACT LOCATION, QUANTITY AND STYLE OF S, AND [OS] DEVICES WITH ARCHITECT FOR CONTROL INTENT
 - PROVIDE CLASS 2 WIRING AND CONDUIT FROM EVERY OS AND SL DEVICE, HOMERUNS BACK TO BMS SERVER CLOSETS
 - CIRCUIT EXIT SIGNS TO NEAREST SPARE CIRCUIT BREAKER IN A LOW VOLTAGE EMERGENCY PANEL UNSWITCHED
 - TWO-TRACK SYSTEMS ARE USED FOR NORMAL AND EMERGENCY LIGHTING, ONE-TRACK FOR EACH ON TRACKS RUNNING NORTH-SOUTH, WIRE EMERGENCY CIRCUITS TO WEST-SIDE TRACK. ON TRACKS RUNNING EAST-WEST WIRE EMERGENCY CIRCUITS TO NORTH-SIDE TRACK. EMERGENCY CIRCUITS HOME RUNS ARE DXXXX, DXXXX, SXXXX, SLXXXX. MOUNT L2/A FIXTURES PERMANENTLY TO EMERGENCY TRACK SIDE.
 - ON DXXXX AND SXXXX (DIMMERS AND SWITCHES) NEVER USE A NEUTRAL IN COMMON TO TWO OR MORE MODULES IN THE PANELS. ALL DXXXX AND SXXXX MUST HAVE DEDICATED NEUTRALS FROM THE LOAD(S) ALL THE WAY BACK TO THE MODULE.

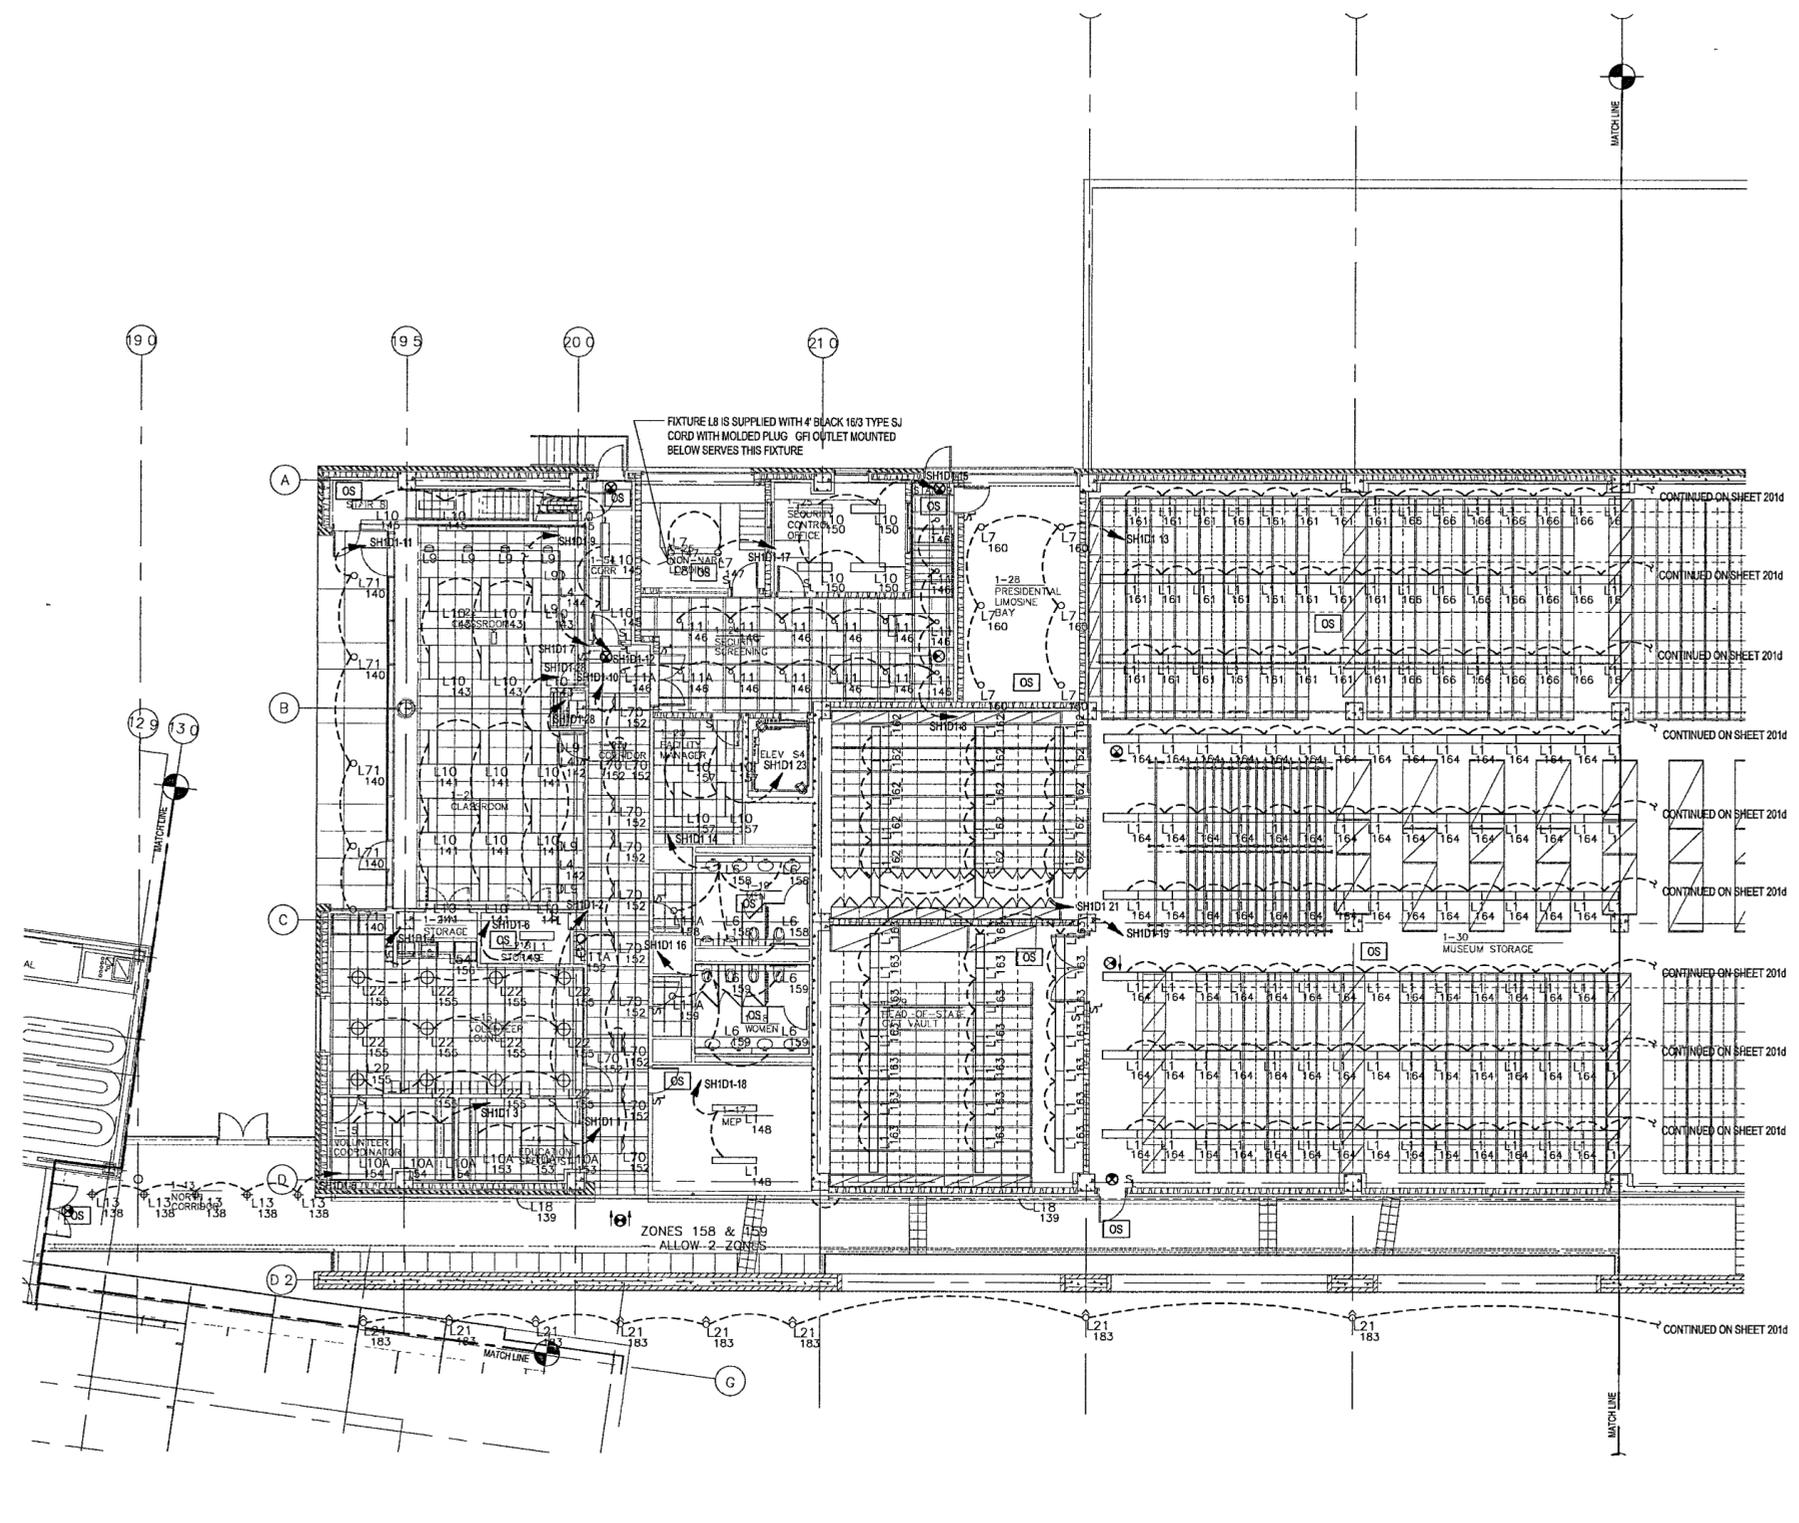

1 GROUND LEVEL AREA C LIGHTING PLAN
E201c | E201c 1/8" = 1'-0"

