


100% Construction Documents	09/27/02
90% Progress Printing	08/09/02
100% Design Development	03/01/02
Issue	Date



Job No: POLSHEK & PARTNERS ARCH. 9908
CROMWELL A.E. 99-114

Scale: 1/8" = 1'-0"

Date: SEPTEMBER 27, 2002

Title: GROUND LEVEL AREA D LIGHTING PLAN

Sheet No:


E201d



GENERAL NOTES

- COORDINATE EXACT LOCATION, QUANTITY AND STYLE OF S₁ AND OS₁ DEVICES WITH ARCHITECT FOR CONTROL INTENT
- PROVIDE CLASS 2 WIRING AND CONDUIT FROM EVERY OS AND SL DEVICE, HOMERUNS BACK TO BMS SERVER CLOSETS
- CIRCUIT EXIT SIGNS TO NEAREST SPARE CIRCUIT BREAKER IN A LOW VOLTAGE EMERGENCY PANEL, UNSWITCHED
- TWO-TRACK SYSTEMS ARE USED FOR NORMAL AND EMERGENCY LIGHTING, ONE-TRACK FOR EACH ON TRACKS RUNNING NORTH SOUTH, WIRE EMERGENCY CIRCUITS TO WEST-SIDE TRACK, ON TRACKS RUNNING EAST-WEST, WIRE EMERGENCY CIRCUITS TO NORTH-SIDE TRACK. EMERGENCY CIRCUITS HOME-RUNS ARE DXXXX, DLXXX, SHXXX, SLXXX. MOUNT L27A FIXTURES PERMANENTLY TO EMERGENCY TRACK SIDE
- ON DXXXX AND SXXXX (DIMMERS AND SWITCHES) NEVER USE A NEUTRAL IN COMMON TO TWO OR MORE MODULES IN THE PANELS. ALL DXXXX AND SXXXX MUST HAVE DEDICATED NEUTRALS FROM THE LOAD(S) ALL THE WAY BACK TO THE MODULE

FIXTURE L8 IS SUPPLIED WITH 4" BLACK 18G TYPE SJ CORD WITH MOLDED PLUG. GFI OUTLET MOUNTED BELOW SERVES THIS FIXTURE

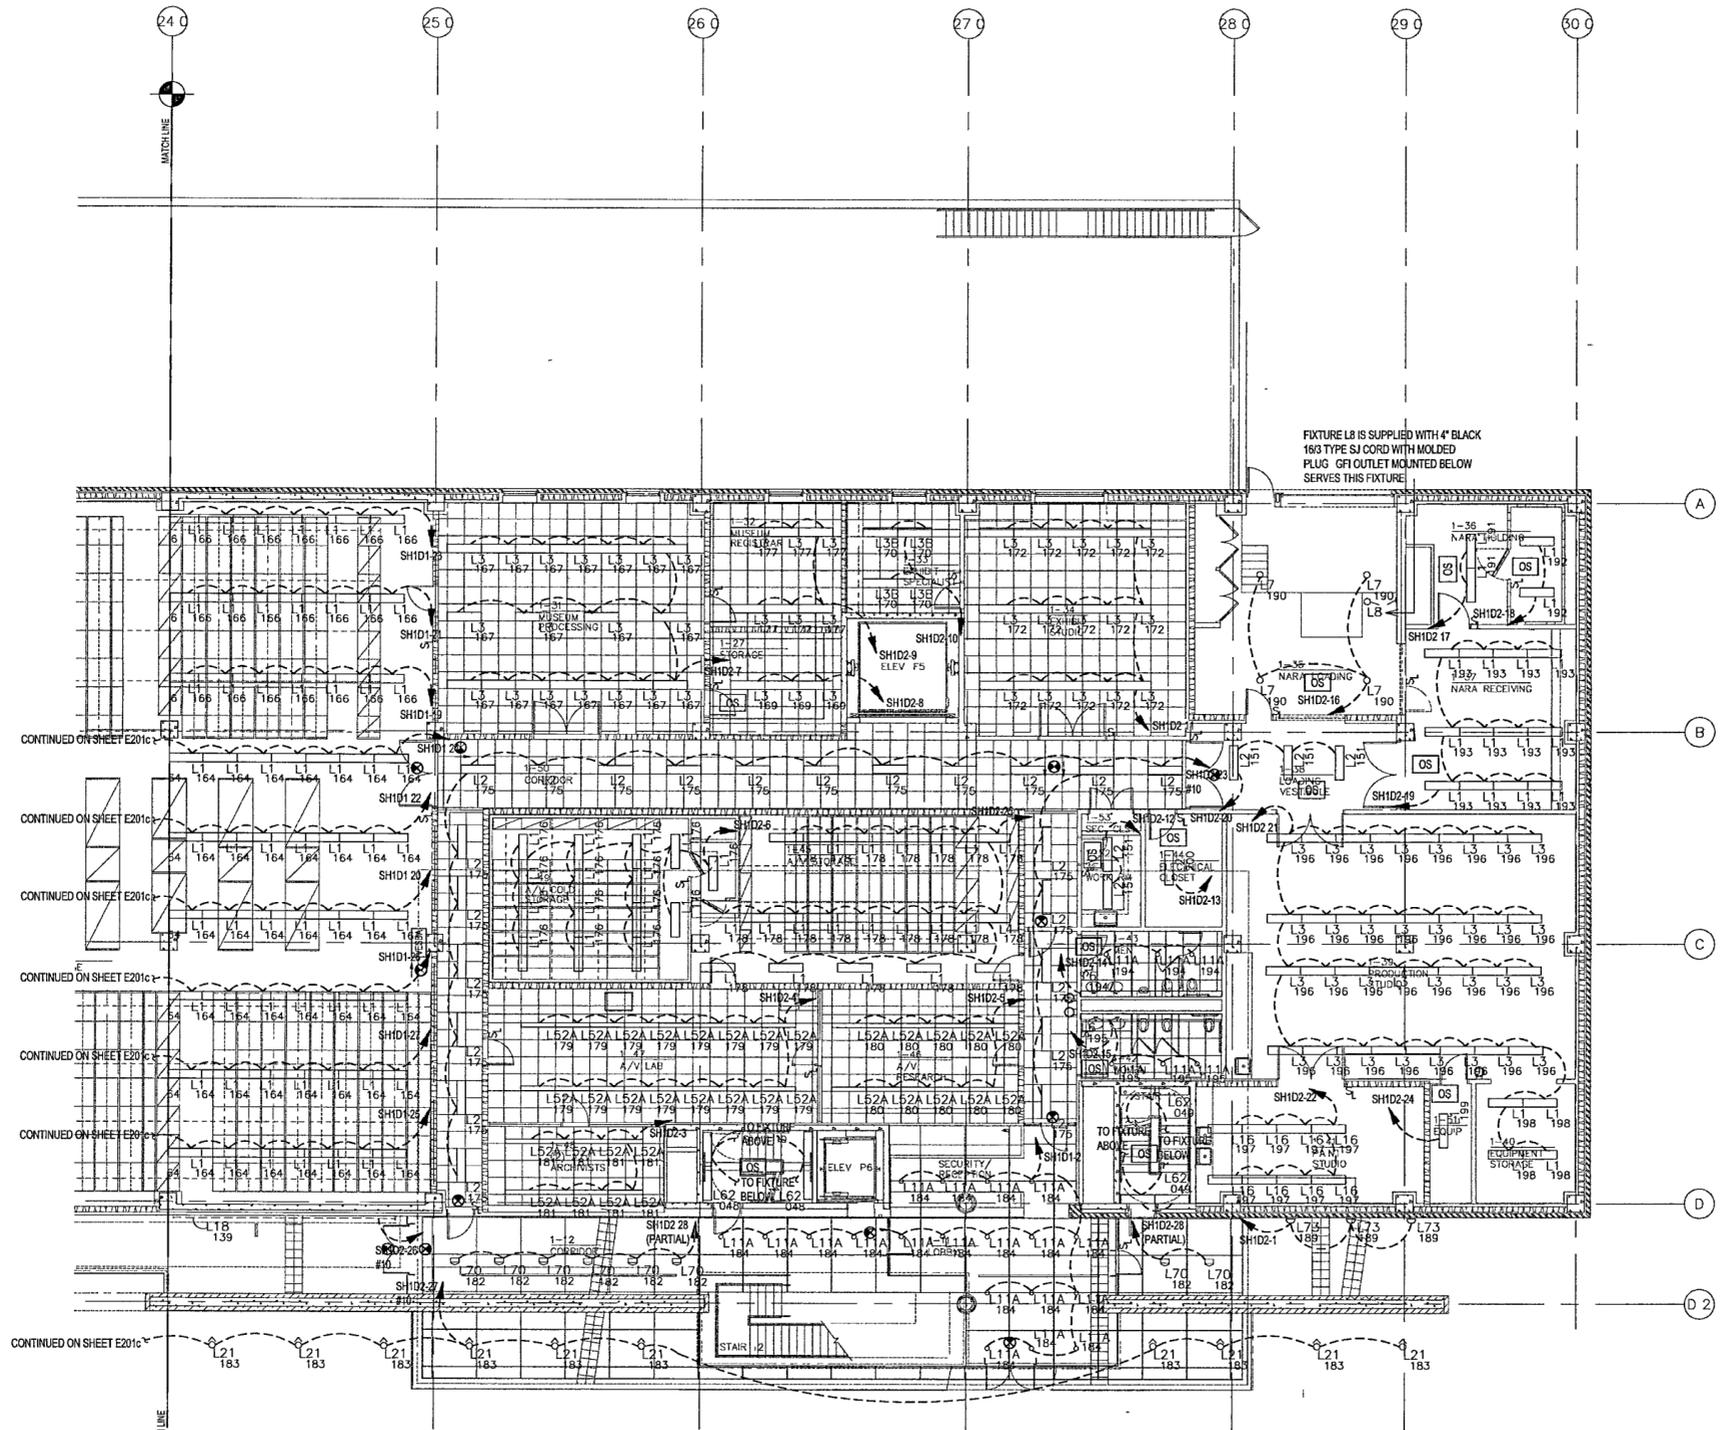

1 GROUND LEVEL AREA D LIGHTING PLAN

E201d | E201d 1/8" = 1'-0"



atls