

**WILLIAM J CLINTON  
PRESIDENTIAL  
CENTER**

LITTLE ROCK, ARKANSAS

Architect  
POLSHKE PARTNERSHIP LLP  
320 West 13th Street  
New York, New York 10014  
212.807.7171

Coordinating Architects  
POLK STANLEY YEARY ARCHITECTS Ltd  
700 South Sollier Street  
Little Rock, Arkansas 72201  
501.378.0878

WITSELL EVANS RASCO  
501 West Third Street  
Little Rock, Arkansas 72201  
501.374.5300

WOODS CARADINE ARCHITECTS  
2200 South Main Street  
Little Rock, Arkansas 72206  
501.374.4060

Landscape Architects  
HARGREAVES ASSOCIATES  
118 Magazine Street  
Cambridge, Massachusetts 02139  
617.601.0070

LANDSCAPE ARCHITECTURE, Inc.  
2300 Cottondale Lane Suite 202  
Little Rock, Arkansas 72202  
501.374.5610

Structural Engineer  
LESLIE E. ROBERTSON ASSOC. P.L.L.C.  
30 Broad Street 4th Floor  
New York, New York 10004  
212.750.9000


MEP Engineers  
FLACK + KURTZ Inc.  
475 Fifth Avenue  
New York, New York 10017  
212.532.9600

CROMMELL ARCHITECTS ENGINEERS  
101 South Spring Street  
Little Rock, Arkansas 72201  
501.372.2300

Curtilage Consultant  
R. A. HEINTGES ARCHITECTS  
126 Fifth Avenue 9th Floor  
New York, New York 10011  
212.552.2366



100% Construction Documents	09/21/02
90% Progress Printing	08/30/02
100% Design Development	03/01/02
Issue	Date



Job No: POLSHKE & PARTNERS ARCH 8908  
CROMMELL AE 99-114

Scale: 1/8" = 1'-0"

Date: SEPTEMBER 27, 2002


Title: GROUND LEVEL  
DOCUMENT STORAGE  
VESDA PLAN

Sheet No:

**FA501**




FOR OFFICIAL USE ONLY

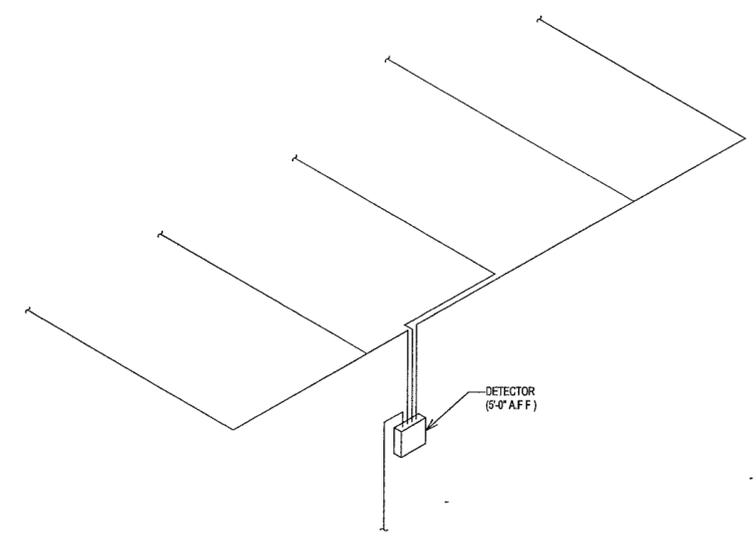

**2 VESDA SMOKE DETECTION RISER DIAGRAM**  
FA501c | FA501c NTS

- KEYED NOTES**
- ◇ FOR CALCULATION PURPOSES, SOME PIPE DIMENSIONS MAY BE ROUNDED UP TO THE NEAREST FOOT
  - 15/132 TOP NUMBER INDICATES DISTANCE TO PREVIOUS HOLE OR INTERSECTION BOTTOM NUMBER INDICATES DISTANCE FROM HOLE/INTERSECTION TO DETECTOR INCLUDING ELEVATIONS DIMENSIONS ARE IN FEET
  - 5-2 INDICATES PIPE #5 & HOLE #2
  - 5-EC INDICATES PIPE #5 & END-CAP (WITH HOLE)
  - ◇ DETECTOR MOUNTED AT 5' AFF

- GENERAL NOTES**
- 1 3/4 INCH MANUFACTURER APPROVED CPVC PIPE SHALL BE RUN UNDER BEAMS PIPE SHALL BE SUSPENDED 1"-3" BELOW CEILING TO ALLOW ELECTRICAL CONDUIT TO BE FLUSH WITH CEILING SAMPLING PIPE SHALL RUN OVER SPRINKLER PIPE AND DUCT
  - 2 ALL PIPES TO HAVE HOLES 20' APART WITH SOME EXCEPTIONS AS INDICATED
  - 3 HOLES SHALL POINT DOWNWARD EXCLUDING END VENT
  - 4 ALL HOLES AND PIPE SHALL BE LABELED WITH MFG PROVIDED LABELS
  - 5 DEVIATION FROM THESE PLANS WILL REQUIRE NEW CALCULATIONS AND APPROVAL OF ENGINEER
  - 6 HOLES DO VARY AND SHALL BE SIZED PER CALCULATIONS
  - 7 CALCULATIONS BASED ON 14" TO BOTTOM OF BEAMS
  - 8 SAMPLING PIPE SHALL BE PAINTED TO MATCH CEILING
  - 9 MFG PIPE LABELING SHALL BE MASKED AT LEAST ONCE ON EACH SECTION OF PIPE PRIOR TO PAINTING MASKING SHALL BE RECTANGULAR AND PROVIDE PROFESSIONAL LOOK WHEN REMOVED
  - 10 PIPE SHALL BE CLEANED WITH SOAP PRIOR TO PAINTING
  - 11 PAINT SHALL BE ALLOWED TO DRY COMPLETELY PRIOR TO DRILLING HOLES

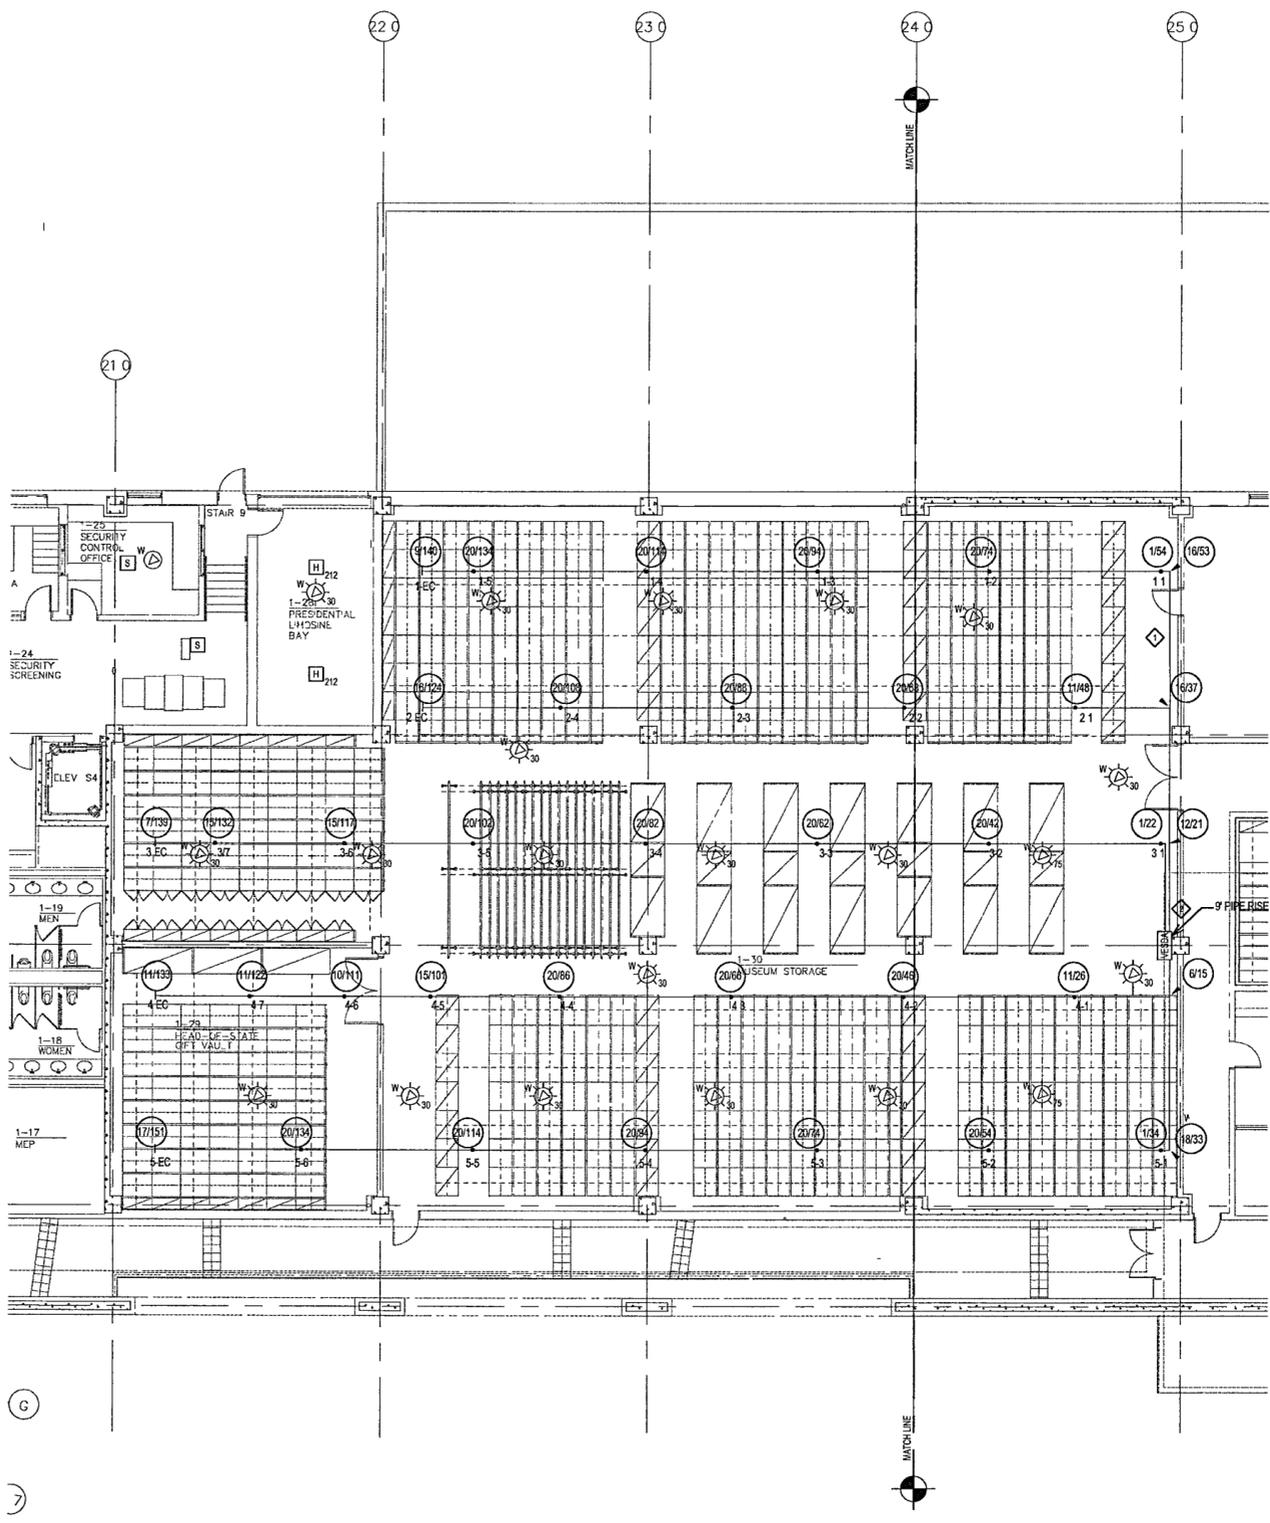

**1 GROUND LEVEL DOCUMENT STORAGE VESDA PLAN**  
FA501 | FA501 1/8" = 1'-0"

