

**WILLIAM J. CLINTON  
PRESIDENTIAL  
CENTER**

LITTLE ROCK, ARKANSAS

Architect  
POLSHEK PARTNERSHIP LLP  
320 West 13th Street  
New York, New York 10014  
212 807 7171

Coordinating Architects  
POLK STANLEY YEARY ARCHITECTS  
700 South Schiller Street  
Little Rock, Arkansas 72201  
501 378 0878

WITSELL EVANS & RASCO  
901 West Third Street  
Little Rock, Arkansas 72201  
501 374 5300

WOODS CARADINE ARCHITECTS  
2200 South Main Street  
Little Rock, Arkansas 72206  
501 374 4060

Landscape Architects  
HARGREAVES ASSOCIATES  
118 Magazine Street  
Cambridge, Massachusetts 02139  
617 861 0070

LANDSCAPE ARCHITECTURE, Inc.  
2300 Cottondale Lane, Suite 202  
Little Rock, Arkansas 72202  
501 374 5610

Structural Engineer  
LESLIE E. ROBERTSON ASSOC., RLLP  
30 Broad Street, 4th Floor  
New York, New York 10004  
212 750 9000

MEP Engineers  
FLACK + KURTZ Inc  
475 Fifth Avenue  
New York, New York 10017  
212 532 9600

CROMMELL ARCHITECTS ENGINEERS  
101 South Spring Street  
Little Rock, Arkansas 72201  
501 372 2900


FoodService Consultants



NEXT STEP DESIGN, INC  
1116 West Street, Suite C  
Annapolis, Maryland 21401  
410 263 1200

Seal

Issue	Date
100% Construction Docs	9/27/02
90% Progress Printing	8/30/02
100% Construction	6/14/02
100% DD	2/28/02



Job No 9908


Scale 1/4" = 1'-0"

Date SEPTEMBER 27, 2002

Title  
**FOOD SERVICE  
GROUND LEVEL  
SPECIAL CONDITIONS  
PLAN**


Sheet No

**FS-SC2**

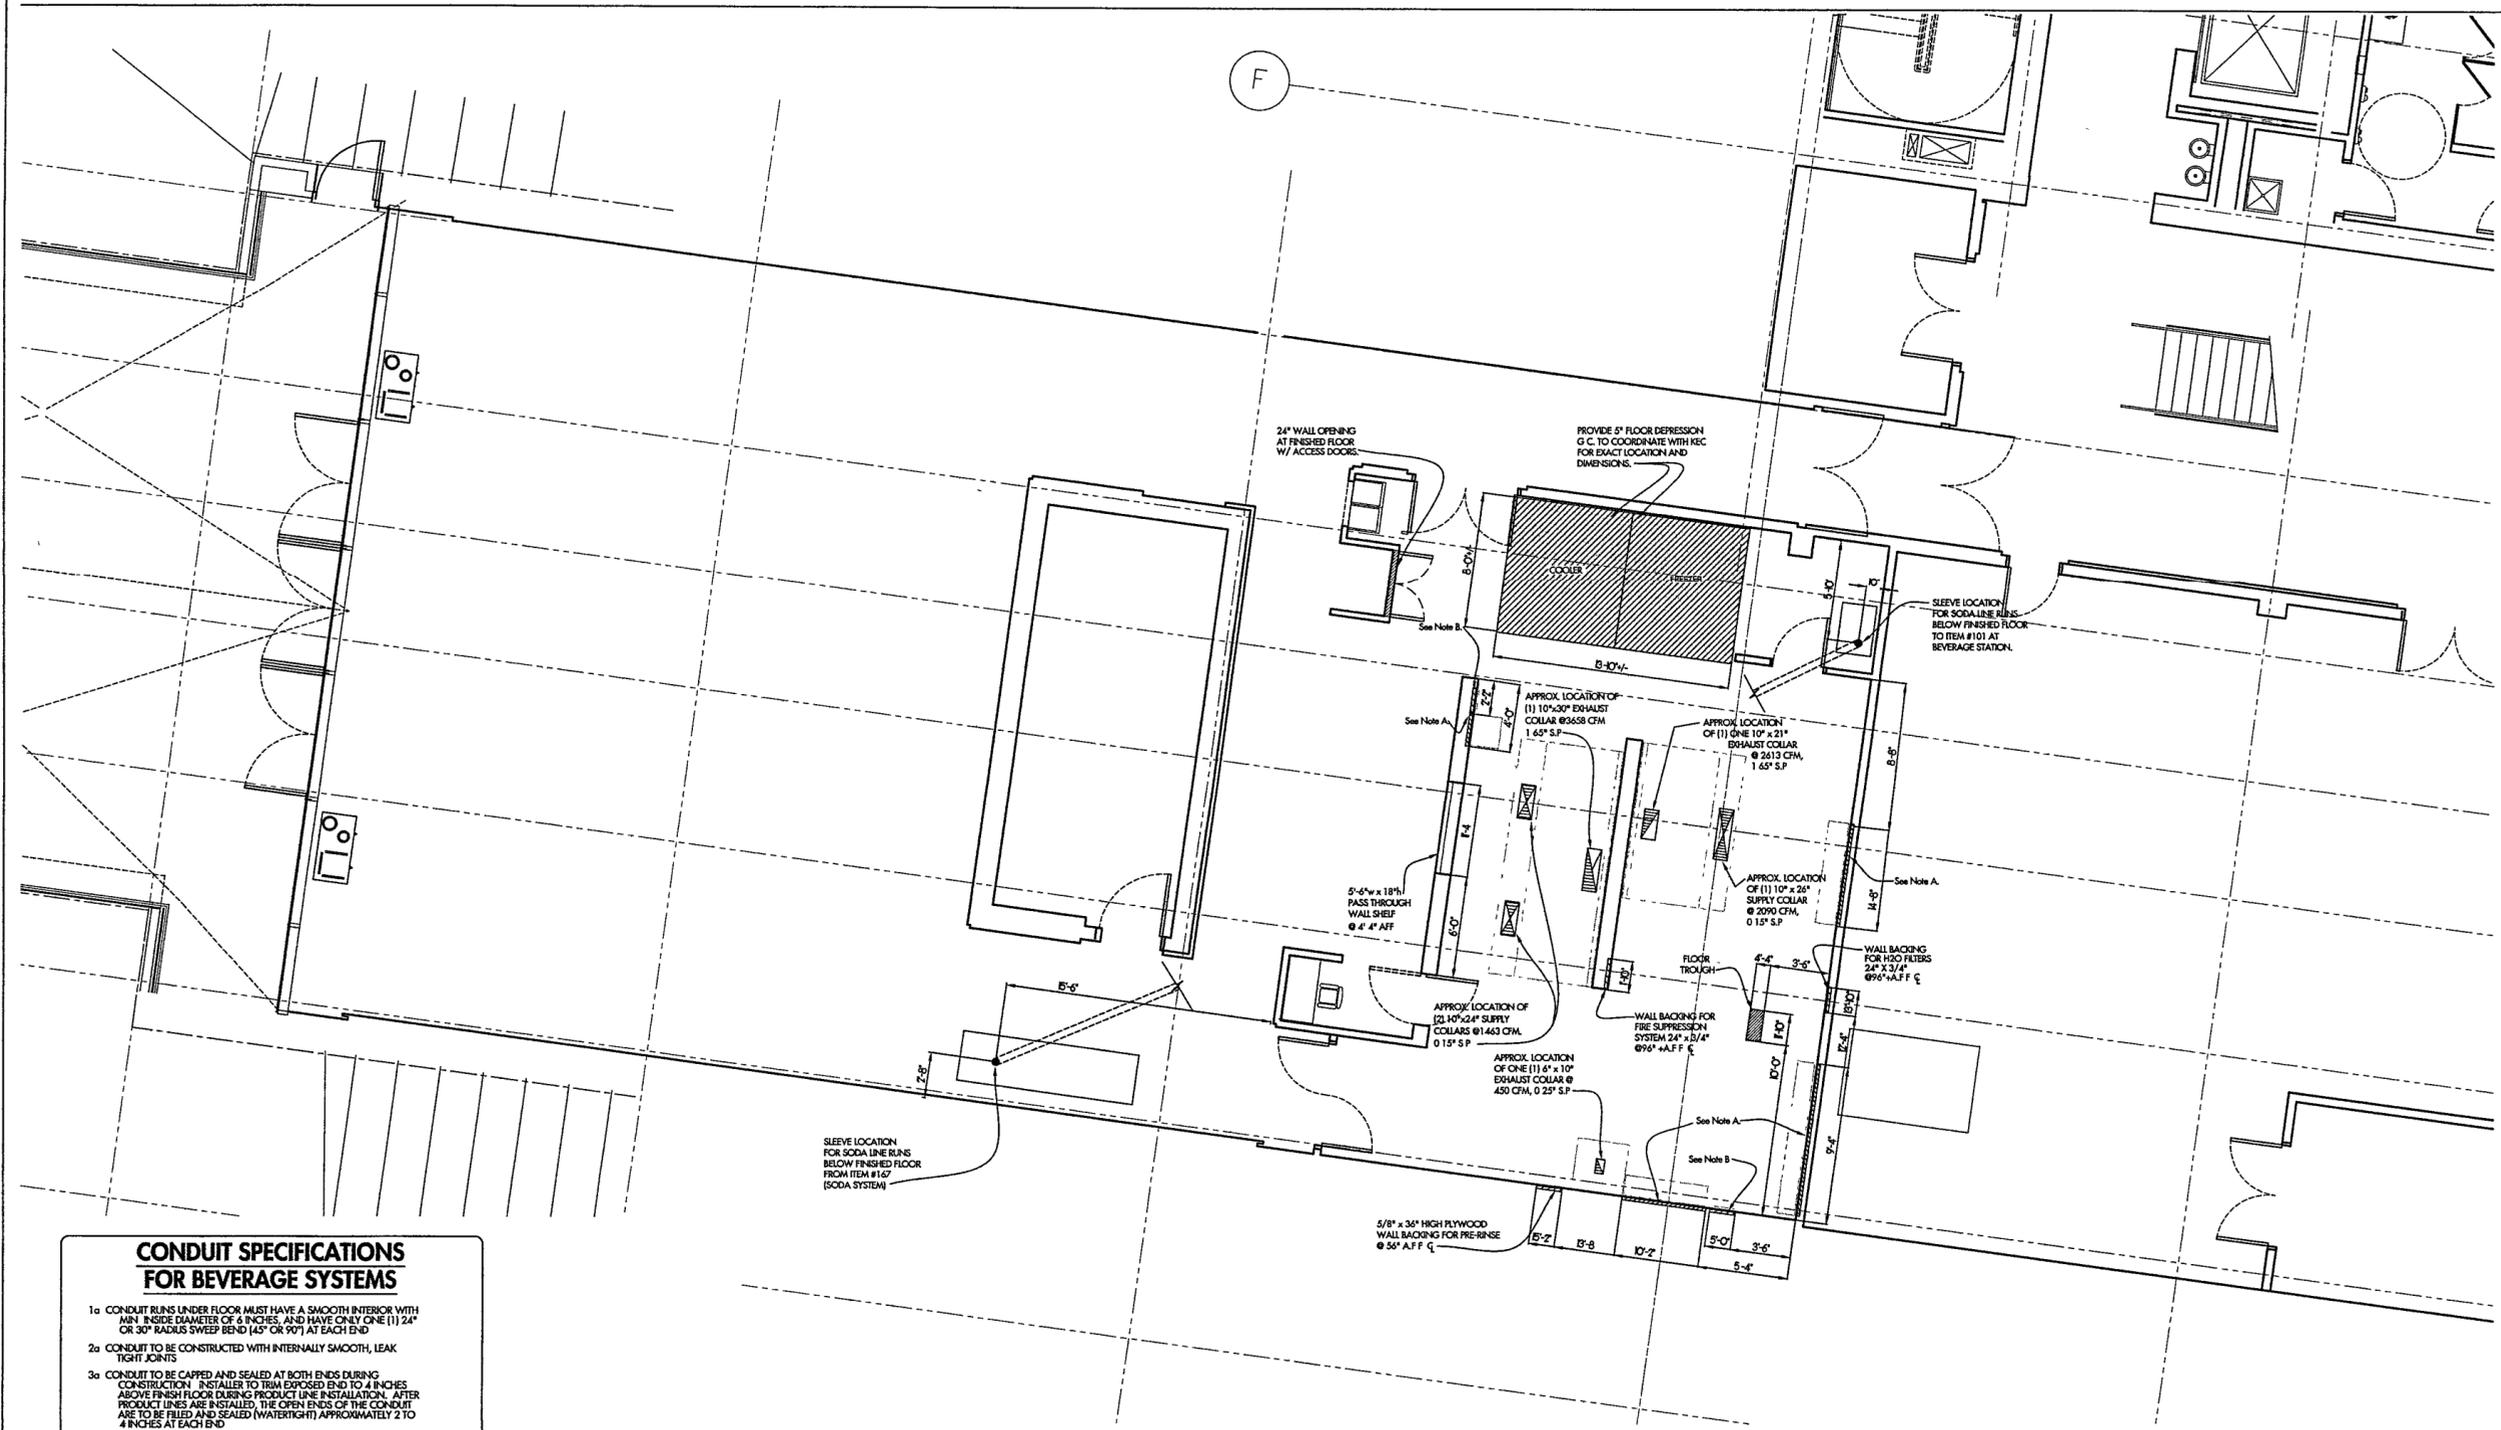

**CONDUIT SPECIFICATIONS  
FOR BEVERAGE SYSTEMS**

- CONDUIT RUNS UNDER FLOOR MUST HAVE A SMOOTH INTERIOR WITH MIN INSIDE DIAMETER OF 6 INCHES, AND HAVE ONLY ONE (1) 24" OR 30" RADIUS SWEEP BEND (45° OR 90°) AT EACH END
- CONDUIT TO BE CONSTRUCTED WITH INTERNALLY SMOOTH, LEAK TIGHT JOINTS
- CONDUIT TO BE CAPPED AND SEALED AT BOTH ENDS DURING CONSTRUCTION. INSTALLER TO TRIM EXPOSED END TO 4 INCHES ABOVE FINISH FLOOR DURING PRODUCT LINE INSTALLATION. AFTER PRODUCT LINES ARE INSTALLED, THE OPEN ENDS OF THE CONDUIT ARE TO BE FILLED AND SEALED (WATER TIGHT) APPROXIMATELY 2 TO 4 INCHES AT EACH END
- PROVIDE 4 & 8 INCH INSIDE DIAMETER EMT CONDUIT PLUS SCHEDULE 40 CONDUIT AND FITTINGS, OR EQUAL. ALL JOINTS SHALL BE SOLVENT CEMENTED IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS
- PLUMBING STYLE EMT SHORT RADIUS FACTORY "ELLS" ARE NOT ACCEPTABLE
- PROVIDE 24" RADIUS SWEEP ELBOWS UP TO BAR, WHERE SHOWN, FOR BEER LINE RUNS
- "PULL" JUNCTION BOXES TO BE 2'-6" X 3'-0" X 18" H WHERE SHOWN



G.C. NOTE  
COORDINATE PENETRATIONS WITH EXISTING POST-TENSIONED FLOOR SLAB G.C. TO SURVEY AREA PRIOR TO INSTALLATION

- NOTES
- PROVIDE 6" ALUMINUM EMT OR GALVANIZED CONDUIT W/24" RADIUS SWEEPS TO SODA OUTLET LOCATIONS FROM EXISTING SODA LINE CHASE. NEC TO COORDINATE W/SODA VENDOR AND ELECTRICAL CONTRACTOR TO DETERMINE ROUTING AND VERIFY EXISTING CONDITIONS
  - PROVIDE 4" ALUMINUM EMT OR GALVANIZED CONDUIT W/24" RADIUS SWEEPS TO BEER OUTLET LOCATIONS. NEC TO COORDINATE W/BEER VENDOR AND ELECTRICAL CONTRACTOR TO DETERMINE ROUTING

ALL BEVERAGE CONDUIT BY KELLY SYSTEMS INC., CHICAGO, IL (312) 733-3224


**GROUND LEVEL SPECIAL CONDITIONS PLAN**

SCALE 1/4" = 1'-0"

**FINISH SCHEDULE**

KITCHEN & STORAGE AREAS	
FLOOR:	CERAMIC TILE, COVED TO WALL
WALLS:	CERAMIC TILE & DRYWALL PAINTED SMOOTH, LIGHT COLOR, REFLECTIVE, WASHABLE, GREASE RESISTANT
CEILING:	SUSPENDED ACOUSTICAL TILE, T-GRID SYSTEM, 2' X 4', WASHABLE UNFISSURED AND UNPERFORATED
CAFE	
FLOOR:	STONE-HONED BASALT, COVED TO WALL
WALLS:	WOOD PAINTED SMOOTH, WASHABLE, GREASE RESISTANT
CEILING:	GYPSUM WALL BOARD, WASHABLE


NOTE FOR DETAILED FINISH SCHEDULE SEE ARCHITECTUAL PLANS



SECTION DETAIL / FLOOR TROUGH

**LEGEND**

- = EXHAUST DUCT COLLAR
- = SUPPLY DUCT COLLAR
- = WALL BACKING
- = PVC PENETRATION FOR BEER AND SODA LINES. SEE DETAIL
- = RECESSED SLAB
- = FLOOR PITCH AREA
- = CONCRETE CURB

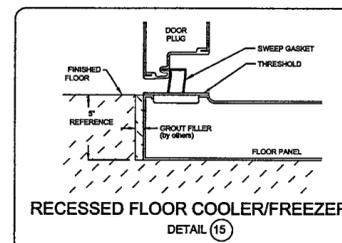

RECESSED FLOOR COOLER/FREEZER  
DETAIL (15)

**GENERAL CONTRACTOR NOTES**

- NOTE A:**  
GC WILL INSTALL WALL BACKING (REINFORCEMENT) FOR WALL MOUNTED SHELVING & FIXTURES. SUGGESTED 5/8" X 3/4" HIGH PLYWOOD WHERE INDICATED SECURED WITH HORIZONTAL CENTERLINE AT 5" A.F.F.
- NOTE B:**  
BACKING FOR HAND SINKS AND MOP FAUCET BY PLUMBER. SUGGESTED 12" X 18" PLYWOOD SECURED WITH HORIZONTAL CENTERLINE AT 42" A.F.F.
- NOTE C:**  
CO-ORDINATE OPENINGS IN MILLWORK WITH KITCHEN EQUIPMENT CONTRACTOR. VERIFY ALL DIMENSIONS IN CONJUNCTION WITH FOOD SERVICE MANUFACTURERS CUT SHEETS AND SHOP DRAWINGS

SEE ARCHITECTURAL PLANS FOR OTHER DETAILS ON MILLWORK. CONTRACTOR TO VERIFY ALL DIMENSIONS

**NOTICE**  
ALL ITEMS NOTED ON THIS PLAN ARE TO BE INCLUDED AS PART OF THE GENERAL CONTRACTOR'S SCOPE OF WORK.