

ITEM #118
PLAN VIEW

VENTILATOR NOTES (NON-WATER WASH)

A) VERIFY ALL MAKES AND MODELS OF COOKING EQUIPMENT AND LOCATION IN RELATION TO VENTILATOR PRIOR TO FABRICATION

B) FRONT AND REAR MOUNTING BRACKETS HAVE KULEST HOLES. BRACKETS TO BE SUPPORTED WITHIN 12" OF EACH END OF EACH SECTION WITH A MAXIMUM SPAN OF 72" BETWEEN SUPPORTS.

C) INTERIOR MOUNTING BRACKET(S) TO BE SUPPORTED WITHIN 36" OF EACH END OF EACH SECTION WITH A MAXIMUM SPAN OF 72" BETWEEN SUPPORTS.

VENTILATOR WIRING NOTES (NON-WATER WASH) (ELECTRIC DAMPER)

① (4) WIRES AND GROUND, FOR CONTROL(S) IN FLEXIBLE CONDUIT EXTENDING 6' BEYOND END OF VENTILATOR BY GAYLORD. WIRE TO FAN ON/OFF SWITCH BY ELECTRICAL CONTRACTOR.

* LIGHT FIXTURES, VAPOR PROOF ALL LISTED. * FURNISHED, INSTALLED AND WIRED BY GAYLORD.


② (2) WIRES AND GROUND FOR LIGHT(S) IN FLEXIBLE CONDUIT EXTENDING 6' BEYOND END OF VENTILATOR BY GAYLORD. WIRE TO LIGHT SWITCH BY ELECTRICAL CONTRACTOR.

VERIFY CEILING CONDITIONS


EXACT FLOOR TO STRUCTURAL CEILING AND FLOOR TO FINISH CEILING HEIGHTS MUST BE VERIFIED FOR VENTILATOR DESIGN. INCORRECT HEIGHTS MAY CAUSE THE VENTILATOR TO NOT FIT PROPERLY OR COMPLY WITH CLEARANCES SPECIFIED IN APPLICABLE CODES AND STANDARDS. CAUTION: IF THE FINISHED CEILING IS HIGHER THAN THE TOP OF THE VENTILATOR, ENCLOSURE PANELS MAY BE REQUIRED.

FLOOR TO STRUCTURAL CEILING: _____ (VERIFY)


FLOOR TO FINISH CEILING: _____ 9'-0" (VERIFY)

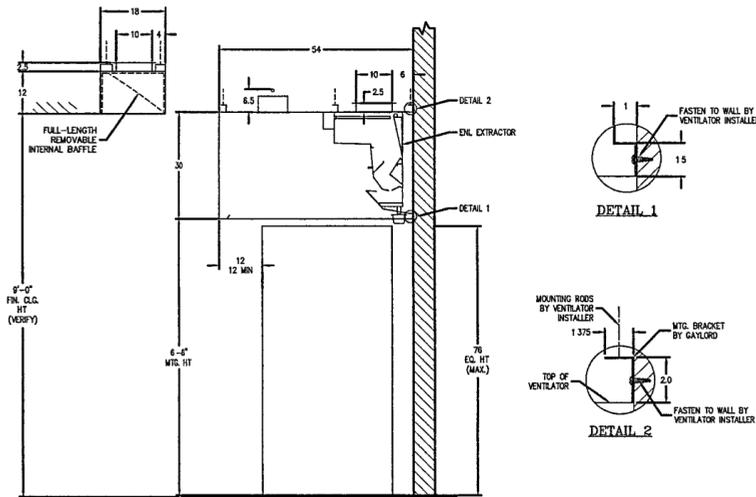


ITEM #118
SECTION VIEW

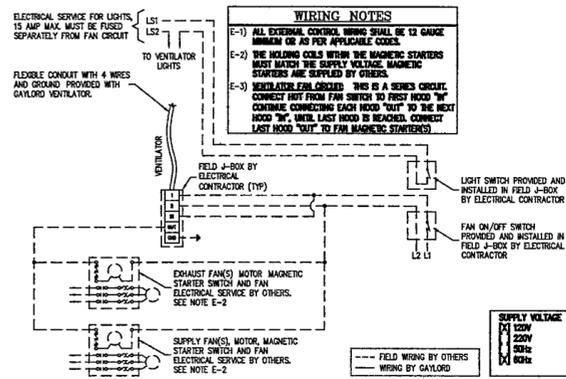


NOTE: FIRE PROTECTION SYSTEM SUPPLIED AND INSTALLED WITHIN VENTILATOR BY OTHERS.

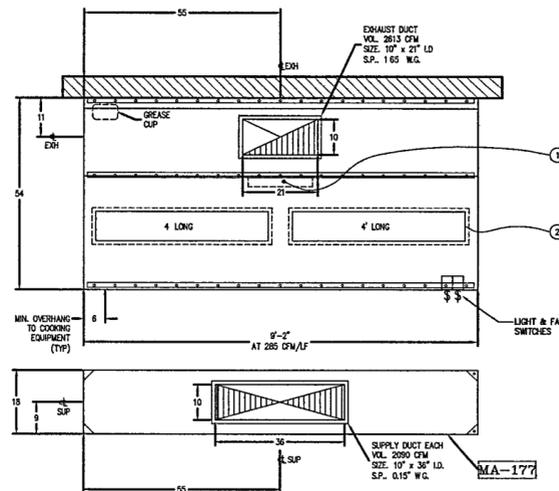


ITEM #177
PLAN VIEW

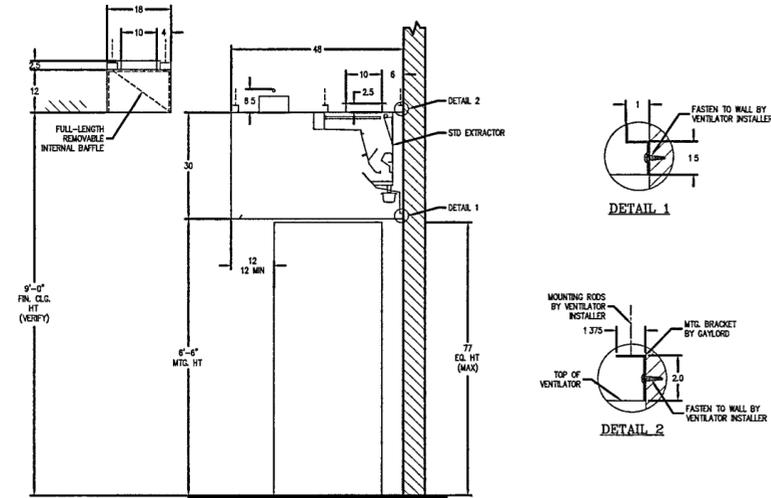

ITEM #177
SECTION VIEW

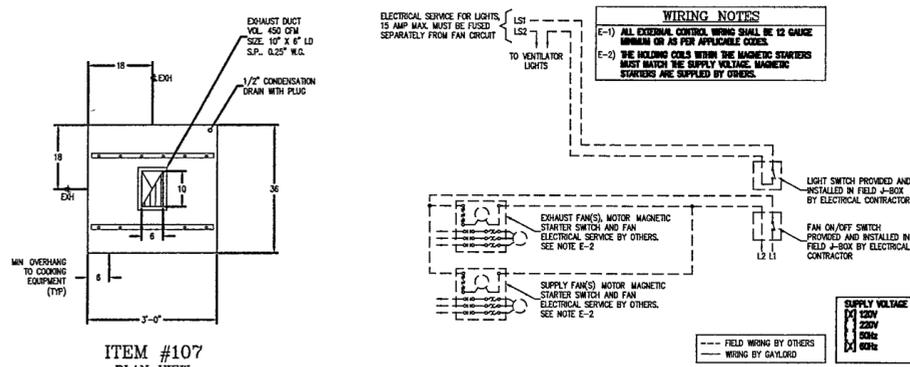

ITEM #107
PLAN VIEW

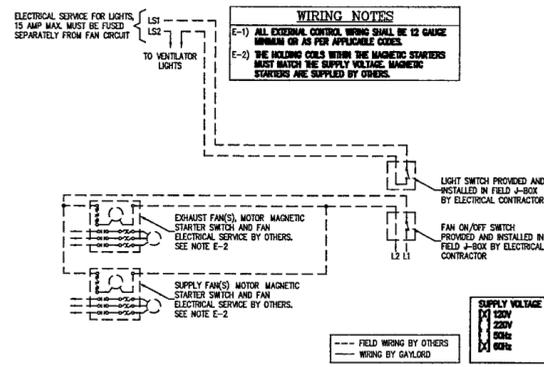

GAYLORD INDUSTRIES, INC.

1000 U.S. HWY 91 ST. TEL: (800) 890-8900
P.O. BOX 1048 TEL: (800) 890-8900
SANTA FE, NM 87508-0148 FAX: (505) 890-8900

EXHAUST FLOW: 4 (1/2) (200)

VH2 VENTILATOR NOTES

A) VERIFY ALL MAKES AND MODELS OF COOKING EQUIPMENT AND LOCATION IN RELATION TO VENTILATOR PRIOR TO FABRICATION

B) FRONT AND REAR MOUNTING BRACKETS HAVE KULEST HOLES. BRACKETS TO BE SUPPORTED WITHIN 12" OF EACH END OF EACH SECTION, WITH A MAXIMUM SPAN OF 72" BETWEEN SUPPORTS.

C) 1/2" CONDENSATION DRAIN WITH PLUG.

VENTILATOR WIRING NOTES (NON-WATER WASH)


① (2) WIRES AND GROUND, FOR FAN ON/OFF SWITCH TO J-BOX ON TOP OF VENTILATOR BY ELECTRICAL CONTRACTOR. WIRE TO SUPPLY VOLTAGE AND FANS BY ELECTRICAL CONTRACTOR.

VERIFY CEILING CONDITIONS

EXACT FLOOR TO STRUCTURAL CEILING AND FLOOR TO FINISH CEILING HEIGHTS MUST BE VERIFIED FOR VENTILATOR DESIGN. INCORRECT HEIGHTS MAY CAUSE THE VENTILATOR TO NOT FIT PROPERLY OR COMPLY WITH CLEARANCES SPECIFIED IN APPLICABLE CODES AND STANDARDS. CAUTION: IF THE FINISHED CEILING IS HIGHER THAN THE TOP OF THE VENTILATOR, ENCLOSURE PANELS MAY BE REQUIRED.

FLOOR TO STRUCTURAL CEILING: _____ (VERIFY)

FLOOR TO FINISH CEILING: _____ 9'-0" (VERIFY)

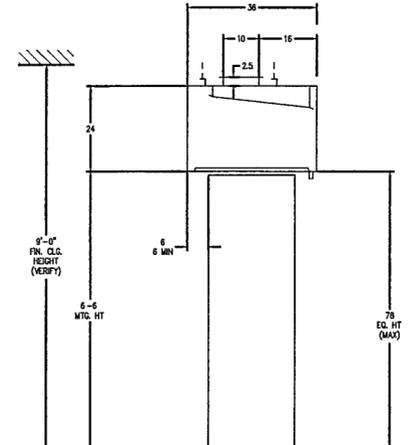

ITEM #107
SECTION VIEW

MECHANICAL HOOD PLAN

NOT TO SCALE

**WILLIAM J. CLINTON
PRESIDENTIAL
CENTER**

LITTLE ROCK, ARKANSAS

Architect
POLSHEK PARTNERSHIP LLP
320 West 13th Street
New York, New York 10014
212 807 7171

Coordinating Architects
POLK STANLEY YEARY ARCHITECTS
700 South Schiller Street
Little Rock, Arkansas 72201
501 378 0878

WITSELL EVANS & RASCO
901 West Third Street
Little Rock, Arkansas 72201
501 374 5300

WOODS CARADINE ARCHITECTS
2200 South Main Street
Little Rock, Arkansas 72206
501 374 4060

Landscape Architects
HARGREAVES ASSOCIATES
118 Magazine Street
Cambridge, Massachusetts 02139
617 661 0070

LANDSCAPE ARCHITECTURE, Inc.
2300 Cottondale Lane, Suite 202
Little Rock, Arkansas 72202
501 374 5610

Structural Engineer
LESLIE E. ROBERTSON ASSOC., LLP
30 Broad Street, 47th Floor
New York, New York 10004
212 750 9000

MEP Engineers
FLACK + KURTZ, Inc.
475 Fifth Avenue
New York, New York 10017
212 532 9600

CROMWELL ARCHITECTS ENGINEERS
101 South Spring Street
Little Rock, Arkansas 72201
501 372-2900


FoodService Consultants

n s d

NEXT STEP DESIGN, INC.
1116 West Street, Suite C
Annapolis, Maryland 21401
410.283.1200

Seal

100% Construction Docs	9/27/02
100% Progress Printing	8/30/02
100% Construction	6/14/02
100% DD	2/28/02
Issue	Date



Job No: 9908

Scale: _____

Date: JUNE 14 2002

Title: **FOOD SERVICE MECHANICAL HOOD PLAN**

Sheet No: **FS-M2**