


Seal

100% Construction Documents 09/27/02
90% Progress Printing 08/30/02
100% Design Development 03/01/02

Issue Date



Job No 9908

Scale NTS

Date September 27, 2002

Title

TELECOM BACKBONE
PATHWAYS
RISER DIAGRAM

Sheet No


T500

GENERAL NOTES

1 REFER TO FLOOR PLANS FOR HORIZONTAL CABLE DISTRIBUTION PATHWAYS

NOTES

- 1 (6) 4" EC RUN TIGHT TO CEILING TO CHOCTAW STATION CONDUITS TO TRANSITION TO SCHEDULE 40 PVC AT BUILDING PENETRATION AND SHALL BE INSTALLED AT A MIN OF 30" BELOW GRADE
- 2 32" WIDE X 60" LONG X 16" DEEP PULLBOX MOUNTED TO CEILING SLAB WITH LOCKABLE HINGED STEEL COVER FACING DOWN
- 3 (8) 4" EC RUN TIGHT TO CEILING TO CARRIER MANHOLE FOR INCOMING SERVICES CONDUITS TO TRANSITION TO SCHEDULE 40 PVC AT BUILDING PENETRATION AND SHALL BE INSTALLED AT A MIN OF 30" BELOW GRADE
- 4 48" WIDE X 60" LONG X 16" DEEP PULLBOX MOUNTED TO CEILING SLAB WITH LOCKABLE HINGED STEEL COVER FACING DOWN
- 5 (6) 4" EC
- 6 (4) 4" EC FROM TSER FOR CARRIER SERVICES
- 7 (3) 4" EC RUN FROM TELECOM SERVICE ENTRANCE ROOM (TSER) TO SECRET SERVICE ROOM ON EXECUTIVE LEVEL
- 8 12" WIDE X 4" DEEP OPEN STEEL MESH FLEXIBLE CABLE TRAY
- 9 (3) 4" EC
- 10 24" WIDE X 60" LONG X 8" DEEP WALL MOUNTED TELECOMMUNICATIONS PULLBOX
- 11 (4) 4" EC TO CONNECT BETWEEN CABLE TRAY SECTIONS AND TELECOM ROOMS
- 12 (2) 4" EC
- 13 (4) 4" EC
- 14 12" WIDE X 2" DEEP FLEXIBLE STEEL MESH CABLE TRAY
- 15 (1) 4" EC
- 16 32" WIDE X 60" LONG X 14" DEEP TELECOMMUNICATION PULLBOX, FLUSH MOUNTED IN FLOOR SLAB, WITH LOCKABLE HINGED STEEL COVER FACING UP
- 17 24" WIDE X 60" LONG X 20" DEEP TELECOMMUNICATION PULLBOX, FLUSH MOUNTED IN FLOOR SLAB, WITH LOCKABLE HINGED STEEL COVER FACING UP
- 18 (4) 4" METALLIC SLEEVES

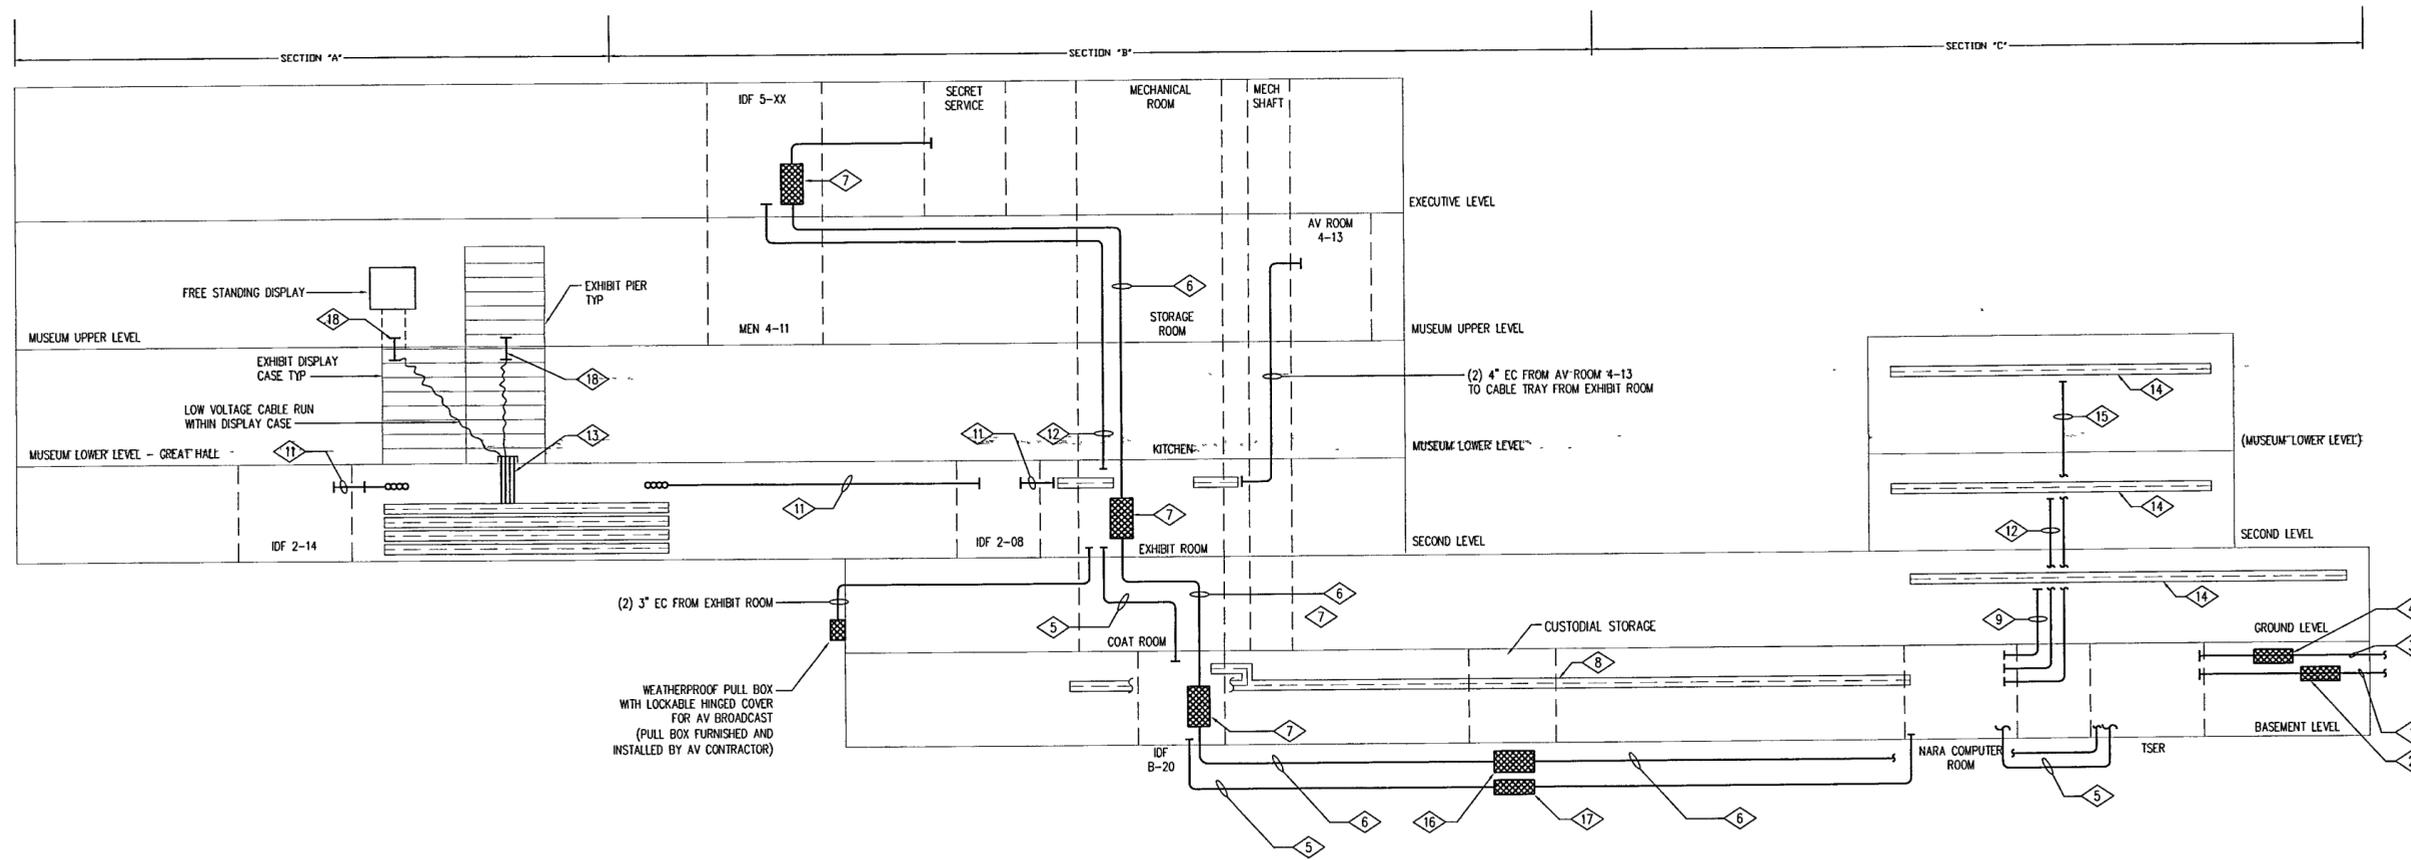

BACKBONE PATHWAY RISER DIAGRAM