




LITTLE ROCK A.F.B.  
ARKANSAS

PROJECT TITLE  
REPAIR MEDICAL CENTER PH 3  
LITTLE ROCK AFB, ARKANSAS

SHEET TITLE  
LIFE SAFETY PLAN

DRAWN BY CP	LEAD DESIGNER AM
TECH REVIEWER AM	PROJECT NUMBER NKAK 06-8001
DESIGNED BY CP	SHEET A0.11
DATE 8-11-06	SCALE 1/16"=1'-0"
	6 of 37

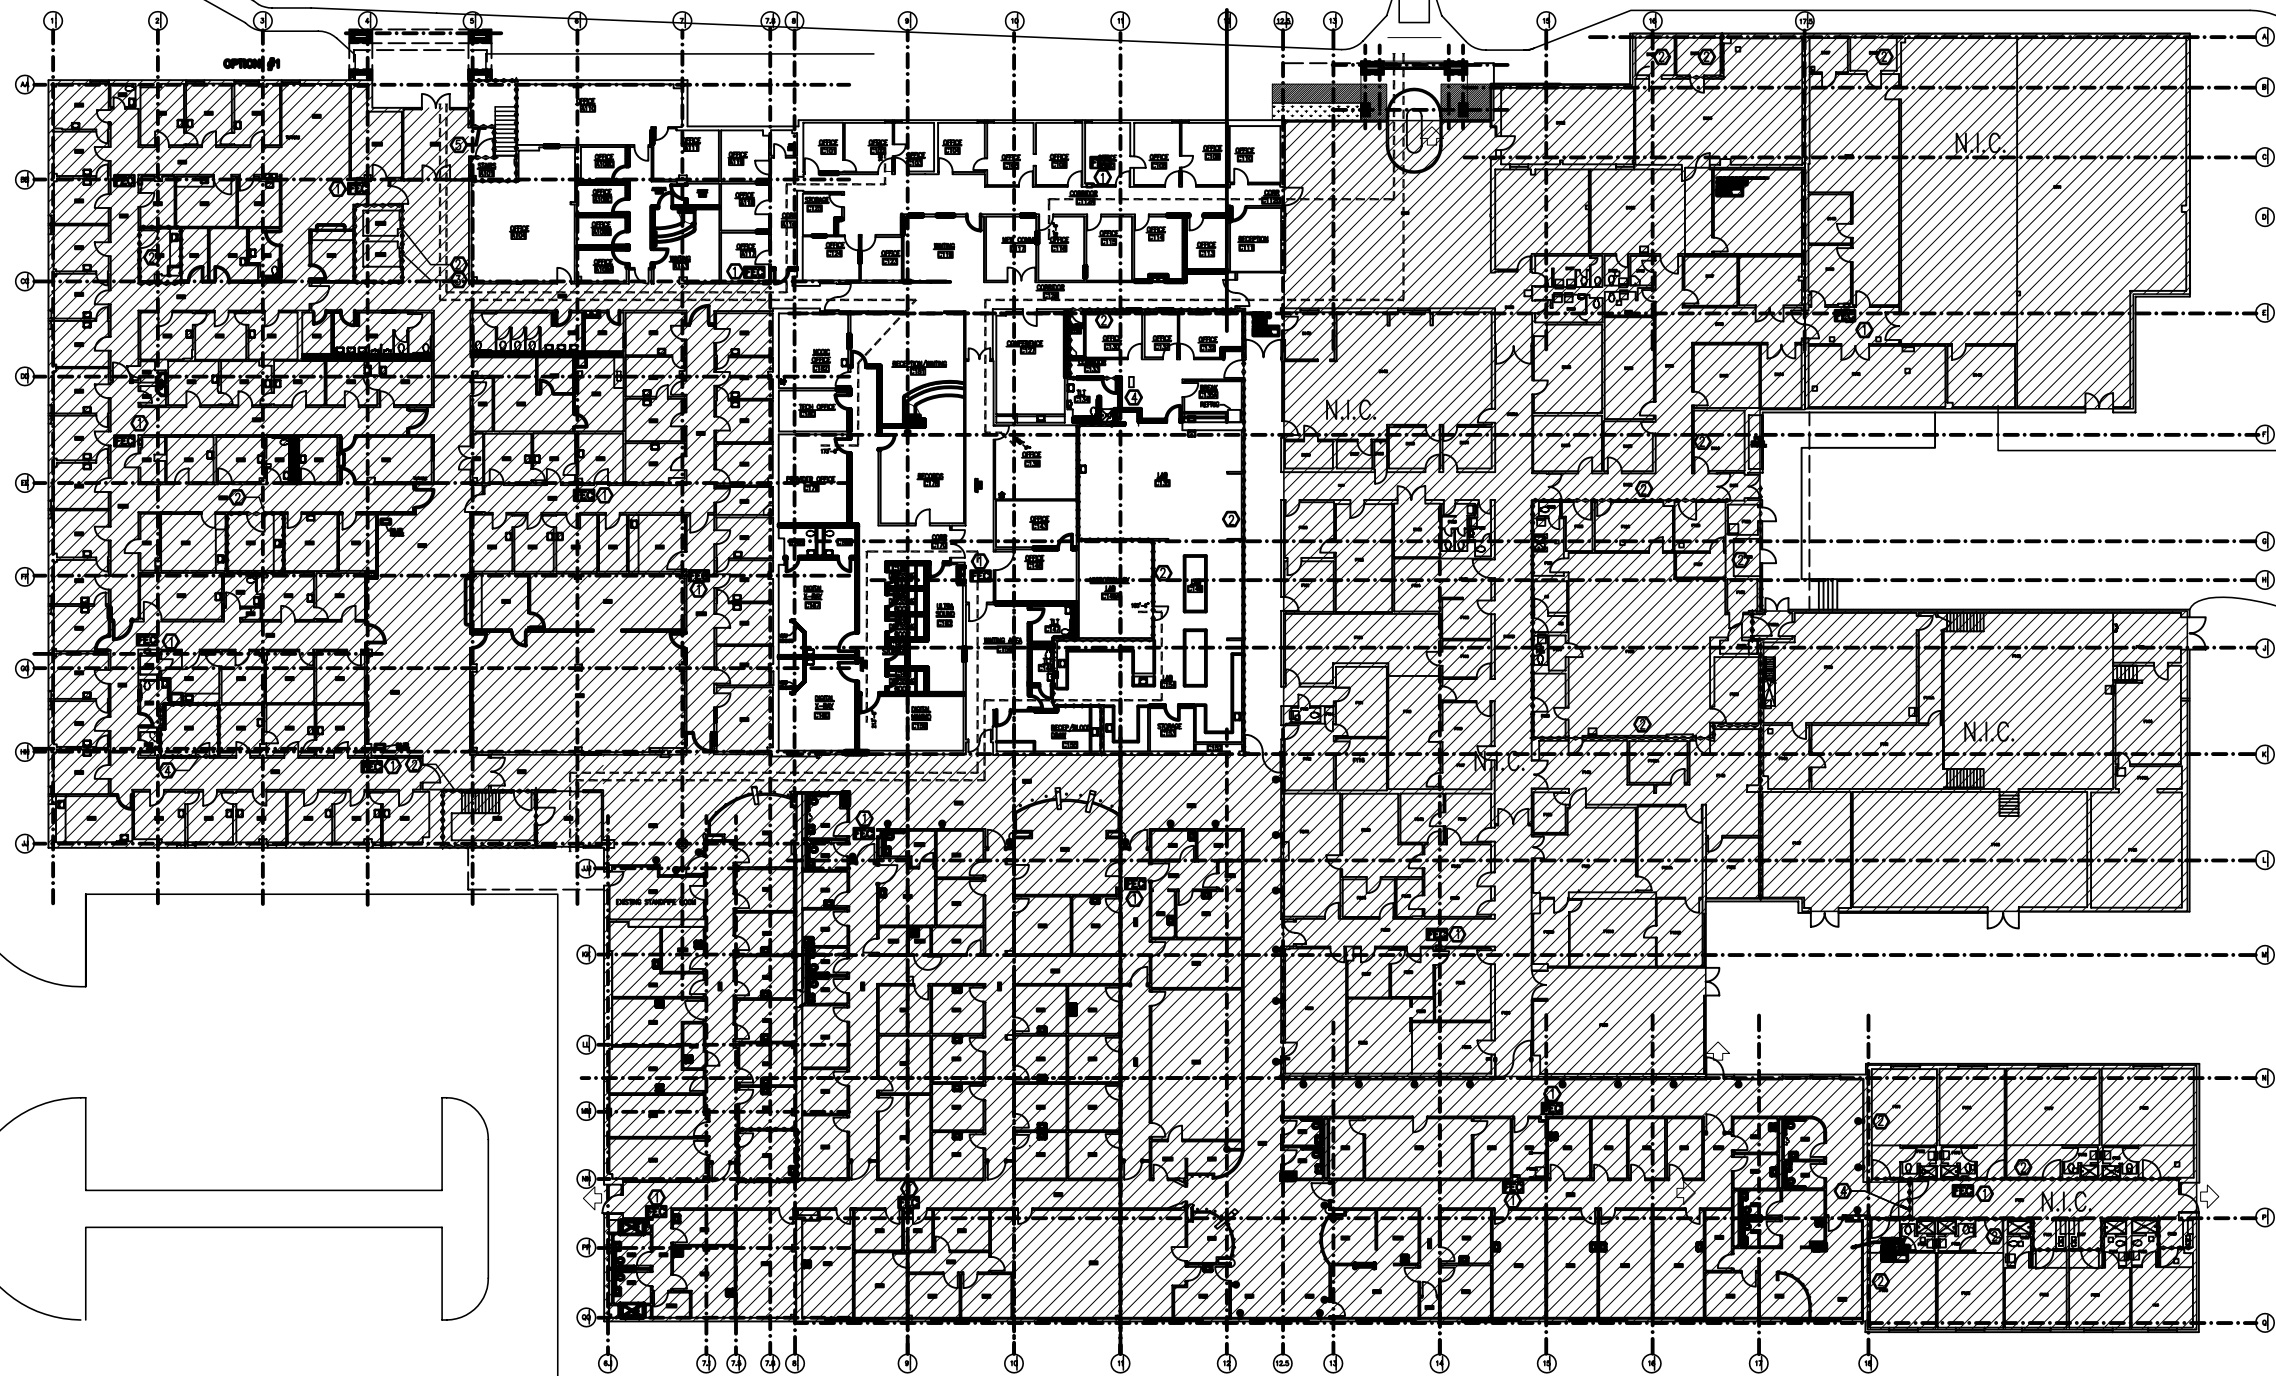


### CODE COMPLIANCE GENERAL NOTES

- A. CODE COMPLIANCE PLANS INDICATE THE CONFORMANCE OF EXISTING REQUIREMENTS FOR EXISTING CONSTRUCTION BASED ON INFORMATION MADE AVAILABLE BY THE GOVERNMENT. THIS DRAWING SHOWS INTEGRATION OF NEW WORK WITH EXISTING CONSTRUCTION AS PART OF A COMPREHENSIVE FIRE / SMOKE BARRIER SYSTEM. CODE COMPLIANCE PLANS SHOULD NOT BE CONSTRUED TO MEAN VERIFICATION OF FIRE / SMOKE RATING OF EXISTING CONSTRUCTION PER APPLICABLE CODE AND / OR GOVERNING CODE AGENCIES' CONSTRUCTION REQUIREMENTS.
- B. CODE COMPLIANCE PLANS INDICATE THE CONFORMANCE OF NEW REMODELED CONSTRUCTION TO APPLICABLE CODE REQUIREMENTS FOR FIRE WALLS AND SMOKE ZONES. WHERE NEW AND REMODELED CONSTRUCTION OCCURS, AS INDICATED IN THE ARCHITECTURAL DRAWINGS, PARTITION FIRE AND SMOKE RATINGS MEET APPLICABLE CODE REQUIREMENTS FOR NEW CONSTRUCTION AS INDICATED IN CODE COMPLIANCE PLANS.
- C. GOVERNING CODES  
2003 INTERNATIONAL BUILDING CODE  
2003 NFPA 101
- D. ALL WOOD BLOCKING SHALL BE FIRE RETARDANT TREATED.
- FLOOR FINISHES : CLASS I OR CLASS II (CORRIDORS AND EXITS ONLY)
- F. ALL WALL AND CEILING FINISHES SHALL BE CLASS 'A' OR 'B' IN ACCORDANCE WITH NFPA 255.
- G. ALL DOORS SHALL BE UNLOCKABLE / KEYLESS IN THE DIRECTION OF EGRESS TRAVEL.
- H. WITHIN PROJECT AREA, SEAL EXISTING OR NEW PENETRATIONS AND CLOSE UP ALL WALL AND SLAB OPENINGS WEATHER EXISTING OR LEFT BY THE REMOVAL OF ITEMS PENETRATING EXISTING OR NEW CONSTRUCTION. FOR FIRE RATED ASSEMBLIES, USE UL TESTED FIRESTOPPING SYSTEMS ASSEMBLIES APPLICABLE TO THE GIVEN FIELD CONDITIONS THAT EQUAL THE FIRE RATING OF EXISTING OR NEW CONSTRUCTION.
- J. ELEVATOR SHAFT WALLS WILL MAINTAIN 1 HOUR FIRE RATING.

### LIFE SAFETY COMPLIANCE PLAN KEYS

- ① EXISTING FIRE EXTINGUISHER / CABINETS TO REMAIN - SHOWN FOR CODE COMPLIANCE ONLY - NOT NEW WORK
- ② EXISTING FIRE RATINGS TO REMAIN - SHOWN FOR CODE COMPLIANCE ONLY
- ③ EXISTING CONSTRUCTION, ELEVATOR ASSEMBLY AND RATING(S) ARE LEFT AS-IS.
- ④ NEW, ONE HOUR FIRE RATED PARTITION - THIS AREA ONLY. ALIGN NEW PARTITION WITH FACE OF CORRIDOR WALL.
- ⑤ FIRE ANNUNCIATOR PANEL

### LIFE SAFETY COMPLIANCE PLAN LEGEND

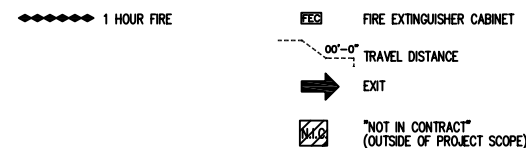

### CODE ANALYSIS/ PROJECT DESCRIPTION

LITTLE ROCK AIR FORCE BASE --- BUILDING 1090 OUTPATIENT CLINIC RENOVATIONS		NEW	YES
NAME OF FACILITY	PROJECT NAME/DESCRIPTION	NEW	REL/ADDITION
TERRY BARBER	SCOTT HANSCHKE	319.364.4700	
FACILITY REP.	PROJECT ARCHITECT	PHONE NUMBER	
2003 INTERNATIONAL BUILDING CODE	LITTLE ROCK AIR FORCE BASE	ASSIST. FIRE CHIEF JIM MILET	404.987.6592
BUILDING CODE USED/IR	MUNICIPALITY	CODE REVIEWER	PHONE NUMBER
<input type="checkbox"/> Narrative Included	<input checked="" type="checkbox"/> Code Compliance Drawings Included	Occupancy Classification/GROUP	B- BUSINESS
LOCAL CODE INFORMATION		N.F.P.A. INFORMATION	
TYPE - IR	SEE BELOW FOR LOCAL INFORMATION	BUSINESS	NFPA 101/2003
Construction Type	Code Name/Year	Construction Type	Code No./Year
Number of Stories/2	Project Area	CSF/Floor	Height in Feet/27
Structural Component	Assembly Rating	U.L. Number	
Roof	NOT REQUIRED	NA	
Floor	NOT REQUIRED	NA	
Beams	NOT REQUIRED	NA	
Columns	NOT REQUIRED	NA	
Girders	NOT REQUIRED	NA	
Interior Walls	NOT REQUIRED	NA	
Exterior Walls	NOT REQUIRED	NA	

ADDITIONAL INFORMATION  
ADDITIONAL LOCAL CODE INFORMATION:  
DoD: UFG GENERAL REQUIREMENTS FOR BUILDINGS  
DoD: UFG MINIMUM ANTI-TERRORISM STANDARDS FOR BUILDINGS  
DoD: UFG ENERGY CONSERVATION

SPRINKLER SYSTEM		<input checked="" type="checkbox"/> Full	<input type="checkbox"/> Partial	<input type="checkbox"/> None
EXITS AND EXIT COMPONENTS				
Travel Distances				
<input type="checkbox"/> Maximum Room/Suite to Corridor NA - NA -		<input checked="" type="checkbox"/> Maximum Room/Suite to Exit 213' - 6"		
Number of Stairs 2		Enclosure Rating NA		
Corridor Width 5' - 0"		<input checked="" type="checkbox"/> Discharge to Outside <input type="checkbox"/> Thru Bldg.		
Door Width VARIES				
FIRE WALLS				
Rating	U.L. Assembly Number			
1 Hour Fire	U465			
1 Hour Fire/Smoke	NOT REQUIRED			
2 Hour Fire	NOT REQUIRED			
3 Hour Fire	NOT REQUIRED			
FIRE ALARM SYSTEM - EXISTING				
<input type="checkbox"/> Direct F.D. Connection		<input checked="" type="checkbox"/> Non-Coded <input checked="" type="checkbox"/> Supervisory <input checked="" type="checkbox"/> Central Remote Station <input checked="" type="checkbox"/> Analog / Addressable		
EMERGENCY POWER				
<input type="checkbox"/> Generating Set		<input type="checkbox"/> UPS <input checked="" type="checkbox"/> Alternative 750KW Diesel generator + Interim battery power		
FINISH MATERIALS				
Classification: CLASS I	Flame Spread: 0-25			

KEYPLAN  
N.T.S.

