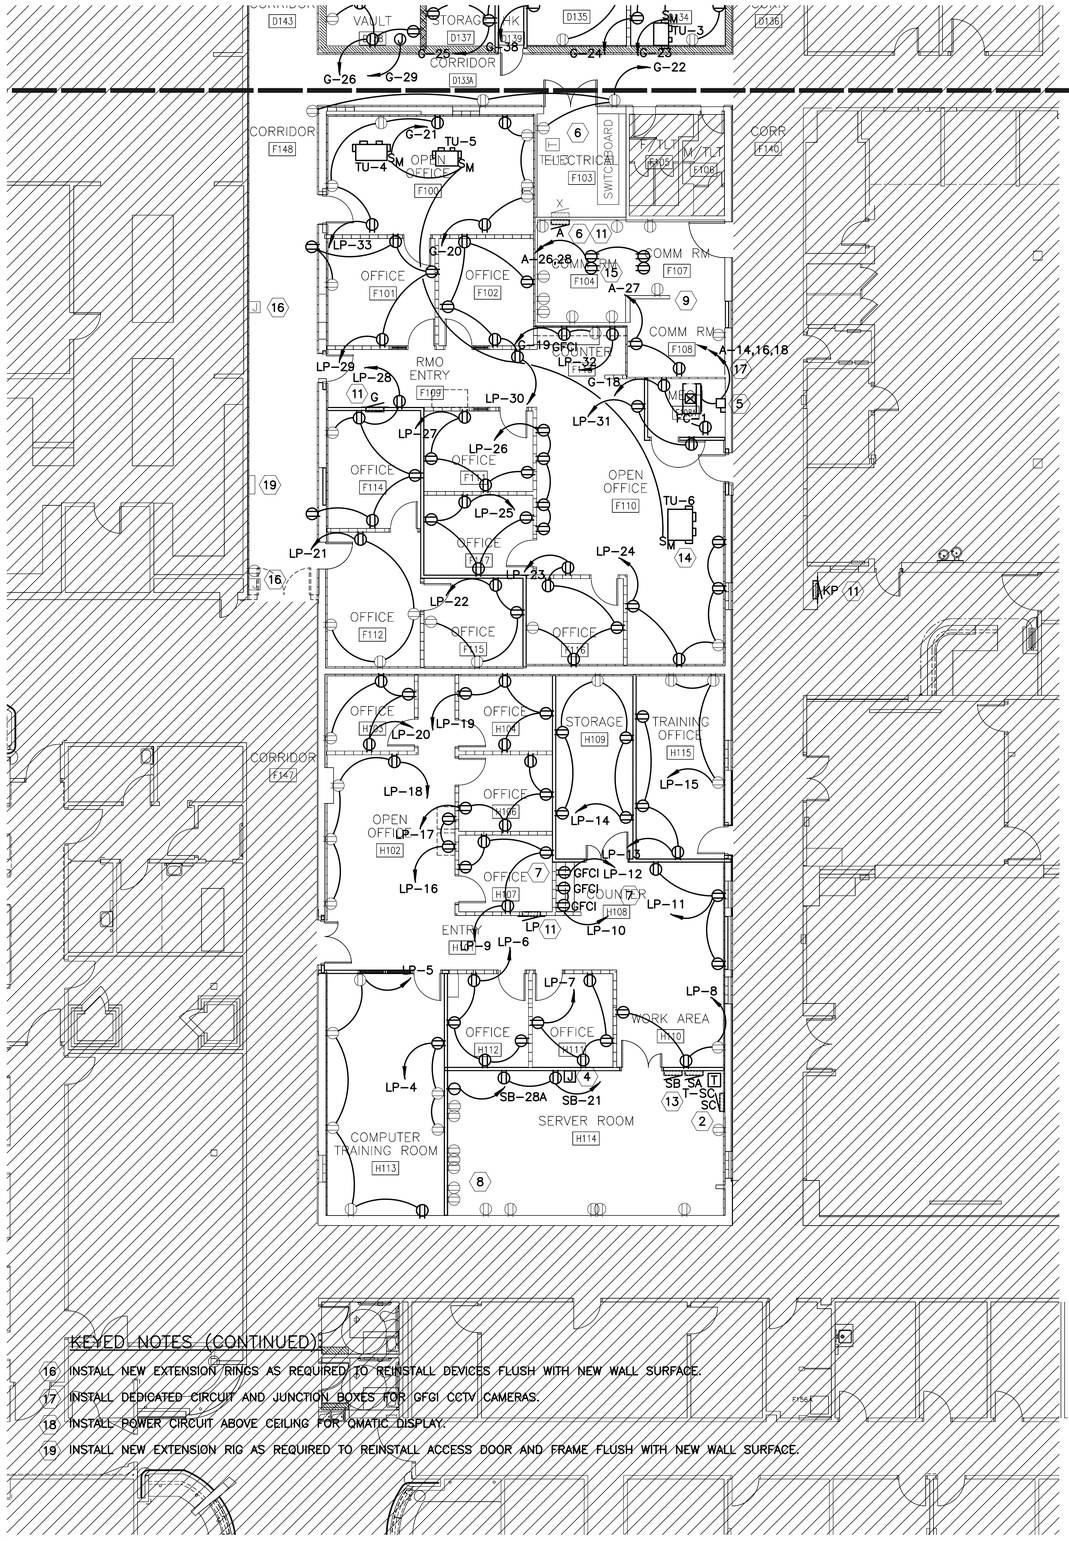

KEYED NOTES (CONTINUED):

16. INSTALL NEW EXTENSION RINGS AS REQUIRED TO REINSTALL DEVICES FLUSH WITH NEW WALL SURFACE.
17. INSTALL DEDICATED CIRCUIT AND JUNCTION BOXES FOR GFCI CCTV CAMERAS.
18. INSTALL POWER CIRCUIT ABOVE CEILING FOR QMATIC DISPLAY.
19. INSTALL NEW EXTENSION RIG AS REQUIRED TO REINSTALL ACCESS DOOR AND FRAME FLUSH WITH NEW WALL SURFACE.

1 E-202 ELECTRICAL POWER INSTALLATION PARTIAL PLAN
SCALE: 1/8" = 1'-0"

KEYED NOTES:

1. INSTALL NEW AUTOMATIC POWERED DOOR AND SENSORS AT NEW ENTRY WAY. INSTALL NEW BRANCH CIRCUIT
2. REINSTALL EMERGENCY STOP PUSH BUTTON. EXTEND AND RECONNECT TO EXISTING CIRCUIT.
3. INSTALL NEW JUNCTION BOX AND POWER CIRCUIT TO SUPPLY POWER TO THE NEW OVERHEAD PHARMACY DOORS. (TYPICAL)
4. INSTALL NEW JUNCTION BOXES FOR EXISTING PANELBOARD FEEDERS. EXTEND AND RECONNECT FEEDERS TO PANELBOARDS IN NEW LOCATION INDICATED.
5. INSTALL NEW 30A/3P/NEMA 1 FUSED DISCONNECT SWITCH FOR MECHANICAL EQUIPMENT.
6. CONNECT NEW HVAC COMM ROOM EQUIPMENT TO PANEL "A". INSTALL NEW PANEL SCHEDULE.
7. INSTALL DEDICATED GFCI RECEPTACLE AND CIRCUIT FOR REFRIGERATOR. INSTALL TWO COUNTER TOP RECEPTACLES INCLUDING OUTLET FOR MICROWAVE.
8. MAINTAIN SERVER ROOM CIRCUITS. INSTALL NEW CIRCUITS AND RECEPTACLES. COORDINATE WORK WITH EXACT EQUIPMENT LOCATIONS AND RELOCATED PANELBOARDS.
9. MAINTAIN COMM. ROOM CIRCUITS. INSTALL NEW CIRCUITS AND RECEPTACLES INCLUDING DEDICATED SET ON ENDS OF EQUIPMENT RACKS TO PANEL "A". COORDINATE WORK WITH EXACT EQUIPMENT LOCATIONS.
10. INSTALL DEDICATED CIRCUIT AND JUNCTION BOXES ABOVE CEILING FOR FUTURE EQUIPMENT,
11. INSTALL NEW PANELBOARD. EXTEND AND RECONNECT FEEDER AND BRANCH CIRCUITS.
12. INSTALL DEDICATED CIRCUIT AND JUNCTION BOXES ABOVE CEILING FOR OVERHEAD TELEVISION.
13. REINSTALL EXISTING ELECTRICAL EQUIPMENT. GROUND TRANSFORMER. RECONNECT EXISTING FEEDERS AND BRANCH CIRCUITS. RELABEL ALL EQUIPMENT AND INSTALL NEW TYPED PANEL SCHEDULES INDICATING EXISTING AND NEW WORK.
14. INSTALL NEW DISCONNECT SWITCH AT EACH TU UNIT. (TYPICAL)
15. INSTALL 4 NEW DUPLEX RECEPTACLES, 2 ON EACH END OF COMM RACK, USING 2 NEW DEDICATED BRACH CIRCUITS.

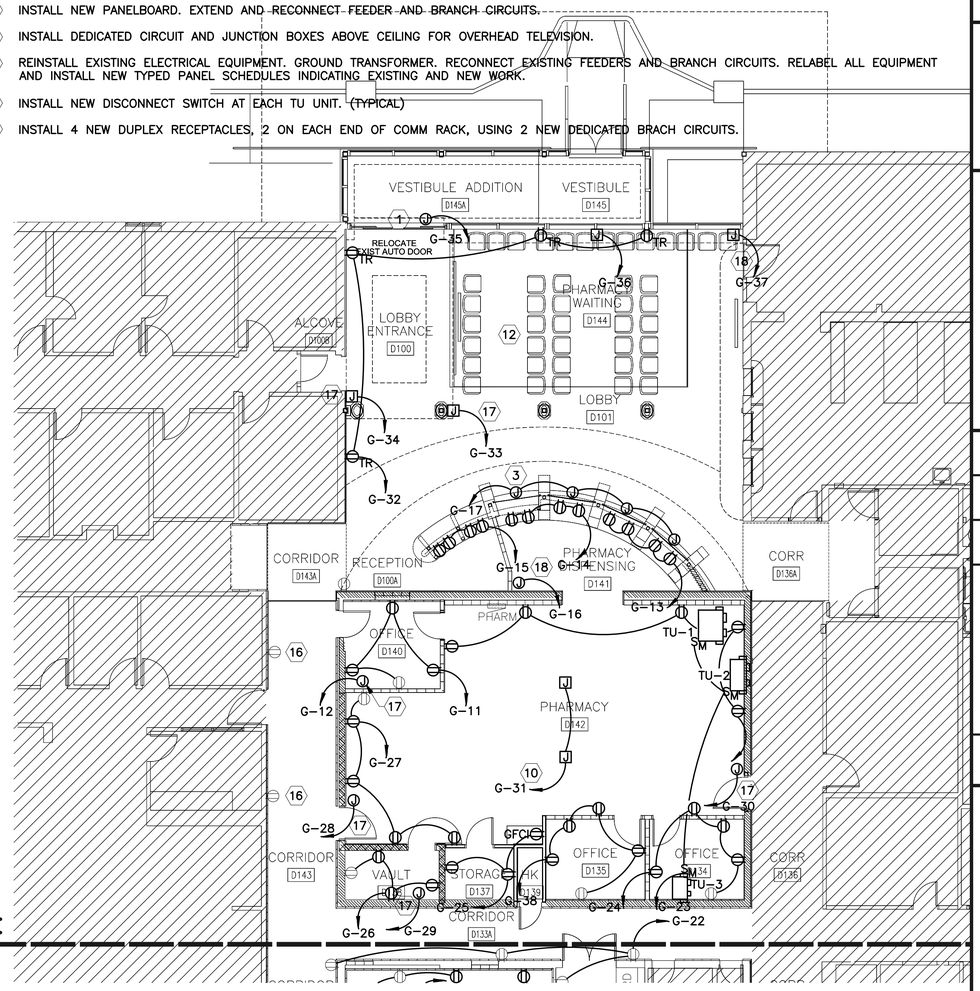

GENERAL NOTES:

1. ELECTRICAL AND COMMUNICATION OUTLETS SHALL BE INSTALLED AT UNIFORM MOUNTING HEIGHT, INCLUDING NEW AND EXISTING DEVICES. ADJUST EXISTING AS REQUIRED TO MATCH NEW ITEMS.

2 E-202 ELECTRICAL POWER INSTALLATION PARTIAL PLAN
SCALE: 1/8" = 1'-0"

LEGEND:

- INSTALL NEW DUPLEX OUTLET
- EXISTING ELECTRICAL OUTLET

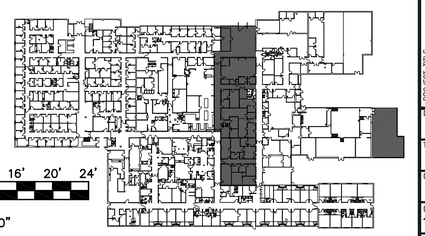

N

96" 48" 0 4' 8' 12' 16' 20' 24'

SCALE: 1/8" = 1'-0"

AIR MOBILITY COMMAND
LITTLE ROCK A.F.B.
ARKANSAS

GARVER
1010 Battery St.
Little Rock, AR
72202
501-376-3633
www.GarverUSA.com

CROMWELL
ARCHITECTS ENGINEERS
101 SOUTH SPRING ST
LITTLE ROCK AR 72201
TELEPHONE 501-372-2900
FACSIMILE 501-372-0482

CERTIFICATE OF AUTHORIZATION
GARVER LLC
No. 766
ARKANSAS ENGINEER

STATE of ARKANSAS
REGISTERED PROFESSIONAL ENGINEER
No.9236
ERIC C. FARMER

No.	Revision/Issue	Date	BY	APP'D

PROJECT TITLE
REPAIR & RENOVATE MED. CLINIC PH IV A
LITTLE ROCK AIR FORCE BASE
JACKSONVILLE, ARKANSAS

SHEET TITLE
ELECTRICAL POWER INSTALLATION PLAN

DRAWN BY: MCL	LEAD DESIGNER: ECF
TECH REVIEWER: ECF	PROJECT NUMBER: NKAK 06-8006 4A
DESIGNED BY: ECF	SHEET: E-201
DATE: 13 MAY 2009	
SCALE: AS SHOWN	44 OF 51

mcl LRAFB_E201_INST.dwg L:\2007\07056004 LRAFB Repair Renovate Medical Clinic Phase 4A\Drawings\CTSMPCS\GARVER LLC AR 766 JCF AR ECF AR ECF_AR_ici.ctb 07056004 24x36 1=1 5/11/09 3:22 pm
Images: [none]
Xrefs: C:\COMPANY WIDE\Cadd Standards\CTSMPCS\GARVER LLC AR 766 JCF AR ECF AR ECF_AR_ici.ctb [L:\2007\07056004 LRAFB Repair Renovate Medical Clinic Phase 4A\Drawings\RFF\ Key Plan e-xrlist e-fe01 e-sh01 P-FP_M-FP_4refp11 [L:\2007\07056004 LRAFB Repair Renovate Medical Clinic Phase 4A\Drawings\RFF\ 02- borderset 1090n601