




LITTLE ROCK A.F.B.
ARKANSAS



NOTE:
1. ALL PIPING AND SPRINKLER
INSTALLATIONS SHALL BE IN ACCORDANCE
WITH NFPA 13, - INSTALLATION OF
SPRINKLER SYSTEMS (LATEST EDITION)

LEGEND:
● EXISTING SPRINKLERS TO REMAIN.
⊗ DEMO - EXISTING SPRINKLERS TO BE REMOVED ALONG WITH PIPING.

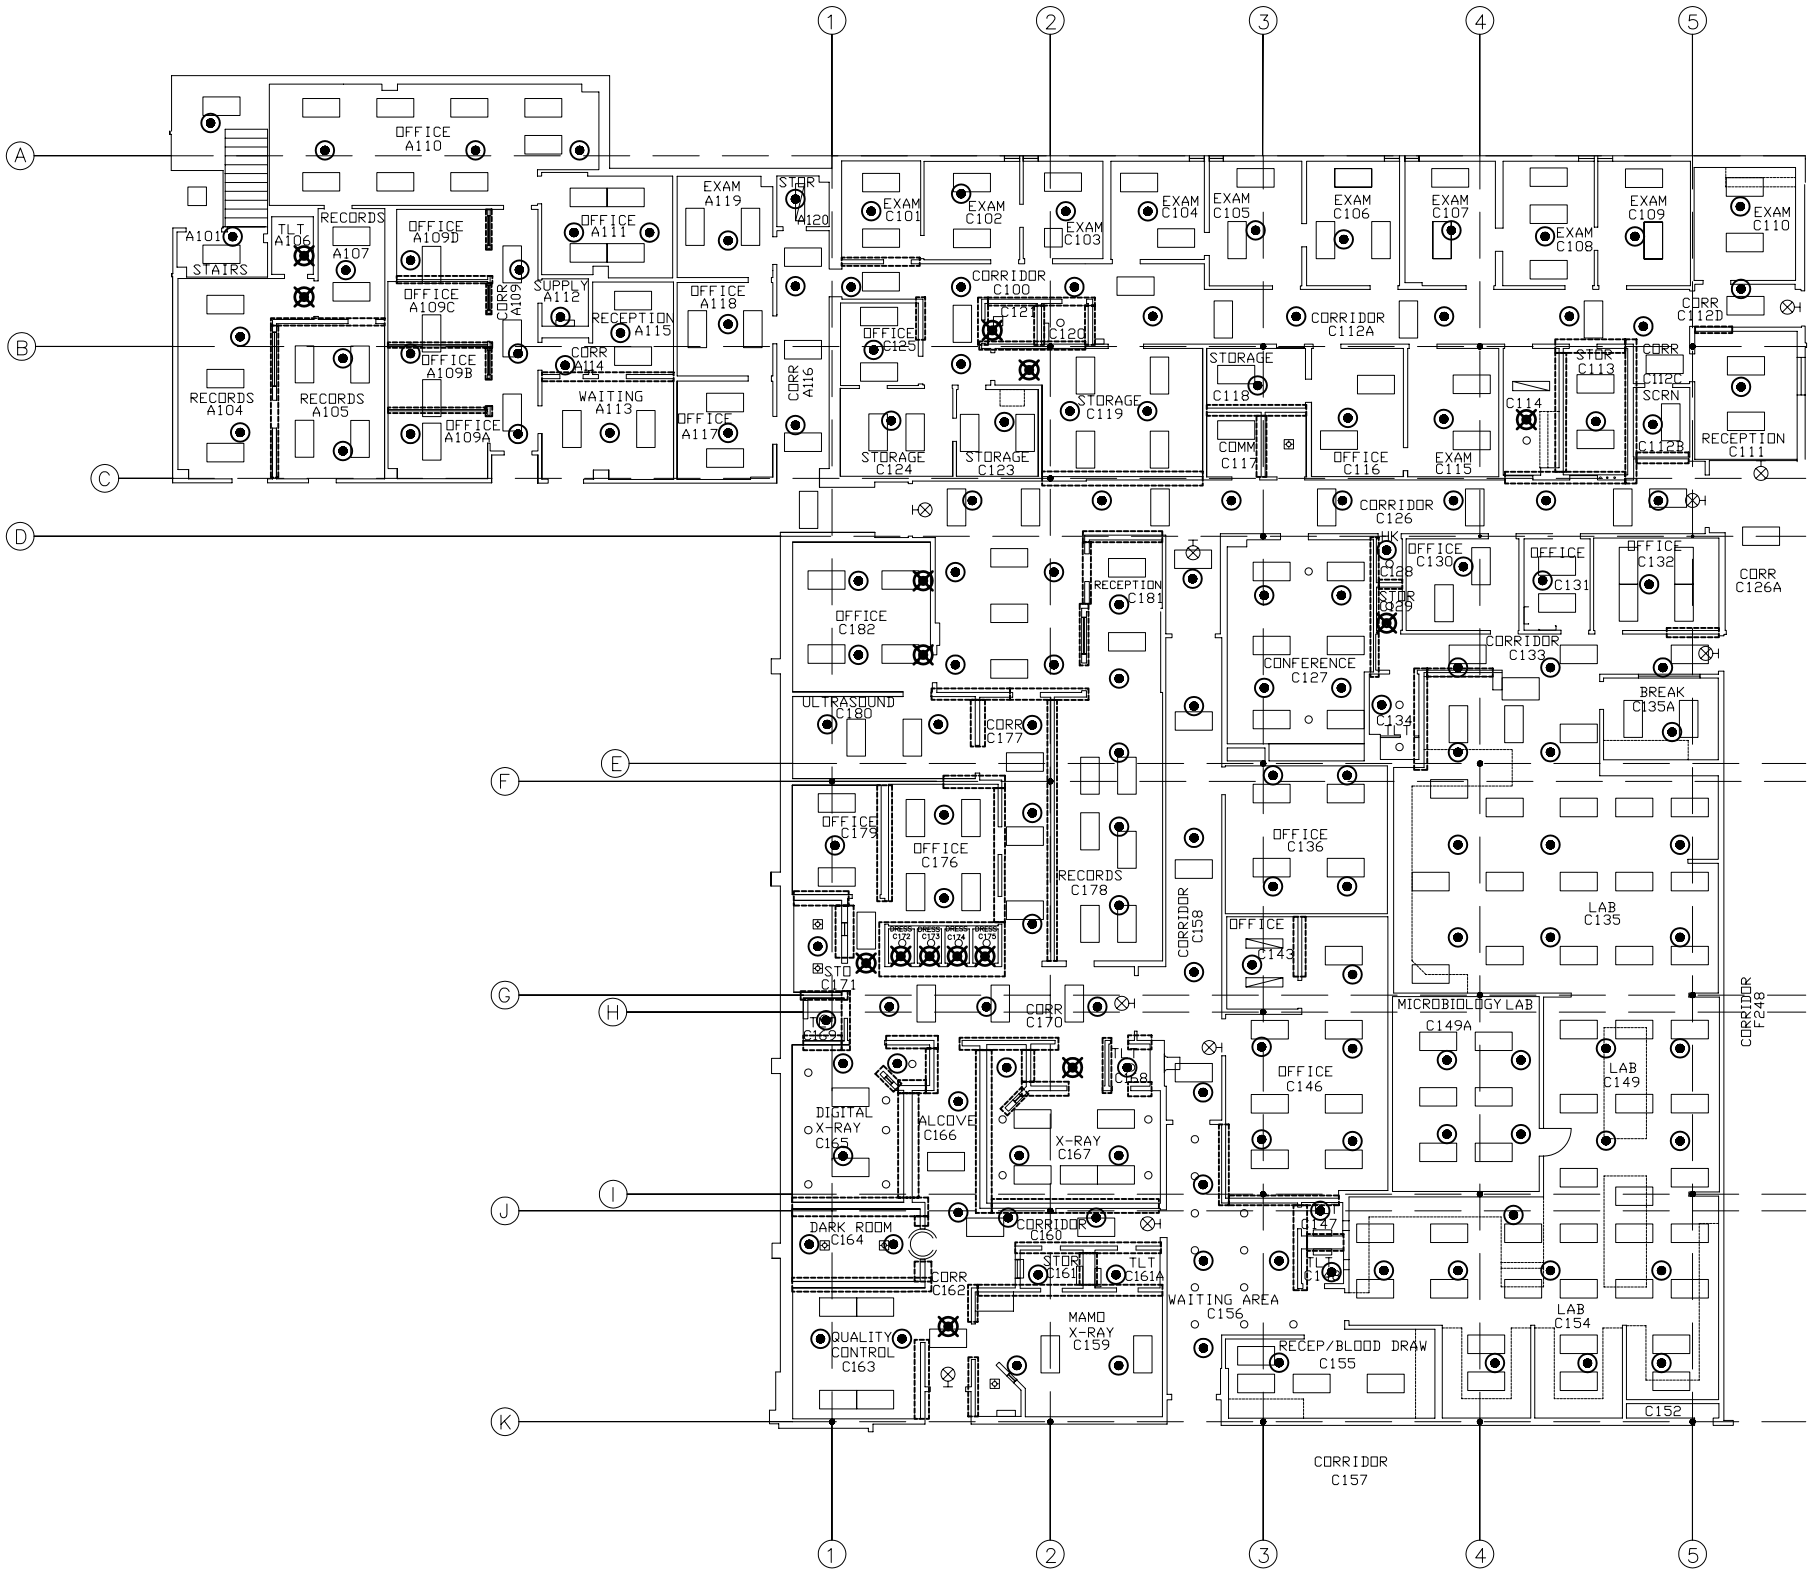

1 AUTOMATIC SPRINKLER SYSTEM DEMOLITION PLAN

SCALE: 1/8" = 1'-0"

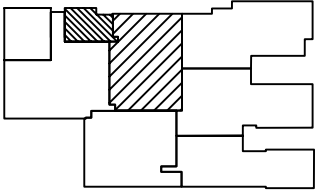

PROJECT TITLE
REPAIR MEDICAL CENTER PH 3
LITTLE ROCK AFB, ARKANSAS

SHEET TITLE
FIRE PROTECTION
AUTOMATIC SPRINKLER
DEMOLITION PLAN

DRAWN BY RJR/MJG	LEAD DESIGNER AM
TECH REVIEWER AM	PROJECT NUMBER NKAK 06-8001
DESIGNED BY AO	SHEET FP0.11
DATE 8-11-06	SCALE 1/8"=1'
	23 of 37