




LITTLE ROCK A.F.B.
ARKANSAS

NOTE:

1. ALL PIPING AND SPRINKLER
INSTALLATIONS SHALL BE IN ACCORDANCE
WITH NFPA 13, - INSTALLATION OF
SPRINKLER SYSTEMS (LATEST EDITION)
2. CONTRACTOR TO FIELD CHECK LOW POINT
DRAIN IN C-128.

LEGEND:

- NEW SPRINKLERS TO BE INSTALLED.
- EXISTING SPRINKLERS TO REMAIN.
- _R EXISTING SPRINKLERS TO BE RELOCATED AS SHOWN.

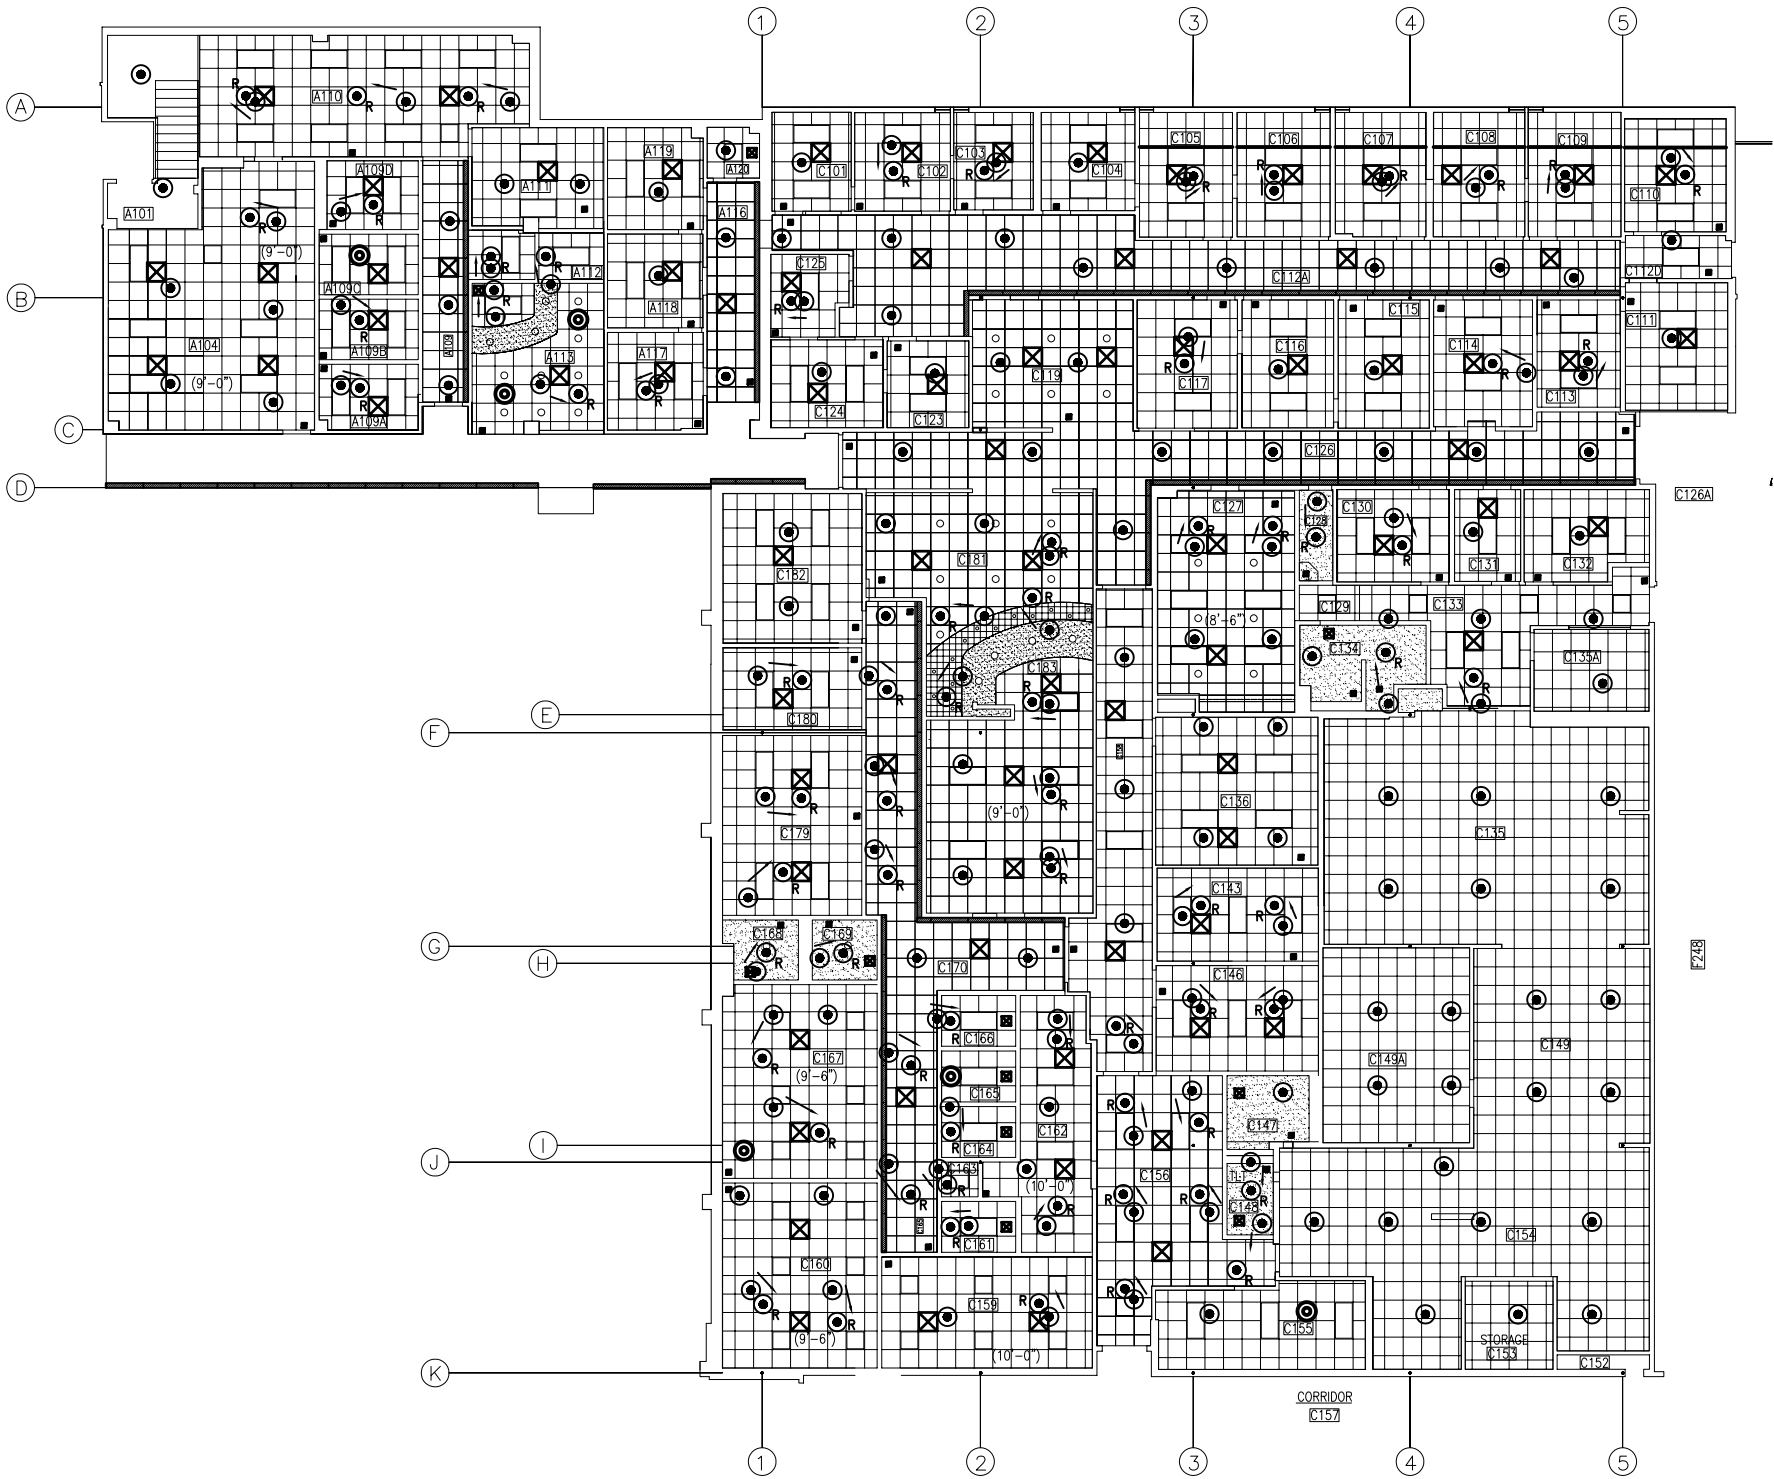


1 AUTOMATIC SPRINKLER SYSTEM INSTALLATION PLAN

SCALE: 1/8" = 1'-0"

KEYPLAN

N.T.S.



SCALE



PROJECT TITLE
REPAIR MEDICAL CENTER PH 3
LITTLE ROCK AFB, ARKANSAS

SHEET TITLE
FIRE PROTECTION
AUTOMATIC SPRINKLER
INSTALLATION PLAN

DRAWN BY RJR/MJG	LEAD DESIGNER AM
TECH REVIEWER AM	PROJECT NUMBER NKAK 06-8001
DESIGNED BY AO	SHEET FP1.11
DATE 8-11-06	
SCALE 1/8"=1'-0"	24 of 37