

**DOOR SCHEDULE**

**WINDOW SCHEDULE**

**DRAWING TITLE SYMBOL**

**BUILDING/ INTERIOR ELEVATION SYMBOL**


**BUILDING / WALL SECTION SYMBOL**

**DETAIL SYMBOL**

**MATCH LINE**

**ROOM NUMBER SYMBOL**

**REVISION INDICATION**

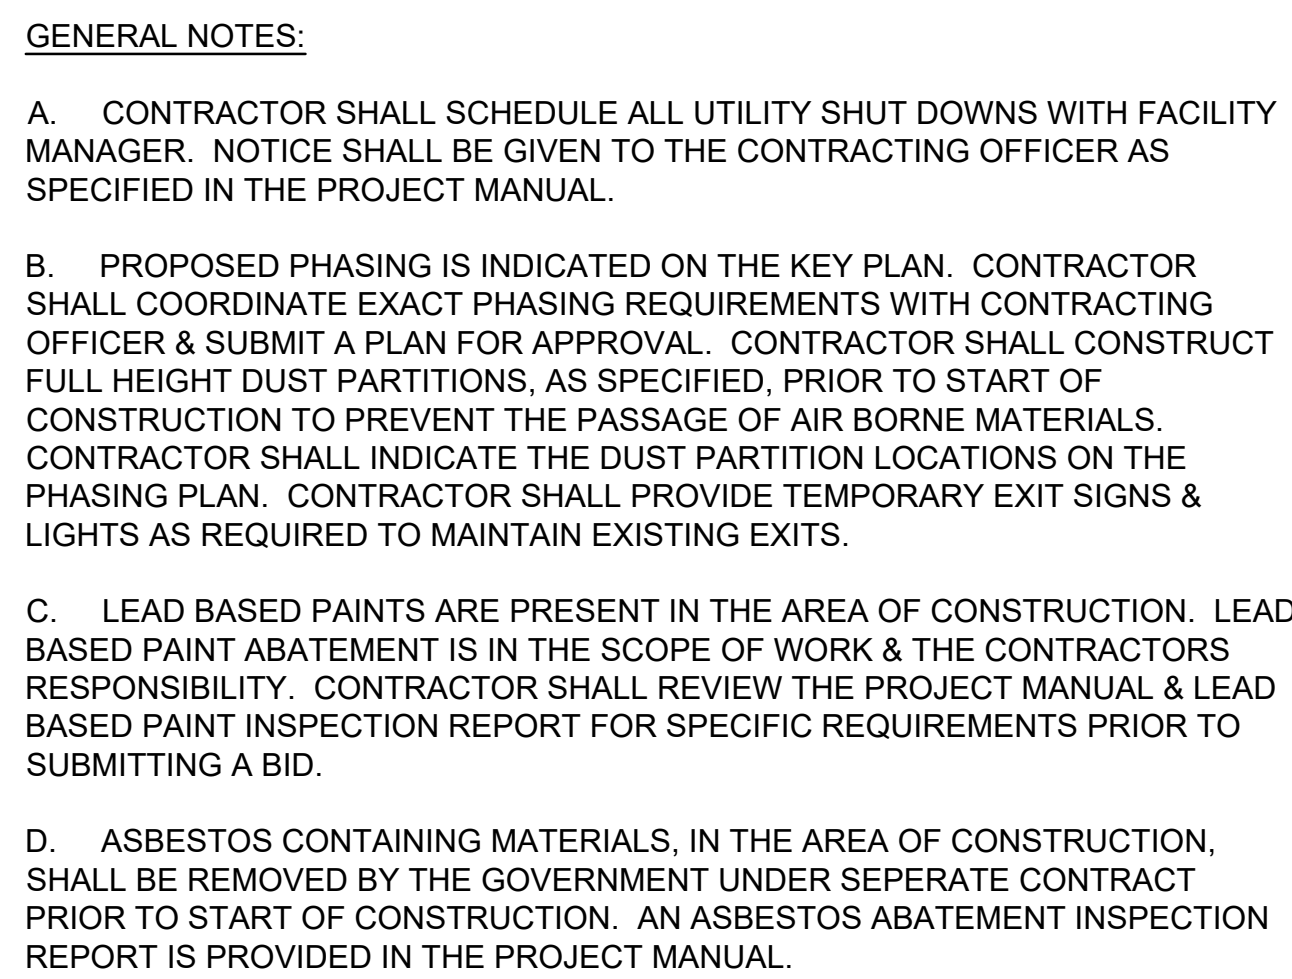

## AREA OF WORK

NOTE: EXISTING ROOM NUMBERS ARE INDICATED ON THE DEMOLITION PLANS



## CODE STUDY

A				F		I		N		RCP	REFLECTED CEILING PLAN	T	
A.C.	AIR CONDITIONED	C.M.U.	CONCRETE MASONRY UNIT	F.A.	FIRE ALARM	I.E.	INSIDE DIAMETER	N.A.	NOT APPLICABLE	RD	ROUND	T.	TOILET
A.D.	AREA DRAIN	C.O.	CLEAN OUT	F.C.	FLEXIBLE CONNECTION	I.E.	INVERT	N.I.C.	NOT IN CONTRACT	REC'D	RECESSED	TEL.	TELEPHONE
A.H.U.	AIR HANDLING UNIT	COL.	COLUMN	F.D.	FLOOR DRAIN	IN.	INCHES	NO.	NUMBER	RECIRC.	RECIRCULATING	TEMP.	TEMPERATURE
ALT.	ALTERNATE	CONC.	CONCRETE	F.E.C.	FIRE EXTINGUISHER CABINET	INCAND.	INCANDESCENT			RECP.	RECEPTACLE	THK.	THICKNESS
ALUM.	ALUMINUM	COND.	CONDENSATE	FIN.	FINISH	INSUL.	INSULATION	0		REG.	REGISTER	THD.	THRESHOLD
AMP., A.	AMPERES	CONN.	CONNECTION	FL.	FLOOR	INT.	INTERIOR	O.A.	OUTDOOR AIR	REINF.	REINFORCING	TOL.	TOILET
A.O.	ACCESS OPENING	CONST.	CONSTRUCTION	FT.	FOOT/FEET			O.C.	ON CENTER	REQ.	REQUIRED	TYP.	TYPICAL
APPROX.	APPROXIMATELY	CONT.	CONTINUOUS	FTG.	FOOTING	J		O.D.	OUTSIDE DIAMETER	RET.	RETURN	V	
ARCH.	ARCHITECTURAL	CONTR. JT.	CONTRACTION JOINT			J.B.	JUNCTION BOX	O.H.	OVERHEAD	R.G.	RETURN GRILLE		
A.T.C.	ASPHALT TILE	C.T.	CERAMIC TILE	G		JCT.	JUNCTION	OL.	OVERLOAD	RM.	ROOM	V.	VOLT
A.T.C.	ACOUSTIC TILE CEILING	C.T.B.	CERAMIC TILE BASE	GAL.	GAGE	JT.	JOINT	OPNG.	OPENING	R.P.M.	REVOLUTION/MINUTE	VCT	VINYL COMPOSITION TILE
B		C. TO C.	CENTER TO CENTER	GALV.	GALLON	K		OPP.	OPPOSITE	S		VENT.	VENTILATION
BAL.	BALANCE	D		G.F.E.	GOVERNMENT FURNISHED	KVA	KILOVOLT AMPERE	O.S.	OVERFLOW SCUPPER	S.D.		VERT.	VERTICAL
BD.	BOARD	DET.	DETAIL		EQUIPMENT	KW	KILOWATT	P	OPEN SIGHT DRAIN	S.	SUPPLY	VTR	VENT THRU ROOF
BLDG.	BUILDING	DIA.	DIAMETER	G.L.	GLASS	L		P.	PAPER	S.A.	SUPPLY AIR	SCH.	SCHEDULE
BLK.	BLANK	DIFF.	DIFFUSER	GND.	GROUND			PART.	PARTITION	SECT.	SECTION	W	
BM.	BEAM	DIM.	DIMENSION	GOV'T	GOVERNMENT	LB. #	POUND	PER.	PERIMETER	SERV.	SERVICE	W.	WATT
BOT.	BOTTOM	DISC.	DISCONNECT	G.P.H.	GALLONS/HR.	LG.	LONG	R_PL	PLATE	SHT.	SHEET	W/	WITH
BRG.	BEARING	D.J.	DUMMY JOINT	G.P.M.	GALLONS/MIN.	L.P.	LIGHTING PANEL	PLBG.	PLUMBING	S.J.	SLIP JOINT	WD.	WOOD
B.T.U.H.	BRITISH THERMAL UNIT/HR.	DN.	DOWN	GR.	GRILLES/MIN.	LTG.	LIGHTING	PLYWD	PLYWOOD	SPEC.	SPECIFICATIONS	W.D.	WINDOW DIMENSION
C		DR.	DRAIN	G.W.B.	GYPSUM WALL BOARD			PNL.	PANEL	SQ. FT.	SQUARE FEET	WF	WIDE FLANGE
CAB.	CABINET	D.S.	DOWNSPOUT	GYP.	GYPSUM	M		PRESS.	PRESSURE	ST.	STEEL	W.G.	WATER GAGE
CAP.	CAPACITY	DWG.(S)	DRAWING(S)					PSF.	POUNDS/SQUARE FOOT	STOR.	STORAGE	WP.	WEATHERPROOF
C/B	CIRCUIT BREAKER	E		H		M.	MOTOR	PSI	POUNDS/SQUARE INCH	STRUC.	STRUCTURAL	WTR	WATER
C.D.	CEILING DIFFUSER	EA.	EACH	H.	HIGH	MAINT.	MAINTENANCE	PSIG	POUNDS/SQUARE INCH GAGE	SUSP.	SUSPENDED	W.W.F.	WELDED WIRE FABRIC
CEM.	CEMENT	E.C.	EMPTY CONDUIT	H.B.	HOSE BIBB	MAX.	MAXIMUM	PT.	POINT	SW.	SWITCH		
CER.	CERAMIC	E.F.	EXHAUST FAN	H.C.	HOLLOW CORE	M.D.P.	MAIN DISTRIBUTION PANEL	MECH.	MECHANICAL				
C.F.M.	CUBIC FEET/MINUTE	HT.	HEIGHT	H.T.	HOLLOW METAL	M.T.L.	METAL THRESHOLD	MTL.	METAL				
CIRC.	CIRCULATING	H.M.	HOLLOW METAL	H.P.	HORSE POWER	MIN.	MINIMUM	Q					
C.J.	CONTROL JOINT	H.R.	HOUR	H.E.C.	ELECTRIC WATER COOLER	MISC.	MISCELLANEOUS	QTR.	QUARTER				
CK'D	CHECKERED	HR.	HOUR	M.O.	MASONRY OPENING	MTG.	MOUNTING	QUAN.	QUANTITY				
CKT.	CIRCUIT	HTG.	HEATING	M.T.	METAL THRESHOLD	MTD.	MOUNTED	R					
CL	CENTER LINE	HTR.	HEATER	MTG.	MOUNTING	R.	RISER						
CEIL.	CEILING	H. & V.	HEATING & VENTILATING	M.V.	MECHANICAL VENTILATION	R.A.	RETURN AIR						
CL.	CLOSET	HW.	HARDWARE	M.G.T.	MATT GLAZE TILE	RAD.	RADIUS						
		EXIST.	EXISTING	HYD.	HYDRANT								

GOVERNING CODE: 2003 IBC, 2002 AFPC, NFPA 101,  
UFC GUIDELINES 4-510-01, MIL HNDBK 1191, 1013, 1008.  
SIESMIC CATAGORY: D

OCCUPANCY TYPE: "B" BUSINESS

CONSTRUCTION TYPE: II-B FULLY SPRINKLED

AREA OF EXISTING FIRST FLOOR: 104,040 GSF


AREA OF RENOVATION FIRST FLOOR: 35,587 GSF TOTAL  
(MECH/ELECT 5,946 SF WAREHOUSE 4,450 SF OF TOTAL)

OCCUPANT LOAD RENOVATION AREA A & B: 252  
(NOT INCLUDING MECH RM & WAREHOUSE OCCUPANTS)

MAX EXIT TRAVEL DISTANCE: 300' COMMON PATH: 100'

FIRE RESISTIVE RATING FOR BLDG ELEMENTS: 0 HR  
STORAGE/JANITOR < 100 SF: 0 HR / > 100 SF: 1 HR

FIRE EXTINGUISHERS MAX TRAVEL DISTANCE: 75' APART



LITTLE ROCK A.F.B.  
ARKANSAS

**GARVER|ENGINEERS**

1010 BATTERY STREET  
LITTLE ROCK, ARKANSAS 72202  
www.garverengineers.com  
(501) 376-3633

**CROMWELL**  
ARCHITECTS ENGINEERS

101 SOUTH SPRING ST  
LITTLE ROCK AR 72201  
TELEPHONE 501-372-2900  
FACSIMILE 501-372-0482

[illegible]

PROJECT TITLE  
REPAIR & RENOVATE MEDICAL CLINIC PH IV  
LITTLE ROCK AIR FORCE BASE  
JACKSONVILLE, ARKANSAS  
100% SUBMITTAL

KEY PLAN, CODE STUDY &  
SYMBOLS & ABBREVIATIONS

DRAWN BY P.JL	LEAD DESIGNER K. TAYLOR
TECH REVIEWER P.JL	PROJECT NUMBER NKAK#06-8006-4
DESIGNED BY P. LEDFORD	SHEET G-002
DATE JULY 1, 2008	
SCALE AS NOTED	2 of 50