PLUMBING FIXTURE SCHEDULE

MARK	DESCRIPTION	MFGR. & MODEL	ACCESSORIES, FAUCETS & FITTINGS	TRAP	WASTE	COLD	HOT	REMARKS
P-1	SINGLE COMPARTMENT SINK (STAINLESS STEEL)	JUST US-1620-A	18"x14" ID 7-1/2" DEPTH UNDER MOUNT STAINLESS STEEL SINK. PROVIDE WITH CHICAGO 201-AGN8E3-317XK SINK FAUCET, 8" CENTERS, WITH 8" SWING GOOSENECK SPOUT, AERATOR, WRIST BLADE HANDLES, ELKAY LK35 DRAIN WITH STAINLESS STEEL STRAINER BASKET, McGUIRE 8912 P-TRAP, McGUIRE 2166 WHEEL HANDLE ANGLE SUPPLY STOPS	1 1/2"	2"	1/2"	1/2"	SINGLE COMPARTMENT SINK. PROVIDE GUARDIAN G1806 DECK MOUNTED, SWIVEL EYE WASH STATION MOUNTED TO COUNTER TOP. FURNISH AND INSTALL McGUIRE 2166 HOT AND COLD WATER WHEEL HANDLE STOPS ADJACENT TO SINK STOPS. CONNECT TO EYE WASH STATION THRU SYMMONS 5-120 THERMOSTATIC MIXING VALVE. ADJUST THERMOSTATIC MIXING VALVE AND SET PER ANSI STANDARDS. MAKE ALL FINAL CONNECTIONS. INSTALL ALL SIGNAGE PROVIDED WITH EYE WASH STATION.
P-2	SERVICE SINK (FLOOR MOUNTED)	FIAT MSB-2424	24"X24" MOLDED STONE MOP SERVICE BASIN. PROVIDE WITH 830-AA WALL MOUNTED FAUCET WITH VACUUM BREAKER, INTEGRAL STOPS, ADJUSTABLE WALL BRACE, PAIL HOOK, AND ¾" HOSE THREADS ON SPOUT.	3"	3"	3/4"	3/4"	NEATLY CAULK PERIMETER WITH WHITE SILICONE

SUMP PUMP SCHEDULE

MARK	SP-1
MANUFACTURER	MEYERS
MODEL	S33
SWITCH	VERTICAL PROXIMITY
VOLTAGE	120
PUMP HP	1/3
GPM	20
HEAD (FT)	17
REMARKS	WITH PLUG AND CORD SET

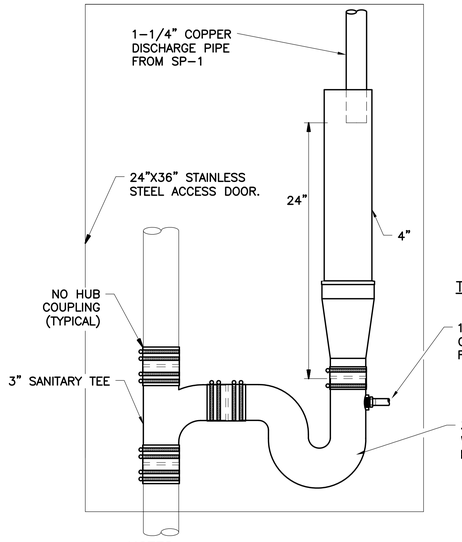



NOTE:

INSTALL ½" COPPER NIPPLE ON TOP OF DOMESTIC COLD WATER PIPE.

TRAP PRIMER DOMESTIC WATER CONNECTION

NOTES:

1. INSTALL ZURN Z1022 SANI-GUARD AUTOMATIC TRAP PRIMER ON EXISTING DOMESTIC COLD WATER SUPPLY ABOVE CEILING (FIELD VERIFY LOCATION). INSTALL 1/2" COPPER NIPPLE, SHUT-OFF VALVE, AND TRAP PRIMER. ROUTE TYPE "L" COPPER TUBING ON SLOPE FROM TRAP PRIMER OUTLET ABOVE CEILING TO SANITARY P-TRAP IN CHASE.
2. CONNECT TO EXISTING TOILET DRAIN LINE AND VENT SYSTEM (FIELD VERIFY EXACT LOCATIONS).
3. COORDINATE INSTALLATION WITH WALL CONSTRUCTION.
4. FINISH FLOOR SLAB SMOOTH AND PREPARE FOR NEW FLOORING.

3 / P-301 EXISTING SANITARY SEWER CONNECTION
SCALE: NONE

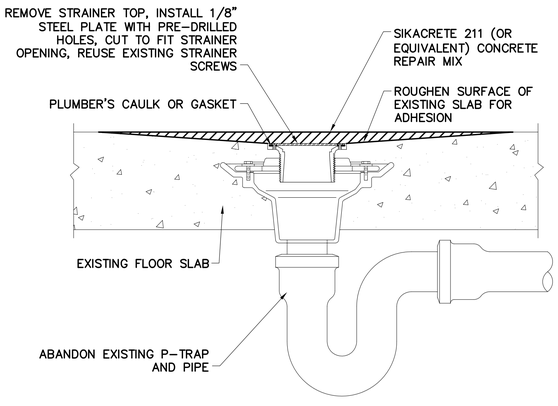

2 / P-301 FLOOR PENETRATION FLOOR PATCH
SCALE: NONE

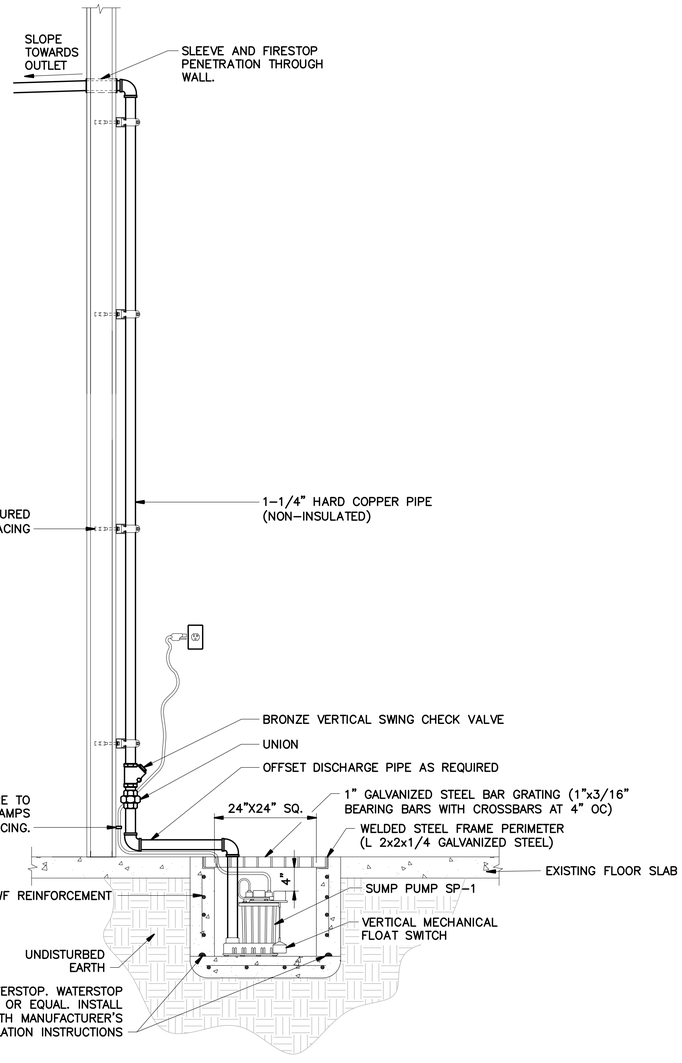

1 / P-301 SUMP PUMP DETAIL
SCALE: 1" = 1'-0"

LITTLE ROCK A.F.B.
ARKANSAS

GARVER
1010 Battery St.
Little Rock, AR
72202
501-376-3633
www.GarverUSA.com

CROMWELL
ARCHITECTS ENGINEERS
101 SOUTH SPRING ST
LITTLE ROCK AR 72201
TELEPHONE 501-372-2900
FACSIMILE 501-372-0482

CERTIFICATE OF AUTHORIZATION
GARVER LLC
No. 766
ARKANSAS ENGINEER

STATE OF ARKANSAS
REGISTERED PROFESSIONAL ENGINEER
No. 11828
JOEL PUNKHOUSER

No.	Revision/Issue	Date	BY	APP'D

PROJECT TITLE
REPAIR & RENOVATE MED. CLINIC PH IV A
LITTLE ROCK AIR FORCE BASE
JACKSONVILLE, ARKANSAS

SHEET TITLE
PLUMBING SCHEDULES AND DETAILS

DRAWN BY: BMS	LEAD DESIGNER: JCF
TECH REVIEWER: JCF	PROJECT NUMBER: NKAK 06-8006 4A
DESIGNED BY: JCF	SHEET: P-301
DATE: 13 MAY 2009	
SCALE: AS SHOWN	36 OF 51

bmspahn LRAFB_P301_DET I.dwg L:\2007\07056004 LRAFB Repair Renovate Medical Clinic Phase 4A\Drawings\ 07056004 24X36 1=1
Images: [none]
Xrefs: C:\COMPANY WIDE\Cadd Standards\STAMPS\ JCF AR FOF AR ici ar GARVER LLC AR 7661 [\REF\ 02- borderms1]