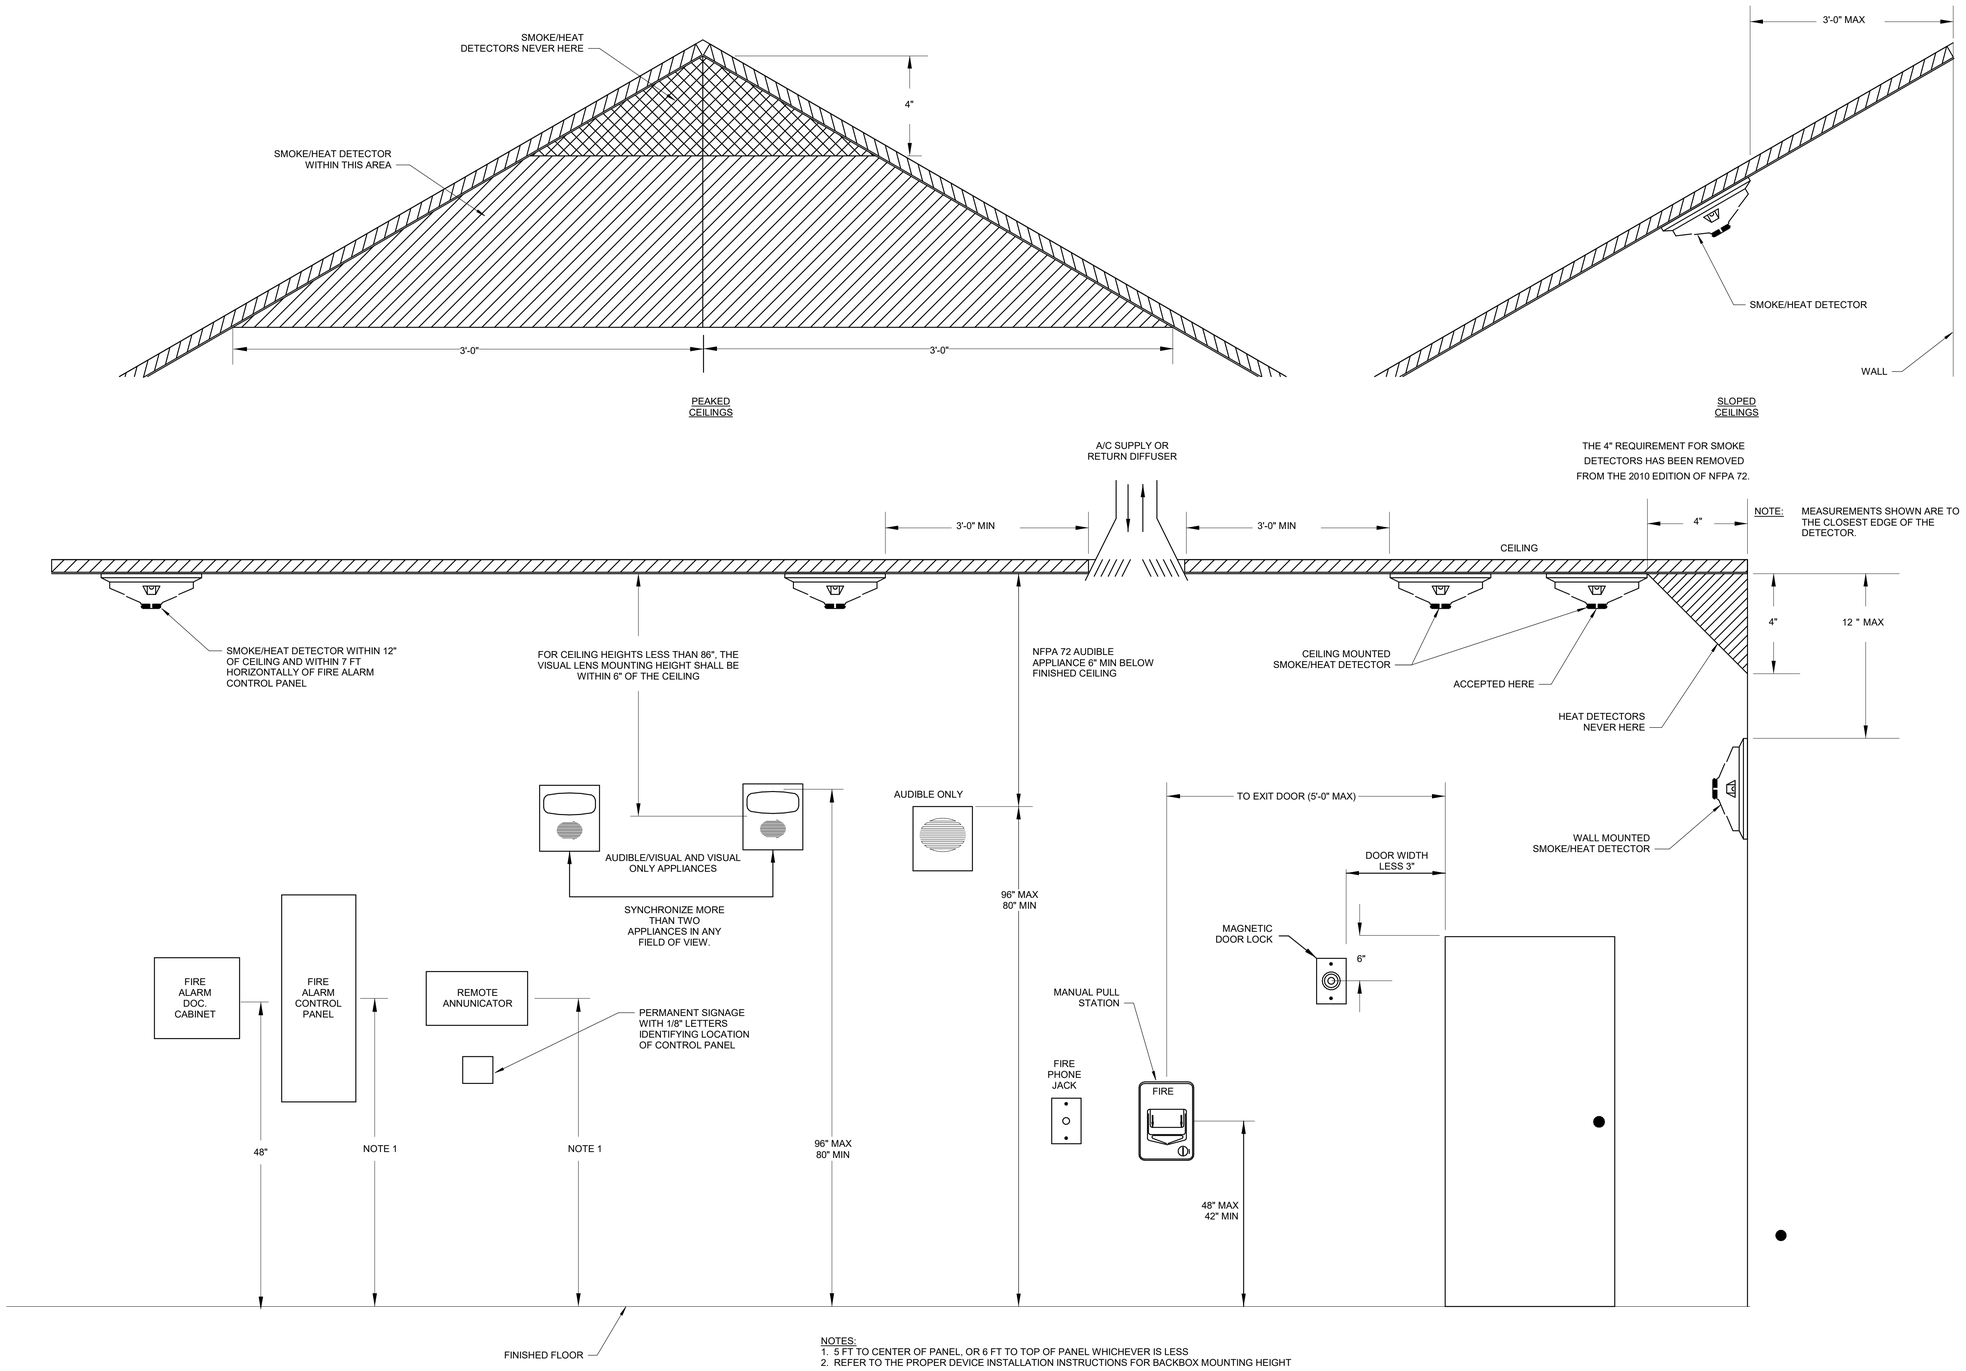

NOTES:
1. 5 FT TO CENTER OF PANEL, OR 6 FT TO TOP OF PANEL WHICHEVER IS LESS
2. REFER TO THE PROPER DEVICE INSTALLATION INSTRUCTIONS FOR BACKBOX MOUNTING HEIGHT

1 TYPICAL FIRE ALARM MOUNTING HEIGHTS

NOT TO SCALE

LITTLE ROCK A.F.B. ARKANSAS

MARK	DESCRIPTION	DATE

File Path: Autodesk Docs://806-2600756/ - LRAFB B718 Dorm/806-2600756 - LRAFB B718 Dorm - MEP/_R25.rvt

Plot Date: 7/20/2026 2:11:53 PM

DESIGNED BY: Designer
DRAWN BY: Author
CHECKED BY: Checker
SUBMITTED BY:
SIZE: ARCH D
ISSUE DATE: JULY 2026
SOLICITATION NO.:
CONTRACT NO.:

NORTH LITTLE ROCK AIR FORCE BASE

GARVER GIDEON USA

LITTLE ROCK AFB, JACKSONVILLE, AR
LRAFB B718 DORM

TYPICAL DEVICES MOUNTING HEIGHTS

SHEET ID

FA002